


FTFA 23-VH59 D51 Hangar Conversion, Human Performance Center

Eglin AFB, FL

Specifications Volume 1 of 2

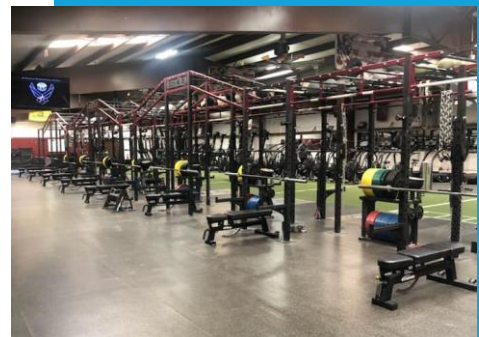

23 May 2024
Final Submittal


This page left blank.

PROJECT TABLE OF CONTENTS

VOLUME 1 OF 2

DIVISION 01 - GENERAL REQUIREMENTS

01 11 00	SUMMARY OF WORK
01 14 00	WORK RESTRICTIONS
01 20 00	PRICE AND PAYMENT PROCEDURES
01 30 00	ADMINISTRATIVE REQUIREMENTS
01 32 17.00 20	COST-LOADED NETWORK ANALYSIS SCHEDULES (NAS)
01 33 00	SUBMITTAL PROCEDURES
01 33 29	SUSTAINABILITY REQUIREMENTS AND REPORTING
01 35 26	GOVERNMENTAL SAFETY REQUIREMENTS
01 42 00	SOURCES FOR REFERENCE PUBLICATIONS
01 45 00.00 10	QUALITY CONTROL
01 45 35	SPECIAL INSPECTIONS
01 50 00	TEMPORARY CONSTRUCTION FACILITIES AND CONTROLS
01 57 19	TEMPORARY ENVIRONMENTAL CONTROLS - EGLIN STANDARD
01 57 20.01	SUPPLEMENTAL ENVIRONMENTAL PROTECTION
01 74 19	CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL
01 78 00	CLOSEOUT SUBMITTALS
01 78 23	OPERATION AND MAINTENANCE DATA
01 91 00.15	BUILDING COMMISSIONING
01 91 19	BUILDING ENCLOSURE COMMISSIONING

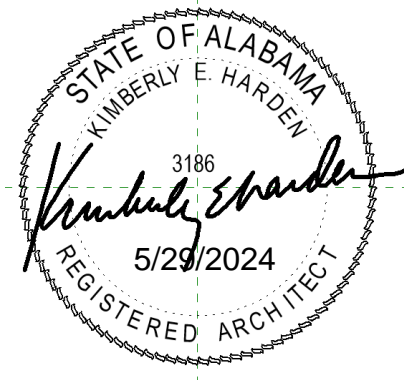

DIVISION 02 - EXISTING CONDITIONS

02 41 00	DEMOLITION
----------	------------

DIVISION 03 - CONCRETE


03 30 00	CAST-IN-PLACE CONCRETE
----------	------------------------

DIVISION 04 - MASONRY

04 20 00	UNIT MASONRY
----------	--------------

DIVISION 05 - METALS

05 12 00	STRUCTURAL STEEL
05 21 00	STEEL JOIST FRAMING
05 30 00	STEEL DECKS
05 50 13	MISCELLANEOUS METAL FABRICATIONS

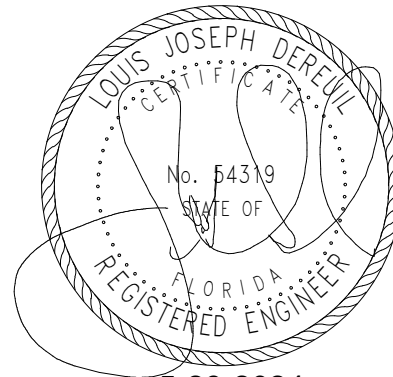

5-29-2024
Structural

DIVISION 06 - WOOD, PLASTICS, AND COMPOSITES

06 10 00	ROUGH CARPENTRY
06 41 16.00 10	PLASTIC-LAMINATE-CLAD ARCHITECTURAL CABINETS
06 61 16	SOLID SURFACING FABRICATIONS

DIVISION 07 - THERMAL AND MOISTURE PROTECTION

07 21 16	MINERAL FIBER BLANKET INSULATION
07 27 10	BUILDING AIR BARRIER SYSTEM
07 27 19.01	SELF-ADHERING AIR BARRIERS
07 27 26	FLUID-APPLIED MEMBRANE AIR BARRIERS

07 27 36 SPRAY FOAM AIR BARRIERS
07 60 00 FLASHING AND SHEET METAL
07 61 14.00 20 STEEL STANDING SEAM ROOFING
07 92 00 JOINT SEALANTS

DIVISION 08 - OPENINGS

08 11 13 STEEL DOORS AND FRAMES
08 14 00 WOOD DOORS
08 31 00 ACCESS DOORS AND PANELS
08 33 13 COILING COUNTER DOORS
08 33 23 OVERHEAD COILING DOORS
08 34 00 SPECIAL FUNCTION DOORS
08 71 00 DOOR HARDWARE
08 81 00 GLAZING
08 91 00 METAL WALL LOUVERS

DIVISION 09 - FINISHES

09 22 00 SUPPORTS FOR PLASTER AND GYPSUM BOARD
09 24 23 STUCCO
09 29 00 GYPSUM BOARD
09 30 10 CERAMIC, QUARRY, AND GLASS TILING
09 51 00 ACOUSTICAL CEILINGS
09 62 38 STATIC-CONTROL FLOORING
09 65 00 RESILIENT FLOORING
09 65 66 RESILIENT ATHLETIC FLOORING
09 84 20 ACOUSTICAL WALL PANELS
09 90 00 PAINTS AND COATINGS
09 96 00 HIGH-PERFORMANCE COATINGS

DIVISION 10 - SPECIALTIES

10 14 00.10 EXTERIOR SIGNAGE
10 14 00.20 INTERIOR SIGNAGE
10 26 00 WALL AND DOOR PROTECTION
10 28 13 TOILET ACCESSORIES
10 44 16 FIRE EXTINGUISHERS

VOLUME 2 OF 2

DIVISION 22 - PLUMBING

22 00 00 PLUMBING, GENERAL PURPOSE

DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)

23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC
23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS
23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC
23 09 13 INSTRUMENTATION AND CONTROL DEVICES FOR HVAC
23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING
CONTROL SYSTEMS
23 21 23 HYDRONIC PUMPS
23 30 00 HVAC AIR DISTRIBUTION
23 64 10 WATER CHILLERS, VAPOR COMPRESSION TYPE
23 64 26 CHILLED, CHILLED-HOT, AND CONDENSER WATER PIPING SYSTEMS



23 Bl 00 DECENTRALIZED UNITARY HVAC EQUIPMENT

DIVISION 25 - INTEGRATED AUTOMATION

25 OS 11.01 CYBERSECURITY FOR FACILITY-RELATED CONTROL SYSTEMS - DOC
AND METERING

DIVISION 26 - ELECTRICAL

26 OS 73 POWER SYSTEM STUDIES
26 20 00 INTERIOR DISTRIBUTION SYSTEM
26 29 23 ADJUSTABLE SPEED DRIVE (ASD) SYSTEMS UNDER 600 VOLTS
26 41 00 LIGHTNING PROTECTION SYSTEM
26 51 00 INTERIOR LIGHTING

DIVISION 27 - COMMUNICATIONS

27 10 00 BUILDING TELECOMMUNICATIONS CABLING SYSTEM

DIVISION 31 - EARTHWORK

31 00 00 EARTHWORK
31 11 00 CLEARING AND GRUBBING

DIVISION 32 - EXTERIOR IMPROVEMENTS

32 16 19 CONCRETE CURBS, GUTTERS AND SIDEWALKS
32 92 23 SODDING

DIVISION 33 - UTILITIES



33 11 00 WATER UTILITY DISTRIBUTION PIPING
33 30 00 SANITARY SEWERS
33 40 00 STORM DRAINAGE UTILITIES
33 71 02 UNDERGROUND ELECTRICAL DISTRIBUTION
33 82 00 TELECOMMUNICATIONS OUTSIDE PLANT (OSP)

APPENDICES

APPENDIX A STRUCTURAL INTERIOR DESIGN

APPENDIX B 96 CS CYBER INFRASTRUCTURE STANDARDS AND INSTALLATION
SPECIFICATIONS JAN 2024

APPENDIX C GEOTECHNICAL REPORT

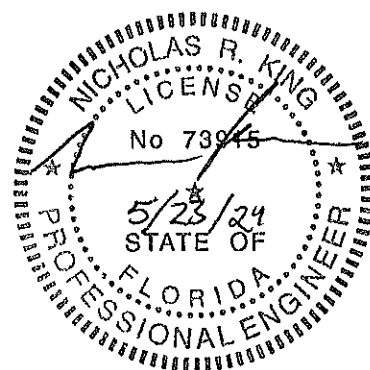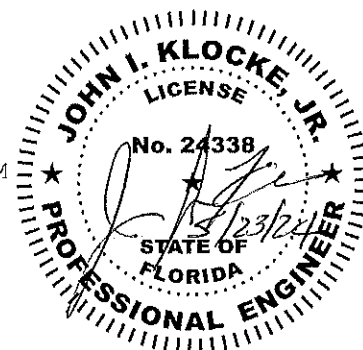

-- End of Project Table of Contents --

This page left blank.

SECTION 01 11 00

SUMMARY OF WORK
08/15

PART 1 GENERAL

1.1 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Utility Outage Requests; G

Utility Connection Requests; G

Excavation Permits

Welding Permits

Salvage Plan; G

1.2 WORK COVERED BY CONTRACT DOCUMENTS

1.2.1 Project Description

The work includes selective demolition to the existing facade Hangar building including removal of exhaust fans, bird netting, removal of existing doors/louvers, etc. as indicated on the drawings. New electrical, mechanicals, plumbing, and communications systems will be provided for the existing structure as well as the addition. The addition will include steel framing, masonry cmu walls with stucco exterior, interior stud walls, casework finishes, The existing structure will have a retrofit insulation system and addition will have spray-foam insulation.

1.2.2 Location

The work is located at existing facade Hangar B59040, Area D51, Eglin AFB, Florida, as indicated.

1.3 CONTRACT DRAWINGS

Five sets of full size contract drawings, and specifications will be furnished to the Contractor without charge. Reference publications will not be furnished. Immediately check furnished drawings and notify the Government of any discrepancies.

1.4 WORK RESCHEDULING

Normal duty hours for work are from 7 a.m. to 4 p.m., Monday through Friday. Requests for additional work requires written approval from the Contracting Officer 7 days in advance of the proposed work period.

Coordinate any construction or excavation work beyond the 4' UXO clearance with _____.

1.5 OCCUPANCY OF PREMISES

Adjacent facilities will be occupied during performance of work under this contract. Protective barriers will be provided at work area.

Before work is started, arrange with the Contracting Officer a location for storage of materials and equipment, and use of drives/haul routes at the installation.

1.6 EXISTING WORK

In addition to FAR 52.236-9 Protection of Existing Vegetation, Structures, Equipment, Utilities, and Improvements:

- a. Remove or alter existing work in such a manner as to prevent injury or damage to any portions of the existing work which remain.
- b. Repair or replace portions of existing work which have been altered during construction operations to match existing or adjoining work, as approved by the Contracting Officer. At the completion of operations, existing work must be in a condition equal to or better than that which existed before new work started.

1.7 ON-SITE PERMITS

1.7.1 Utility Outage Requests and Utility Connection Requests

Schedule work to minimize outages. For utility outages and connections required during the execution of work that affect existing systems, schedule during normal business hours, as approved by the Contracting Officer. Schedule utility outages and connections to minimize disruptions to the Government. No additional payment will be provided for utility outages and connections required to be performed outside the regular work hours.

Submit requests for utility outages and connections in writing to the Contracting Officer for approval at least 7 calendar days in advance of the time required. In each request, state the system involved, area involved, approximate duration of outage, and the nature of work involved.

1.7.2 Excavation and Welding Permits

<u>ACTIVITY</u>	<u>SUBMISSION DATE</u>	<u>SUBMISSION FORM</u>
Excavation Permits	15 calendar days prior to work	Eglin Standard
Welding Permits	15 calendar days prior to work	Eglin Standard

Post permits at a conspicuous location in the construction area.

Burning of trash or rubbish is not permitted on project site.

1.8 LOCATION OF UNDERGROUND UTILITIES

Obtain digging permits prior to start of excavation, and comply with

Installation requirements for locating and marking underground utilities. Contact local utility locating service a minimum of 48 hours prior to excavating, to mark utilities, and within sufficient time required if work occurs on a Monday or after a Holiday. Verify existing utility locations indicated on contract drawings, within area of work.

Identify and mark all other utilities not managed and located by the local utility companies. Scan the construction site with Ground Penetrating Radar (GPR), electromagnetic, or sonic equipment, and mark the surface of the ground or paved surface where existing underground utilities are discovered. Verify the elevations of existing piping, utilities, and any type of underground or encased obstruction not indicated, or specified to be removed, that is indicated or discovered during scanning, in locations to be traversed by piping, ducts, and other work to be conducted or installed. Verify elevations before installing new work closer than nearest manhole or other structure at which an adjustment in grade can be made.

1.8.1 Notification Prior to Excavation

Notify the Contracting Officer at least 15 days prior to starting excavation work.

1.9 GOVERNMENT-INSTALLED WORK

Government will remove, store, and reinstall existing moveable equipment. Furnishings shown on drawings for location - purchased/installed by Government.

1.10 SALVAGE MATERIAL AND EQUIPMENT

Items designated by the Contracting Officer to be salvaged remain the property of the Government. Segregate, itemize, deliver and off-load the salvaged property at the Government designated storage area located within 10 miles of the construction site.

Provide a salvage plan, listing material and equipment to be salvaged, and their storage location. Maintain property control records for material or equipment designated as salvage. Use a system of property control that is approved by the Contracting Officer. Store and protect salvaged materials and equipment until disposition by the Contracting Officer.

PART 2 PRODUCTS

Not used.

PART 3 EXECUTION

Not used.

-- End of Section --

This page left blank.

SECTION 01 14 00

WORK RESTRICTIONS

11/22

PART 1 GENERAL

1.1 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

List of Contact Personnel

1.2 CONTRACTOR ACCESS AND USE OF PREMISES

1.2.1 Activity Regulations

Ensure that Contractor personnel employed on the Activity become familiar with and obey Activity regulations including safety, fire, traffic and security regulations. Keep within the limits of the work and avenues of ingress and egress. Wear appropriate personal protective equipment (PPE) in designated areas. Do not enter any restricted areas unless required to do so and until cleared for such entry. Ensure all Contractor equipment, include delivery vehicles, are clearly identified with their company name.

1.2.1.1 Subcontractors and Personnel Contacts

Provide a list of contact personnel of the Contractor and subcontractors including addresses and telephone numbers for use in the event of an emergency. As changes occur and additional information becomes available, correct and change the information contained in previous lists.

1.2.1.2 Installation Access

1.2.1.2.1 One-Day Passes

Personnel applying for One-Day passes at the Base Visitor Control Office are subject to daily mandatory vehicle inspection, and will have limited access to the installation. The Government is not responsible for any cost or lost time associated with obtaining daily passes or added vehicle inspections.

1.2.1.3 Personnel Entry Approval

Failure to obtain entry approval will not affect the contract price or time of completion.

1.2.1.4 No Smoking Policy

Smoking is prohibited within and outside of all buildings on installation, except in designated smoking areas. This applies to existing buildings, buildings under construction and buildings under renovation. Discarding tobacco materials other than into designated tobacco receptacles is considered littering and is subject to fines. The

Contracting Officer will identify designated smoking areas.

1.2.2 Working Hours

Regular working hours will consist of a daily period as approved by the Contracting Officer, typically between, 7 a.m. and 4 p.m., excluding Government holidays.

1.2.3 Work Outside Regular Hours

The intent is for all work to be conducted during normal working hours. Work outside regular working hours beyond that identified on the approved work plan or this specification section, requires Contracting Officer approval. Make application 15 calendar days prior to such work to allow arrangements to be made by the Government for inspecting the work in progress, giving the specific dates, hours, location, type of work to be performed, contract number and project title. Based on the justification provided, the Contracting Officer may approve work outside regular hours. During periods of darkness, the different parts of the work must be lighted in a manner approved by the Contracting Officer.

Make utility cutovers and interruption of any building service, power, comm., water, sewer, fire alarm, sprinkler, HVAC, etc., after normal working hours or on Saturdays, Sundays, and Government holidays unless directed otherwise. Government escort is required for all work outside of regular work hours, and 15 calendar day advance notice is required to be provided to the Contracting Officer.

1.2.4 Occupied and Existing Building

The Contractor shall be working on a site with adjacent buildings which are occupied. Provide barriers as required to maintain security as directed by the Contracting Officer.

1.2.5 Utility Cutovers and Interruptions

See Section 01 00 00, Interruption of Utility Services, for utility cutover and interruption requirements.

In addition:

- a. Make utility cutovers and interruptions after normal working hours or on Saturdays, Sundays, and Government holidays. Conform to procedures required in paragraph WORK OUTSIDE REGULAR HOURS.
- b. Ensure that new utility lines are complete, except for the connection, before interrupting existing service.
- c. Interruption to water, sanitary sewer, storm sewer, telephone service, electric service, air conditioning, heating, fire alarm, compressed air, and other systems are considered utility cutovers pursuant to the paragraph WORK OUTSIDE REGULAR HOURS. This time limit includes time for deactivation and reactivation.

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

Not Used

-- End of Section --

This page left blank.

SECTION 01 20 00

PRICE AND PAYMENT PROCEDURES

11/20, CHG 2: 08/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

U.S. ARMY CORPS OF ENGINEERS (USACE)

EP 1110-1-8 (2021) Engineering and Design --
Construction Equipment Ownership and
Operating Expense Schedule

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Earned Value Report; G

1.3 EARNED VALUE REPORT

1.3.1 Data Required

This Contract requires the use of a cost-loaded Network Analysis Schedule (NAS). Schedule of Prices must not be used with cost-loaded Network Analysis Schedule (NAS). Use Earned Value Report derived from cost-loaded NAS. Within 15 calendar days of notice of award, prepare and deliver to the Contracting Officer a Earned Value Report (construction Contract) as directed by the Contracting Officer. Provide a detailed breakdown of the Contract price, giving quantities for each of the various kinds of work, unit prices and extended prices. Contractor overhead and profit including salaries for field office personnel, if applicable, must be proportionately spread over all pay items and not included as individual pay items.

1.3.2 Payment Schedule Instructions

Payments will not be made until the Earned Value Report from the cost-loaded NAS has been submitted to and accepted by the Contracting Officer. For design phase progress payment(s), the Schedule of Prices or Earned Value Report from the Cost Loaded CPM must include detailed design activities and general (summarized) approach for the construction phase(s) of the project. The Schedule of Prices or Earned Value Report must be fully developed with detailed construction line items as design progresses. The complete design and construction Schedule of Prices or Earned Value Report must be submitted and accepted prior to starting construction work.

a. Primary Facilities Cost Breakdown:

Defined as work on the primary facilities out to the 5 foot line. Work out to the 5 foot line includes construction encompassed within a theoretical line 5 foot from the face of exterior walls and includes attendant construction, such as pad mounted HVAC cooling equipment, cooling towers, and transformers placed beyond the 5 foot line.

b. Supporting Facilities Cost Breakdown:

Defined as site work, including incidental work, outside the 5 foot line.

1.3.3 Schedule Requirements for HVAC TAB

The field work requirements in Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC must be broken down in the Earned Value Report from the cost-loaded NAS by separate line items which reflect measurable deliverables. The value for each pay item listed below will be established on a case by case basis for each Contract. The line items are as follows:

- a. Approval of Design Review Report: The TABS Agency is required to conduct a review of the project plans and specifications to identify any feature, or the lack thereof, that would preclude successful testing and balancing of the project HVAC systems. Submit the resulting findings to the Government to allow correction of the design. The progress payment will not be issued until the report is reviewed and approved.
- b. Approval of the pre-field engineering report: The TABS Agency submits a report which outlines the scope of field work. The report must contain details of what systems will be tested, procedures to be used, sample report forms for reporting test results and a quality control checklist of work items that must be completed before TABS field work commences.
- c. Season I field work: Incremental payments are issued as the TABS field work progresses. The TABS Agency mobilizes to the project site and executes the field work as outlined in the pre-field engineering report. The HVAC water and air systems are balanced and operational data must be collected for one seasonal condition (either summer or winter depending on project timing).
- d. Approval of Season I report: On completion of the Season I field work, the data is compiled into a report and submitted to the Government. The report is reviewed, and approved, after ensuring compliance with the pre-field engineering report scope of work.
- e. Completion of Season I field QA check: Contract QC and Government representatives meet the TABS Agency at the jobsite to retest portions of the systems reported in the Season I report. The purpose of these tests are to validate the accuracy and completeness of the previously submitted Season I report.
- f. Approval of Season II report: The TABS Agency completes all Season II field work, which is normally comprised mainly of taking heat transfer temperature readings, in the season opposite of that under which

Season I performance data was compiled. Compile this data into a report and submit to the Government. On completion of submittal review to ensure compliance with the pre-field engineering report scope, progress payment is issued. Progress payment is less than that issued for the Season I report since most of the water and air balancing work effort is completed under Season I.

1.4 CONTRACT MODIFICATIONS

In conjunction with the Contract Clause DFARS 252.236-7000 Modification Proposals-Price Breakdown, and where actual ownership and operating costs of construction equipment cannot be determined from Contractor accounting records, base equipment use rates upon the applicable provisions of the EP 1110-1-8.

1.5 CONTRACTOR'S INVOICE AND CONTRACT PERFORMANCE STATEMENT

1.5.1 Content of Invoice

Requests for payment will be processed in accordance with the Contract Clause FAR 52.232-27 Prompt Payment for Construction Contracts and FAR 52.232-5 Payments Under Fixed-Price Construction Contracts. Invoices not completed in accordance with contract requirements will be returned to the Contractor for correction of the deficiencies. The requests for payment shall include the documents listed below.

- a. The Contractor's invoice, furnished by the Government, showing in summary form, the basis for arriving at the amount of the invoice. Form must include certification by Quality Control (QC) Manager as required by the Contract.
- b. The Earned Value Report from the cost-loaded NAS.
- c. Updated Construction Progress Schedule and tabular reports required by the contract.
- d. Contractor Safety Self Evaluation Checklist.
- e. Other supporting documents as requested.

1.5.2 Submission of Invoices

If DFARS Clause 252.232-7006 Wide Area WorkFlow Payment Instructions is included in the Contract, provide the documents listed in above paragraph CONTENT OF INVOICE in their entirety as attachments in Wide Area Work Flow (WAWF) for each invoice submitted. The maximum size of each WAWF attachment is two megabytes, but there are no limits on the number of attachments. If a document cannot be attached in WAWF due to system or size restriction, provide it as instructed by the Contracting Officer.

1.5.3 Final Invoice

- a. A final invoice must be accompanied by the certification required by DFARS 252.247.7023 Transportation of Supplies by Sea, and the Contractor's Final Release. If the Contractor is incorporated, the Final Release must contain the corporate seal. An officer of the corporation must sign and the corporate secretary must certify the Final Release.

- b. For final invoices being submitted via WAWF, the original Contractor's Final Release Form and required certification of Transportation of Supplies by Sea must be provided directly to the respective Contracting Officer prior to submission of the final invoice. Once receipt of the original Final Release Form and required certification of Transportation of Supplies by Sea has been confirmed by the Contracting Officer, the Contractor must then submit final invoice and attach a copy of the Final Release Form and required certification of Transportation of Supplies by Sea in WAWF.
- c. Final invoices not accompanied by the Contractor's Final Release and required certification of Transportation of Supplies by Sea will be considered incomplete and will be returned to the Contractor.

1.6 PAYMENTS TO THE CONTRACTOR

Payments will be made on submission of itemized requests by the Contractor which comply with the requirements of this section, and will be subject to reduction for overpayments or increase for underpayments made on previous payments to the Contractor.

1.6.1 Obligation of Government Payments

The obligation of the Government to make payments required under the provisions of this Contract will, at the discretion of the Contracting Officer, be subject to reductions and suspensions permitted under the FAR and agency regulations including the following in accordance with FAR 32.103 Progress Payments Under Construction Contracts:

- a. Reasonable deductions due to defects in material or workmanship;
- b. Claims which the Government may have against the Contractor under or in connection with this Contract;
- c. Unless otherwise adjusted, repayment to the Government upon demand for overpayments made to the Contractor; and
- d. Failure to maintain accurate "as-built" or record drawings in accordance with FAR 52.236.21.

1.6.2 Payment for Onsite and Offsite Materials

Progress payments may be made to the Contractor for materials delivered on the site, for materials stored off construction sites, or materials that are in transit to the construction sites under the following conditions:

- a. FAR 52.232-5(b) Payments Under Fixed Price Construction Contracts.
- b. Materials delivered on the site but not installed, including completed preparatory work, and off-site materials to be considered for progress payment must be major high cost, long lead, special order, or specialty items, not susceptible to deterioration or physical damage in storage or in transit to the construction site. Examples of materials acceptable for payment consideration include, but are not limited to, structural steel, non-magnetic steel, non-magnetic aggregate, equipment, machinery, large pipe and fittings, precast/prestressed concrete products, plastic lumber (e.g., fender piles/curbs), and high-voltage electrical cable. Materials not acceptable for payment include consumable materials such as nails,

fasteners, conduits, gypsum board, glass, insulation, and wall coverings.

- c. Materials to be considered for progress payment prior to installation must be specifically and separately identified in the Contractor's estimates of work submitted for the Contracting Officer's approval in accordance with Earned Value Report requirement of this Contract. Requests for progress payment consideration for such items must be supported by documents establishing their value and that the title requirements of the clause at FAR 52.232-5 Payments Under Fixed-Price Construction Contracts have been met.
- d. Materials are adequately insured and protected from theft and exposure.
- e. Provide a written consent from the surety company with each payment request for offsite materials.
- f. Materials to be considered for progress payments prior to installation must be stored either in Hawaii, Guam, Puerto Rico, or the Continental United States. Other locations are subject to written approval by the Contracting Officer.
- g. Materials in transit to the job site or storage site are not acceptable for payment.

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

Not Used

-- End of Section --

This page left blank.

SECTION 01 30 00

ADMINISTRATIVE REQUIREMENTS

11/20, CHG 2: 05/22

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

U.S. ARMY CORPS OF ENGINEERS (USACE)

EM 385-1-1 (2014) Safety -- Safety and Health
Requirements Manual

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

View Location Map

Progress and Completion Pictures

SD-04 Samples

Color Boards; G

1.3 COLOR BOARDS FOR AIR FORCE PROJECTS

Submit five sets of color boards within 90 calendar days after Contract Award. Each set of boards must include samples of colors and finishes of interior surfaces, such as walls, floors, and ceilings. Present the samples on 8 by 10-1/2 inches boards (modules) with a maximum spread of 24 by 31-1/2 inches for foldouts. Design modules to fit in a standard loose-leaf, three-ring binder. Where special finishes such as architectural concrete, carpet, or prefinished textured metal panels are required, submit samples not less than 12 inches square with the board. If more space is needed, more than one board per set may be submitted. Certify that the color samples have been reviewed in detail, and that the color samples are in strict accordance with contract drawings and specifications, except as may be otherwise explicitly stated. Submittal of color samples does not relieve the Contractor of the responsibility to submit samples required elsewhere herein.

1.4 VIEW LOCATION MAP

Submit, prior to or with the first digital photograph submittals, a sketch or drawing indicating the required photographic locations. Update as required if the locations are moved.

1.5 PROGRESS AND COMPLETION PICTURES

Photographically document site conditions prior to start of construction operations. Provide monthly, and within one month of the completion of work, digital photographs, 1600x1200x24 bit true color minimum resolution in JPEG file format showing the sequence and progress of work. Take a minimum of 20 digital photographs each week throughout the entire project from a minimum of ten different viewpoints selected by the Contractor unless otherwise directed by the Contracting Officer. Submit with the monthly invoice two sets of digital photographs, each set on a separate compact disc (CD) or data versatile disc (DVD), cumulative of all photos to date. Indicate photographs demonstrating environmental procedures. Provide photographs for each month in a separate monthly directory and name each file to indicate its location on the view location sketch. Also provide the view location sketch on the CD or DVD as a digital file. Include a date designator in file names. Photographs provided are for unrestricted use by the Government.

1.6 MINIMUM INSURANCE REQUIREMENTS

Provide the minimum insurance coverage required by FAR 28.307-2 Liability, during the entire period of performance under this contract. Provide other insurance coverage as required by State

1.7 SUPERVISION

1.7.1 Superintendent Qualifications

Provide project superintendent with a minimum of 5 years experience in construction with at least 2 of those years as a superintendent on projects similar in size and complexity. The individual must be familiar with the requirements of EM 385-1-1 and have experience in the areas of hazard identification and safety compliance. The individual must be capable of interpreting a critical path schedule and construction drawings. The qualification requirements for the alternate superintendent are the same as for the project superintendent. The Contracting Officer may request proof of the superintendent's qualifications at any point in the project if the performance of the superintendent is in question.

1.7.2 Minimum Communication Requirements

Have at least one qualified superintendent, or competent alternate, capable of reading, writing, and conversing fluently in the English language, on the job-site at all times during the performance of Contract work. In addition, if a Quality Control (QC) representative is required on the Contract, then that individual must also have fluent English communication skills.

1.7.3 Duties

The project superintendent is primarily responsible for managing subcontractors and coordinating day-to-day production and schedule adherence on the project. The superintendent is required to attend Red Zone meetings, partnering meetings, and quality control meetings. The superintendent or qualified alternative must be on-site at all times during the performance of this contract until the work is completed and accepted.

1.7.4 Non-Compliance Actions

The Project Superintendent is subject to removal by the Contracting Officer for non-compliance with requirements specified in the contract and for failure to manage the project to ensure timely completion. Furthermore, the Contracting Officer may issue an order stopping all or part of the work until satisfactory corrective action has been taken. No part of the time lost due to such stop orders is acceptable as the subject of claim for extension of time for excess costs or damages by the Contractor.

1.8 PRECONSTRUCTION MEETING CONFERENCE

Immediately after award, prior to commencing any work at the site, coordinate with the Contracting Officer a time and place to meet for the Preconstruction Meeting Conference. The meeting conference must take place within 35 calendar days after award of the contract, but prior to commencement of any work at the site. The purpose of this meeting conference is to discuss and develop a mutual understanding of the administrative requirements of the Contract including but not limited to: daily reporting, invoicing, value engineering, safety, base-access, outage requests, hot work permits, schedule requirements, quality control, schedule of prices or earned value report, shop drawings, submittals, cybersecurity, prosecution of the work, government acceptance, final inspections and contract close-out. Contractor must present and discuss their basic approach to scheduling the construction work and any required phasing.

1.8.1 Attendees

Contractor attendees must include the Project Manager, Superintendent, Site Safety and Health Officer (SSHO), Quality Control Manager and major subcontractors.

1.9 FACILITY TURNOVER PLANNING MEETINGS (Red Zone Meetings)

Meet with the Government to identify strategies to ensure the project is carried to expeditious closure and turnover to the Client. Start planning the turnover process at the Pre-Construction Conference meeting with a discussion of the Red Zone process and convene at regularly scheduled NRZ Meetings beginning at approximately 75 percent of project completion. Include the following in the facility Turnover effort:

1.9.1 Red Zone Checklist

- a. Contracting Officer's Technical Representative (COTR) will provide the Contractor a copy of the Red Zone Checklist template.
- b. Prior to 75 percent completion, modify the Red Zone Checklist template by adding or deleting critical activities applicable to the project and assign planned completion dates for each activity. Submit the modified Red Zone Checklist to the Contracting Officer. The Contracting Officer may request additional activities be added to the Red Zone Checklist at any time as necessary.

1.9.2 Meetings

- a. Conduct regular Red Zone Meetings beginning at approximately 75 percent project completion, or three to six months prior to Beneficial

Occupancy Date (BOD), whichever comes first.

- b. The Contracting Officer will establish the frequency of the meetings, which is expected to increase as the project completion draws nearer. At the beginning, Red Zone meetings may be every two weeks then increase to weekly towards the final month of the project.
- c. Using the Red Zone Checklist as a Plan of Action and Milestones (POAM) and basis for discussion, review upcoming critical activities and strategies to ensure work is completed on time.
- d. During the Red Zone Meetings discuss with the COTR any upcoming activities that require Government involvement.
- e. Maintain the Red Zone Checklist by documenting the actual completion dates as work is completed and update the Red Zone Checklist with revised planned completion dates as necessary to match progress. Distribute copies of the current Red Zone Checklist to attendees at each Red Zone Meeting.

1.10 PARTNERING

To most effectively accomplish this Contract, the Contractor and Government must form a cohesive partnership with the common goal of drawing on the strength of each organization in an effort to achieve a successful project without safety mishaps, conforming to the Contract, within budget and on schedule. The partnering team must consist of personnel from both the Government and Contractor including project level and corporate level leadership positions. Key Personnel from the supported command, end user, , Contractor, key subcontractors and the Designer of Record are required to participate in the Partnering process.

1.10.1 Team-Led (Informal) Partnering

- a. The Contracting Officer will coordinate the initial Team-Led (Informal) Partnering Session with key personnel of the project team, including Contractor and Government personnel. The Partnering Session will be co-led by the Government Construction Manager and Contractor's Project Manager.
- b. The Initial Team-led Partnering session may be held concurrently with the Pre-Construction Post-Award Kickoff meeting. Partnering sessions will be held at a location mutually agreed to by the Contracting Officer and the Contractor, typically at a conference room on-base or at the Contractor's temporary trailer.
- c. The Initial Team-Led Partnering Session will be conducted and facilitated using electronic media (a video and accompanying forms) provided by Contracting Officer.
- d. The Partners will determine the frequency of the follow-on sessions.
- e. Participants will bear their own costs for meals, lodging and transportation associated with Partnering.

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

Not Used

-- End of Section --

This page left blank.

SECTION 01 32 17.00 20

COST-LOADED NETWORK ANALYSIS SCHEDULES (NAS)

05/18

PART 1 GENERAL

1.1 DEFINITIONS

The cost-loaded Network Analysis Schedule (NAS) is a tool to manage the project, both for Contractor and Government activities. The NAS is also used to report progress, evaluate time extensions, and provide the basis for progress payments.

For consistency, when scheduling software terminology is used in this section, the terms in Primavera's scheduling programs are used.

1.2 SCHEDULE REQUIREMENTS PRIOR TO THE START OF WORK

1.2.1 Preliminary Scheduling Meeting

Before preparation of the Project Baseline Schedule, and prior to the start of work, meet with the Contracting Officer to discuss the proposed schedule and the requirements of this section.

1.3 THREE-WEEK LOOK AHEAD SCHEDULE

1.3.1 Weekly CQC Coordination and Production Meeting

Deliver three hard copies and one electronic file of the 3-Week Look Ahead Schedule to the Contracting Officer no later than 8 a.m. each Monday, for review during the weekly CQC Coordination or Production Meeting.

1.3.2 Look Ahead Schedule Requirements

Prepare and issue a 3-Week Look Ahead schedule to provide a more detailed day-to-day plan of upcoming work identified on the Project Network Analysis Schedule. Requirements include:

- a. Key the work plans mapped to NAS activity numbers and updated each week to show the planned work for the current and following two-week period.
- b. Include upcoming outages, closures, field evaluation tests, preparatory meetings, and initial meetings.
- c. Identify critical path activities on the Three-Week Look Ahead Schedule.
- d. The detail work plans are to be bar chart type schedules, derived from but maintained separately from the Project NAS on an electronic spreadsheet program and printed on 8-1/2 by 11 inch sheets as directed by the Contracting Officer.
- e. Activities must not exceed 5 working days in duration and have sufficient level of detail to assign crews, tools and equipment required to complete the work.

1.4 MONTHLY NETWORK ANALYSIS

1.4.1 Monthly Network Analysis Updates

Meet with Government representatives at monthly intervals to review and agree on the information presented in the updated project schedule. The submission of an acceptable, updated schedule to the Government is a condition precedent to the processing of the Contractor's invoice. Submit an acceptable, updated schedule to the Government regardless of whether a Contractor's invoice is submitted for the given period. The Contractor and Government must consent to agree on unit quantities of work completed equating to a percentage of payment for each activity progressed during the update period. Monthly update schedules must incorporate as-built events as they occurred and provide ongoing status of anticipated finish dates. As-built events must correspond to contemporaneous records including but not limited to submittals, daily production reports and quality control reports.

Provide the following with each Schedule submittal:

- a. Time-Scaled Logic Diagram.
- b. Reports listed in paragraph REQUIRED TABULAR REPORTS.
- c. Data disks containing the project schedule. Include the back-up native .xer program files.

1.4.2 As-Built Schedule

As a condition precedent to the release of retention and making final payment, submit an "As-Built Schedule," as the last schedule update showing all activities at 100 percent completion. This schedule must reflect the exact manner in which the project was actually constructed.

1.5 CORRESPONDENCE AND TEST REPORTS

Reference Schedule activity IDs that are being addressed in each correspondence (e.g., letters, Requests for Information (RFIs), e-mails, meeting minute items, Production and QC Daily Reports, material delivery tickets, photographs) and test report (e.g., concrete, soil compaction, weld, pressure).

1.6 ADDITIONAL SCHEDULING REQUIREMENTS

References to additional scheduling requirements, including systems to be inspected, tested and commissioned, that are located throughout the remainder of the Contract Documents, are subject to the requirements of this section.

1.7 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Designated Project Scheduler; G

Baseline NAS; G

Construction Baseline NAS; G

SD-07 Certificates

Monthly Network Analysis Updates; G

SD-11 Closeout Submittals

As-Built Schedule; G

1.8 SOFTWARE

Prepare and maintain project schedules using Primavera P6 software in a version compatible with Government's current version. Importing data into P6 using data conversion techniques or third party software is cause for rejection of the submitted schedule.

1.9 DESIGNATED PROJECT SCHEDULER

Submit to the Contracting Officer for approval an individual who will serve as the Designated Project Scheduler. Include a copy of the candidate's resume with qualifications. The Contracting Officer may remove the Designated Project Scheduler, and require replacement, if the scheduler does not effectively fulfill their duties in accordance with the contract requirements. Payment request will not be processed without an approved Designated Project Scheduler.

1.9.1 Qualifications

The Designated Project Scheduler must have prepared and maintained at least three previous construction schedules, of similar size and complexity to this contract, using Primavera P6.

1.9.2 Duties

Duties of the Designated Project Scheduler:

- a. Prepare Baseline NAS.
- b. Prepare monthly schedule updates.
- c. Prepare tabular reports.
- d. Prepare Time Impact Analysis (TIA) as necessary.
- e. Provide certification that NAS and TIA submittals conform to the contract requirements.
- f. Participate with the Prime Contractor and Government Representative in a monthly meeting at the job site in-person, and scheduled with sufficient time to support the Monthly Network Analysis Updates process, to discuss project status, schedule updates, critical activities, potential delays, and contract modifications impacting the schedule.

1.10 NETWORK SYSTEM FORMAT

The system must include time-scaled logic diagrams and specified reports.

Prepare the schedule in accordance with the following Primavera P6 settings and parameters. Deviation from these settings and parameters, without prior consent of the Contracting Officer, is cause for rejection of schedule submission.

1.10.1 Diagrams

Provide 11 by 17 inch hard-copy of Time-scaled Logic Diagram in color and landscape-oriented. Clearly show activities on the longest path. Include the following information for each activity and include accompanying Gantt chart:

- a. Activity ID
- b. Activity Name
- c. Original Duration in Work Days
- d. Remaining duration in Work Days
- e. Physical Percent Complete
- f. Start Date
- g. Finish Date
- h. Total Float

1.10.2 Schedule Activity Properties and Level of Detail

1.10.2.1 Design-Build Schedules

Logically incorporate design and construction for the entire project in a single schedule. Unless otherwise indicated, the Contractor may begin construction when design is signed, stamped and submitted to the Government via the Contractor's quality control organization. If Government approval is required for any portion of a final signed and sealed design package prior to construction, include that review time in the schedule.

1.10.2.2 Activity Identification and Organization

- a. Identify design and construction activities planned for the project and other activities that could impact project completion if delayed in the NAS.
- b. Identify administrative type activity/milestones, including all pre-construction submittal and permit requirements prior to demolition or construction stage.
- c. Include times for procurement, Contractor quality control and construction, acceptance testing and training in the schedule.
- d. Include the Government approval time required for the submittals that

require Government Approval prior to construction, as indicated in Section 01 33 00 SUBMITTAL PROCEDURES Section 01 33 00.05 20 CONSTRUCTION SUBMITTAL PROCEDURES.

- e. Create separate activities for each Phase, Area, Floor Level and Location the activity is occurring.
- f. Do not use construction category activity to represent non-work type reference (e.g. Serial Letter, Request for Information) in NAS. Place Non-work reference within the P6 activity details notebook.

Activity categories included in the schedule are specified below.

1.10.2.3 Activity Logic

- a. With the exception of the Contract Award and Contract Completion Date (CCD) milestone activities, activity must not be open-ended; each activity must have predecessor and successor ties.
- b. Activities must not have open start or open finish (dangling) logic.
- c. Do not use lead or lag logic without Contracting Officer prior approval.
- d. Minimize redundant logic ties.
- e. Once an activity exists on the schedule it must not be deleted or renamed to change the scope of the activity and must not be removed from the schedule logic without approval from the Contracting Officer.
 - (1) While an activity cannot be deleted, where said activity is no longer applicable to the schedule, but must remain within the logic stream for historical record, change the activity to a milestone and clearly label "NO LONGER REQUIRED" after the activity name. Redistribute accordingly any remaining budget associated with that activity.
 - (2) Document any such change in the milestone's "Notebook," including a date and explanation for the change.
 - (3) The ID number for a "NO LONGER REQUIRED" activity must not be re-used for another activity.

1.10.2.4 Critical and Near Critical Activity Baseline Limitation

For P6 settings, critical activities are defined as being on the Longest Path. "Near Critical" is defined as having total float, of up to 14 days more, than the greatest float value found on the Longest Path. Longest Path (Critical) and Near Critical Activities must not make up more than 20 percent of all activity within the Baseline Schedule.

1.10.2.5 Assigned Calendars

All NAS activity must be assigned calendars that reflect required and anticipated non-work days.

1.10.2.6 Activity Categories

1.10.2.6.1 Pre-construction Activities

Examples of pre-construction activities include, but are not limited to, bond approval, permits, pre-construction submittals and approvals. Include pre-construction activities that are required to be completed prior to the Contractor starting the demolition or construction stage of work.

1.10.2.6.2 Procurement Activities

Examples of procurement activities include, but are not limited to: Material/equipment submittal preparation, submittal and approval of material/equipment; material/equipment fabrication and delivery, and material/equipment on-site. As a minimum, separate procurement activities must be provided for critical items, long lead items, items requiring Government approval and material/equipment procurement for which payment will be requested in advance of installation. Show each delivery with relationship tie to the Construction Activity specifically for the delivery.

1.10.2.6.3 Government Activities

Government and other agency activities that could impact progress must be clearly identified. Government activities include, but are not limited to; Government approved submittal reviews, Government conducted inspections/tests, environmental permit approvals by State regulators, utility outages, Design Start, Construction Start (including Design/Construction Start for each Fast-Track Phase, and delivery of Government Furnished Material/Equipment.

1.10.2.6.4 Construction Quality Management (CQM) Activities

The Preparatory and Initial Phase meetings for each Definable Feature of Work identified in the Contractor's Quality Control Plan must be included in the Three-Week Look Ahead Schedule. Preparatory and Initial phase meetings are not required in the NAS, but can be represented by a start milestone linked to successor parent Construction Activity. The Follow-up Phase must be represented by the Construction Activities themselves in the NAS.

1.10.2.6.5 Construction Activities

No on-site construction activity may have a duration in excess of 20 working days. Contractor activities must be driven by calendars that reflect Saturdays, Sundays and all Federal Holidays as non-work days, unless otherwise defined in this contract.

1.10.2.6.6 Turnover and Closeout Activities

Include activities or milestones for items on the NAVFAC Red Zone Checklist/POAM that are applicable to this project. As a minimum, include required Contractor testing, required Government acceptance inspections on equipment, Pre-Final Inspection, Punch List Completion, Final Inspection and Acceptance. Add an unconstrained start milestone for the initial NAVFAC Red Zone - Facility Turnover Planning Meeting at approximately 75 percent construction contract completion or six months prior to Contract Completion Date (CCD), whichever is sooner.

1.10.2.6.7 Testing of HVAC - DALT, TAB, and PVT Activities

Include in the baseline schedule, activities and milestones associated with Government acceptance of Duct Air Leakage Test (DALT), Testing, Adjusting, and Balancing (TAB) and Performance Verification Test (PVT) as required and in accordance with Section 23 05 93 TESTING, ADJUSTING AND BALANCING FOR HVAC.

- a. Identify the general area or location(s) for Government Acceptance Testing of DALT, TAB and PVT.
- b. Incorporate into the baseline schedule, time periods required for advance notification of work, and Government submittal review in accordance with Section 23 05 93 TESTING, ADJUSTING AND BALANCING FOR HVAC, paragraph DALT AND TAB SUBMITTAL AND WORK SCHEDULE.
- c. Include the following as schedule activities or milestones:
 - (1) Pre-DALT/TAB/PVT Meeting
 - (2) TAB Design Review Report, Government review
 - (3) TAB Pre-Field Engineering Report, Government review
 - (4) DALT Field Work
 - (5) DALT Field Acceptance Testing
 - (6) Certified Final DALT Report, Government review
 - (7) Control Contractors PVT Plan, Government review
 - (8) Equipment Suppliers PVT Plan, Government review
 - (9) Season I TAB Field Work
 - (10) Season I Certified Final TAB Report, Government review
 - (11) Endurance Testing, Government review
 - (12) PVT Field Work
 - (13) PVT Report, Government review
 - (14) Season I TAB Field Acceptance Testing
 - (15) Season II TAB Field Work
 - (16) Season II Certified Final TAB Report, Government review
 - (17) Season II TAB Field Acceptance Testing

1.10.2.6.8 Commissioning Activities

Include in the baseline schedule activities and milestones associated with Commissioning.

- a. Identify the general area or location(s) of systems for Commissioning

Inspection and Testing

- b. Incorporate into the baseline schedule time periods for Government submittal review

1.10.2.7 Contract Milestones and Constraints

1.10.2.7.1 Project Start Date Milestones

Include as the first activity on the schedule a start milestone titled "Contract Award," which must have a Mandatory Start constraint equal to the Contract Award Date.

1.10.2.7.2 NAVFAC Red Zone - Facility Turnover Planning Meeting Milestones

See paragraph TURNOVER AND CLOSEOUT ACTIVITIES above.

1.10.2.7.3 Substantial Completion Milestone

Include an unconstrained finish milestone on the schedule titled "Substantial Completion." Substantial Completion is defined as the point in time the Government would consider the project ready for beneficial occupancy wherein by mutual agreement of the Government and Contractor, Government use of the facility is allowed while construction access continues in order to complete remaining items (e.g. punch list and other close out submittals). Include a separate Substantial Completion Milestone for each phase if the contract requires construction to be completed in phases.

1.10.2.7.4 DD-1354 Finish Milestone

Add unconstrained finish milestone, titled "DD-1354" and scheduled 30 calendar days prior to Substantial Completion, whenever a Form DD-1354 is required in accordance with Section 01 20 00 PRICE AND PAYMENT PROCEDURES PRICE AND PAYMENT PROCEDURES.

1.10.2.7.5 Projected Completion Milestone

Include an unconstrained finish milestone on the schedule titled "Projected Completion." Projected Completion is defined as the point in time all contract requirements are complete and verified by the Government with a successful Final Inspection in accordance with Section 01 45 00.00 20 QUALITY CONTROL. This milestone must have the Contract Completion Date (CCD) milestone as its only successor.

1.10.2.7.6 Contract Completion Date (CCD) Milestone

Last schedule entry must be an unconstrained finish milestone titled "Contract Completion (CCD: DD-MM-YY)." DD-MM-YYYY is the current contract completion date at data date, day-month-year corresponding to P6 Must Finish Date. NAS milestone updates of Project Completion finish date for longest path must reflect calculated float as positive or negative based on CCD. Calculation of schedule updates must be such that if the finish of the "Projected Completion" milestone falls after the contract completion date, then negative float is calculated on the longest path. If the finish of the "Projected Completion" milestone falls before the contract completion date, the float calculation must reflect positive float on the longest path.

1.10.2.8 Work Breakdown Structure & Activity Code

At a minimum, establish a Work Breakdown Structure (WBS) and provide activity codes identified as follows:

1.10.2.8.1 Work Breakdown Structure (WBS)

Group all activities and milestones within appropriate WBS categories including, at a minimum, the following:

- a. Project Milestones:
 - (1) Management Milestones
 - (2) Project Administrative Meetings
 - (3) Permits
- b. Pre-Construction Phase:
 - (1) Submittals and Reviews
 - (2) Procurement
 - (3) Mobilization
- c. Construction Phase: Create multiple sub-sections in accordance with project specific categories of work including in WBS descending order as follows:
 - (1) General Area
 - (a) Type of Work Item
 - 1. Location
- d. Commissioning & Testing:
 - (1) Specific area/locations of commissioning
 - (2) Final Testing
 - (3) Training
- d. Project Closeout: Include activity items such as Punchlist, Demobilization, O&M, As-built Drawings, Training, and As-built NAS.
- e. Modifications: Create sub-category of Conformed and Non-Conformed under Modification WBS. Create multiple sub-sections as the project progresses identified by issue and Fragnet placed in Conformed for modifications issued prior data date, or Non-Conformed for issues not modified to contract prior data date.
- f. Removed Activity: Activity "removed" by remaining within logic sequence and changing to Finish Milestone. Actualize finish date to date activity removed from schedule and provide reason(s) for removal explained in Activity Notebook.

1.10.2.8.2 Responsibility Code

All activities in the project schedule must be identified with the party responsible for completing the task. Activities must not belong to more than one responsible party.

1.10.2.8.3 Activity Category Code

Provide user defined "CAT" codes for Project Level activity codes. Use the following codes:

- a. Assign "Procure" to Procurement type activity
- b. Assign "Construct" Construction type activity
- c. Assign "Close Out" to dedicated Commissioning, Testing & Close Out type activity.
- d. Assign "Other" to other activity not otherwise designated.

1.10.2.8.4 Construction Specification Institute (CSI) Masterformat Code

Identify all activities in the project schedule with its respective Specification Section number. Activities must not belong to more than one Section number. If an activity does not have an applicable CSI Code (e.g. Mobilize), the code must be "0000".

1.10.2.9 Anticipated Weather Lost Work Days

Use the National Oceanic and Atmospheric Administration's (NOAA) Summary of Monthly Normals report to obtain the historical average number of days each month with precipitation, using a nominal 30-year, greater than 0.10 inch precipitation amount parameter, as indicated on the Station Report for the NOAA location closest to the project site as the basis for establishing a "Weather Calendar" showing the number of anticipated non-workdays for each month due to adverse weather, in addition to Saturdays, Sundays and all Federal Holidays as non-work days.

1.10.2.10 Anticipated Restricted Delays

Unless otherwise noted or defined in Section 01 14 00 WORK RESTRICTIONS, allow in the schedule one lost workday for every two months of project duration for instances where base access is not permitted or where work areas are temporarily not accessible for security reasons which causes a delay in the work. Use Anticipated Restricted Delays as basis for establishing a "Security Calendar" showing the number of anticipated non-workdays for each month due to anticipated restrictions, in addition to anticipated adverse weather, Saturdays, Sundays and all Federal Holidays as non-work days. Assign the Security Calendar to any activity that could be impacted by restriction delays. The Contracting Officer will issue a modification in accordance with the contract clauses, giving the Contractor a time extension for the difference of days between the anticipated and actual lost work days if the number of actual restriction delay days exceeds the number of anticipated for the month in which the delay occurs and the restriction delayed activities are critical to contract completion. A lost workday due to restriction delay is defined as a day in which the Contractor cannot work at least 50 percent of the day on the impacted activity.

1.10.2.11 Cost Loading

The Project Network Analysis Schedule (NAS) must be cost-loaded and will provide the basis for progress payments. Earned Value Reports must be derived from and correspond to cost loaded NAS. Use the Critical Path Method (CPM) and the Precedence Diagram Method (PDM) to satisfy time and cost applications.

1.10.2.11.1 Cost Loading Activities

Assign Material and Equipment Costs, for which payment will be requested in advance of installation, to their respective procurement activity (i.e., the material/equipment on-site activity). Assign cost for material/equipment, paid for after installation; labor; and construction equipment to their respective Construction Activities. Provide breakdown of definable features of work for cost loaded activities comprising Mobilization and De-Mobilization (Lump sum not allowed). The value of commissioning, testing and closeout WBS section may not be less than 10 percent of the total costs for Procurement and Construction Activities. Evenly disperse overhead and profit to each activity over the duration of the project.

1.10.2.11.2 Partial Payment

Breakdown unit of measure and cost must be defined within P6 Activity Detail Expenses for partial payment of any cost loaded activity. Lump sum cost loaded activity will not be partially paid.

1.10.3 Schedule Software Settings and Restrictions

- a. Activity Constraints: Date/time constraint(s), other than those required by the contract, are not allowed unless accepted by the Contracting Officer. Identify any constraints proposed and provide an explanation for the purpose of the constraint in the Narrative Report as described in paragraph REQUIRED TABULAR REPORTS.
- b. Default Progress Data Disallowed: Actual Start and Actual Finish dates on the CPM schedule must match the dates on the Contractor Quality Control and Production Reports.
- c. Software Settings: Handle schedule calculations and Out-of-Sequence progress (if applicable) through Retained Logic, not Progress Override. Show all activity durations and float values in days. Show activity progress using Remaining Duration. Set default activity type to "Task Dependent".
- d. At a minimum, include the following settings and parameters in P6 Schedule preparation:
 - (1) General: Define or establish Calendars and Activity Codes at the "Project" level, not the "Global" level.
 - (2) Admin Drop-Down Menu, Admin Preferences, Time Periods Tab:
 - (a) Set time periods for P6 to 8.0 Hours/Day, 40.0 Hours/Week, 172.0 Hours/Month and 2000.0 Hours/Year.
 - (b) Use assigned calendar to specify the number of work hours for each time period: Must be checked.

- (3) Admin Drop-Down Menu, Admin Preferences, Earned Value Tab:
 - (a) Earned Value Calculation: Use "Budgeted values with current dates".
- (4) Project Level, Dates Tab:
 - (a) Set "Must Finish By" date to "Contract Completion Date", and set "Must Finish By" time to 05:00pm.
- (5) Project Level, Defaults Tab:
 - (a) Duration Type: Set to "Fixed Duration & Units".
 - (b) Percent Complete Type: Set to "Physical".
 - (c) Activity Type: Set to "Task Dependent".
 - (d) Calendar: Set to "Standard 5 Day Workweek". Calendar must reflect Saturday, Sunday and all Federal holidays as non-work days. Alternative calendars may be used with Contracting Officer approval.
- (6) Project Level, Calculations Tab:
 - (a) Activity percent complete based on activity steps: Must be Checked.
 - (b) Reset Remaining Duration and Units to Original: Must be Checked.
 - (c) Subtract Actual from At Completion: Must be Checked.
 - (d) Recalculate Actual units and Cost when duration percent complete changes: Must be Checked.
 - (e) Link Actual to Date and Actual This Period Units and Cost: Must be Checked.
 - (f) Price/Unit: Set to "\$1/h".
 - (g) Update units when costs change on resource assignments: Must be Unchecked.
- (7) Project Level, Settings Tab:
 - (a) Define Critical Activities: Check "Longest Path".
- (8) Work Breakdown Structure Level, Earned Value Tab:
 - (a) Technique for Computing Performance Percent Complete: "Activity percent complete" is selected.
 - (b) Technique for Computing Estimate to Complete (ETC): "PF = 1" is selected.

1.10.4 Required Tabular Reports

Include the following reports with the Baseline, Monthly Update and any other required schedule submittals:

- a. Log Report: P6 Scheduling/Leveling Report.
- b. Narrative Report: Identify and justify:
 - (1) Progress made in each area of the project;
 - (2) Longest Path;
 - (3) Date/time constraint(s), other than those required by the contract
 - (4) Listing of all changes made between the previous schedule and current updated schedule include: added or deleted activities, original and remaining durations for activities that have not started, logic (sequence constraint lag/lead), milestones, planned sequence of operations, longest path, calendars or calendar assignments, and cost loading;
 - (5) Any decrease in previously reported activity Earned Amount;
 - (6) Pending items and status thereof, including permits, changes orders, and time extensions;
 - (7) Status of Contract Completion Date and interim milestones;
 - (8) Current and anticipated delays (describe cause of delay and corrective actions(s) and mitigation measures to minimize);
 - (9) Description of current and potential future schedule problem areas.

Each entry in the narrative report must cite the respective Activity ID and Activity Name, the date and reason for the change, and description of the change.

- c. Earned Value Report: Derive from and correspond to P6 cost loaded schedule. List all activities having a budget amount cost loaded. Compile total earnings on the project from notice to proceed to current progress payment request. Show current budget, previous physical percent complete, to-date physical percent complete, previous earned value, to-date earned value and cost to complete on the report for each activity.
- d. Schedule Variance Control (SVC) Diagram: With each schedule submission, provide a SVC diagram showing 1) Cash Flow S-Curves indicating planned project cost based on projected early and late activity finish dates and 2) Earned Value to-date. Revise Cash Flow S-Curves when the contract is modified, or as directed by the Contracting Officer.
- e. Daily Reported Production Activity: Submit on a monthly basis, in electronic spreadsheet (format provided by the Government), summary of daily reported production activity for the reporting month in the update schedule. Use the following columns for reporting:
 - (1) Date

- (2) Activity ID
- (3) Work Description
- (4) Contractor
- (5) Billable Hours

1.11 CONTRACT MODIFICATION

1.11.1 Time Impact Analysis (TIA)

Submit a Time Impact Analysis with each cost and time proposal for a proposed change. TIA must illustrate the influence of each change or delay on the Contract Completion Date or milestones. No time extensions will be granted nor delay damages paid unless a delay occurs which consumes all available Project Float, and extends the Projected Completion beyond the Contract Completion Date.

- a. Each TIA must be in both narrative and schedule form. The narrative must define the scope and conditions of the change; provide start and finish dates of impact, successor and predecessor activity to impact period, responsible party; describe how it originated, and how it impacts the schedule. The schedule submission must consist of three native files:
 - (1) Fragnet used to define the scope of the changed condition
 - (2) Most recent accepted schedule update as of the time of the proposal or claim submission that has been updated to show all activity progress as of the time of the impact start date.
 - (3) The impacted schedule that has the fragnet inserted in the updated schedule and the schedule "run" so that the new completion date is determined.
- b. For claimed as-built project delay, the inserted fragnet TIA method must be modified to account for as-built events known to occur after the data date of schedule update used.
- c. All TIAs must include any mitigation, and must determine the apportionment of the overall delay assignable to each individual delay. Apportionment must provide identification of delay type and classification of delay by compensable and non-compensable events. The associated narrative must clearly describe analysis methodology used, and the findings in a chronological listing beginning with the earliest delay event.
 - (1) Identify and classify types of delay defined as follows:
 - (a) Force majeure delay (e.g. weather delay): Any delay event caused by something or someone other than the Government or the Contractor, or the risk of which has not been assigned solely to the Government or the Contractor. If the force majeure delay is on the longest path, in absence of other types of concurrent delays, the Contractor is granted an extension of contract time, classified as a non-compensable event.

(b) A Contractor-delay: Any delay event caused by the Contractor, or the risk of which has been assigned solely to the Contractor. If the contractor-delay is on the longest path, in absence of other types of concurrent delays, Contractor is not granted extension of contract time, and classified as a non-compensable event. Where absent other types of delays, and having impact to project completion, Contractor must provide to Contracting Officer a Corrective Action Plan identifying plan to mitigate delay.

(c) A Government-delay: Any delay event caused by the Government, or the risk of which has been assigned solely to the Government. If the Government-delay is on the longest path, in absence of other types of concurrent delays, the Contractor is granted an extension of contract time, and classified as a compensable event.

(2) Functional theory must be used to analyze concurrent delays, where: separate delay issues delay project completion, do not necessarily occur at same time, rather occur within same monthly schedule update period at minimum, or within same as-built period under review. If a combination of functionally concurrent delay types occurs, it is considered Concurrent Delay, which is defined in the following combinations:

(a) Government-delay concurrent with contractor-delay: excusable time extension, classified non-compensable event.

(b) Government-delay concurrent with force majeure delay: excusable time extension, classified non-compensable event.

(c) Contractor-delay concurrent with force majeure delay: excusable time extension, classified non-compensable event.

(3) Pacing delay reacting to another delay (parent delay) equally or more critical than paced activity must be identified prior to pacing. Contracting Officer will notify Contractor prior to pacing. Contractor must notify Contracting Officer prior to pacing. Notification must include identification of parent delay issue, estimated parent delay time period, paced activity(s) identity, and pacing reason(s). Pacing Concurrency is defined as follows:

(a) Government-delay concurrent with contractor-pacing: excusable time extension, classified compensable event.

(b) Contractor-delay concurrent with Government-pacing: inexcusable time extension, classified non-compensable event

d. Submit Data disks containing the narrative and the source schedule files used in the time impact analysis.

e. All as-built and known planned activity must be included in NAS. Add cost loading or change Contract Completion Date to NAS in accordance to conformed contract modifications issued prior to Data Date of NAS update.

1.11.2 No Reservation of Rights

All direct costs, indirect cost, and time extensions will be negotiated and made full, equitable and final at the time of modification issuance.

1.12 PROJECT FLOAT

Project Float is the length of time between the Contractor's Projected Completion Milestone and the Contract Completion Date Milestone. Project Float available in the schedule will not be for the exclusive use of either the Government or the Contractor.

The use of Resource Leveling or other techniques used for the purpose of artificially adjusting activity durations to consume float and influence critical path is prohibited.

PART 2 PRODUCTS

Not used.

PART 3 EXECUTION

Not used.

-- End of Section --

SECTION 01 33 00

SUBMITTAL PROCEDURES

08/18, CHG 4: 02/21

PART 1 GENERAL

1.1 SUMMARY

1.1.1 Submittal Information

The Contracting Officer may request submittals in addition to those specified when deemed necessary to adequately describe the work covered in the respective sections. Each submittal is to be complete and in sufficient detail to allow ready determination of compliance with contract requirements.

Units of weights and measures used on all submittals are to be the same as those used in the contract drawings.

1.1.2 Project Type

The Contractor's Quality Control (CQC) System Manager are to check and approve all items before submittal and stamp, sign, and date indicating action taken. Proposed deviations from the contract requirements are to be clearly identified. Include within submittals items such as: Contractor's, manufacturer's, or fabricator's drawings; descriptive literature including (but not limited to) catalog cuts, diagrams, operating charts or curves; test reports; test cylinders; samples; O&M manuals (including parts list); certifications; warranties; and other such required submittals.

The Contractor is to check and approve all items before submittal and stamp, sign, and date indicating action taken. Proposed deviations from the contract requirements are to be clearly identified. Include within submittals items such as: Contractor's, manufacturer's, or fabricator's drawings; descriptive literature including (but not limited to) catalog cuts, diagrams, operating charts or curves; test reports; test cylinders; samples; O&M manuals (including parts list); certifications; warranties; and other such required submittals.

1.1.3 Submission of Submittals

Schedule and provide submittals requiring Government approval before acquiring the material or equipment covered thereby. Pick up and dispose of samples not incorporated into the work in accordance with manufacturer's Safety Data Sheets (SDS) and in compliance with existing laws and regulations.

1.2 DEFINITIONS

1.2.1 Submittal Descriptions (SD)

Submittal requirements are specified in the technical sections. Examples and descriptions of submittals identified by the Submittal Description (SD) numbers and titles follow:

SD-01 Preconstruction Submittals

Submittals that are required prior to or commencing with the start of work on site. Submittals that are required prior to or at the start of construction (work) or the next major phase of the construction on a multiphase contract.

Preconstruction Submittals include schedules and a tabular list of locations, features, and other pertinent information regarding products, materials, equipment, or components to be used in the work.

Certificates Of Insurance

Surety Bonds

List Of Proposed Subcontractors

List Of Proposed Products

Baseline Network Analysis Schedule (NAS)

Submittal Register

Schedule Of Prices Or Earned Value Report

Accident Prevention Plan Health And Safety Plan

Work Plan

Quality Control (QC) plan

Environmental Protection Plan

SD-02 Shop Drawings

Drawings, diagrams and schedules specifically prepared to illustrate some portion of the work.

Diagrams and instructions from a manufacturer or fabricator for use in producing the product and as aids to the Contractor for integrating the product or system into the project.

Drawings prepared by or for the Contractor to show how multiple systems and interdisciplinary work will be coordinated.

SD-03 Product Data

Catalog cuts, illustrations, schedules, diagrams, performance charts, instructions and brochures illustrating size, physical appearance and other characteristics of materials, systems or equipment for some portion of the work.

Samples of warranty language when the contract requires extended product warranties.

SD-04 Samples

Fabricated or unfabricated physical examples of materials, equipment or workmanship that illustrate functional and aesthetic characteristics of a material or product and establish standards by

which the work can be judged.

Color samples from the manufacturer's standard line (or custom color samples if specified) to be used in selecting or approving colors for the project.

Field samples and mock-ups constructed on the project site establish standards ensuring work can be judged. Includes assemblies or portions of assemblies that are to be incorporated into the project and those that will be removed at conclusion of the work.

SD-05 Design Data

Design calculations, mix designs, analyses or other data pertaining to a part of work.

Design submittals, design substantiation submittals and extensions of design submittals.

SD-06 Test Reports

Report signed by authorized official of testing laboratory that a material, product or system identical to the material, product or system to be provided has been tested in accord with specified requirements. Unless specified in another section, testing must have been within three years of date of contract award for the project.

Report that includes findings of a test required to be performed on an actual portion of the work or prototype prepared for the project before shipment to job site.

Report that includes finding of a test made at the job site or on sample taken from the job site, on portion of work during or after installation.

Investigation reports

Daily logs and checklists

Final acceptance test and operational test procedure

SD-07 Certificates

Statements printed on the manufacturer's letterhead and signed by responsible officials of manufacturer of product, system or material attesting that the product, system, or material meets specification requirements. Must be dated after award of project contract and clearly name the project.

Document required of Contractor, or of a manufacturer, supplier, installer or Subcontractor through Contractor. The document purpose is to further promote the orderly progression of a portion of the work by documenting procedures, acceptability of methods, or personnel qualifications.

Confined space entry permits

Text of posted operating instructions

SD-08 Manufacturer's Instructions

Preprinted material describing installation of a product, system or material, including special notices and (SDS) concerning impedances, hazards and safety precautions.

SD-09 Manufacturer's Field Reports

Documentation of the testing and verification actions taken by manufacturer's representative at the job site, in the vicinity of the job site, or on a sample taken from the job site, on a portion of the work, during or after installation, to confirm compliance with manufacturer's standards or instructions. The documentation must be signed by an authorized official of a testing laboratory or agency and state the test results; and indicate whether the material, product, or system has passed or failed the test.

Factory test reports.

SD-10 Operation and Maintenance Data

Data provided by the manufacturer, or the system provider, including manufacturer's help and product line documentation, necessary to maintain and install equipment, for operating and maintenance use by facility personnel.

Data required by operating and maintenance personnel for the safe and efficient operation, maintenance and repair of the item.

Data incorporated in an operations and maintenance manual or control system.

SD-11 Closeout Submittals

Documentation to record compliance with technical or administrative requirements or to establish an administrative mechanism.

Submittals required for Guiding Principle Validation (GPV) or Third Party Certification (TPC).

Special requirements necessary to properly close out a construction contract. For example, Record Drawings and as-built drawings. Also, submittal requirements necessary to properly close out a major phase of construction on a multi-phase contract.

1.2.2 Approving Authority

Office or designated person authorized to approve the submittal.

1.2.3 Work

As used in this section, on-site and off-site construction required by contract documents, including labor necessary to produce submittals, construction, materials, products, equipment, and systems incorporated or to be incorporated in such construction. In exception, excludes work to produce SD-01 submittals.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Submittal Register; G

1.4 SUBMITTAL CLASSIFICATION

1.4.1 Government Approved (G)

Government approval is required for extensions of design, critical materials, variations, equipment whose compatibility with the entire system must be checked, and other items as designated by the Government.

Government approval is required for any variations from the Solicitation or the Accepted Proposal and for other items as designated by the Government.

Within the terms of the Contract Clause SPECIFICATIONS AND DRAWINGS FOR CONSTRUCTION, submittals are considered to be "shop drawings."

1.5 FORWARDING SUBMITTALS REQUIRING GOVERNMENT APPROVAL

As soon as practicable after award of contract, and before procurement or fabrication, forward to the Air Force Project Manager, submittals required in the technical sections of this specification, including shop drawings, product data and samples. In addition, forward a copy of the submittals to the Contracting Officer.

1.5.1 O&M Data

Submit data specified for a given item within 30 calendar days after the item is delivered to the contract site.

In the event the Contractor fails to deliver O&M data within the time limits specified, the Contracting Officer may withhold from progress payments 50 percent of the price of the items to which such O&M data apply.

1.6 PREPARATION

1.6.1 Transmittal Form

Transmit each submittal, except sample installations and sample panels to the office of the approving authority using the transmittal form prescribed by the Contracting Officer. Include all information prescribed by the transmittal form and required in paragraph IDENTIFYING SUBMITTALS. Use the submittal transmittal forms to record actions regarding samples.

As directed by the Contracting Officer, use the ENG Form 4025-R transmittal form for submitting both Government-approved and information-only submittals. Submit in accordance with the instructions on the reverse side of the form. These forms or similar forms will be

furnished to the Contractor. Properly complete this form by filling out all the heading blank spaces and identifying each item submitted. Exercise special care to ensure proper listing of the specification paragraph and sheet number of the contract drawings pertinent to the data submitted for each item.

1.6.2 Identifying Submittals

The Contractor's Quality Control Manager must prepare, review and stamp submittals, including those provided by a subcontractor, before submittal to the Government.

Identify submittals, except sample installations and sample panels, with the following information permanently adhered to or noted on each separate component of each submittal and noted on transmittal form. Mark each copy of each submittal identically, with the following:

- a. Project title and location
- b. Construction contract number
- c. Dates of the drawings and revisions
- d. Name, address, and telephone number of Subcontractor, supplier, manufacturer, and any other Subcontractor associated with the submittal.
- e. Section number of the specification by which submittal is required
- f. Submittal description (SD) number of each component of submittal
- g. For a resubmission, add alphabetic suffix on submittal description, for example, submittal 18 would become 18A, to indicate resubmission
- h. Product identification and location in project.

1.6.3 Submittal Format

1.6.3.1 Format of SD-01 Preconstruction Submittals

When the submittal includes a document that is to be used in the project, or is to become part of the project record, other than as a submittal, do not apply the Contractor's approval stamp to the document itself, but to a separate sheet accompanying the document.

Provide data in the unit of measure used in the contract documents.

1.6.3.2 Format for SD-02 Shop Drawings

Provide shop drawings not less than 8 1/2 by 11 inches nor more than 30 by 42 inches, except for full-size patterns or templates. Prepare drawings to accurate size, with scale indicated, unless another form is required. Ensure drawings are suitable for reproduction and of a quality to produce clear, distinct lines and letters, with dark lines on a white background.

- a. Include the nameplate data, size, and capacity on drawings. Also include applicable federal, military, industry, and technical society publication references.

- b. Dimension drawings, except diagrams and schematic drawings. Prepare drawings demonstrating interface with other trades to scale. Use the same unit of measure for shop drawings as indicated on the contract drawings. Identify materials and products for work shown.

Present shop drawings sized 8 1/2 by 11 inches as part of the bound volume for submittals. Present larger drawings in sets. Submit an electronic copy of drawings in PDF format.

1.6.3.2.1 Drawing Identification

Include on each drawing the drawing title, number, date, and revision numbers and dates, in addition to information required in paragraph IDENTIFYING SUBMITTALS.

Number drawings in a logical sequence. Each drawing is to bear the number of the submittal in a uniform location next to the title block. Place the Government contract number in the margin, immediately below the title block, for each drawing.

Reserve a blank space, no smaller than 3 inches on the right-hand side of each sheet for the Government disposition stamp.

1.6.3.3 Format of SD-03 Product Data

Present product data submittals for each section as a complete, bound volume. Include a table of contents, listing the page and catalog item numbers for product data.

Indicate, by prominent notation, each product that is being submitted; indicate the specification section number and paragraph number to which it pertains.

1.6.3.3.1 Product Information

Supplement product data with material prepared for the project to satisfy the submittal requirements where product data does not exist. Identify this material as developed specifically for the project, with information and format as required for submission of SD-07 Certificates.

Provide product data in units used in the Contract documents. Where product data are included in preprinted catalogs with another unit, submit the dimensions in contract document units, on a separate sheet.

1.6.3.3.2 Standards

Where equipment or materials are specified to conform to industry or technical-society reference standards of such organizations as the American National Standards Institute (ANSI), ASTM International (ASTM), National Electrical Manufacturer's Association (NEMA), Underwriters Laboratories (UL), or Association of Edison Illuminating Companies (AEIC), submit proof of such compliance. The label or listing by the specified organization will be acceptable evidence of compliance. In lieu of the label or listing, submit a certificate from an independent testing organization, competent to perform testing, and approved by the Contracting Officer. State on the certificate that the item has been tested in accordance with the specified organization's test methods and that the item complies with the specified organization's reference standard.

1.6.3.3.3 Data Submission

Collect required data submittals for each specific material, product, unit of work, or system into a single submittal that is marked for choices, options, and portions applicable to the submittal. Mark each copy of the product data identically. Partial submittals will not be accepted for expedition of the construction effort.

Submit the manufacturer's instructions before installation.

1.6.3.4 Format of SD-04 Samples

1.6.3.4.1 Sample Characteristics

Furnish samples in the following sizes, unless otherwise specified or unless the manufacturer has prepackaged samples of approximately the same size as specified:

- a. Sample of Equipment or Device: Full size.
- b. Sample of Materials Less Than 2 by 3 inches: Built up to 8 1/2 by 11 inches.
- c. Sample of Materials Exceeding 8 1/2 by 11 inches: Cut down to 8 1/2 by 11 inches and adequate to indicate color, texture, and material variations.
- d. Sample of Linear Devices or Materials: 10 inch length or length to be supplied, if less than 10 inches. Examples of linear devices or materials are conduit and handrails.
- e. Sample Volume of Nonsolid Materials: Pint. Examples of nonsolid materials are sand and paint.
- f. Color Selection Samples: 2 by 4 inches. Where samples are specified for selection of color, finish, pattern, or texture, submit the full set of available choices for the material or product specified. Sizes and quantities of samples are to represent their respective standard unit.
- g. Sample Panel: 4 by 4 feet.
- h. Sample Installation: 100 square feet.

1.6.3.4.2 Sample Incorporation

Reusable Samples: Incorporate returned samples into work only if so specified or indicated. Incorporated samples are to be in undamaged condition at the time of use.

Recording of Sample Installation: Note and preserve the notation of any area constituting a sample installation, but remove the notation at the final clean-up of the project.

1.6.3.4.3 Comparison Sample

Samples Showing Range of Variation: Where variations in color, finish, pattern, or texture are unavoidable due to nature of the materials, submit

sets of samples of not less than three units showing extremes and middle of range. Mark each unit to describe its relation to the range of the variation.

When color, texture, or pattern is specified by naming a particular manufacturer and style, include one sample of that manufacturer and style, for comparison.

1.6.3.5 Format of SD-05 Design Data

Provide design data and certificates on 8 1/2 by 11 inch paper. Provide a bound volume for submittals containing numerous pages.

1.6.3.6 Format of SD-06 Test Reports

Provide reports on 8 1/2 by 11 inch paper in a complete bound volume.

By prominent notation, indicate each report in the submittal. Indicate the specification number and paragraph number to which each report pertains.

1.6.3.7 Format of SD-07 Certificates

Provide design data and certificates on 8 1/2 by 11 inch paper. Provide a bound volume for submittals containing numerous pages.

1.6.3.8 Format of SD-08 Manufacturer's Instructions

Present manufacturer's instructions submittals for each section as a complete, bound volume. Include the manufacturer's name, trade name, place of manufacture, and catalog model or number on product data. Also include applicable federal, military, industry, and technical-society publication references. If supplemental information is needed to clarify the manufacturer's data, submit it as specified for SD-07 Certificates.

Submit the manufacturer's instructions before installation.

1.6.3.8.1 Standards

Where equipment or materials are specified to conform to industry or technical-society reference standards of such organizations as the American National Standards Institute (ANSI), ASTM International (ASTM), National Electrical Manufacturer's Association (NEMA), Underwriters Laboratories (UL), or Association of Edison Illuminating Companies (AEIC), submit proof of such compliance. The label or listing by the specified organization will be acceptable evidence of compliance. In lieu of the label or listing, submit a certificate from an independent testing organization, competent to perform testing, and approved by the Contracting Officer. State on the certificate that the item has been tested in accordance with the specified organization's test methods and that the item complies with the specified organization's reference standard.

1.6.3.9 Format of SD-09 Manufacturer's Field Reports

Provide reports on 8 1/2 by 11 inch paper in a complete bound volume.

By prominent notation, indicate each report in the submittal. Indicate the specification number and paragraph number to which each report

pertains.

1.6.3.10 Format of SD-10 Operation and Maintenance Data (O&M)

Comply with the requirements specified in Section 01 78 23 OPERATION AND MAINTENANCE DATA for O&M Data format.

1.6.3.11 Format of SD-11 Closeout Submittals

When the submittal includes a document that is to be used in the project or is to become part of the project record, other than as a submittal, do not apply the Contractor's approval stamp to the document itself, but to a separate sheet accompanying the document.

Provide data in the unit of measure used in the contract documents.

1.6.4 Source Drawings for Shop Drawings

1.6.4.1 Source Drawings

The entire set of source drawing files (DWG) will not be provided to the Contractor. Request the specific Drawing Number for the preparation of shop drawings. Only those drawings requested to prepare shop drawings will be provided. These drawings are provided only after award.

1.6.4.2 Terms and Conditions

Data contained on these electronic files must not be used for any purpose other than as a convenience in the preparation of construction data for the referenced project. Any other use or reuse is at the sole risk of the Contractor and without liability or legal exposure to the Government. The Contractor must make no claim, and waives to the fullest extent permitted by law any claim or cause of action of any nature against the Government, its agents, or its subconsultants that may arise out of or in connection with the use of these electronic files. The Contractor must, to the fullest extent permitted by law, indemnify and hold the Government harmless against all damages, liabilities, or costs, including reasonable attorney's fees and defense costs, arising out of or resulting from the use of these electronic files.

These electronic source drawing files are not construction documents. Differences may exist between the source drawing files and the corresponding construction documents. The Government makes no representation regarding the accuracy or completeness of the electronic source drawing files, nor does it make representation to the compatibility of these files with the Contractor hardware or software. The Contractor is responsible for determining if any conflict exists. In the event that a conflict arises between the signed and sealed construction documents prepared by the Government and the furnished source drawing files, the signed and sealed construction documents govern. Use of these source drawing files does not relieve the Contractor of the duty to fully comply with the contract documents, including and without limitation the need to check, confirm and coordinate the work of all contractors for the project. If the Contractor uses, duplicates or modifies these electronic source drawing files for use in producing construction data related to this contract, remove all previous indication of ownership (seals, logos, signatures, initials and dates).

1.6.5 Electronic File Format

Provide submittals in electronic format, with the exception of material samples required for SD-04 Samples items. Compile the submittal file as a single, complete document, to include the Transmittal Form described within. Name the electronic submittal file specifically according to its contents, and coordinate the file naming convention with the Contracting Officer. Electronic files must be of sufficient quality that all information is legible. Use PDF as the electronic format, unless otherwise specified or directed by the Contracting Officer. Generate PDF files from original documents with bookmarks so that the text included in the PDF file is searchable and can be copied. If documents are scanned, optical character resolution (OCR) routines are required. Index and bookmark files exceeding 30 pages to allow efficient navigation of the file. When required, the electronic file must include a valid electronic signature or a scan of a signature.

E-mail electronic submittal documents smaller than 10MB to an e-mail address as directed by the Contracting Officer. Provide electronic documents over 10 MB on an optical disc or through an electronic file sharing system such as the DOD SAFE Web Application located at the following website: <https://safe.apps.mil/>.

1.7 QUANTITY OF SUBMITTALS

1.7.1 Number of SD-01 Preconstruction Submittal Copies

Unless otherwise specified, submit two sets of administrative submittals.

1.7.2 Number of SD-02 Shop Drawing Copies

Unless otherwise specified, submit six copies of submittals of shop drawings requiring review and approval by a QC organization. Submit seven copies of shop drawings requiring review and approval by the Contracting Officer.

1.7.3 Number of SD-03 Product Data Copies

Submit in compliance with quantity requirements specified for shop drawings.

1.7.4 Number of SD-04 Samples

- a. Submit two samples, or two sets of samples showing the range of variation, of each required item. One approved sample or set of samples will be retained by the approving authority and one will be returned to the Contractor.
- b. Submit one sample panel or provide one sample installation where directed. Include components listed in the technical section or as directed.
- c. Submit one sample installation, where directed.
- d. Submit one sample of nonsolid materials.

1.7.5 Number of SD-05 Design Data Copies

Submit in compliance with quantity requirements specified for shop

drawings.

1.7.6 Number of SD-06 Test Report Copies

Submit in compliance with quantity and quality requirements specified for shop drawings, other than field test results that will be submitted with QC reports.

1.7.7 Number of SD-07 Certificate Copies

Submit in compliance with quantity requirements specified for shop drawings.

1.7.8 Number of SD-08 Manufacturer's Instructions Copies

Submit in compliance with quantity requirements specified for shop drawings.

1.7.9 Number of SD-09 Manufacturer's Field Report Copies

Submit in compliance with quantity and quality requirements specified for shop drawings other than field test results that will be submitted with QC reports.

1.7.10 Number of SD-10 Operation and Maintenance Data Copies

Submit five copies of O&M data to the Contracting Officer for review and approval.

1.7.11 Number of SD-11 Closeout Submittals Copies

Unless otherwise specified, submit two sets of administrative submittals.

1.8 INFORMATION ONLY SUBMITTALS

Submittals without a "G" designation must be certified by the QC manager and submitted to the Contracting Officer for information-only. Provide information-only submittals to the Contracting Officer a minimum of 14 calendar days prior to the Preparatory Meeting for the associated Definable Feature of Work (DFOW). Approval of the Contracting Officer is not required on information only submittals. The Contracting Officer will mark "receipt acknowledged" on submittals for information and will return only the transmittal cover sheet to the Contractor. Normally, submittals for information only will not be returned. However, the Government reserves the right to return unsatisfactory submittals and require the Contractor to resubmit any item found not to comply with the contract. This does not relieve the Contractor from the obligation to furnish material conforming to the plans and specifications; will not prevent the Contracting Officer from requiring removal and replacement of nonconforming material incorporated in the work; and does not relieve the Contractor of the requirement to furnish samples for testing by the Government laboratory or for check testing by the Government in those instances where the technical specifications so prescribe.

1.9 PROJECT SUBMITTAL REGISTER AND DATABASE

A sample Project Submittal Register showing items of equipment and materials for when submittals are required by the specifications is provided as a "Submittal Register" attachment at the end of this section.

1.9.1 Submittal Management

Prepare and maintain a submittal register, as the work progresses. Use an electronic submittal register program furnished by the Government. Do not change data that is output in columns (c), (d), (e), and (f) as delivered by Government; retain data that is output in columns (a), (g), (h), and (i) as approved. As an attachment, provide a submittal register showing items of equipment and materials for which submittals are required by the specifications. This list may not be all-inclusive and additional submittals may be required. Maintain a submittal register for the project in accordance with Section 01 45 00.00 10 QUALITY CONTROL. The Government will provide the initial submittal register in electronic format with the following fields completed, to the extent that will be required by the Government during subsequent usage.

Column (c): Lists specification section in which submittal is required.

Column (d): Lists each submittal description (SD Number, and type, e.g., SD-02 Shop Drawings) required in each specification section.

Column (e): Lists one principal paragraph in each specification section where a material or product is specified. This listing is only to facilitate locating submitted requirements. Do not consider entries in column (e) as limiting the project requirements.

Column (f): Lists the approving authority for each submittal.

1.9.2 Preconstruction Use of Submittal Register

Submit the submittal register as an electronic database, using the submittal management program furnished to Contractor. Include the QC plan and the project schedule. Verify that all submittals required for the project are listed and add missing submittals. Coordinate and complete the following fields on the register database submitted with the QC plan and the project schedule:

Column (a) Activity Number: Activity number from the project schedule.

Column (g) Contractor Submit Date: Scheduled date for the approving authority to receive submittals.

Column (h) Contractor Approval Date: Date that Contractor needs approval of submittal.

Column (i) Contractor Material: Date that Contractor needs material delivered to Contractor control.

1.9.3 Contractor Use of Submittal Register

Update the following fields in the Government-furnished submittal register program or equivalent fields in the program used by the Contractor with each submittal throughout the contract.

Column (b) Transmittal Number: List of consecutive,

Contractor-assigned numbers.

Column (j) Action Code (k): Date of action used to record Contractor's review when forwarding submittals to QC.

Column (l) Date submittal transmitted.

Column (q) Date approval was received.

1.9.4 Approving Authority Use of Submittal Register

Update the following fields:

Column (b) Transmittal Number: List of consecutive, Contractor-assigned numbers.

Column (l) Date submittal was received.

Column (m) through (p) Dates of review actions.

Column (q) Date of return to Contractor.

1.9.5 Action Codes

Entries for columns (j) and (o) are to be used as follows (others may be prescribed by the Transmittal Form):

1.9.5.1 Government Review Action Codes

"A" - "Approved as submitted"

"AN" - "Approved as noted"

"RR" - "Disapproved as submitted"; "Completed"

"NR" - "Not Reviewed"

"RA" - "Receipt Acknowledged"

1.9.5.2 Contractor Action Codes

DESIGN BID BUILD SUBMITTALS			
Submittal Classifications shown in UFGS Sections	Submittal Classification	Corresponding SpecsIntact Submittal Register Code which is populated in the SI Submittal Register. Software Limitations: (The software shows one character delineation in the SpecsIntact Submittal Register)	RMS - The following Submittal Classifications are populated in RMS when the SpecsIntact Submittal Data File is pulled into RMS)
G	Submittal requires Government Approval	G	GA
BLANK	Submittal is For Information Only (FIO)	BLANK	FIO
S	Submittal is for documentation of Sustainable requirements	S	S/FIO

1.9.6 Delivery of Copies

Submit an updated electronic copy of the submittal register to the Contracting Officer with each invoice request, unless a paper copy is requested by the Contracting Officer. Provide an updated Submittal Register monthly regardless of whether an invoice is submitted.

1.10 VARIATIONS

Variations from contract requirements require Contracting Officer approval pursuant to contract Clause FAR 52.236-21 Specifications and Drawings for Construction, and will be considered where advantageous to the Government.

1.10.1 Considering Variations

Discussion of variations with the Contracting Officer before submission will help ensure that functional and quality requirements are met and minimize rejections and resubmittals. For variations that include design changes or some material or product substitutions, the Government may require an evaluation and analysis by a licensed professional engineer hired by the contractor.

Specifically point out variations from contract requirements in a transmittal letter. Failure to point out variations may cause the Government to require rejection and removal of such work at no additional cost to the Government.

1.10.2 Warranting that Variations are Compatible

When delivering a variation for approval, the Contractor warrants that this contract has been reviewed to establish that the variation, if incorporated, will be compatible with other elements of work.

1.10.3 Review Schedule Extension

In addition to the normal submittal review period, a period of 14 calendar working days will be allowed for the Government to consider submittals with variations.

1.11 SCHEDULING

Schedule and submit concurrently product data and shop drawings covering component items forming a system or items that are interrelated. Submit pertinent certifications at the same time. No delay damages or time extensions will be allowed for time lost in late submittals. .

- a. Coordinate scheduling, sequencing, preparing, and processing of submittals with performance of work so that work will not be delayed by submittal processing. The Contractor is responsible for additional time required for Government reviews resulting from required resubmittals. The review period for each resubmittal is the same as for the initial submittal.
- b. Submittals required by the contract documents are listed on the submittal register. If a submittal is listed in the submittal register but does not pertain to the contract work, the Contractor is to include the submittal in the register and annotate it "N/A" with a brief explanation. Approval by the Contracting Officer does not relieve the Contractor of supplying submittals required by the contract documents but that have been omitted from the register or marked "N/A."
- c. Resubmit the submittal register and annotate it monthly with actual submission and approval dates. When all items on the register have been fully approved, no further resubmittal is required.

Contracting Officer review will be completed within 14 calendar working days after the date of submission.

- d. A schedule of shop drawings and technical submittals required by the specifications and drawings. Indicate the specification or drawing reference requiring the submittal; the material, item, or process for which the submittal is required; the "SD" number and identifying title of the submittal; the anticipated submission date, and the approval need date.
- e. A separate schedule of other submittals required under the contract but not listed in the specifications or drawings. Indicate the contract requirement reference, the type or title of the submittal, the anticipated submission date, and the approval need date (if approval is required).

1.12 GOVERNMENT APPROVING AUTHORITY

When the approving authority is the Contracting Officer, the Government will:

- a. Note the date on which the submittal was received from the QC manager.
- b. Review submittals for approval within the scheduling period specified and only for conformance with project design concepts and compliance with contract documents.
- c. Identify returned submittals with one of the actions defined in paragraph REVIEW NOTATIONS and with comments and markings appropriate for the action indicated.

Upon completion of review of submittals requiring Government approval, stamp and date submittals. Two copies of the submittal will be retained by the Contracting Officer and the remaining copies of the submittal will be returned to the Contractor.

1.12.1 Review Notations

Submittals will be returned to the Contractor with the following notations:

- a. Submittals marked "approved" or "accepted" authorize proceeding with the work covered.
- b. Submittals marked "approved as noted" or "approved, except as noted, resubmittal not required," authorize proceeding with the work covered provided that the Contractor takes no exception to the corrections.
- c. Submittals marked "not approved," "disapproved," or "revise and resubmit" indicate incomplete submittal or noncompliance with the contract requirements or design concept. Resubmit with appropriate changes. Do not proceed with work for this item until the resubmittal is approved.
- d. Submittals marked "not reviewed" indicate that the submittal has been previously reviewed and approved, is not required, does not have evidence of being reviewed and approved by Contractor, or is not complete. A submittal marked "not reviewed" will be returned with an explanation of the reason it is not reviewed. Resubmit submittals returned for lack of review by Contractor or for being incomplete, with appropriate action, coordination, or change.
- e. Submittals marked "receipt acknowledged" indicate that submittals have been received by the Government. This applies only to "information-only submittals" as previously defined.

1.13 DISAPPROVED SUBMITTALS

Make corrections required by the Contracting Officer. If the Contractor considers any correction or notation on the returned submittals to constitute a change to the contract drawings or specifications, give notice to the Contracting Officer as required under the FAR clause titled CHANGES. The Contractor is responsible for the dimensions and design of connection details and the construction of work. Failure to point out variations may cause the Government to require rejection and removal of such work at the Contractor's expense.

If changes are necessary to submittals, make such revisions and resubmit in accordance with the procedures above. No item of work requiring a submittal change is to be accomplished until the changed submittals are

approved.

1.14 APPROVED SUBMITTALS

The Contracting Officer's approval of submittals is not to be construed as a complete check, and indicates only that the general method of construction, materials, detailing, and other information are satisfactory and that the design, general method of construction, materials, detailing, and other information appear to meet the Solicitation and Accepted Proposal.

Approval or acceptance by the Government for a submittal does not relieve the Contractor of the responsibility for meeting the contract requirements or for any error that may exist, because under the Quality Control (QC) requirements of this contract, the Contractor is responsible for ensuring information contained within each submittal accurately conforms with the requirements of the contract documents.

After submittals have been approved or accepted by the Contracting Officer, no resubmittal for the purpose of substituting materials or equipment will be considered unless accompanied by an explanation of why a substitution is necessary.

1.15 APPROVED SAMPLES

Approval of a sample is only for the characteristics or use named in such approval and is not to be construed to change or modify any contract requirements. Before submitting samples, provide assurance that the materials or equipment will be available in quantities required in the project. No change or substitution will be permitted after a sample has been approved.

Match the approved samples for materials and equipment incorporated in the work. If requested, approved samples, including those that may be damaged in testing, will be returned to the Contractor, at its expense, upon completion of the contract. Unapproved samples will also be returned to the Contractor at its expense, if so requested.

Failure of any materials to pass the specified tests will be sufficient cause for refusal to consider, under this contract, any further samples of the same brand or make as that material. The Government reserves the right to disapprove any material or equipment that has previously proved unsatisfactory in service.

Samples of various materials or equipment delivered on the site or in place may be taken by the Contracting Officer for testing. Samples failing to meet contract requirements will automatically void previous approvals. Replace such materials or equipment to meet contract requirements.

1.16 WITHHOLDING OF PAYMENT

Payment for materials incorporated in the work will not be made if required approvals have not been obtained. No payment for materials incorporated in the work will be made unless all required Government approvals have been obtained. No payment will be made for any materials incorporated into the work for any conformance review submittals or information-only submittals found to contain errors or deviations from the Solicitation or Accepted Proposal.

1.17 CERTIFICATION OF SUBMITTAL DATA

Certify the submittal data as follows on Form ENG 4025 or other approved form: "I certify that the above submitted items had been reviewed in detail and are correct and in strict conformance with the contract drawings and specifications except as otherwise stated.

_____NAME OF CONTRACTOR _____ SIGNATURE OF CONTRACTOR

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

Not Used

-- End of Section --

This page left blank.

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE	DATE OF ACTION		MAILED TO CONTR/ DATE RCD FRM APPR AUTH
(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)	(l)	(m)	(n)	(o)	(p)	(q)	(r)
		01 11 00	SD-01 Preconstruction Submittals														
			Utility Outage Requests	1.7.1	G												
			Utility Connection Requests	1.7.1	G												
			Excavation Permits	1.7.2													
			Welding Permits	1.7.2													
			Salvage Plan	1.10	G												
		01 14 00	SD-01 Preconstruction Submittals														
			List of Contact Personnel	1.2.1.1													
		01 20 00	SD-01 Preconstruction Submittals														
			Earned Value Report	1.3	G												
		01 30 00	SD-01 Preconstruction Submittals														
			View Location Map	1.4													
			Progress and Completion Pictures	1.5													
			SD-04 Samples														
			Color Boards	1.3	G												
		01 32 17.00 20	SD-01 Preconstruction Submittals														
			Designated Project Scheduler	1.9	G												
			Baseline NAS		G												
			Construction Baseline NAS		G												
			SD-07 Certificates														
			Monthly Network Analysis	1.4.1	G												
			Updates														
			SD-11 Closeout Submittals														
			As-Built Schedule	1.4.2	G												
		01 33 00	SD-01 Preconstruction Submittals														

SUBMITTAL REGISTER

CONTRACT NO. _____

TITLE AND LOCATION
D51 Hangar Conversion to Human Performance Center

CONTRACTOR _____

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		01 33 00	Submittal Register	1.9	G													
		01 33 29	SD-01 Preconstruction Submittals															
			Preliminary High Performance and Sustainable Building Checklist		G													
			Sustainability Action Plan	1.4.1	G													
			Preliminary Sustainability eNotebook		G													
			SD-11 Closeout Submittals															
			Final High Performance and Sustainable Building Checklist	1.5.3.2	G													
			Final Sustainability eNotebook	1.5.3.2	G													
			Amended Final Sustainability eNotebook	1.5.3.2	G													
			Amended Final High Performance and Sustainable Building Checklist	1.5.3.2	G													
			Third Party Certification Certificate, Assessment, or Validation and Compliance Report		G													
		01 35 26	SD-01 Preconstruction Submittals															
			Accident Prevention Plan (APP)	1.8	G													
			SD-06 Test Reports															
			Monthly Exposure Reports	1.4														
			Notifications and Reports	1.13														
			Accident Reports	1.7.2.1	G													
			LHE Inspection Reports	1.13.2														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		01 35 26	SD-07 Certificates															
			Contractor Safety Self-Evaluation Checklist	1.5														
			Crane Operators/Riggers	1.7.1.5														
			Standard Lift Plan	1.8.2.2	G													
			Critical Lift Plan	1.8.2.3	G													
			Activity Hazard Analysis (AHA)	1.9														
			Confined Space Entry Permit	1.10.1														
			Hot Work Permit	1.10.1														
			Certificate of Compliance	1.13.3														
			License Certificates	1.15														
			Radiography Operation Planning Work Sheet	1.15.1	G													
			Portable Gauge Operations Planning Worksheet	1.15.1	G													
			Machinery & Mechanized Equipment	3.7.3														
		01 45 00.00 10	SD-01 Preconstruction Submittals															
			Contractor Quality Control (CQC) Plan	3.2	G													
			Additional Requirements for Design Quality Control (DQC) Plan	3.2.2	G DO													
			SD-05 Design Data															
			Discipline-Specific Checklists	3.2.2														
			Design Quality Control	3.9.1														
			SD-06 Test Reports															

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		01 45 00.00 10	Verification Statement	3.9.2														
		01 45 35	SD-01 Preconstruction Submittals															
			SIOR Letter of Acceptance		G													
			Project Manual		G													
			Written NDT Practices	3.1.2														
			SD-06 Test Reports															
			Daily Reports	3.1.2														
			Biweekly Reports	3.1.1														
			SD-07 Certificates															
			AISC Certified Steel Fabricator	2.1														
			Steel Truss Plant Quality Assurance Program															
			AC472 Accreditation															
			Steel Joist Institute Membership	2.1														
			Special Inspector of Record		G													
			Special Inspector	1.5	G													
			Qualification Records	3.1.2														
			SD-11 Closeout Submittals															
			Interim Report	3.1.2	G													
			Comprehensive Final Report	3.1.2	G													
		01 50 00	SD-01 Preconstruction Submittals															
			Construction Site Plan	1.3	G													
			Traffic Control Plan	3.4.1	G													
		01 57 19	SD-01 Preconstruction Submittals															
			Preconstruction Survey	1.5.1														
			Solid Waste Management Permit	1.9	G RO													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		01 57 19	Regulatory Notifications	1.5.2														
			Environmental Protection Plan	1.6	G RO													
			Stormwater Notice of Intent	3.3.1.2	G RO													
			Dirt and Dust Control Plan	1.6.9.1	G RO													
			Employee Training Records	1.5.5	G RO													
			Environmental Manager	1.5.4														
			Qualifications															
			SD-06 Test Reports															
			Laboratory Analysis	3.8.1.1.2														
			Inspection Reports	3.3.1.3														
			Solid Waste Management Report	3.8.2.1														
			SD-07 Certificates															
			Employee Training Records	1.5.5														
			Erosion and Sediment Control	1.5.5														
			Inspector															
			SD-11 Closeout Submittals															
			Stormwater Pollution Prevention	3.3.1.4	G RO													
			Plan Compliance Notebook															
			Stormwater Notice of Termination	3.3.1.5	G RO													
			Waste Determination	3.8.1	G RO													
			Documentation															
			Disposal Documentation for	3.8.3.6	G RO													
			Hazardous and Regulated Waste															
			Assembled Employee Training	1.5.5	G													
			Records															
			Solid Waste Management Permit	1.9														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE	DATE OF ACTION		MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		01 57 19	Solid Waste Management Report	3.8.2.1	G													
			Hazardous Waste/Debris Management	3.8.3.1														
			Regulatory Notifications	1.5.2	G													
			Sales Documentation	3.8.2.1	G													
			Contractor Certification	3.8.2.1														
		01 57 20.01	SD-01 Preconstruction Submittals															
			Hazardous materials	1.5.4	G													
			SD-07 Certificates															
			Environmental Protection Plan	1.7.1	G													
			Management Plan	1.7.2	G													
			Disposal permit for hazardous wastes	1.7.4	G													
			Hazardous waste certification	1.7.5	G													
		01 74 19	SD-01 Preconstruction Submittals															
			Construction Waste Management Plan	1.7	G													
			SD-06 Test Reports															
			Quarterly Reports	1.9.2														
			Annual Report	1.9.3														
			SD-11 Closeout Submittals															
			Final Construction Waste Diversion Report	1.10	S													
		01 78 00	SD-03 Product Data															
			Warranty Management Plan	1.8.1														
			Warranty Tags	1.8.5														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE	DATE OF ACTION		MAILED TO CONTR/ DATE RCD FRM APPR AUTH
(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)	(l)	(m)	(n)	(o)	(p)	(q)	(r)
		01 78 00	Final Cleaning	3.8													
			Spare Parts Data	1.6													
			SD-08 Manufacturer's Instructions														
			Instructions	1.8.1													
			SD-10 Operation and Maintenance Data														
			Operation and Maintenance Manuals	3.7	G												
			SD-11 Closeout Submittals														
			As-Built Drawings	3.1	G												
			Record Drawings	3.3	G												
			As-Built Record of Equipment and Materials	1.8.1													
			As-Built Record of Equipment and Materials	3.6													
			Final Approved Shop Drawings	3.4													
			Construction Contract Specifications	3.5													
			Interim DD FORM 1354	3.9	G												
			Checklist for DD FORM 1354	3.9	G												
		01 78 23	SD-10 Operation and Maintenance Data														
			O&M Database	1.4	G												
			Training Plan	3.1.1	G												
			Training Outline	3.1.3	G												
			Training Content	3.1.2	G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		01 78 23	SD-11 Closeout Submittals															
			Training Video Recording	3.1.4	G													
			Validation of Training Completion	3.1.6	G													
		01 91 00.15	SD-06 Test Reports															
			Completed Construction	3.6	G													
			Observation Checklists															
			Design Review Report	3.1	G													
			Final Construction Phase	3.5	G													
			Commissioning Plan															
			Issues Log	1.10	G													
			SD-07 Certificates															
			Commissioning Firm	1.8	G													
			SD-10 Operation and Maintenance Data															
			Maintenance and Service Life Plan	3.10	G													
			Systems Manual	3.9	G													
			SD-11 Closeout Submittals															
			Final Commissioning Report	3.11	G													
		01 91 19	SD-01 Preconstruction Submittals															
			Building Enclosure	1.12.2.1	G													
			Commissioning Specialist Qualifications															
			Building Enclosure Testing Work Plan	1.8	G													
			SD-03 Product Data															

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		01 91 19	Thermal Imaging Camera	2.3	G													
			Test Equipment	2.1	G													
			SD-05 Design Data															
			Envelope Surface Area Calculations		G													
			SD-06 Test Reports															
			Completed Building Envelope Inspection Checklists	3.7	G													
			Pressure Test Procedures	3.8.5	G													
			Air Leakage Test Report	1.12.3	G													
			Air Leakage Test Report	3.8.5.6	G													
			Diagnostic Test Report	1.12.3	G													
			Diagnostic Test Report	3.8.6.6	G													
			SD-07 Certificates															
			Pressure Test Agency	1.12.2.2														
			Thermographer Qualifications	1.12.2.3														
			Certificate of Readiness	1.14														
			SD-10 Operation and Maintenance Data															
			Training	3.9	G													
		02 41 00	SD-01 Preconstruction Submittals															
			Demolition Plan	1.2.1														
		03 30 00	SD-01 Preconstruction Submittals															
			Concrete Curing Plan	1.6.3.1														
			Quality Control Program	1.6.5	G													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE		DATE OF ACTION	MAILED TO CONTR/
(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)	(l)	(m)	(n)	(o)	(p)	(q)	(r)	
		03 30 00	Quality Control Personnel Certifications	1.6.6	G													
			Quality Control Organizational Chart	1.6.6														
			Laboratory Accreditation	1.6.8	G													
			Maturity Method Data	3.3.7														
			SD-02 Shop Drawings															
			Reinforcing Steel	1.6.2.1	G													
			SD-03 Product Data															
			Joint Sealants		S													
			Joint Filler	2.4.3	S													
			Formwork Materials	2.1														
			Recycled Aggregate Materials		S													
			Cementitious Materials	2.3.1	S													
			Vapor Retarder and Vapor Barrier	2.4.4														
			Concrete Curing Materials	2.4.1														
			Reinforcement	2.6	S													
			Liquid Chemical Floor Hardeners and Sealers															
			Admixtures	2.3.4														
			Reinforcing Fibers															
			Mechanical Reinforcing Bar Connectors															
			Waterstops															
			Local/Regional Materials		S													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		03 30 00	Biodegradable Form Release Agent															
			Pumping Concrete	1.6.3.2														
			Nonshrink Grout	2.4.2														
			SD-05 Design Data															
			Concrete Mix Design	1.6.1.1	G													
			SD-06 Test Reports															
			Concrete Mix Design	1.6.1.1	G													
			Fly Ash	1.6.4.1														
			Pozzolan	1.6.4.1														
			Slag Cement															
			Aggregates	1.6.4.2														
			Compressive Strength Tests	3.12.3.3	G													
			Unit Weight of Structural Concrete															
			Chloride Ion Concentration															
			Air Content	3.12.3.4														
			Slump Tests	3.12.3.1														
			Water	2.3.2														
			SD-07 Certificates															
			Reinforcing Bars	2.6.1														
			Welder Qualifications															
			Forest Stewardship Council (FSC) Certification															
			Field Testing Technician and Testing Agency	1.6.6.2														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION	
																		(g)
		03 30 00	SD-08 Manufacturer's Instructions Liquid Chemical Floor Hardeners and Sealers Joint Sealants		S													
			Curing Compound	2.4.1														
		04 20 00	SD-02 Shop Drawings Detail Drawings	3.4.1.1	G													
			SD-03 Product Data Hot Weather Procedures	1.5.1	G													
			Cold Weather Procedures	1.5.2	G													
			Cement	2.2.2.2.1	G													
			Cementitious Materials	2.4.1.1	G													
			SD-04 Samples Admixtures for Masonry Mortar	2.4.1.3	G													
			Anchors, Ties, and Bar Positioners	2.6.2	G													
			Joint Reinforcement	2.6.3	G													
			SD-05 Design Data Masonry Compressive Strength	2.1.2	G													
			Bracing Calculations	3.2.4	G													
			SD-06 Test Reports Field Testing of Mortar	3.6.1.1														
			Field Testing of Grout	3.6.1.2														
			Prism Tests															
			SD-07 Certificates															

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE	DATE OF ACTION		MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		04 20 00	Special Masonry Inspector Qualifications	1.3.1														
			Concrete Masonry Units (CMU)	2.2.2.2														
			Concrete Brick															
			Precast Concrete Units															
			Cementitious Materials	2.4.1.1														
			Admixtures for Masonry Mortar	2.4.1.3														
			Admixtures for Grout	2.4.2.2														
			Anchors, Ties, and Bar Positioners	2.6.2														
			Joint Reinforcement	2.6.3														
			SD-08 Manufacturer's Instructions															
			Admixtures for Masonry Mortar	2.4.1.3														
			Admixtures for Grout	2.4.2.2														
			SD-10 Operation and Maintenance Data															
			Take-Back Program	3.8														
			SD-11 Closeout Submittals															
			Recycled Content		S													
		05 12 00	SD-01 Preconstruction Submittals															
			Erection and Erection Bracing Drawings	1.4.1.1	G													
			SD-02 Shop Drawings															
			Fabrication Drawings	1.4.2	G													
			SD-03 Product Data															
			Shop Primer	2.5.2														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS			
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE		DATE OF ACTION	MAILED TO CONTR/	DATE RCD FRM APPR AUTH
		05 12 00	Welding Electrodes and Rods	2.4.1															
			Direct Tension Indicator Washers																
			Non-Shrink Grout	2.4.2															
			Tension Control Bolts	2.3.2															
			Recycled Content for Structural Steel	2.2.1	S														
			Recycled Content for Structural Steel Tubing	2.2.2	S														
			Recycled Content for Steel Pipe		S														
			SD-06 Test Reports																
			Class B Coating	2.5.2															
			Bolts, Nuts, and Washers	2.3															
			Weld Inspection Reports	3.6.1.2															
			Direct Tension Indicator Washer Inspection Reports																
			Bolt Testing Reports																
			SD-07 Certificates																
			Steel	2.2															
			Bolts, Nuts, and Washers	2.3															
			AISC Structural Steel Fabricator Quality Certification	1.3															
			AISC Structural Steel Erector Quality Certification	1.3															
			Welding Procedures and Qualifications	1.4.3.1															
			Welding Electrodes and Rods	2.4.1															

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		05 12 00	Certified Welding Inspector	3.6.1.1													
			NDT Technician	3.6.1.2													
			Welding Procedure Specifications (WPS)	3.4													
		05 21 00	SD-01 Preconstruction Submittals														
			Welder Qualification	1.3.2													
			SD-02 Shop Drawings														
			Steel Joist Framing	1.3.1	G												
			SD-03 Product Data														
			Recycled Content Of Steel Products		S												
			SD-05 Design Data														
			Design Calculations	2.2	G												
			SD-06 Test Reports														
			Erection Inspection	3.4													
			Welding Inspections	3.4													
			SD-07 Certificates														
			Certification of Compliance	1.3.2													
		05 30 00	SD-02 Shop Drawings														
			Fabrication Drawings	1.3.5	G												
			SD-03 Product Data														
			Accessories	2.2													
			Deck Units	2.1													
			Galvanizing Repair Paint	2.1.3													
			Mechanical Fasteners	2.2.12													
			Touch-Up Paint	2.1.3													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		05 30 00	Sound Absorbing Materials														
			Welding Equipment	1.3.3													
			Welding Rods and Accessories	1.3.3													
			Recycled Content of Steel Products	2.1	S												
			SD-04 Samples														
			Metal Roof Deck Units	2.1.1													
			Cellular Metal Floor Deck Units														
			Flexible Closure Strips	2.2.3													
			Acoustical Material														
			SD-05 Design Data														
			Deck Units	2.1	G												
			SD-07 Certificates														
			Powder-Actuated Tool Operator	1.3.2													
			Welder Qualifications	1.3.3													
			Welding Procedures	1.3.3													
			Fire Safety	1.3.4.1													
			Wind Storm Resistance	1.3.4.2													
			Manufacturer's Certificate	1.3.1													
			Stud Manufacture's Certification														
			Stud Manufacture's Test Reports														
		05 50 13	SD-02 Shop Drawings														
			Structural Steel Door Frames	2.7	G												
			Expansion Joint Covers	2.4	G												
			Bollards/Pipe Guards	2.5	G												
			Angles and Plates	2.6	G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION	
																		(g)
		05 50 13	SD-03 Product Data															
			Expansion Joint Covers	2.4	G													
			Structural Steel Door Frames	2.7	G													
			Recycled Content	2.1	S													
			SD-04 Samples															
			Expansion Joint Covers	2.4														
			SD-07 Certificates															
			Certificates of Compliance	2.1	G													
		06 10 00	SD-02 Shop Drawings															
			Nailing Strips	2.1.1	G													
			SD-03 Product Data															
			Fire-retardant Treatment	1.8														
			Adhesives	2.3.2														
			SD-06 Test Reports															
			Preservative-treated	1.4.3														
			SD-07 Certificates															
			Certificates of Grade	1.11.1														
			Certified Sustainably Harvested Plywood for Other Uses	2.2.1.1	S													
			Preservative Treatment	1.7														
		06 41 16.00 10	SD-02 Shop Drawings															
			Shop Drawings	2.9	G													
			Installation	3.1														
			SD-03 Product Data															
			Wood Materials	2.1	G													
			Laminate Finishes		G													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		06 41 16.00 10	Finish Schedule Certification	2.9.7.3	G												
			SD-04 Samples														
			Plastic Laminates	2.3	G												
			Cabinet Hardware	2.5	G												
			SD-07 Certificates														
			Quality Assurance	1.5													
			Laminate Clad Casework	3.1													
			SD-11 Closeout Submittals														
			LEED Documentation	1.3													
		06 61 16	SD-02 Shop Drawings														
			Detail Fabrication Drawings														
			Installation	3.1													
			SD-03 Product Data														
			Solid Polymer	2.1.1													
			Indoor air quality for solid surface seam and sealant products	2.2.2													
			Quartz Agglomerate Material	2.1.1													
			SD-04 Samples														
			Material	2.1													
			SD-06 Test Reports														
			Test Report Results	2.1.1													
			SD-07 Certificates														
			Qualifications	1.4.1													
			Indoor Air Quality for solid surface fabrication products	2.1.1													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		06 61 16	SD-10 Operation and Maintenance Data														
			Solid Polymer	2.1.1													
			Quartz Agglomerate Material	2.1.1													
		07 21 16	SD-03 Product Data														
			Blanket Insulation	2.1	G												
			Recycled Content for Insulation Materials	2.1.1	S												
			Energy Star Label for Insulation Materials	2.1.2	S												
			Vapor Retarder														
			Pressure Sensitive Tape	2.3													
			Accessories	2.4													
			SD-07 Certificates														
			Indoor Air Quality for Insulation Materials	2.1.4	S												
			Indoor Air Quality for Adhesives	2.4.1	S												
			SD-08 Manufacturer's Instructions														
			Insulation	3.2.1													
		07 27 10	SD-02 Shop Drawings														
			Air Barrier System Shop Drawings	2.1	G												
			SD-03 Product Data														
			Air Barrier System Product Data	2.1	G												
			SD-04 Samples														
			Mock-Up	3.1.2	G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				REMARKS			
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE		DATE OF ACTION	MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		07 27 10	Material Samples For Air Barrier System	2.1	G													
			SD-05 Design Data															
			Design Data And Calculations For The Air Barrier System	1.8	G													
			SD-06 Test Reports															
			Design Review Report	1.8	G													
			Testing and Inspection	3.1.3	G													
			SD-07 Certificates															
			Air Barrier Inspector	1.7	G													
		07 27 19.01	SD-01 Preconstruction Submittals															
			Qualifications of Manufacturer	1.7.1	G													
			Qualifications of Installer	1.7.2	G													
			SD-02 Shop Drawings															
			Self-adhering Air Barrier Shop Drawings	1.4.1	G													
			SD-03 Product Data															
			Self-adhering Air Barrier	2.1	G													
			Primers, Adhesives, and Mastics	2.2	G													
			Safety Data Sheets	1.4.2	G													
			SD-04 Samples															
			Self-adhering Air Barrier System Mockup	1.4.3	G													
			SD-06 Test Reports															
			Field Peel Adhesion Test	1.7.3	G													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE	DATE OF ACTION		MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		07 27 19.01	Flame Propagation of Wall Assemblies	1.4.4	G													
			Site Inspections and Testing	3.4.1	G													
			SD-08 Manufacturer's Instructions															
			Self-adhering Air Barrier	1.4.2	G													
			Manufacturer's Printed Instructions															
			Primers, Adhesives, and Mastics	2.2	G													
		07 27 26	SD-01 Preconstruction Submittals															
			Qualifications of Manufacturer	1.9.1	G													
			Qualifications of Installer	1.9.2	G													
			SD-02 Shop Drawings															
			Fluid-Applied Membrane Air Barrier Shop Drawings	1.4.1	G													
			SD-03 Product Data															
			Fluid-Applied Membrane Air Barrier	1.4	G													
			Transition Membrane	2.3	G													
			Primers, Adhesives, and Mastics	2.2	G													
			Reinforcement	2.6	G													
			Safety Data Sheets	1.4.2	G													
			SD-04 Samples															
			Mockup	1.4.3	G													
			SD-06 Test Reports															
			Capillary Moisture Test	1.6	G													
			Field Peel Adhesion Test	1.4.4	G													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION
D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE	DATE OF ACTION		MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		07 27 26	Flame Propagation of Wall Assemblies	1.4.4	G													
			Site Inspections	3.4.1	G													
			SD-08 Manufacturer's Instructions															
			Fluid-Applied Membrane Air Barrier Manufacturer's Printed Instructions	1.4.2	G													
			Primers, Adhesives, and Mastics Printed Manufacturer's Instructions	1.4.2	G													
		07 27 36	SD-01 Preconstruction Submittals															
			Qualification of Manufacturer	1.8.1	G													
			Qualification of Installer	1.8.2	G													
			Quality Control Plan	1.9	G													
			Safety Plan	1.9	G													
			Fire Prevention Plan	1.7.1	G													
			Respiratory Protection Plan	1.7.2	G													
			SD-02 Shop Drawings															
			Spray Foam Air Barrier System Shop Drawings	1.4.1														
			SD-03 Product Data															
			Blowing Agents	2.1.5	G													
			Closed Cell	2.1.2	G													
			Primers, Adhesives, and Mastics	2.3	G													
			Sealants	2.5	G													
			Safety Data Sheets	1.4.2	G													
			Thermal Barrier Materials		G													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		07 27 36	Ignition Barrier Coatings		G													
			SD-04 Samples															
			Spray Foam Air Barrier Mockup	1.4.3	G													
			SD-06 Test Reports															
			Mockup Peel Adhesion Test	1.4.4	G													
			Thermographic Test	3.4.5.1	G													
			Fire-Ratings Of Thermallgnition Barrier Materials	1.4.4	G													
			Flame Spread and Smoke Developed Index Ratings of SPF Products	1.4.4	G													
			Site Inspections	3.4.1	G													
			SD-07 Certificates															
			Indoor Air Quality for Spray Foam Air Barrier	2.1.5	S													
			SD-08 Manufacturer's Instructions															
			SPF Handling, Storage, and Spray Procedures	1.5.1	G													
			Substrate Preparation	3.2.1	G													
			Thermal Barrier	1.4.2	G													
			Manufacturer's Printed Installation Instructions for Primers, Adhesives, and Mastics	1.4.2	G													
			SD-09 Manufacturer's Field Reports															
			Core Samples	1.9														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		07 27 36	Daily Work Record	3.3.2														
			Visual Inspection and Thermal Scanning	3.4.5														
		07 60 00	SD-02 Shop Drawings															
			Gutters	3.1.11	G													
			Downspouts	3.1.12	G													
			Splash Pans	3.1.13	G													
			Counterflashing	3.1.10	G													
			Flashing at Roof Penetrations and Equipment Supports	3.1.18	G													
			Reglets	2.2.13	G													
			Copings		G													
			Drip Edges		G													
			Eave Flashing	3.1.14	G													
			Recycled Content	2.1	S													
			SD-04 Samples															
			Finish Samples	1.4.2	G													
			SD-07 Certificates															
			Warranty on Finishes	2.2.10.1	G													
			SD-08 Manufacturer's Instructions															
			Instructions for Installation	1.4.3	G													
			SD-10 Operation and Maintenance Data															
			Cleaning and Maintenance	1.4.3	G													
		07 61 14.00 20	SD-02 Shop Drawings															
			Roofing	1.2.4														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		07 61 14.00 20	SD-03 Product Data															
			Roofing Panels	2.1														
			Energy Star Label for Steel Roofing Product	2.1	S													
			Recycled Content for Steel Roofing Product	2.1.1	S													
			Heat Island Reduction	2.1	S													
			Attachment Clips	2.2	G													
			Closures	2.4.1														
			Accessories	2.4														
			Fasteners	2.4.2														
			Sealants	2.4.3														
			Insulation	2.5														
			Fall Protection System		G													
			Warranty	1.7	G													
			SD-04 Samples															
			Fall Protection System		G													
			SD-05 Design Data															
			Design Calculations	1.5	G													
			Fall Protection System		G													
			SD-06 Test Reports															
			Field Inspection	3.6	G													
			Structural Performance	1.3.3														
			Finish	1.6.6														
			SD-07 Certificates															

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				REMARKS			
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE		DATE OF ACTION	MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		07 61 14.00 20	Manufacturer's Technical Representative	1.6.3														
			Installer's Qualifications	1.6.4														
			Coil Stock	2.1	G													
			SD-08 Manufacturer's Instructions															
			Installation	3.3	G													
			SD-11 Closeout Submittals															
			Information Card	3.8	G													
			Fall Protection System		G													
			Warranty	1.7	G													
		07 92 00	SD-03 Product Data															
			Sealants	2.1	G													
			Primers	2.2	G													
			Bond Breakers	2.3	G													
			Backstops	2.4	G													
			Caulking	2.5	G													
			Cleaning Solvents	2.6	G													
			Field Adhesion	3.1	G													
			SD-07 Certificates															
			Indoor Air Quality For Interior Sealants	2.1.1	S													
			Indoor Air Quality For Interior Floor Joint Sealants	2.1.3	S													
			Indoor Air Quality For Interior Acoustical Sealants	2.1.4	S													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION	
																		(g)
		07 92 00	Indoor Air Quality For Interior Caulking	2.5	S													
		08 11 13	SD-02 Shop Drawings															
			Doors	2.1	G													
			Doors	2.1	G													
			Frames	2.5	G													
			Frames	2.5	G													
			Accessories	2.3														
			SD-03 Product Data															
			Doors	2.1	G													
			Recycled Content for Steel Door Product	2.1	S													
			Frames	2.5	G													
			Recycled Content for Steel Frame Product	2.5	S													
			Accessories	2.3														
		08 14 00	SD-02 Shop Drawings															
			Doors	2.1	G													
			SD-03 Product Data															
			Doors	2.1	G													
			Recycled Content for Door Cores	2.1.1.1	S													
			Accessories	2.2														
			Water-resistant Sealer	2.3.7														
			Warranty	1.5														
			Fire Resistance Rating		G													
			SD-04 Samples															

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE	DATE OF ACTION		MAILED TO CONTR/ DATE RCD FRM APPR AUTH
(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)	(l)	(m)	(n)	(o)	(p)	(q)	(r)
		08 14 00	Doors	2.1													
			Door Finish Colors	2.3.6.2	G												
			SD-06 Test Reports														
			Cycle-Slam	2.4													
			Hinge Loading Resistance	2.4													
			SD-07 Certificates														
			Certificates of Grade	1.3.1													
			Certified Sustainably Harvested		S												
			Stile and Rail Wood Doors														
			Certified Sustainably Harvested	2.1.1	S												
			Flush Wood Doors														
			Indoor Air Quality for	2.1.1.1	S												
			Particleboard and Agrifiber Door Cores														
			SD-11 Closeout Submittals														
			Warranty	1.5													
		08 31 00	SD-02 Shop Drawings														
			Access Doors And Panels	1.3	G												
			SD-03 Product Data														
			Access Doors And Panels	1.3	G												
			Hardware	1.3.2	G												
			Accessories	2.2.8	G												
			Recycled Content	2.1	S												
			SD-04 Samples														
			Finishes	2.5	G												
		08 33 13	SD-02 Shop Drawings														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		08 33 13	Detail Drawings	1.3	G													
			SD-03 Product Data															
			Warranty	1.5														
			Rolling Counter Doors	2.1														
			Installation	3.1														
			Cleaning	3.4														
			SD-11 Closeout Submittals															
			Rolling Counter Door	2.3														
			(Non-Rated)															
		08 33 23	SD-02 Shop Drawings															
			Overhead Coiling Doors	2.2.1	G													
			Counterbalancing Mechanism	2.2.3	G													
			Electric Door Operators	2.2.4	G													
			Bottom Bars	2.2.1.3	G													
			Guides	2.1.1.1	G													
			Mounting Brackets	2.2.3.1	G													
			Hood	2.2.2.2	G													
			Installation Drawings	2.1.1.1	G													
			SD-03 Product Data															
			Overhead Coiling Doors	2.2.1	G													
			Hardware	2.2.2	G													
			Counterbalancing Mechanism	2.2.3	G													
			Electric Door Operators	2.2.4	G													
			Recycled content for steel curtain slats	2.2.1.1	S													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		08 33 23	Recycled content for stainless steel curtain slats		S												
			SD-05 Design Data														
			Overhead Coiling Doors	2.2.1	G												
			Hardware	2.2.2	G												
			Counterbalancing Mechanism	2.2.3	G												
			Electric Door Operators	2.2.4	G												
			SD-10 Operation and Maintenance Data														
			Operation and Maintenance Manuals	1.3.2	G												
			SD-11 Closeout Submittals														
			Warranty	1.3.1	G												
		08 34 00	SD-04 Samples finish														
		08 71 00	SD-02 Shop Drawings														
			Manufacturer's Detail Drawings	1.3	G												
			Verification of Existing Conditions	1.3	G												
			Hardware Schedule	1.5	G												
			Keying System	2.2.6	G												
			SD-03 Product Data														
			Hardware Items	2.2	G												
			SD-08 Manufacturer's Instructions														
			Installation	3.1													
			SD-10 Operation and Maintenance Data														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		08 71 00	Hardware Schedule	1.5	G												
			SD-11 Closeout Submittals														
			Key Bitting	1.6.1													
		08 81 00	SD-02 Shop Drawings														
			Installation	1.4	G												
			SD-03 Product Data														
			Insulating Glass	1.7.1	G												
			Glazing Accessories	1.3													
			Local/Regional Materials	1.6.1													
			SD-04 Samples														
			Insulating Glass	1.7.1	G												
			Glazing Compound	2.3.2													
			Tape	2.3.6													
			Sealant	2.3.3.1	G												
			SD-07 Certificates														
			Insulating Glass	1.7.1													
			Glazing Accessories	1.3													
			SD-08 Manufacturer's Instructions														
			Setting and sealing materials	2.3													
			Glass setting	3.2													
		08 91 00	SD-02 Shop Drawings														
			Wall Louvers	1.4													
			SD-03 Product Data														
			Metal Wall Louvers	2.2													
			SD-04 Samples														
			Wall Louver Samples	1.5	G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		09 22 00	SD-02 Shop Drawings															
			Metal Support Systems	2.1														
			SD-03 Product Data															
			Metal Support Systems	2.1														
			Recycled Content For Metal Support Systems	2.1														
		09 24 23	SD-02 Shop Drawings															
			Lath	3.3														
			SD-03 Product Data															
			Proportions and Mixing	3.6														
			SD-04 Samples															
			Colored Stucco Finish Coat	2.2														
			Sample Panel	1.3														
			SD-11 Closeout Submittals															
			LEED Documentation															
		09 29 00	SD-03 Product Data															
			Cementitious Backer Units															
			Water-Resistant Gypsum Backing Board	2.2.2														
			Water-Resistant Gypsum Backing Board	2.2.2														
			Accessories	2.2.8														
			Certifications	1.3														
			Gypsum Board	2.2.1														
			SD-07 Certificated															
			Asbestos Free Materials	2.2	G													

SUBMITTAL REGISTER

CONTRACT NO. _____

TITLE AND LOCATION
D51 Hangar Conversion to Human Performance Center

CONTRACTOR _____

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE	DATE OF ACTION		MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		09 29 00	Indoor Air Quality	1.3.1	G													
			SD-08 Manufacturer's Instructions															
			Material Safety Data Sheets	2.2														
			SD-10 Operation and Maintenance Data															
			Manufacturer Maintenance Instructions	2.2														
			SD-11 Closeout Submittals															
			Recycled Content for Gypsum Board	2.2.1	S													
			Recycled Content for Paper Facing and Gypsum Cores	2.2.1	S													
			Indoor Air Quality for Gypsum Board	2.2.1	S													
			VOC Content of Joint Compound	2.2.3	S													
			Indoor Air Quality for Non-aerosol Adhesives	2.2.5	S													
			Indoor Air Quality for Aerosol Adhesives	2.2.5	S													
		09 30 10	SD-02 Shop Drawings															
			Detail Drawings	3.2														
			SD-03 Product Data															
			Porcelain Tile	2.1.1	G													
			Recycled Content for Porcelain Tile	2.1.1														
			Mosaic Tile	2.1.2	G													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		09 30 10	Recycled Content for Mosaic Tile	2.1.2													
			Transition Strips	2.1	G												
			Transition Strips	2.5.1	G												
			Metal Strips	2.5.2	G												
			Mortar, Grout, and Adhesive	2.3	G												
			Cementitious Backer Units	2.4.1													
			SD-04 Samples														
			Tile	2.1	G												
			Accessories	2.1	G												
			Transition Strips	2.1	G												
			Transition Strips	2.5.1	G												
			Metal Strips	2.5.2	G												
			Grout	1.4	G												
			SD-07 Certificates														
			Indoor Air Quality for Adhesives	2.3													
			Indoor Air Quality for Sealants	2.3.3													
			Water Absorption Rates	1.3.2													
			SD-08 Manufacturer's Instructions														
			Manufacturer's Approved Cleaning Instructions	3.8													
			SD-10 Operation and Maintenance Data														
			Porcelain Tile	2.1.1													
			Mosaic Tile	2.1.2													
			Transition Strips	2.1	G												
			Transition Strips	2.5.1	G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		09 30 10	Metal Strips	2.5.2	G												
		09 51 00	SD-02 Shop Drawings														
			Approved Detail Drawings	2.1													
			SD-03 Product Data														
			Acoustical Ceiling Systems														
			Recycled Content for Type IV Ceiling Tiles	2.2.1.1													
			Recycled Content for Suspension Systems	2.3													
			Acoustical Performance	2.1.1													
			SD-04 Samples														
			Acoustical Ceiling Tiles														
			Ceiling Suspension System	2.5													
			SD-07 Certificates														
			Indoor Air Quality for Type IV Ceiling Tiles	2.2.1.1	S												
			Indoor Air Quality for Sealants	2.7													
		09 62 38	SD-03 Product Data														
			Static-Control Resilient Flooring	2.1	G												
			Accessories	2.5													
			Adhesives	2.3													
			Warranty	1.9													
			SD-04 Samples														
			Static-Control Resilient Flooring	2.1	G												
			Moldings	2.4	G												
			Accessories	2.5	G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		09 62 38	SD-06 Test Reports														
			Fire Resistance														
			Moisture, Alkalinity and Bond	3.2													
			Testing	3.7													
			SD-07 Certificates														
			Indoor Air Quality for	2.1.1.1	S												
			Static-Dissipative Vinyl Tile														
			SD-08 Manufacturer's Instructions														
			Static-Control Resilient Flooring	2.1	G												
			Accessories	2.5	G												
			SD-10 Operation and Maintenance Data														
			Static-Control Resilient Flooring	2.1	G												
			Accessories	2.5	G												
		09 65 00	SD-02 Shop Drawings														
			Resilient Flooring and	2.7													
			Accessories														
			SD-03 Product Data														
			Resilient Flooring and	2.7	G												
			Accessories														
			Adhesives	2.4													
			Wall Base	2.1													
			Stair Treads, Risers and	2.2													
			Stringers														
			SD-04 Samples														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		09 65 00	Resilient Flooring and Accessories	2.7	G												
			SD-06 Test Reports														
			Moisture, Alkalinity and Bond Tests	3.3	G												
			SD-07 Certificates														
			Indoor Air Quality for Wall Base	2.1	S												
			Indoor Air Quality for Adhesives	2.4	S												
			SD-08 Manufacturer's Instructions														
			Surface Preparation	3.2													
			Installation	3.1													
			SD-10 Operation and Maintenance Data														
			Resilient Flooring and Accessories	2.7													
		09 65 66	SD-02 Shop Drawings														
			Approved Detail Drawings		G												
			SD-03 Product Data														
			Installation	3.3													
			Indoor Air Quality for Rubber Flooring		S												
			Indoor Air Quality for Adhesives	2.3	S												
			Indoor Air Quality for Primer	2.6	S												
			Indoor Air Quality for Game Line Marking Materials	2.7	S												
			SD-04 Samples														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		09 65 66	Flooring	1.3.8													
			SD-06 Test Reports														
			Laboratory Test Results	1.3.4													
			SD-07 Certificates														
			Indoor Air Quality for	2.1.1													
			Indoor-Outdoor Carpeting														
			Indoor Air Quality for Sheet	2.1.2													
			Rubber Composition Flooring														
			Indoor Air Quality for Sheet Vinyl	2.1.3													
			Composition Flooring														
			Indoor Air Quality for Wall Base														
			SD-11 Closeout Submittals														
			Warranty	1.6													
		09 84 20	SD-02 Shop Drawings														
			Approved Detail Drawings	2.1.1.1	G												
			SD-03 Product Data														
			Installation	3.2													
			Acoustical Wall Panels		G												
			Indoor Air Quality for Composite	2.1.1.1													
			Wood and Agrifiber Products														
			SD-04 Samples														
			Acoustical Wall Panels		G												
			SD-07 Certificates														
			Acoustical Wall Panels														
			SD-11 Closeout Submittals														
			Warranty	1.5													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		09 90 00	SD-02 Shop Drawings														
			Piping Identification	3.8													
			SD-03 Product Data														
			Coating	2.1	G												
			Product Data Sheets	2.1													
			SD-04 Samples														
			Color	2.2	G												
			SD-07 Certificates														
			Qualification Testing	1.6.5.2	G												
			Indoor Air Quality for Paints and Primers	1.6.4													
			Indoor Air Quality for Consolidated Latex Paints	1.6.4													
			SD-08 Manufacturer's Instructions														
			Application Instructions	3.2.1													
			Mixing	2.1													
			Manufacturer's Safety Data Sheets	1.8.1													
			SD-10 Operation and Maintenance Data														
			Coatings	2.1	G												
		09 96 00	SD-01 Preconstruction Submittals														
			Material, Equipment and Fixture List	1.3													
			SD-03 Product Data														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION	
																		(g)
		09 96 00	Organic Zinc Rich Moisture Cured Urethane Primer	2.3.2	G													
			Epoxy Polyurethane	2.2.1	G													
			SD-04 Samples Color Chips	1.3	G													
			SD-07 Certificates															
			Organic Zinc Rich Moisture Cured Urethane Primer	2.3.2														
			Epoxy Polyurethane	2.2.1														
		10 14 00.10	SD-02 Shop Drawings Approved Detail Drawings	3.1	G													
			SD-03 Product Data Exterior Signage	1.2	G													
			Wind Load Requirements	1.2.1														
			SD-04 Samples Exterior Signage	1.2	G													
			SD-10 Operation and Maintenance Data															
			Protection and Cleaning	3.1.2	G													
		10 14 00.20	SD-02 Shop Drawings Installation	3.1														
			SD-03 Product Data															

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE	DATE OF ACTION		MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		10 14 00.20	Room Identification And Directional Signage System		G													
			SD-04 Samples															
			Interior Signage	1.4.1	G													
			Room Identification Signage System	1.4.1	G													
			Room Identification Signage System	2.1	G													
			SD-08 Manufacturer's Instructions															
			Installation	3.1														
			SD-10 Operation and Maintenance Data															
			Approved Manufacturer's Instructions	3.1														
			Protection and Cleaning	3.1.2														
		10 26 00	SD-02 Shop Drawings															
			Corner Guards	2.1														
			SD-03 Product Data															
			Corner Guards	2.1														
			Recycled content for aluminum component of corner guards	2.1.1	S													
			SD-04 Samples															
			Corner Guards	2.1	G													
			SD-07 Certificates															
			Indoor air quality for adhesives	2.4														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				REMARKS			
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE		DATE OF ACTION	MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		10 26 00	SD-10 Operation and Maintenance Data															
			Corner Guards	2.1														
		10 28 13	SD-02 Shop Drawings															
			Product Schedule	2.1														
			SD-03 Product Data															
			Recycled content for stainless steel toilet accessories	2.1														
			Item A5030	2.1.3	G													
			Item A5080	2.1.4														
			Item A5090	2.1.5	G													
			Item A5145	2.1.6	G													
			Item A5145	2.1.6	G													
			Item A5200	2.1.7														
			SD-10 Operation and Maintenance Data															
			Item A5030	2.1.3	G													
			Item A5080	2.1.4														
			Item A5090	2.1.5	G													
			Item A5145	2.1.6	G													
			Item A5145	2.1.6	G													
			Item A5200	2.1.7														
		10 44 16	SD-02 Shop Drawings															
			Fire Extinguishers	2.1.1	G													
			Accessories	Part 2	G													
			Cabinets	Part 2	G													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		10 44 16	Wall Brackets	2.2.2	G												
			Schedule	1.5	G												
			SD-03 Product Data														
			Fire Extinguishers	2.1.1	G												
			Accessories	Part 2	G												
			Cabinets	Part 2	G												
			Wall Brackets	2.2.2	G												
			Replacement Parts List	3.2.1	G												
			SD-07 Certificates														
			Fire Extinguishers Certifications	2.1.1	G												
			Manufacturer's Warranty with Inspection Tag	1.4	G												
		22 00 00	SD-03 Product Data														
			Backflow Prevention Assemblies	3.7.1.1	G												
			Shower Faucets	2.6.2	G												
			Fixtures	2.4													
			Flush Valve Water Closets	2.4.2													
			Countertop Lavatories	2.4.3													
			Kitchen Sinks	2.4.4													
			Drinking-Water Coolers	2.4.5	G												
			Water Heaters	2.10	G												
			Welding	1.5.1													
			Plumbing System	3.7.1													
			SD-06 Test Reports														
			Tests, Flushing and Disinfection	3.7													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		22 00 00	Test of Backflow Prevention Assemblies	3.7.1.1	G												
			SD-07 Certificates														
			Materials and Equipment	1.3													
			Bolts	2.1.1													
			SD-10 Operation and Maintenance Data														
			Plumbing System	3.7.1	G												
		23 05 93	SD-01 Preconstruction Submittals														
			Records of Existing Conditions	1.3.3	G												
			TAB Firm	1.5.3.1	G												
			TAB Team Assistants	1.2	G												
			TAB Team Engineer	1.2	G												
			TAB Specialist	1.5.3.2	G												
			TAB Team Field Leader	1.2	G												
			SD-02 Shop Drawings														
			TAB Schematic Drawings and Report Forms	1.3.3	G												
			SD-03 Product Data														
			Equipment and Performance Data	1.3	G												
			TAB Related HVAC Submittals	1.5.3.4	G												
			TAB Procedures	1.5.2	G												
			Calibration	1.5.2	G												
			Systems Readiness Check	1.3.3	G												
			TAB Execution	1.5.4	G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		23 05 93	TAB Verification	1.5.4.3	G													
			SD-06 Test Reports															
			Completed Pre-Final DALT Report	3.3.5	G													
			Certified Final DALT Report	3.3.8	G													
			TAB Design Review Report	1.6.1.1	G													
			TAB Report	1.5.5.2	G													
			SD-07 Certificates															
			Independent TAB Agency and Personnel Qualifications	1.5.1	G													
			DALT and TAB Submittal and Work Schedule	1.6.1	G													
			TAB Pre-Field Engineering Report	1.6.1.3	G													
			TAB Firm	1.5.3.1	G													
			Design Review Report	1.3.3	G													
			Pre-field DALT Preliminary Notification	1.6.1.2	G													
			Advanced Notice for TAB Field Work	1.6.1	G													
			Prerequisite HVAC Work Check Out List	1.6.1	G													
		23 07 00	SD-02 Shop Drawings															
			MICA Plates	3.2.2.4	G													
			Pipe Insulation Systems	2.3														
			Pipe Insulation Systems	3.2														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		23 07 00	Duct Insulation Systems	3.3													
			Equipment Insulation Systems	3.4													
			SD-03 Product Data														
			Pipe Insulation Systems	2.3	G												
			Pipe Insulation Systems	3.2	G												
			Duct Insulation Systems	3.3	G												
			Equipment Insulation Systems	3.4	G												
			SD-04 Samples														
			Thermal Insulation	2.2.1.2	G												
			Display Samples	3.1.1	G												
			SD-07 Certificates														
			Indoor air quality for adhesives	2.2.1	S												
			SD-08 Manufacturer's Instructions														
			Pipe Insulation Systems	2.3	G												
			Pipe Insulation Systems	3.2	G												
			Duct Insulation Systems	3.3	G												
			Equipment Insulation Systems	3.4	G												
		23 09 00	SD-02 Shop Drawings														
			DDC Contractor Design Drawings	3.2	G												
			Draft As-Built Drawings	3.2	G												
			Final As-Built Drawings	3.2	G												
			SD-03 Product Data														
			Programming Software	1.8.3	G												
			Controller Application Programs	1.8.4	G												
			Configuration Software	1.8.1	G												
			Controller Configuration Settings	1.8.2	G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVERNOR CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				REMARKS				
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER		ACTION CODE	DATE OF ACTION	MAILED TO CONTR/	DATE RCD FRM APPR AUTH
		23 09 00	Proprietary Multi-Split Engineering Tool Software	1.1.1.3	G														
			Manufacturer's Product Data	2.2	G														
			Niagara Framework Supervisory Gateway Backups	1.8.5	G														
			Niagara Framework Engineering Tool	1.8.6	G														
			SD-05 Design Data																
			Boiler Or Chiller Plant Gateway Request	1.9															
			SD-06 Test Reports																
			Pre-Construction Quality Control (QC) Checklist	1.10.1	G														
			Post-Construction Quality Control (QC) Checklist	1.10.2	G														
			Start-Up Testing Report	3.4.2	G														
			PVT Procedures	3.5.1	G														
			PVT Report	3.5.3	G														
			SD-10 Operation and Maintenance Data																
			Operation and Maintenance (O&M) Instructions	3.6	G														
			Training Documentation	3.7.1	G														
			SD-11 Closeout Submittals																
			Enclosure Keys	2.5	G														
			Password Summary Report	3.1.6.1	G														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		23 09 00	Closeout Quality Control (QC) Checklist	1.10.3	G												
		23 21 23	SD-02 Shop Drawings														
			System Coordination	2.1.2	G												
			SD-03 Product Data														
			Instructions	2.2.2	G												
			Equipment Data	2.2.5	G												
			Training Period	3.5.2	G												
			SD-06 Test Reports														
			Field Quality Control	3.3													
			SD-07 Certificates														
			Manufacturer's Representative	1.3.1													
			SD-10 Operation and Maintenance Data														
			Operation and Maintenance Manuals	3.5.1	G												
			Training	3.5.2	G												
		23 30 00	SD-02 Shop Drawings														
			Detail Drawings	1.4.4	G												
			SD-03 Product Data														
			Metallic Flexible Duct	2.7.1.1													
			Insulated Nonmetallic Flexible Duct Runouts	2.7.1.2													
			Duct Connectors	2.7.1.2													
			Duct Access Doors	2.7.2	G												
			Manual Balancing Dampers	2.7.3	G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		23 30 00	Diffusers	2.7.7.1													
			Registers and Grilles	2.7.7.2													
			Louvers	2.7.8													
			In-Line Centrifugal Fans	2.8.1.1													
			Axial Flow Fans	2.8.1.2													
			Air Handling Units	2.9	G												
			Variable Volume, Single Duct Terminal Units	2.10.1.1	G												
			Indoor Air Quality for Duct Sealants	2.7.1													
			SD-06 Test Reports														
			Performance Tests	3.11	G												
			SD-07 Certificates														
			Ozone Depleting Substances Technician Certification	1.4.3													
			SD-08 Manufacturer's Instructions														
			Manufacturer's Installation Instructions	3.2													
			Operation and Maintenance Training	3.13.2													
			SD-10 Operation and Maintenance Data														
			Operation and Maintenance Manuals	3.13.1	G												
			Manual Balancing Dampers	2.7.3	G												
			In-Line Centrifugal Fans	2.8.1.1	G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		23 30 00	Axial Flow Fans	2.8.1.2	G													
			Air Handling Units	2.9	G													
			Variable Volume, Single Duct Terminal Units	2.10.1.1	G													
			SD-11 Closeout Submittals															
			Indoor Air Quality During Construction	3.12														
		23 64 10	SD-03 Product Data															
			Water Chiller	2.4	G													
			Posted Instructions	3.1.3														
			Verification of Dimensions	1.6.1														
			Factory Tests	2.7														
			System Performance Tests	3.5														
			Demonstrations	3.6														
			Refrigerant	2.5.1														
			SD-06 Test Reports															
			Factory Tests	2.7														
			System Performance Tests	3.5														
			SD-07 Certificates															
			Ozone Depleting Substances Technician Certification	1.3.1														
			SD-08 Manufacturer's Instructions															
			Water Chiller - Installation Instructions	3.1	G													
			SD-10 Operation and Maintenance Data															

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		23 64 10	Operation and Maintenance Manuals	3.6	G												
			SD-11 Closeout Submittals														
			Indoor Air Quality During Construction	3.4													
		23 64 26	SD-03 Product Data														
			Grooved Mechanical Connections For Steel	2.2.2.4	G												
			Grooved Mechanical Connections For Copper	2.3.3	G												
			Calibrated Balancing Valves	2.4.5	G												
			Automatic Flow Control Valves	2.4.6	G												
			Water Pressure Reducing Valve	2.4.7													
			Pressure Relief Valve	2.4.8													
			Combination Pressure and Temperature Relief Valves	2.4.9													
			Expansion Joints	2.5.9	G												
			Combination Strainer and Pump Suction Diffuser	2.5.3													
			Expansion Tanks	2.6													
			Air Separator Tanks	2.7													
			Water Treatment Systems	2.8	G												
			SD-06 Test Reports														
			Pressure Tests Reports	3.4.2	G												
			SD-08 Manufacturer's Instructions														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE	DATE OF ACTION		MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		23 64 26	Lesson plan for the Instruction Course	3.5	G													
			SD-10 Operation and Maintenance Data															
			Water Treatment Systems	2.8	G													
			Calibrated Balancing Valves	2.4.5	G													
			Automatic Flow Control Valves	2.4.6	G													
			Water Pressure Reducing Valve	2.4.7	G													
			Pressure Relief Valve	2.4.8	G													
			Combination Pressure and Temperature Relief Valves	2.4.9	G													
			Expansion Joints	2.5.9	G													
			Combination Strainer and Pump Suction Diffuser	2.5.3	G													
			Expansion Tanks	2.6	G													
			Air Separator Tanks	2.7	G													
		23 81 00	SD-03 Product Data															
			Spare Parts	3.6.1														
			Posted Instructions	3.4														
			Coil Corrosion Protection	2.5.1														
			System Performance Tests	3.5														
			Training	3.4	G													
			Inventory	1.4														
			Supplied Products	2.1														
			Manufacturer's Standard Catalog Data	2.2														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVERNOR CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		23 81 00	SD-06 Test Reports														
			System Performance Tests	3.5	G												
			SD-07 Certificates														
			Service Organizations	3.6.2													
			SD-10 Operation and Maintenance Data														
			Operation and Maintenance Manuals	3.4	G												
			SD-11 Closeout Submittals														
			Ozone Depleting Substances	2.2.2.3													
		25 05 11.01	SD-01 Preconstruction Submittals														
			Wireless and Wired Broadcast Communication Request	3.2.1.3	G												
			Device Account Lock Exception Request	3.3.2	G												
			Multiple Ethernet Connection Device Request	3.2.3.2	G												
			Contractor Computer Cybersecurity Compliance Statements	1.9.1.6	G												
			Contractor Temporary Network Cybersecurity Compliance Statements	1.9.6	G												
			Cybersecurity Interconnection Schedule	1.7.2	G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE	DATE OF ACTION		MAILED TO CONTR/ DATE RCD FRM APPR AUTH
(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)	(l)	(m)	(n)	(o)	(p)	(q)	(r)
		25 05 11.01	Proposed STIG and SRG Applicability Report	1.7.1	G												
			SD-02 Shop Drawings														
			Network Communication Report	1.7.3	G												
			Cybersecurity Riser Diagram	1.7.6	G												
			SD-03 Product Data														
			Control System Cybersecurity Documentation	1.7.8	G												
			SD-06 Test Reports														
			Wireless Communication Test Report	3.2.1.4	G												
			Control System Cybersecurity Testing Procedures	3.13.1	G												
			Control System Cybersecurity Testing Report	3.13.3	G												
			SD-07 Certificates														
			Software Licenses	1.8	G												
			SD-11 Closeout Submittals														
			Confidential Password Report	3.4.4.5	G												
			Enclosure Keys	3.3.5	G												
			Software and Configuration Backups	1.7.5	G												
			Auditing Front End Software	3.5.3	G												
			Device Audit Record Upload Software		G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		25 05 11.01	System Maintenance Tool Software	3.9	G												
			Control System Scanning Tools	3.11.2	G												
			STIG, SRG and Vendor Guide	1.7.7	G												
			Compliance Result Report														
			Control System Inventory Report	1.7.4	G												
		26 05 73	SD-01 Preconstruction Submittals														
			Arc Flash Label Formats	3.2.8	G												
			SD-11 Closeout Submittals														
			Fault Current Study	3.2.4	G												
			System Coordination Study	3.2.5	G												
			Arc Flash Hazard Study	3.2.6	G												
		26 20 00	SD-02 Shop Drawings														
			Panelboards	2.11	G												
			Cable Trays	2.3	G												
			Wireways		G												
			Marking Strips	3.1.8.1	G												
			SD-03 Product Data														
			Receptacles	2.10	G												
			Circuit Breakers	2.11.3	G												
			Switches	2.9	G												
			Metering	2.19	G												
			Secondary Bonding Busbar		G												
			Surge Protective Devices	2.20	G												
			Cable Trays	2.3	G												
			Cable Tray Design		G												

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		26 20 00	SD-06 Test Reports															
			600-volt Wiring Test	3.5.2	G													
			Grounding System Test	3.5.4	G													
			Ground-fault Receptacle Test	3.5.3	G													
			SD-10 Operation and Maintenance Data															
			Electrical Systems	1.6.1	G													
			Metering	2.19	G													
		26 29 23	SD-02 Shop Drawings															
			Schematic Diagrams	1.5.1	G													
			Interconnecting Diagrams	1.5.2	G													
			Installation Drawings	1.5.3	G													
			As-Built Drawings	1.5.3	G													
			SD-03 Product Data															
			Adjustable Speed Drives	2.1	G													
			Wires and Cables	2.3														
			Equipment Schedule	1.5.4														
			SD-06 Test Reports															
			ASD Test	3.3.1														
			Performance Verification Tests	3.3.2														
			Endurance Test	3.3.3														
			SD-07 Certificates															
			Testing Agency's Field Supervisor	3.3.1	G													
			SD-08 Manufacturer's Instructions															
			Installation instructions	1.5.5														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS	
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE			DATE OF ACTION
		26 29 23	SD-09 Manufacturer's Field Reports														
			ASD Test Plan	2.5.1	G												
			Standard Products	1.5.6													
			SD-10 Operation and Maintenance Data														
			Adjustable Speed Drives	2.1													
		26 41 00	SD-06 Test Reports														
			Lightning Protection and Grounding System Test Plan	1.4.2	G												
			Grounding Systems Testing	3.5.2	G												
			SD-07 Certificates														
			Component UL Listed and Labeled	1.4.1	G												
			Lightning Protection System Inspection Certificate	1.4.3	G												
			Roof Manufacturer's Warranty	3.1.1.1	G												
		26 51 00	SD-02 Shop Drawings														
			Luminaire Drawings	1.5.1	G												
			Occupancy/Vacancy Sensor Coverage Layout		G												
			Lighting Control System One-Line Diagram	1.7.1	G												
			Sequence of Operation for Lighting Control System		G												
			SD-03 Product Data														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				REMARKS			
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE		DATE OF ACTION	MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		26 51 00	Luminaires	2.2	G													
			Light Sources		G													
			LED Drivers	2.3	G													
			Luminaire Warranty	1.6.1	G													
			Lighting Controls Warranty	1.6.2	G													
			Lighting Contactor		G													
			Switches		G													
			Occupancy/Vacancy Sensors		G													
			Photosensors		G													
			Emergency Inverters		G													
			Exit Signs	2.4.1	G													
			Emergency Drivers	2.4.2	G													
			SD-05 Design Data															
			Luminaire Design Data	1.5.2	G													
			SD-06 Test Reports															
			ANSI/IES LM-79 Test Report	1.5.3	G													
			ANSI/IES LM-80 Test Report	1.5.4	G													
			ANSI/IES TM-21 Test Report	1.5.5	G													
			ANSI/IES TM-30 Test Report	1.5.6	G													
			Occupancy/Vacancy Sensor	3.2.1.1	G													
			Verification Test															
			Photosensor Verification Test	3.2.1.1	G													
			SD-10 Operation and Maintenance															
			Data															
			Lighting Control System	1.7.1	G													
			Maintenance Staff Training Plan	3.3.2.1	G													

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				REMARKS			
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/ FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE		DATE OF ACTION	MAILED TO CONTR/ DATE RCD FRM APPR AUTH	
																		(g)
		26 51 00	End-User Training Plan	3.3.2.2	G													
		27 10 00	SD-02 Shop Drawings															
			Telecommunications Drawings	1.6.2.1	G													
			Telecommunications Space Drawings	1.6.2.2	G													
			SD-03 Product Data															
			Telecommunications Cabling	2.3	G													
			Patch Panels	2.4.4	G													
			Telecommunications Outlet/Connector Assemblies	2.5	G													
			Connector Blocks		G													
			Spare Parts	1.10.3	G													
			SD-06 Test Reports															
			Telecommunications Cabling Testing	3.5.1	G													
			SD-07 Certificates															
			Telecommunications Contractor	1.6.3.1	G													
			Key Personnel	1.6.3.2	G													
			Manufacturer Qualifications	1.6.3.3	G													
			Test Plan	1.6.4	G													
			SD-09 Manufacturer's Field Reports															
			Factory Reel Tests	2.10.1	G													
			SD-10 Operation and Maintenance Data															

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS			
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE		DATE OF ACTION	MAILED TO CONTR/	DATE RCD FRM APPR AUTH
		27 10 00	Telecommunications Cabling and Pathway System	1.10.1	G														
			SD-11 Closeout Submittals																
			Record Documentation	1.10.2	G														
		31 00 00	SD-01 Preconstruction Submittals																
			Dewatering Work Plan	1.4.3															
			SD-03 Product Data																
			Utilization of Excavated Soils	3.7															
			SD-06 Test Reports																
			Testing	3.15															
			Borrow Site Testing	1.3.1															
			SD-07 Certificates																
			Testing	3.15															
		31 11 00	SD-01 Preconstruction Submittals																
			Herbicide Application Plan	3.1.1															
			SD-03 Product Data																
			Herbicide	2.1.2															
			SD-11 Closeout Submittals																
			Pest Management Report	3.5.1															
		32 16 19	SD-03 Product Data																
			Concrete	2.1															
			Biodegradable Form Release Agent	2.6.5															
			Biodegradable Form Release Agent	3.2															
			SD-06 Test Reports																

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY					REMARKS			
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER	ACTION CODE		DATE OF ACTION	MAILED TO CONTR/	DATE RCD FRM APPR AUTH
		32 16 19	Field Quality Control	3.8															
		32 92 23	SD-03 Product Data																
			Fertilizer	2.4															
			SD-06 Test Reports																
			Topsoil composition tests	2.2.3															
			SD-07 Certificates																
			sods	2.1															
		33 40 00	SD-04 Samples																
			Pipe for Culverts and Storm Drains	2.1															
			SD-07 Certificates																
			Resin Certification	2.1.2															
			Oil Resistant Gasket	2.3.3.1															
			Determination of Density	3.7.1.1															
			Frame and Cover for Gratings	2.3.2															
			Placing Pipe	3.3															
		33 71 02	SD-02 Shop Drawings																
			Precast Underground Structures	1.5.1	G														
			SD-03 Product Data																
			Precast Concrete Structures	2.10.2.1	G														
			Sealing Material	2.10.2.4															
			Pulling-In Irons	3.4.2															
			Manhole Frames and Covers		G														
			Cable Supports	2.11	G														
			SD-06 Test Reports																
			Certificate of Conformance	1.5.2	G														

SUBMITTAL REGISTER

CONTRACT NO.

TITLE AND LOCATION

D51 Hangar Conversion to Human Performance Center

CONTRACTOR

ACTIVITY NO	TRANSMITTAL NO	SPEC SECT	DESCRIPTION ITEM SUBMITTED	PARAGRAPH	GOVT CLASSIFICATION	CONTRACTOR: SCHEDULE DATES			CONTRACTOR ACTION		APPROVING AUTHORITY				MAILED TO CONTR/ DATE RCD FRM APPR AUTH	REMARKS		
						SUBMIT	APPROVAL NEEDED BY	MATERIAL NEEDED BY	ACTION CODE	DATE OF ACTION	DATE FWD TO APPR AUTH/	DATE RCD FROM CONTR	DATE FWD TO OTHER REVIEWER	DATE RCD FROM OTH REVIEWER			ACTION CODE	DATE OF ACTION
		33 82 00	SD-02 Shop Drawings															
			Telecommunications Outside Plant	1.6.1.1	G													
			Telecommunications Entrance Facility Drawings		G													
			SD-03 Product Data															
			Wire and Cable	2.4	G													
			Cable Splices, and Connectors		G													
			Closures		G													
			SD-06 Test Reports															
			Pre-installation Tests	3.2.1	G													
			Acceptance Tests	3.2.2	G													
			Outside Plant Test Plan	1.6.3	G													
			SD-07 Certificates															
			Telecommunications Contractor	1.6.2.1	G													
			Key Personnel	1.6.2.2	G													
			Manufacturer's Qualifications	1.6.2.3	G													
			SD-08 Manufacturer's Instructions															
			Cable Tensions	3.1.19.1	G													
			Fiber Optic Splices		G													
			SD-09 Manufacturer's Field Reports															
			Factory Reel Test Data	2.8.1	G													
			SD-10 Operation and Maintenance Data															

This page left blank.

SECTION 01 33 29

SUSTAINABILITY REQUIREMENTS AND REPORTING

02/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

COUNCIL ON ENVIRONMENTAL QUALITY (CEQ) (WHITE HOUSE)

HPSB Guiding Principles (2016) Guiding Principles for Sustainable Federal Buildings and Determining Compliance with the Guiding Principles for Sustainable Federal Buildings

INTERNATIONAL CODE COUNCIL (ICC)

ICC IgCC (2018) International Green Construction Code

U.S. DEPARTMENT OF AGRICULTURE (USDA)

FSRIA 9002 Farm Security and Rural Investment Act Section 9002 (USDA BioPreferred Program)

U.S. DEPARTMENT OF DEFENSE (DOD)

UFC 1-200-02 (2020; with Change 1, 2020; Change 2, 2022) High Performance and Sustainable Building Requirements

UFC 3-600-01 (2016; with Change 6, 2021) Fire Protection Engineering for Facilities

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

40 CFR 247 Comprehensive Procurement Guideline for Products Containing Recovered Materials

1.2 SUMMARY

This section includes requirements for Sustainability documentation and reporting submittals per the federally mandated High Performance and Sustainable Building (HPSB) or HPSB "Guiding Principles" (GP), in accordance with UFC 1-200-02 High Performance and Sustainable Building Requirements, and other identified requirements.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Preliminary High Performance and Sustainable Building Checklist; G
Sustainability Action Plan; G
Preliminary Sustainability eNotebook; G

SD-11 Closeout Submittals

Final High Performance and Sustainable Building Checklist; G
Final Sustainability eNotebook; G
Amended Final Sustainability eNotebook; G
Amended Final High Performance and Sustainable Building Checklist;
G
Third Party Certification Certificate, Assessment, or Validation
and Compliance Report; G

1.4 GUIDING PRINCIPLES VALIDATION (GPV)

Provide the following sustainability activities and documentation to verify achievement of HPSB Guiding Principles Validation (GPV):

- a. Analysis of each Guiding Principle Requirement and how project complies. Include final government approved narrative(s) in the HPSB Checklist submittal. Multiple checklists indicate multiple buildings that require individual HPSB Checklist tracking.
- b. No changes to the HPSB Checklist are allowed without approval from the Contracting Officer, in accordance with Section 01 33 00 SUBMITTAL REQUIREMENTS. Immediately bring to the attention of the Contracting Officer any project changes that impact meeting the approved HPSB Guiding Principles Requirements for this project. Demonstrate the change will not increase the life-cycle cost and maintains or improves the building performance.
- c. Documentation of all work required to incorporate the applicable HPSB Guiding Principles requirements indicated on the HPSB Checklist and in this contract, including all "S" submittals.
- d. Sustainability Action Plan.
- e. Construction related documentation for the project Sustainability eNotebook and keep updated with regularly-scheduled Construction Quality Control Meetings. Include construction related documentation containing the following components:

- (1) HPSB Checklist(s)

(2) Sustainability Action Plan

(3) Documentation illustrating HPSB Guiding Principles Requirements compliance, including "S" submittals

1.4.1 Sustainability Action Plan

Include the following information in the Sustainability Action Plan:

- a. Analysis of each HPSB Guiding Principles Requirement and how project will comply. Final government approved narrative(s) must be included in the HPSB Checklist submittal.
- b. Name and contact information for: Contractor's Point of Contact (POC) ensuring sustainability goals are accomplished and documentation is assembled.
- c. Indoor Air Quality plan.

1.4.2 Calculations

Provide all calculations, product data, labels and product certifications required in this specification to demonstrate compliance with the HPSB Guiding Principles Requirements.

1.5 SUSTAINABILITY SUBMITTALS

Provide HPSB Checklist and other documentation in the Sustainability eNotebook to indicate compliance with the sustainability requirements of the project.

1.5.1 High Performance Sustainable Building (HPSB) Checklist

Provide construction documentation that provides proof of, and supports compliance with, the completed HPSB Checklist.

1.5.1.1 HPSB Checklist Submittals

Submit updated HPSB Checklist with each Sustainability eNotebook submittal. Include the final HPSB Checklist(s) with the interim DD1354 Real Property Record Submittal.

1.5.2 "S" Submittals for Sustainability Documentation

"S" submittals are the sustainability documentation requirements cited in the various sections of this contract. Submit the GPV sustainability documentation required in this section as "S" submittals in all affected UFGS Sections.

- a. Highlight GPV compliance data in "S" submittal.
- b. Add "S" submittals to the Sustainability eNotebook only after submittal approval, and bookmark them as required in paragraph SUSTAINABILITY ENOTEBOOK below.
- c. Ensure all approved "S" submittals are included in each Sustainability

eNotebook submittal.

1.5.3 Sustainability eNotebook

The Sustainability eNotebook is an electronic organizational file that serves as a repository for all required sustainability submittals. To support documentation of compliance with an approved HPSB checklist, provide and maintain a comprehensive and current Sustainability eNotebook. Include all required data in Sustainability eNotebook, to support full compliance with the HPSB Guiding Principles Requirements, including:

- a. HPSB checklist
- b. Sustainability Action Plan
- c. Calculations
- d. Labels
- e. "S" submittals

1.5.3.1 Sustainability eNotebook Format

Provide Sustainability eNotebook in the form of an Adobe PDF file; bookmark each HPSB Guiding Principles Requirement, and sub-bookmark at each document. Match format to HPSB Guiding Principles numbering system indicated herein. Maintain up-to-date information, such as spreadsheets, templates, with each current submittals.

Contracting Officer may deduct from the monthly progress payment accordingly if Sustainability eNotebook information is not current and on track per project goals.

1.5.3.2 Sustainability eNotebook Submittal Schedule

Provide Sustainability eNotebook Submittals at the following milestones of the project:

- a. Construction Quality Control Meetings.

Provide up-to-date GP documentation in the Sustainability eNotebook for each meeting.

- b. Final Sustainability eNotebook

Submit updated Sustainability eNotebook with updated Final High Performance and Sustainable Building Checklist at Beneficial Occupancy Date (BOD). Final progress payment retainage may be held by Contracting Officer until Final Sustainability construction phase documentation is complete.

- c. Amended Final Sustainability eNotebook

Amend and resubmit the Amended Final Sustainability eNotebook with

Amended Final High Performance and Sustainable Building Checklist to include post-occupancy corrections, updates, and requirements. Final progress payment retainage may be held by Contracting Officer until amended final sustainability documentation is complete. Submit the Amended Final Sustainability eNotebook Submittal on DVDs to the Contracting Officer no later than 30 days after final GP determination.

1.6 DOCUMENTATION REQUIREMENTS

- a. Incorporate each of the following HPSB Guiding Principles requirements into project and provide documentation that proves compliance with each listed requirement. Items below are organized by HPSB Guiding Principles. For life-cycle cost analysis requirements, one document with all analyses is acceptable, with Contracting Officer approval.
- b. For each of the following paragraphs that require the use of products listed on Government-required websites, provide documentation of the process used to select products, or process used to determine why listed products do not meet project performance requirements.

1.6.1 Integrated Design Process

For the submittal documentation below, demonstrate compliance with UFC 1-200-02.

1.6.2 Commissioning (Cx)

Develop and incorporate Commissioning requirements into the documents, in accordance with Section 01 91 00.15 BUILDING COMMISSIONING.

1.6.3 Building-level Power Metering

1.6.3.1 Construction Submittal Documentation

Provide manufacturer's data validating compatibility with base-wide system and component advanced meter requirements.

1.6.4 Indoor Water Use

Provide Construction Documentation proof that fixtures are labeled EPA WaterSense, for products available with EPA WaterSense labeling; for all other fixtures, proof they comply with EPA WaterSense efficiency requirements.

1.6.5 Indoor Water Metering

Provide building-level meters for potable water use. Provide the requirements cited in the following paragraphs:

1.6.5.1 Construction Submittal Documentation

Provide manufacturer's data validating compatibility with base-wide system and component advanced meter requirements.

1.6.6 Outdoor Water Use

Where new irrigation is required, provide only non-potable sources.
Provide the requirements cited in the following paragraphs:

1.6.6.1 Construction Submittal Documentation

Provide manufacturer's data validating compatibility with base-wide system and component advanced meter requirements.

1.6.7 Outdoor Water Meters

Provide meters for outdoor systems that use potable water. P

1.6.7.1 Construction Submittal Documentation

Provide manufacturer's data validating compatibility with base-wide system and component advanced meter requirements.

1.6.8 Moisture Control

Provide the following:

1.6.8.1 Construction Submittal Documentation

Ensure construction materials are separated and protected in accordance with other sections in this contract document, with adequate humidity controls during construction. In accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA, includes plan for ongoing building moisture control.

Coordinate with the moisture control requirements of Section 01 45 00 QUALITY CONTROL.

1.6.9 Reduce Volatile Organic Compounds (VOC) (Low-Emitting Materials)

Meet the requirements of Table 3-1 at the end of this specification.

For Construction submittal documentation, provide certifications or labels that demonstrate compliance with cited requirements, based on the attached TABLE 3-1.

1.6.10 Indoor Air Quality During Construction

Prior to construction, create indoor air quality plan. Develop and implement an IAQ construction management plan during construction and flush building air before occupancy.

For new construction and for renovation of unoccupied existing buildings, meet the requirements of ICC IgCC 1001.3.1.5 (10.3.1.4) Indoor Air Quality (IAQ) Construction Management.

Provide documentation showing that after construction ends and prior to occupancy, HVAC filters were replaced and building air was flushed out in accordance with the cited standard.

1.6.11 Recycled Content

Comply with 40 CFR 247. Refer to:

<https://www.epa.gov/smm/comprehensive-procurement-guideline-cpg-program> for assistance identifying products cited in 40 CFR 247. Selected products must comply with non-proprietary requirements of the Federal Acquisition Regulation and must meet performance requirements.

1.6.11.1 Construction Submittal Documentation

- a. Provide manufacturers' documents stating the recycled content by material, or written justification for claiming one of the exceptions allowed on the cited website.
- b. Substitutions: Submit for Government approval for proposed alternative products or systems that provide equivalent performance and appearance and have greater contribution to project recycled content requirements. For all such proposed substitutions, submit with the Sustainability Action Plan accompanied by product data demonstrating equivalence.
- c. In order to complete compliance with FAR 52.223-9 Estimate of Percentage of Recovered Material Content for EPA Designated Items, refer to submittal requirement for recycled/recovered material content in Section 01 78 00 CLOSEOUT SUBMITTALS.

1.6.12 Bio-Based Products

Provide products and materials composed of the highest percentage of bio-based materials (including rapidly renewable resources and certified sustainably harvested products), consistent with FSRIA 9002 USDA BioPreferred Program, to the maximum extent possible without jeopardizing the intended end use or detracting from the overall quality delivered to the end user and when available at a reasonable cost. Use only supplies and materials of a type and quality that conform to applicable specifications and standards.

Comply with FSRIA 9002 USDA BioPreferred Program. Refer to www.biopREFERRED.gov for the product categories and BioPreferred Catalog. Selected products must comply with non-proprietary requirements of the Federal Acquisition Regulation and must meet performance requirements. Provide the following documentation:

- a. USDA BioPreferred label for each product; for bio-based products used on project but not listed with BioPreferred program, provide bio-based content and percentage.
- b. In order to complete compliance with FAR 52.223-1 Biobased Product Certification, refer to submittal requirement for biobased products in Section 01 78 00 CLOSEOUT SUBMITTALS, paragraphs CERTIFICATION OF EPA DESIGNATED ITEMS and CERTIFICATION OF USDA DESIGNATED ITEMS.

1.6.13 Waste Material Management (Recycling - Design)

For the submittal documentation below, demonstrate compliance with UFC 1-200-02.

1.6.14 Waste Material Management (Recycling - Construction)

Divert demolition and construction debris in accordance with Section

01 74 19 CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL.

PART 2 PRODUCTS

Not used.

PART 3 EXECUTION

3.1 SUSTAINABILITY COORDINATION

Provide sustainability focus and coordination at all meetings to achieve sustainability goals. Coordinate meeting requirements with other UFGS Sections meeting requirements in this project. Ensure the designated sustainability professional responsible for GP documentation participates in these meetings to coordinate documentation completion. Review GP sustainability requirements, HPSB Checklist documentation, Sustainability Action Plan, and completeness status of Sustainability eNotebook, and TPC status at the following meetings:

- a. Pre-Construction Conference
- b. Construction Quality Control Meetings

Refer to Section 01 30 00 ADMINISTRATIVE PROCEDURES for Post Award Meetings.

- c. Facility Turnover Meetings

Conduct review no later than 60 days before final turnover and identify any outstanding issues that affect correct completion of all documentation, assessment or validation, and actions that will achieve requirements. Conduct corrective actions prior to turnover, to ensure all requirements are achieved.

3.2 TABLE 3-1 VOLATILE ORGANIC COMPOUNDS (VOC) (LOW EMITTING MATERIALS) REQUIREMENTS

TABLE 3-1 Volatile Organic Compounds (VOC) (Low Emitting Materials) Requirements Source: ICC IgCC Chapter 8 (Materials) (Interior Applications Only)				
MATERIAL CATEGORY	EMISSIONS REQUIREMENT		MATERIALS WITH ADDED VOC REQUIREMENT	EMISSIONS REQUIREMENTS
Adhesives and Sealants	CDPH/EHLB/Standard method V1.1 (California Section 01350) (Use "office" or "classroom" space limits for all applications)	or	Adhesives (carpet, resilient, wood flooring; base cove; ceramic tile; drywall and panel; primers) Sealants (acoustical; firestop; HVAC Air duct; primers) Caulks	SCAQMD Rule 1168 (Use "other" category for HVAC duct sealant) (for firestop adhesive, UFC 3-600-01 overrides conflicting requirements)
			Aerosol adhesives	Section 3 of Green Seal Standard GS-36 (except: cleaners, solvent cements, and primers used with plastic piping and conduit in plumbing, fire suppression, and electrical systems; HVAC air duct sealants when the application space air temp is less than 40 F (4.5 C)).

TABLE 3-1 Volatile Organic Compounds (VOC) (Low Emitting Materials) Requirements Source: ICC IgCC Chapter 8 (Materials) (Interior Applications Only)				
MATERIAL CATEGORY	EMISSIONS REQUIREMENT		MATERIALS WITH ADDED VOC REQUIREMENT	EMISSIONS REQUIREMENTS
Paints and Coatings	CDPH/EHLB/Standard method V1.1 (California Section 01350) (Use "office" or "classroom" space limits for all applications)	or	Flat and nonflat, nonflat high-gloss, specialty, basement specialty, fire-resistive, floor, low-solids, rust preventative, wood, reflective wall coatings; concrete/masonry sealers; primers; sealers; undercoaters; shellacs (clear and opaque); stains; varnishes; conjugated oil varnish; lacquer; clear brushing lacquer	Green Seal Standard GS-11

TABLE 3-1 Volatile Organic Compounds (VOC) (Low Emitting Materials) Requirements				
Source: ICC IgCC Chapter 8 (Materials) (Interior Applications Only)				
MATERIAL CATEGORY	EMISSIONS REQUIREMENT		MATERIALS WITH ADDED VOC REQUIREMENT	EMISSIONS REQUIREMENTS
Paints and Coatings	CDPH/EHLB/Standard method V1.1 (California Section 01350) (Use "office" or "classroom" space limits for all applications)	or	Concrete curing compounds; dry fog, faux finishing, graphic arts (sign paints), industrial maintenance, mastic texture, metallic pigmented, multicolor, recycled coatings; pretreatment wash primers, reactive penetrating sealers; specialty primers, wood preservatives, and zinc primers	California Air Resources Board (CARB) Suggested Control Measure for Architectural Coatings or SCAQMD Rule 1113r
Paints and Coatings	CDPH/EHLB/Standard method V1.1 (California Section 01350) (Use "office" or "classroom" space limits for all applications)	or	High-temperature coatings; stone consolidants; swimming-pool coatings; tub- and tile-refining coatings; and waterproofing membranes	California Air Resources Board (CARB) Suggested Control Measure for Architectural Coatings

TABLE 3-1 Volatile Organic Compounds (VOC) (Low Emitting Materials) Requirements Source: ICC IgCC Chapter 8 (Materials) (Interior Applications Only)				
MATERIAL CATEGORY	EMISSIONS REQUIREMENT		MATERIALS WITH ADDED VOC REQUIREMENT	EMISSIONS REQUIREMENTS
Floor Covering Materials	For carpet, all locations: CDPH/EHLB/Standard Method V1.1 (California Section 01350) or label for Section 9 of CDPH/EHLB/Standard Method V1.1 (California Section 01350)		none	none
Insulation	CDPH/EHLB/Standard method V1.1 (California Section 01350) (Use "office" or "classroom" space limits for all applications)		none	none

TABLE 3-1 Volatile Organic Compounds (VOC) (Low Emitting Materials) Requirements

Source: ICC IgCC Chapter 8 (Materials) (Interior Applications Only)

MATERIAL CATEGORY	EMISSIONS REQUIREMENT		MATERIALS WITH ADDED VOC REQUIREMENT	EMISSIONS REQUIREMENTS
<p>Composite Wood, Wood Structural Panel, and Agrifiber Products, no added urea-formaldehyde resins including laminating adhesives for composite wood and agrifiber assemblies - particleboard, medium density fiberboard (MDF), wheatboard, strawboard, panel substrates, door cores</p>	<p>Third-party certification (approved by CARB) of California Air Resource Board's (CARB) regulation, Airborne Toxic Control Measure to Reduce Formaldehyde Emissions from Composite Wood Products</p>	<p>or</p>	<p>none</p>	<p>CDPH/EHLB/Standard method V1.1 (California Section 01350) (Use "office" or "classroom" space limits for all applications) (except: Structural panel components such as plywood, particle board, wafer board, and oriented strand board identified as "EXPOSURE 1," "EXTERIOR," or "HUD-APPROVED" are considered acceptable for interior use.)</p>
<p>Office Furniture Systems and Seating installed prior to occupancy</p>	<p>ANSI/BIFMA X7.1 ANSI/BIFMA X7.1: (95-percent of installed office furniture system workstations and seating units) Section 7.6.2 of ANSI/BIFMA e3 (50-percent of office furniture system workstations and seating units)</p>		<p>none</p>	<p>none</p>

TABLE 3-1 Volatile Organic Compounds (VOC) (Low Emitting Materials) Requirements Source: ICC IgCC Chapter 8 (Materials) (Interior Applications Only)			
MATERIAL CATEGORY	EMISSIONS REQUIREMENT	MATERIALS WITH ADDED VOC REQUIREMENT	EMISSIONS REQUIREMENTS
Ceiling and Wall assemblies and systems including: acoustical treatments; ceiling panels and tiles; tackable wall panels and coverings; wall coverings; wall and ceiling paneling and planking	CDPH/EHLB/Standard method V1.1 (California Section 01350) (Use "office" or "classroom" space limits for all applications)	none	none

-- End of Section --

SECTION 01 35 26

GOVERNMENTAL SAFETY REQUIREMENTS

11/15

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN SOCIETY OF SAFETY PROFESSIONALS (ASSP)

ASSP A10.22	(2007; R 2017) Safety Requirements for Rope-Guided and Non-Guided Workers' Hoists
ASSP A10.34	(2021) Protection of the Public on or Adjacent to Construction Sites
ASSP A10.44	(2020) Control of Energy Sources (Lockout/Tagout) for Construction and Demolition Operations
ASSP Z244.1	(2016) The Control of Hazardous Energy Lockout, Tagout and Alternative Methods
ASSP Z359.0	(2018) Definitions and Nomenclature Used for Fall Protection and Fall Arrest
ASSP Z359.1	(2020) The Fall Protection Code
ASSP Z359.11	(2014) Safety Requirements for Full Body Harnesses
ASSP Z359.12	(2019) Connecting Components for Personal Fall Arrest Systems
ASSP Z359.13	(2013) Personal Energy Absorbers and Energy Absorbing Lanyards
ASSP Z359.14	(2014) Safety Requirements for Self-Retracting Devices for Personal Fall Arrest and Rescue Systems
ASSP Z359.15	(2014) Safety Requirements for Single Anchor Lifelines and Fall Arresters for Personal Fall Arrest Systems
ASSP Z359.2	(2017) Minimum Requirements for a Comprehensive Managed Fall Protection Program
ASSP Z359.3	(2019) Safety Requirements for Lanyards and Positioning Lanyards
ASSP Z359.4	(2013) Safety Requirements for

Assisted-Rescue and Self-Rescue Systems,
Subsystems and Components

- ASSP Z359.6 (2016) Specifications and Design Requirements for Active Fall Protection Systems
- ASSP Z359.7 (2019) Qualification and Verification Testing of Fall Protection Products
- ASSP Z490.1 (2016) Criteria for Accepted Practices in Safety, Health, and Environmental Training

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

- ASME B30.20 (2018) Below-the-Hook Lifting Devices
- ASME B30.22 (2016) Articulating Boom Cranes
- ASME B30.23 (2016) Personnel Lifting Systems Safety Standard for Cableways, Cranes, Derricks, Hoists, Hooks, Jacks, and Slings
- ASME B30.26 (2015; R 2020) Rigging Hardware
- ASME B30.3 (2020) Tower Cranes
- ASME B30.5 (2018) Mobile and Locomotive Cranes
- ASME B30.7 (2016) Winches
- ASME B30.8 (2020) Floating Cranes and Floating Derricks
- ASME B30.9 (2018) Slings

ASTM INTERNATIONAL (ASTM)

- ASTM F855 (2019) Standard Specifications for Temporary Protective Grounds to Be Used on De-energized Electric Power Lines and Equipment

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

- IEEE 1048 (2016) Guide for Protective Grounding of Power Lines
- IEEE C2 (2023) National Electrical Safety Code

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

- NEMA Z535.2 (2011; R 2017) Environmental and Facility Safety Signs

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

- NFPA 10 (2022; ERTA 1 2021) Standard for Portable Fire Extinguishers

NFPA 241 (2022) Standard for Safeguarding Construction, Alteration, and Demolition Operations

NFPA 51B (2019; TIA 20-1) Standard for Fire Prevention During Welding, Cutting, and Other Hot Work

NFPA 70 (2020; TIA 22-1; ERTA 1 2022) National Electrical Code

NFPA 70E (2021) Standard for Electrical Safety in the Workplace

TELECOMMUNICATIONS INDUSTRY ASSOCIATION (TIA)

TIA-1019 (2012; R 2016) Standard for Installation, Alteration and Maintenance of Antenna Supporting Structures and Antennas

TIA-222 (2018H; Add 1 2019) Structural Standard for Antenna Supporting Structures and Antennas and Small Wind Turbine Support Structures

U.S. ARMY CORPS OF ENGINEERS (USACE)

EM 385-1-1 (2014) Safety -- Safety and Health Requirements Manual

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

10 CFR 20 Standards for Protection Against Radiation

29 CFR 1910 Occupational Safety and Health Standards

29 CFR 1910.146 Permit-required Confined Spaces

29 CFR 1910.147 The Control of Hazardous Energy (Lock Out/Tag Out)

29 CFR 1910.333 Selection and Use of Work Practices

29 CFR 1915 Confined and Enclosed Spaces and Other Dangerous Atmospheres in Shipyard Employment

29 CFR 1915.89 Control of Hazardous Energy (Lockout/Tags-Plus)

29 CFR 1926 Safety and Health Regulations for Construction

29 CFR 1926.1400 Cranes and Derricks in Construction

29 CFR 1926.16 Rules of Construction

29 CFR 1926.450 Scaffolds

29 CFR 1926.500	Fall Protection
29 CFR 1926.552	Material Hoists, Personal Hoists, and Elevators
29 CFR 1926.553	Base-Mounted Drum Hoists
49 CFR 173	Shippers - General Requirements for Shipments and Packagings
CPL 02-01-056	(2014) Inspection Procedures for Accessing Communication Towers by Hoist
CPL 2.100	(1995) Application of the Permit-Required Confined Spaces (PRCS) Standards, 29 CFR 1910.146

1.2 DEFINITIONS

1.2.1 Competent Person (CP)

The CP is a person designated in writing, who, through training, knowledge and experience, is capable of identifying, evaluating, and addressing existing and predictable hazards in the working environment or working conditions that are dangerous to personnel, and who has authorization to take prompt corrective measures with regards to such hazards.

1.2.2 Competent Person, Confined Space

The CP, Confined Space, is a person meeting the competent person requirements as defined EM 385-1-1 Appendix Q, with thorough knowledge of OSHA's Confined Space Standard, 29 CFR 1910.146, and designated in writing to be responsible for the immediate supervision, implementation and monitoring of the confined space program, who through training, knowledge and experience in confined space entry is capable of identifying, evaluating and addressing existing and potential confined space hazards and, who has the authority to take prompt corrective measures with regard to such hazards.

1.2.3 Competent Person, Cranes and Rigging

The CP, Cranes and Rigging, as defined in EM 385-1-1 Appendix Q, is a person meeting the competent person, who has been designated in writing to be responsible for the immediate supervision, implementation and monitoring of the Crane and Rigging Program, who through training, knowledge and experience in crane and rigging is capable of identifying, evaluating and addressing existing and potential hazards and, who has the authority to take prompt corrective measures with regard to such hazards.

1.2.4 Competent Person, Excavation/Trenching

A CP, Excavation/Trenching, is a person meeting the competent person requirements as defined in EM 385-1-1 Appendix Q and 29 CFR 1926, who has been designated in writing to be responsible for the immediate supervision, implementation and monitoring of the excavation/trenching program, who through training, knowledge and experience in excavation/trenching is capable of identifying, evaluating and addressing existing and potential hazards and, who has the authority to take prompt

corrective measures with regard to such hazards.

1.2.5 Competent Person, Fall Protection

The CP, Fall Protection, is a person meeting the competent person requirements as defined in EM 385-1-1 Appendix Q and in accordance with ASSP Z359.0, who has been designated in writing by the employer to be responsible for immediate supervising, implementing and monitoring of the fall protection program, who through training, knowledge and experience in fall protection and rescue systems and equipment, is capable of identifying, evaluating and addressing existing and potential fall hazards and, who has the authority to take prompt corrective measures with regard to such hazards.

1.2.6 Competent Person, Scaffolding

The CP, Scaffolding is a person meeting the competent person requirements in EM 385-1-1 Appendix Q, and designated in writing by the employer to be responsible for immediate supervising, implementing and monitoring of the scaffolding program. The CP for Scaffolding has enough training, knowledge and experience in scaffolding to correctly identify, evaluate and address existing and potential hazards and also has the authority to take prompt corrective measures with regard to these hazards. CP qualifications must be documented and include experience on the specific scaffolding systems/types being used, assessment of the base material that the scaffold will be erected upon, load calculations for materials and personnel, and erection and dismantling. The CP for scaffolding must have a documented, minimum of 8-hours of scaffold training to include training on the specific type of scaffold being used (e.g. mast-climbing, adjustable, tubular frame), in accordance with EM 385-1-1 Section 22.B.02.

1.2.7 Competent Person (CP) Trainer

A competent person trainer as defined in EM 385-1-1 Appendix Q, who is qualified in the material presented, and who possesses a working knowledge of applicable technical regulations, standards, equipment and systems related to the subject matter on which they are training Competent Persons. A competent person trainer must be familiar with the typical hazards and the equipment used in the industry they are instructing. The training provided by the competent person trainer must be appropriate to that specific industry. The competent person trainer must evaluate the knowledge and skills of the competent persons as part of the training process.

1.2.8 High Risk Activities

High Risk Activities are activities that involve work at heights, crane and rigging, excavations and trenching, scaffolding, electrical work, and confined space entry.

1.2.9 High Visibility Accident

A High Visibility Accident is any mishap which may generate publicity or high visibility.

1.2.10 Load Handling Equipment (LHE)

LHE is a term used to describe cranes, hoists and all other hoisting equipment (hoisting equipment means equipment, including crane, derricks,

hoists and power operated equipment used with rigging to raise, lower or horizontally move a load).

1.2.11 Medical Treatment

Medical Treatment is treatment administered by a physician or by registered professional personnel under the standing orders of a physician. Medical treatment does not include first aid treatment even when provided by a physician or registered personnel.

1.2.12 Near Miss

A Near Miss is a mishap resulting in no personal injury and zero property damage, but given a shift in time or position, damage or injury may have occurred (e.g., a worker falls off a scaffold and is not injured; a crane swings around to move the load and narrowly misses a parked vehicle).

1.2.13 Operating Envelope

The Operating Envelope is the area surrounding any crane or load handling equipment. Inside this "envelope" is the crane, the operator, riggers and crane walkers, other personnel involved in the operation, rigging gear between the hook, the load, the crane's supporting structure (i.e. ground or rail), the load's rigging path, the lift and rigging procedure.

1.2.14 Qualified Person (QP)

The QP is a person designated in writing, who, by possession of a recognized degree, certificate, or professional standing, or extensive knowledge, training, and experience, has successfully demonstrated their ability to solve or resolve problems related to the subject matter, the work, or the project.

1.2.15 Qualified Person, Fall Protection (QP for FP)

A QP for FP is a person meeting the requirements of EM 385-1-1 Appendix Q, and ASSP Z359.0, with a recognized degree or professional certificate and with extensive knowledge, training and experience in the fall protection and rescue field who is capable of designing, analyzing, and evaluating and specifying fall protection and rescue systems.

1.2.16 USACE Property and Equipment

Interpret "USACE" property and equipment specified in USACE EM 385-1-1 as Government property and equipment.

1.2.17 Load Handling Equipment (LHE) Accident or Load Handling Equipment Mishap

A LHE accident occurs when any one or more of the eight elements in the operating envelope fails to perform correctly during operation, including operation during maintenance or testing resulting in personnel injury or death; material or equipment damage; dropped load; derailment; two-blocking; overload; or collision, including unplanned contact between the load, crane, or other objects. A dropped load, derailment, two-blocking, overload and collision are considered accidents, even though no material damage or injury occurs. A component failure (e.g., motor burnout, gear tooth failure, bearing failure) is not considered an accident solely due to material or equipment damage unless the component

failure results in damage to other components (e.g., dropped boom, dropped load, or roll over). Document an LHE mishap or accident using the NAVFAC prescribed Navy Crane Center (NCC) accident form. Document an LHE mishap using the Crane High Hazard working group mishap reporting form.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Accident Prevention Plan (APP); G

SD-06 Test Reports

Monthly Exposure Reports

Notifications and Reports

Accident Reports; G

LHE Inspection Reports

SD-07 Certificates

Contractor Safety Self-Evaluation Checklist

Crane Operators/Riggers

Standard Lift Plan; G

Critical Lift Plan ; G

Activity Hazard Analysis (AHA)

Confined Space Entry Permit

Hot Work Permit

Certificate of Compliance

License Certificates

Radiography Operation Planning Work Sheet; G

Portable Gauge Operations Planning Worksheet; G

Machinery & Mechanized Equipment Certification Form

1.4 MONTHLY EXPOSURE REPORTS

Provide a Monthly Exposure Report and attach to the monthly billing request. This report is a compilation of employee-hours worked each month for all site workers, both Prime and subcontractor. Failure to submit the report may result in retention of up to 10 percent of the voucher.

1.5 CONTRACTOR SAFETY SELF-EVALUATION CHECKLIST

Contracting Officer will provide a "Contractor Safety Self-Evaluation checklist" to the Contractor at the pre-construction conference. Complete the checklist monthly and submit with each request for payment voucher. An acceptable score of 90 or greater is required. Failure to submit the completed safety self-evaluation checklist or achieve a score of at least 90 may result in retention of up to 10 percent of the voucher.

1.6 REGULATORY REQUIREMENTS

In addition to the detailed requirements included in the provisions of this contract, comply with the most recent edition of USACE EM 385-1-1, and the following federal, state, and local laws, ordinances, criteria, rules and regulations. Submit matters of interpretation of standards to the appropriate administrative agency for resolution before starting work. Where the requirements of this specification, applicable laws, criteria, ordinances, regulations, and referenced documents vary, the most stringent requirements govern.

1.6.1 Subcontractor Safety Requirements

For this contract, neither Contractor nor any subcontractor may enter into contract with any subcontractor that fails to meet the following requirements. The term subcontractor in this and the following paragraphs means any entity holding a contract with the Contractor or with a subcontractor at any tier.

1.6.1.1 Experience Modification Rate (EMR)

Subcontractors on this contract must have an effective EMR less than or equal to 1.10, as computed by the National Council on Compensation Insurance (NCCI) or if not available, as computed by the state agency's rating bureau in the state where the subcontractor is registered, when entering into a subcontract agreement with the Prime Contractor or a subcontractor at any tier. The Prime Contractor may submit a written request for additional consideration to the Contracting Officer where the specified acceptable EMR range cannot be achieved. Relaxation of the EMR range will only be considered for approval on a case-by-case basis for special conditions and must not be anticipated as tacit approval. Contractor's Site Safety and Health Officer (SSHO) must collect and maintain the certified EMR ratings for all subcontractors on the project and make them available to the Government at the Government's request.

1.6.1.2 OSHA Days Away from Work, Restricted Duty, or Job Transfer (DART) Rate

Subcontractors on this contract must have a DART rate, calculated from the most recent, complete calendar year, less than or equal to 3.4 when entering into a subcontract agreement with the Prime Contractor or a subcontractor at any tier. The OSHA Dart Rate is calculated using the following formula:

$$(N/EH) \times 200,000$$

where:

N = number of injuries and illnesses with days away, restricted work, or job transfer

EH = total hours worked by all employees during most recent, complete calendar year

200,000 = base for 100 full-time equivalent workers (working 40 hours per week, 50 weeks per year)

The Prime Contractor may submit a written request for additional consideration to the Contracting Officer where the specified acceptable OSHA Dart rate range cannot be achieved for a particular subcontractor. Relaxation of the OSHA DART rate range will only be considered for approval on a case-by-case basis for special conditions and must not be anticipated as tacit approval. Contractor's Site Safety and Health Officer (SSHO) must collect and maintain self-certified OSHA DART rates for all subcontractors on the project and make them available to the Government at the Government's request.

1.7 SITE QUALIFICATIONS, DUTIES, AND MEETINGS

1.7.1 Personnel Qualifications

1.7.1.1 Site Safety and Health Officer (SSHO)

Provide an SSHO that meets the requirements of EM 385-1-1 Section 1. The SSHO must ensure that the requirements of 29 CFR 1926.16 are met for the project. Provide a Safety oversight team that includes a minimum of one (1) person at each project site to function as the Site Safety and Health Officer (SSHO). The SSHO or an equally-qualified Alternate SSHO must be at the work site at all times to implement and administer the Contractor's safety program and government-accepted Accident Prevention Plan. The SSHO and Alternate SSHO must have the required training, experience, and qualifications in accordance with EM 385-1-1 Section 01.A.17, and all associated sub-paragraphs.

If the SSHO is off-site for a period longer than 24 hours, an equally-qualified alternate SSHO must be provided and must fulfill the same roles and responsibilities as the primary SSHO. When the SSHO is temporarily (up to 24 hours) off-site, a Designated Representative (DR), as identified in the AHA may be used in lieu of an Alternate SSHO, and must be on the project site at all times when work is being performed. Note that the DR is a collateral duty safety position, with safety duties in addition to their full time occupation.

1.7.1.1.1 Additional Site Safety and Health Officer (SSHO) Requirements and Duties

The SSHO may also serve as the Quality Control Manager. The SSHO may also serve as the Superintendent.

The SSHO must have completed a 40 hour contract safety awareness course based on the content and principles of EM 385-1-1, and instructed in accordance with the guidelines of ASSP Z490.1, by a trainer meeting the qualifications of paragraph QUALIFIED TRAINER REQUIREMENTS. If the SSHO does not have a current certification, certification must be obtained within 60 days, maximum, of contract award.

1.7.1.2 Competent Person Qualifications

Provide Competent Persons in accordance with EM 385-1-1, Appendix Q and

herein. Competent Persons for high risk activities include confined space, cranes and rigging, excavation/trenching, fall protection, and electrical work. The CP for these activities must be designated in writing, and meet the requirements for the specific activity (i.e. competent person, fall protection).

The Competent Person identified in the Contractor's Safety and Health Program and accepted Accident Prevention Plan, must be on-site at all times when the work that presents the hazards associated with their professional expertise is being performed. Provide the credentials of the Competent Persons(s) to the the Contracting Officer for information in consultation with the Safety Office.

1.7.1.2.1 Competent Person for Confined Space Entry

Provide a Confined Space (CP) Competent Person who meets the requirements of EM 385-1-1, Appendix Q, and herein. The CP for Confined Space Entry must supervise the entry into each confined space in accordance with EM 385-1-1, Section 34.

1.7.1.2.2 Competent Person for Scaffolding

Provide a Competent Person for Scaffolding who meets the requirements of EM 385-1-1, Section 22.B.02 and herein.

1.7.1.2.3 Competent Person for Fall Protection

Provide a Competent Person for Fall Protection who meets the requirements of EM 385-1-1, Section 21.C.04, 21.B.03, and herein.

1.7.1.3 Qualified Trainer Requirements

Individuals qualified to instruct the 40 hour contract safety awareness course, or portions thereof, must meet the definition of a Competent Person Trainer, and, at a minimum, possess a working knowledge of the following subject areas: EM 385-1-1, Electrical Standards, Lockout/Tagout, Fall Protection, Confined Space Entry for Construction; Excavation, Trenching and Soil Mechanics, and Scaffolds in accordance with 29 CFR 1926.450, Subpart L.

Instructors are required to:

- a. Prepare class presentations that cover construction-related safety requirements and includes topics covered in the NAVFAC Construction Safety Hazard Awareness Course for Contractors.
- b. Ensure that all attendees attend all sessions by using a class roster signed daily by each attendee. Maintain copies of the roster for at least five (5) years. This is a certification class and must be attended 100 percent. In cases of emergency where an attendee cannot make it to a session, the attendee can make it up in another class session for the same subject.
- c. Update training course materials whenever an update of the EM 385-1-1 becomes available.
- d. Provide a written exam of at least 50 questions. Students are required to answer 80 percent correctly to pass.

- e. Request, review and incorporate student feedback into a continuous course improvement program.

1.7.1.4 Requirements for all Contractor Jobsite Personnel Holding H-1B or H-2B Visas:

All Contractor jobsite workers holding an H-1B or H-2B visa must complete a minimum 16 hours of classroom training on the requirements of the latest version of EM 385-1-1 prior to their first day on the jobsite to include but not limited to the following topics: Sanitation; Medical and First Aid Requirements; Temporary Facilities; Personal Protective Equipment; Electrical; Hand and Power Tools; Material Handling and Storage; Motor Vehicles; Fall Protection; Work Platforms and Scaffoldings; Demolition; Safe Access, Ladders, Floor & Wall Openings, Stairs and Railing Systems; Excavations and Trenching; and Confined Spaces, prior to reporting to the jobsite.

Provide a list of workers who have completed the training on the jobsite and have readily available upon request by the Contracting Officer. Maintain and update the list as additional workers are available. Include the name and qualifications of the qualified trainer(s) who provided the training. Personnel who have taken the 40 Hour Construction Safety Hazard Awareness Training Course for Contractors or similar course that includes emphasis on EM 385-1-1 compliance, are not required to take the 16 hours of classroom training on the requirements of the latest version of the EM 385-1-1. The 16 hours classroom training may be provided by the Guam Contractors Association (GCA), the Guam Trades Academy, or other qualified trainers as outlined in paragraph QUALIFIED TRAINER REQUIREMENTS.

1.7.1.5 Crane Operators/Riggers

Provide Operators, Signal Persons, and Riggers meeting the requirements in EM 385-1-1, Section 15.B for Riggers and Section 16.B for Crane Operators and Signal Persons. Provide proof of current qualification.

1.7.2 Personnel Duties

1.7.2.1 Duties of the Site Safety and Health Officer (SSHO)

The SSHO must:

- a. Conduct daily safety and health inspections and maintain a written log which includes area/operation inspected, date of inspection, identified hazards, recommended corrective actions, estimated and actual dates of corrections. Attach safety inspection logs to the Contractors' daily production report.
- b. Conduct mishap investigations and complete required accident reports. Report mishaps and near misses.
- c. Use and maintain OSHA's Form 300 to log work-related injuries and illnesses occurring on the project site for Prime Contractors and subcontractors, and make available to the Contracting Officer upon request. Post and maintain the Form 300A on the site Safety Bulletin Board.
- d. Maintain applicable safety reference material on the job site.
- e. Attend the pre-construction conference, pre-work meetings including

preparatory meetings, and periodic in-progress meetings.

- f. Review the APP and AHAs for compliance with EM 385-1-1, and approve, sign, implement and enforce them.
- g. Establish a Safety and Occupational Health (SOH) Deficiency Tracking System that lists and monitors outstanding deficiencies until resolution.
- h. Ensure subcontractor compliance with safety and health requirements.
- i. Maintain a list of hazardous chemicals on site and their material Safety Data Sheets (SDS).
- j. Maintain a weekly list of high hazard activities involving energy, equipment, excavation, entry into confined space, and elevation, and be prepared to discuss details during QC Meetings.
- k. Provide and keep a record of site safety orientation and indoctrination for Contractor employees, subcontractor employees, and site visitors.

Superintendent, QC Manager, and SSSH are subject to dismissal if the above duties are not being effectively carried out. If Superintendent, QC Manager, or SSSH are dismissed, project work will be stopped and will not be allowed to resume until a suitable replacement is approved and the above duties are again being effectively carried out.

1.7.3 Meetings

1.7.3.1 Preconstruction Conference

- a. Contractor representatives who have a responsibility or significant role in accident prevention on the project must attend the preconstruction conference. This includes the project superintendent, Site Safety and Occupational Health officer, quality control manager, or any other assigned safety and health professionals who participated in the development of the APP (including the Activity Hazard Analyses (AHAs) and special plans, program and procedures associated with it).
- b. Discuss the details of the submitted APP to include incorporated plans, programs, procedures and a listing of anticipated AHAs that will be developed and implemented during the performance of the contract. This list of proposed AHAs will be reviewed at the conference and an agreement will be reached between the Contractor and the Contracting Officer as to which phases will require an analysis. In addition, establish a schedule for the preparation, submittal, and Government review of AHAs to preclude project delays.
- c. Deficiencies in the submitted APP, identified during the Contracting Officer's review, must be corrected, and the APP re-submitted for review prior to the start of construction. Work is not permitted to begin until an APP is established that is acceptable to the Contracting Officer.
- d. The functions of a Preconstruction conference may take place at the Post-Award Kickoff meeting for Design Build Contracts.

1.7.3.2 Safety Meetings

Conduct safety meetings to review past activities, plan for new or changed operations, review pertinent aspects of appropriate AHA (by trade), establish safe working procedures for anticipated hazards, and provide pertinent Safety and Occupational Health (SOH) training and motivation. Conduct meetings at least once a month for all supervisors on the project location. The SSHO, supervisors, foremen, or CDSOs must conduct meetings at least once a week for the trade workers. Document meeting minutes to include the date, persons in attendance, subjects discussed, and names of individual(s) who conducted the meeting. Maintain documentation on-site and furnish copies to the Contracting Officer on request. Notify the Contracting Officer of all scheduled meetings 7 calendar days in advance.

1.8 ACCIDENT PREVENTION PLAN (APP)

A qualified person must prepare the written site-specific APP. Prepare the APP in accordance with the format and requirements of EM 385-1-1, Appendix A, and as supplemented herein. Cover all paragraph and subparagraph elements in EM 385-1-1, Appendix A. The APP must be job-specific and address any unusual or unique aspects of the project or activity for which it is written. The APP must interface with the Contractor's overall safety and health program referenced in the APP in the applicable APP element, and made site-specific. Describe the methods to evaluate past safety performance of potential subcontractors in the selection process. Also, describe innovative methods used to ensure and monitor safe work practices of subcontractors. The Government considers the Prime Contractor to be the "controlling authority" for all work site safety and health of the subcontractors. Contractors are responsible for informing their subcontractors of the safety provisions under the terms of the contract and the penalties for noncompliance, coordinating the work to prevent one craft from interfering with or creating hazardous working conditions for other crafts, and inspecting subcontractor operations to ensure that accident prevention responsibilities are being carried out. The APP must be signed by an officer of the firm (Prime Contractor senior person), the individual preparing the APP, the on-site superintendent, the designated SSHO, the Contractor Quality Control Manager, and any designated Certified Safety Professional (CSP) or Certified Health Physicist (CIH). The SSHO must provide and maintain the APP and a log of signatures by each subcontractor foreman, attesting that they have read and understand the APP, and make the APP and log available on-site to the Contracting Officer. If English is not the foreman's primary language, the Prime Contractor must provide an interpreter.

Submit the APP to the Contracting Officer 15 calendar days prior to the date of the preconstruction conference for acceptance. Work cannot proceed without an accepted APP. Once reviewed and accepted by the Contracting Officer, the APP and attachments will be enforced as part of the contract. Disregarding the provisions of this contract or the accepted APP is cause for stopping of work, at the discretion of the Contracting Officer, until the matter has been rectified. Continuously review and amend the APP, as necessary, throughout the life of the contract. Changes to the accepted APP must be made with the knowledge and concurrence of the Contracting Officer, project superintendent, SSHO and Quality Control Manager. Incorporate unusual or high-hazard activities not identified in the original APP as they are discovered. Should any severe hazard exposure (i.e. imminent danger) become evident, stop work in the area, secure the area, and develop a plan to remove the exposure and control the hazard. Notify the Contracting Officer within 24 hours of

discovery. Eliminate and remove the hazard. In the interim, take all necessary action to restore and maintain safe working conditions in order to safeguard onsite personnel, visitors, the public (as defined by ASSP A10.34), and the environment.

1.8.1 Names and Qualifications

Provide plans in accordance with the requirements outlined in Appendix A of EM 385-1-1, including the following:

- a. Names and qualifications (resumes including education, training, experience and certifications) of site safety and health personnel designated to perform work on this project to include the designated Site Safety and Health Officer and other competent and qualified personnel to be used. Specify the duties of each position.
- b. Qualifications of competent and of qualified persons. As a minimum, designate and submit qualifications of competent persons for each of the following major areas: excavation; scaffolding; fall protection; hazardous energy; confined space; health hazard recognition, evaluation and control of chemical, physical and biological agents; and personal protective equipment and clothing to include selection, use and maintenance.

1.8.2 Plans

Provide plans in the APP in accordance with the requirements outlined in Appendix A of EM 385-1-1, including the following:

1.8.2.1 Confined Space Entry Plan

Develop a confined or enclosed space entry plan in accordance with EM 385-1-1, applicable OSHA standards 29 CFR 1910, 29 CFR 1915, and 29 CFR 1926, OSHA Directive CPL 2.100, and any other federal, state and local regulatory requirements identified in this contract. Identify the qualified person's name and qualifications, training, and experience. Delineate the qualified person's authority to direct work stoppage in the event of hazardous conditions. Include procedure for rescue by contractor personnel and the coordination with emergency responders. (If there is no confined space work, include a statement that no confined space work exists and none will be created.)

1.8.2.2 Standard Lift Plan (SLP)

Plan lifts to avoid situations where the operator cannot maintain safe control of the lift. Prepare a written SLP in accordance with EM 385-1-1, Section 16.A.03, using Form 16-2 for every lift or series of lifts (if duty cycle or routine lifts are being performed). The SLP must be developed, reviewed and accepted by all personnel involved in the lift in conjunction with the associated AHA. Signature on the AHA constitutes acceptance of the plan. Maintain the SLP on the LHE for the current lift(s) being made. Maintain historical SLPs for a minimum of 3 months.

1.8.2.3 Critical Lift Plan - Crane or Load Handling Equipment

Provide a Critical Lift Plan as required by EM 385-1-1, Section 16.H.01, using Form 16-3. In addition, Critical Lift Plans are required for the following:

- a. Lifts over 50 percent of the capacity of barge mounted mobile crane's hoist.
- b. When working around energized power lines where the work will get closer than the minimum clearance distance in EM 385-1-1 Table 16-1.
- c. For lifts with anticipated binding conditions.
- d. When erecting cranes.

1.8.2.3.1 Critical Lift Plan Planning and Schedule

Critical lifts require detailed planning and additional or unusual safety precautions. Develop and submit a critical lift plan to the Contracting Officer 30 calendar days prior to critical lift. Comply with load testing requirements in accordance with EM 385-1-1, Section 16.F.03.

1.8.2.3.2 Lifts of Personnel

In addition to the requirements of EM 385-1-1, Section 16.H.02, for lifts of personnel, demonstrate compliance with the requirements of 29 CFR 1926.1400 and EM 385-1-1, Section 16.T.

1.8.2.4 Multi-Purpose Machines, Material Handling Equipment, and Construction Equipment Lift Plan

Multi-purpose machines, material handling equipment, and construction equipment used to lift loads that are suspended by rigging gear, require proof of authorization from the machine OEM that the machine is capable of making lifts of loads suspended by rigging equipment. Written approval from a qualified registered professional engineer, after a safety analysis is performed, is allowed in lieu of the OEM's approval. Demonstrate that the operator is properly trained and that the equipment is properly configured to make such lifts and is equipped with a load chart.

1.8.2.5 Fall Protection and Prevention (FP&P) Plan

The plan must comply with the requirements of EM 385-1-1, Section 21.D and ASSP Z359.2, be site specific, and address all fall hazards in the work place and during different phases of construction. Address how to protect and prevent workers from falling to lower levels when they are exposed to fall hazards above 6 feet. A competent person or qualified person for fall protection must prepare and sign the plan documentation. Include fall protection and prevention systems, equipment and methods employed for every phase of work, roles and responsibilities, assisted rescue, self-rescue and evacuation procedures, training requirements, and monitoring methods. Review and revise, as necessary, the Fall Protection and Prevention Plan documentation as conditions change, but at a minimum every six months, for lengthy projects, reflecting any changes during the course of construction due to changes in personnel, equipment, systems or work habits. Keep and maintain the accepted Fall Protection and Prevention Plan documentation at the job site for the duration of the project. Include the Fall Protection and Prevention Plan documentation in the Accident Prevention Plan (APP).

1.8.2.6 Rescue and Evacuation Plan

Provide a Rescue and Evacuation Plan in accordance with EM 385-1-1 Section 21.N and ASSP Z359.2, and include in the FP&P Plan and as part of the

APP. Include a detailed discussion of the following: methods of rescue; methods of self-rescue; equipment used; training requirement; specialized training for the rescuers; procedures for requesting rescue and medical assistance; and transportation routes to a medical facility.

1.8.2.7 Hazardous Energy Control Program (HECP)

Develop a HECP in accordance with EM 385-1-1 Section 12, 29 CFR 1910.147, 29 CFR 1910.333, 29 CFR 1915.89, ASSP Z244.1, and ASSP A10.44. Submit this HECP as part of the Accident Prevention Plan (APP). Conduct a preparatory meeting and inspection with all effected personnel to coordinate all HECP activities. Document this meeting and inspection in accordance with EM 385-1-1, Section 12.A.02. Ensure that each employee is familiar with and complies with these procedures.

1.8.2.8 Excavation Plan

Identify the safety and health aspects of excavation, and provide and prepare the plan in accordance with EM 385-1-1 and Section 25.A.

1.8.2.9 Site Demolition Plan

Identify the safety and health aspects, and prepare in accordance with Section 02 41 00 DEMOLITION and referenced sources. Include engineering survey as applicable.

1.9 ACTIVITY HAZARD ANALYSIS (AHA)

Before beginning each activity, task or Definable Feature of Work (DFOW) involving a type of work presenting hazards not experienced in previous project operations, or where a new work crew or subcontractor is to perform the work, the Contractor(s) performing that work activity must prepare an AHA. AHAs must be developed by the Prime Contractor, subcontractor, or supplier performing the work, and provided for Prime Contractor review and approval before submitting to the Contracting Officer. AHAs must be signed by the SSHO, Superintendent, QC Manager and the subcontractor Foreman performing the work. Format the AHA in accordance with EM 385-1-1, Section 1 or as directed by the Contracting Officer. Submit the AHA for review at least 15 working days prior to the start of each activity task, or DFOW. The Government reserves the right to require the Contractor to revise and resubmit the AHA if it fails to effectively identify the work sequences, specific anticipated hazards, site conditions, equipment, materials, personnel and the control measures to be implemented.

AHAs must identify competent persons required for phases involving high risk activities, including confined entry, crane and rigging, excavations, trenching, electrical work, fall protection, and scaffolding.

1.9.1 AHA Management

Review the AHA list periodically (at least monthly) at the Contractor supervisory safety meeting, and update as necessary when procedures, scheduling, or hazards change. Use the AHA during daily inspections by the SSHO to ensure the implementation and effectiveness of the required safety and health controls for that work activity.

1.9.2 AHA Signature Log

Each employee performing work as part of an activity, task or DFOV must review the AHA for that work and sign a signature log specifically maintained for that AHA prior to starting work on that activity. The SSHO must maintain a signature log on site for every AHA. Provide employees whose primary language is other than English, with an interpreter to ensure a clear understanding of the AHA and its contents.

1.10 DISPLAY OF SAFETY INFORMATION

1.10.1 Safety Bulletin Board

Within one calendar day(s) after commencement of work, erect a safety bulletin board at the job site. Where size, duration, or logistics of project do not facilitate a bulletin board, an alternative method, acceptable to the Contracting Officer, that is accessible and includes all mandatory information for employee and visitor review, may be deemed as meeting the requirement for a bulletin board. Include and maintain information on safety bulletin board as required by EM 385-1-1, Section 01.A.07. Additional items required to be posted include:

- a. Confined space entry permit.
- b. Hot work permit.

1.10.2 Safety and Occupational Health (SOH) Deficiency Tracking System

Establish a SOH deficiency tracking system that lists and monitors the status of SOH deficiencies in chronological order. Use the tracking system to evaluate the effectiveness of the APP. A monthly evaluation of the data must be discussed in the QC or SOH meeting with everyone on the project. The list must be posted on the project bulletin board and updated daily, and provide the following information:

- a. Date deficiency identified;
- b. Description of deficiency;
- c. Name of person responsible for correcting deficiency;
- d. Projected resolution date;
- e. Date actually resolved.

1.11 SITE SAFETY REFERENCE MATERIALS

Maintain safety-related references applicable to the project, including those listed in paragraph REFERENCES. Maintain applicable equipment manufacturer's manuals.

1.12 EMERGENCY MEDICAL TREATMENT

Contractors must arrange for their own emergency medical treatment in accordance with EM 385-1-1. Government has no responsibility to provide emergency medical treatment.

1.13 NOTIFICATIONS and REPORTS

1.13.1 Mishap Notification

Notify the Contracting Officer as soon as practical, but no more than twenty-four hours, after any mishaps, including recordable accidents, incidents, and near misses, as defined in EM 385-1-1 Appendix Q, any report of injury, illness, or any property damage. For LHE or rigging mishaps, notify the Contracting Officer as soon as practical but not more than 4 hours after mishap. The Contractor is responsible for obtaining appropriate medical and emergency assistance and for notifying fire, law enforcement, and regulatory agencies. Immediate reporting is required for electrical mishaps, to include Arc Flash; shock; uncontrolled release of hazardous energy (includes electrical and non-electrical); load handling equipment or rigging; fall from height (any level other than same surface); and underwater diving. These mishaps must be investigated in depth to identify all causes and to recommend hazard control measures.

Within notification include Contractor name; contract title; type of contract; name of activity, installation or location where accident occurred; date and time of accident; names of personnel injured; extent of property damage, if any; extent of injury, if known, and brief description of accident (for example, type of construction equipment used and PPE used). Preserve the conditions and evidence on the accident site until the Government investigation team arrives on-site and Government investigation is conducted. Assist and cooperate fully with the Government's investigation(s) of any mishap.

1.13.2 LHE Inspection Reports

Submit LHE inspection reports required in accordance with EM 385-1-1 and as specified herein with Daily Reports of Inspections.

1.13.3 Certificate of Compliance and Pre-lift Plan/Checklist for LHE and Rigging

Provide a FORM 16-1 Certificate of Compliance for LHE entering an activity under this contract and in accordance with EM 385-1-1. Post certifications on the crane.

Develop a Standard Lift Plan (SLP) in accordance with EM 385-1-1, Section 16.H.03 using Form 16-2 Standard Pre-Lift Crane Plan/Checklist for each lift planned. Submit SLP to the Contracting Officer for approval within 15 calendar days in advance of planned lift.

1.14 HOT WORK

1.14.1 Permit and Personnel Requirements

Submit and obtain a written permit prior to performing "Hot Work" (i.e. welding or cutting) or operating other flame-producing/spark producing devices, from the Fire Division. A permit is required from the Explosives Safety Office for work in and around where explosives are processed, stored, or handled. CONTRACTORS ARE REQUIRED TO MEET ALL CRITERIA BEFORE A PERMIT IS ISSUED. Provide at least two 20 pound 4A:20 BC rated extinguishers for normal "Hot Work". The extinguishers must be current inspection tagged, and contain an approved safety pin and tamper resistant seal. It is also mandatory to have a designated FIRE WATCH for any "Hot Work" done at this activity. The Fire Watch must be trained in accordance

with NFPA 51B and remain on-site for a minimum of one hour after completion of the task or as specified on the hot work permit.

When starting work in the facility, require personnel to familiarize themselves with the location of the nearest fire alarm boxes and place in memory the emergency Fire Division phone number. REPORT ANY FIRE, NO MATTER HOW SMALL, TO THE RESPONSIBLE FIRE DIVISION IMMEDIATELY.

1.14.2 Work Around Flammable Materials

Obtain permit approval from a NFPA Certified Marine Chemist for "HOT WORK" within or around flammable materials (such as fuel systems or welding/cutting on fuel pipes) or confined spaces (such as sewer wet wells, manholes, or vaults) that have the potential for flammable or explosive atmospheres.

Whenever these materials, except beryllium and chromium (VI), are encountered in indoor operations, local mechanical exhaust ventilation systems that are sufficient to reduce and maintain personal exposures to within acceptable limits must be used and maintained in accordance with manufacturer's instruction and supplemented by exceptions noted in EM 385-1-1, Section 06.H

1.15 RADIATION SAFETY REQUIREMENTS

Submit License Certificates, employee training records, and Leak Test Reports for radiation materials and equipment to the Contracting Officer and Radiation Safety Office (RSO) for all specialized and licensed material and equipment proposed for use on the construction project (excludes portable machine sources of ionizing radiation including moisture density and X-Ray Fluorescence (XRF)). Maintain on-site records whenever licensed radiological materials or ionizing equipment are on government property.

Protect workers from radiation exposure in accordance with 10 CFR 20, ensuring any personnel exposures are maintained As Low As Reasonably Achievable.

1.15.1 Radiography Operation Planning Work Sheet

Submit a Gamma and X-Ray Radiography Operation Planning Work Sheet to Contracting Officer 14 days prior to commencement of operations involving radioactive materials or radiation generating devices. For portable machine sources of ionizing radiation, including moisture density and XRF, use and submit the Portable Gauge Operations Planning Worksheet instead. The Contracting Officer will review the submitted worksheet and provide questions and comments.

Contractors must use primary dosimeters process by a National Voluntary Laboratory Accreditation Program (NVLAP) accredited laboratory.

1.15.2 Site Access and Security

Coordinate site access and security requirements with the Contracting Officer for all radiological materials and equipment containing ionizing radiation that are proposed for use on a government facility. For gamma radiography materials and equipment, a Government escort is required for any travels on the Installation. The Government authorized representative will meet the Contractor at a designated location outside the Installation, ensure safety of the materials being transported, and will

escort the Contractor for gamma sources onto the Installation, to the job site, and off the Installation. For portable machine sources of ionizing radiation, including moisture density and XRF, the Government authorized representative will meet the Contractor at the job site.

Provide a copy of all calibration records, and utilization records for radiological operations performed on the site.

1.15.3 Loss or Release and Unplanned Personnel Exposure

Loss or release of radioactive materials, and unplanned personnel exposures must be reported immediately to the Contracting Officer, RSO, and Base Security Department Emergency Number.

1.15.4 Site Demarcation and Barricade

Properly demark and barricade an area surrounding radiological operations to preclude personnel entrance, in accordance with EM 385-1-1, Nuclear Regulatory Commission, and Applicable State regulations and license requirements, and in accordance with requirements established in the accepted Radiography Operation Planning Work Sheet.

Do not close or obstruct streets, walks, and other facilities occupied and used by the Government without written permission from the Contracting Officer.

1.15.5 Security of Material and Equipment

Properly secure the radiological material and ionizing radiation equipment at all times, including keeping the devices in a properly marked and locked container, and secondarily locking the container to a secure point in the Contractor's vehicle or other approved storage location during transportation and while not in use. While in use, maintain a continuous visual observation on the radiological material and ionizing radiation equipment. In instances where radiography is scheduled near or adjacent to buildings or areas having limited access or one-way doors, make no assumptions as to building occupancy. Where necessary, the Contracting Officer will direct the Contractor to conduct an actual building entry, search, and alert. Where removal of personnel from such a building cannot be accomplished and it is otherwise safe to proceed with the radiography, position a fully instructed employee inside the building or area to prevent exiting while external radiographic operations are in process.

1.15.6 Transportation of Material

Comply with 49 CFR 173 for Transportation of Regulated Amounts of Radioactive Material. Notify Local Fire authorities and the site Radiation Safety officer (RSO) of any Radioactive Material use.

1.15.7 Schedule for Exposure or Unshielding

Actual exposure of the radiographic film or unshielding the source must not be initiated until after 5 p.m. on weekdays.

1.15.8 Transmitter Requirements

Adhere to the base policy concerning the use of transmitters, such as radios and cell phones. Obey Emissions control (EMCON) restrictions.

1.16 CONFINED SPACE ENTRY REQUIREMENTS

Confined space entry must comply with Section 34 of EM 385-1-1, OSHA 29 CFR 1926, OSHA 29 CFR 1910, OSHA 29 CFR 1910.146, and OSHA Directive CPL 2.100. Any potential for a hazard in the confined space requires a permit system to be used.

1.16.1 Entry Procedures

Prohibit entry into a confined space by personnel for any purpose, including hot work, until the qualified person has conducted appropriate tests to ensure the confined or enclosed space is safe for the work intended and that all potential hazards are controlled or eliminated and documented. Comply with EM 385-1-1, Section 34 for entry procedures. Hazards pertaining to the space must be reviewed with each employee during review of the AHA.

1.16.2 Forced Air Ventilation

Forced air ventilation is required for all confined space entry operations and the minimum air exchange requirements must be maintained to ensure exposure to any hazardous atmosphere is kept below its action level.

1.16.3 Sewer Wet Wells

Sewer wet wells require continuous atmosphere monitoring with audible alarm for toxic gas detection.

1.16.4 Rescue Procedures and Coordination with Local Emergency Responders

Develop and implement an on-site rescue and recovery plan and procedures. The rescue plan must not rely on local emergency responders for rescue from a confined space.

1.17 GAS PROTECTION

Provide one or more employees, properly trained and experienced in operation and calibration of gas testing equipment and formally qualified as gas inspectors, on duty during times workers are in confined spaces. Their primary functions are to test for gas and operate testing equipment. Unless equipment of constant supervisory type with automatic alarm is employed, provide gas tests at least every 2 hours, or more often when character of ground or experience indicates gas may be encountered. After an idle period exceeding one-half hour, perform a gas test before permitting workers to enter the excavation.

1.17.1 Gas Test Readings Record

Permanently record readings daily; indicate the concentration of gas, point of test, and time of test. Submit copies of the gas test readings to the Contracting Officer at the end of each work day.

1.17.2 Special Requirements

Special requirements, coordination, and precautions will apply to areas that contain a hazardous atmosphere or, by virtue of their use or physical character, may be oxygen deficient. A check by Government is required prior to entering confined space. Surveillance and monitoring are required in these types of work spaces by both Contractor and Government

personnel.

1.18 HIGH NOISE LEVEL PROTECTION

Schedule operations that involve the use of equipment with output of high noise levels (i.e. jackhammers, air compressors, and explosive-actuated devices) for weekends or after duty working hours. Use of any such equipment must be approved in writing by the Contracting Officer prior to commencement of work.

1.19 SEVERE STORM PLAN

In the event of a severe storm warning, the Contractor must:

- a. Secure outside equipment and materials and place materials that could be damaged in protected areas.
- b. Check surrounding area, including roof, for loose material, equipment, debris, and other objects that could be blown away or against existing facilities.
- c. Ensure that temporary erosion controls are adequate.

PART 2 PRODUCTS

Not used.

2.1 CONFINED SPACE SIGNAGE

Provide permanent signs integral to or securely attached to access covers for new permit-required confined spaces. Signs for confined spaces must comply with NEMA Z535.2. Signs wording: "DANGER--PERMIT-REQUIRED CONFINED SPACE, DO NOT ENTER" in bold letters a minimum of one inch in height and constructed to be clearly legible with all paint removed. The signal word "DANGER" must be red and readable from 5 feet.

PART 3 EXECUTION

3.1 CONSTRUCTION AND OTHER WORK

Comply with EM 385-1-1, NFPA 70, NFPA 70E, NFPA 241, the APP, the AHA, Federal and State OSHA regulations, and other related submittals and activity fire and safety regulations. The most stringent standard prevails.

PPE is governed in all areas by the nature of the work the employee is performing. Use personal hearing protection at all times in designated noise hazardous areas or when performing noise hazardous tasks. Safety glasses must be worn or carried/available on each person. Mandatory PPE includes:

- a. Hard Hat
- b. Long Pants
- c. Appropriate Safety Shoes
- d. Appropriate Class Reflective Vests

3.1.1 Worksite Communication

Employees working alone in a remote location or away from other workers must be provided an effective means of emergency communications (i.e., cellular phone, two-way radios, land-line telephones or other acceptable means). The selected communication must be readily available (easily within the immediate reach) of the employee and must be tested prior to the start of work to verify that it effectively operates in the area/environment. An employee check-in/check-out communication procedure must be developed to ensure employee safety.

3.1.2 Hazardous Material Use

Each hazardous material must receive approval from the Contracting Office or their designated representative prior to being brought onto the job site or prior to any other use in connection with this contract. Allow a minimum of 10 working days for processing of the request for use of a hazardous material.

3.1.3 Hazardous Material Exclusions

Notwithstanding any other hazardous material used in this contract, radioactive materials or instruments capable of producing ionizing/non-ionizing radiation (with the exception of radioactive material and devices used in accordance with EM 385-1-1 such as nuclear density meters for compaction testing and laboratory equipment with radioactive sources) as well as materials which contain asbestos, mercury or polychlorinated biphenyls, di-isocyanates, lead-based paint, and hexavalent chromium, are prohibited. The Contracting Officer, upon written request by the Contractor, may consider exceptions to the use of any of the above excluded materials. Low mercury lamps used within fluorescent lighting fixtures are allowed as an exception without further Contracting Officer approval. Notify the Radiation Safety Officer (RSO) prior to excepted items of radioactive material and devices being brought on base.

3.1.4 Unforeseen Hazardous Material

Contract documents identify materials such as PCB, lead paint, and friable and non-friable asbestos and other OSHA regulated chemicals (i.e. 29 CFR Part 1910.1000). If material(s) that may be hazardous to human health upon disturbance are encountered during construction operations, stop that portion of work and notify the Contracting Officer immediately. Within 14 calendar days the Government will determine if the material is hazardous. If material is not hazardous or poses no danger, the Government will direct the Contractor to proceed without change. If material is hazardous and handling of the material is necessary to accomplish the work, the Government will issue a modification pursuant to FAR 52.243-4 Changes and FAR 52.236-2 Differing Site Conditions.

3.2 UTILITY OUTAGE REQUIREMENTS

Apply for utility outages at least 7 days in advance. At a minimum, the written request must include the location of the outage, utilities being affected, duration of outage, any necessary sketches, and a description of the means to fulfill energy isolation requirements in accordance with EM 385-1-1, Section 11.A.02 (Isolation). Some examples of energy isolation devices and procedures are highlighted in EM 385-1-1, Section 12.D. In accordance with EM 385-1-1, Section 12.A.01, where outages

involve Government or Utility personnel, coordinate with the Government on all activities involving the control of hazardous energy.

These activities include, but are not limited to, a review of HECP and HEC procedures, as well as applicable Activity Hazard Analyses (AHAs). In accordance with EM 385-1-1, Section 11.A.02 and NFPA 70E, work on energized electrical circuits must not be performed without prior government authorization. Government permission is considered through the permit process and submission of a detailed AHA. Energized work permits are considered only when de-energizing introduces additional or increased hazard or when de-energizing is infeasible.

3.3 OUTAGE COORDINATION MEETING

After the utility outage request is approved and prior to beginning work on the utility system requiring shut-down, conduct a pre-outage coordination meeting in accordance with EM 385-1-1, Section 12.A. This meeting must include the Prime Contractor, the Prime and subcontractors performing the work, the Contracting Officer, and the Installation representative. All parties must fully coordinate HEC activities with one another. During the coordination meeting, all parties must discuss and coordinate on the scope of work, HEC procedures (specifically, the lock-out/tag-out procedures for worker and utility protection), the AHA, assurance of trade personnel qualifications, identification of competent persons, and compliance with HECP training in accordance with EM 385-1-1, Section 12.C. Clarify when personal protective equipment is required during switching operations, inspection, and verification.

3.4 CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT)

Provide and operate a Hazardous Energy Control Program (HECP) in accordance with EM 385-1-1 Section 12, 29 CFR 1910.333, 29 CFR 1915.89, ASSP A10.44, NFPA 70E, and paragraph HAZARDOUS ENERGY CONTROL PROGRAM (HECP).

3.4.1 Safety Preparatory Inspection Coordination Meeting with the Government or Utility

For electrical distribution equipment that is to be operated by Government or Utility personnel, the Prime Contractor and the subcontractor performing the work must attend the safety preparatory inspection coordination meeting, which will also be attended by the Contracting Officer's Representative, and required by EM 385-1-1, Section 12.A.02. The meeting will occur immediately preceding the start of work and following the completion of the outage coordination meeting. Both the safety preparatory inspection coordination meeting and the outage coordination meeting must occur prior to conducting the outage and commencing with lockout/tagout procedures.

3.4.2 Lockout/Tagout Isolation

Where the Government or Utility performs equipment isolation and lockout/tagout, the Contractor must place their own locks and tags on each energy-isolating device and proceed in accordance with the HECP. Before any work begins, both the Contractor and the Government or Utility must perform energy isolation verification testing while wearing required PPE detailed in the Contractor's AHA and required by EM 385-1-1, Sections 05.I and 11.B. Install personal protective grounds, with tags, to eliminate the potential for induced voltage in accordance with EM 385-1-1, Section

12.E.06.

3.4.3 Lockout/Tagout Removal

Upon completion of work, conduct lockout/tagout removal procedure in accordance with the HECP. In accordance with EM 385-1-1, Section 12.E.08, each lock and tag must be removed from each energy isolating device by the authorized individual or systems operator who applied the device. Provide formal notification to the Government (by completing the Government form if provided by Contracting Officer's Representative), confirming that steps of de-energization and lockout/tagout removal procedure have been conducted and certified through inspection and verification. Government or Utility locks and tags used to support the Contractor's work will not be removed until the authorized Government employee receives the formal notification.

3.5 FALL PROTECTION PROGRAM

Establish a fall protection program, for the protection of all employees exposed to fall hazards. Within the program include company policy, identify roles and responsibilities, education and training requirements, fall hazard identification, prevention and control measures, inspection, storage, care and maintenance of fall protection equipment and rescue and evacuation procedures in accordance with ASSP Z359.2 and EM 385-1-1, Sections 21.A and 21.D.

3.5.1 Training

Institute a fall protection training program. As part of the Fall Protection Program, provide training for each employee who might be exposed to fall hazards. Provide training by a competent person for fall protection in accordance with EM 385-1-1, Section 21.C. Document training and practical application of the competent person in accordance with EM 385-1-1, Section 21.C.04 and ASSP Z359.2 in the AHA.

3.5.2 Fall Protection Equipment and Systems

Enforce use of personal fall protection equipment and systems designated (to include fall arrest, restraint, and positioning) for each specific work activity in the Site Specific Fall Protection and Prevention Plan and AHA at all times when an employee is exposed to a fall hazard. Protect employees from fall hazards as specified in EM 385-1-1, Section 21.

Provide personal fall protection equipment, systems, subsystems, and components that comply with EM 385-1-1 Section 21.I, 29 CFR 1926.500 Subpart M, ASSP Z359.0, ASSP Z359.1, ASSP Z359.2, ASSP Z359.3, ASSP Z359.4, ASSP Z359.6, ASSP Z359.7, ASSP Z359.11, ASSP Z359.12, ASSP Z359.13, ASSP Z359.14, and ASSP Z359.15.

3.5.2.1 Additional Personal Fall Protection

In addition to the required fall protection systems, other protection such as safety skiffs, personal floatation devices, and life rings, are required when working above or next to water in accordance with EM 385-1-1, Sections 21.0 through 21.0.06. Personal fall protection systems and equipment are required when working from an articulating or extendible boom, swing stages, or suspended platform. In addition, personal fall protection systems are required when operating other equipment such as scissor lifts. The need for tying-off in such equipment is to prevent

ejection of the employee from the equipment during raising, lowering, travel, or while performing work.

3.5.2.2 Personal Fall Protection Harnesses

Only a full-body harness with a shock-absorbing lanyard or self-retracting lanyard is an acceptable personal fall arrest body support device. The use of body belts is not acceptable. Harnesses must have a fall arrest attachment affixed to the body support (usually a Dorsal D-ring) and specifically designated for attachment to the rest of the system. Snap hooks and carabiners must be self-closing and self-locking, capable of being opened only by at least two consecutive deliberate actions and have a minimum gate strength of 3,600 lbs in all directions. Use webbing, straps, and ropes made of synthetic fiber. The maximum free fall distance when using fall arrest equipment must not exceed 6 feet, unless the proper energy absorbing lanyard is used. Always take into consideration the total fall distance and any swinging of the worker (pendulum-like motion), that can occur during a fall, when attaching a person to a fall arrest system. All full body harnesses must be equipped with Suspension Trauma Preventers such as stirrups, relief steps, or similar in order to provide short-term relief from the effects of orthostatic intolerance in accordance with EM 385-1-1, Section 21.I.06.

3.5.3 Fall Protection for Roofing Work

Implement fall protection controls based on the type of roof being constructed and work being performed. Evaluate the roof area to be accessed for its structural integrity including weight-bearing capabilities for the projected loading.

a. Low Sloped Roofs:

- (1) For work within 6 feet of an edge, on a roof having a slope less than or equal to 4:12 (vertical to horizontal), protect personnel from falling by use of personal fall arrest/restraint systems, guardrails, or safety nets. A safety monitoring system is not adequate fall protection and is not authorized. Provide in accordance with 29 CFR 1926.500.
- (2) For work greater than 6 feet from an edge, erect and install warning lines in accordance with 29 CFR 1926.500 and EM 385-1-1, Section L.

b. Steep-Sloped Roofs: Work on a roof having a slope greater than 4:12 (vertical to horizontal) requires a personal fall arrest system, guardrails with toe-boards, or safety nets. This requirement also applies to residential or housing type construction.

3.5.4 Horizontal Lifelines (HLL)

Provide HLL in accordance with EM 385-1-1, Section 21.I.08.d.2. Commercially manufactured horizontal lifelines (HLL) must be designed, installed, certified and used, under the supervision of a qualified person, for fall protection as part of a complete fall arrest system which maintains a safety factor of 2 (29 CFR 1926.500). The competent person for fall protection may (if deemed appropriate by the qualified person) supervise the assembly, disassembly, use and inspection of the HLL system under the direction of the qualified person. Locally manufactured HLLs are not acceptable unless they are custom designed for limited or site

specific applications by a Registered Professional Engineer who is qualified in designing HLL systems.

3.5.5 Guardrails and Safety Nets

Design, install and use guardrails and safety nets in accordance with EM 385-1-1, Section 21.F.01 and 29 CFR 1926 Subpart M.

3.5.6 Rescue and Evacuation Plan and Procedures

When personal fall arrest systems are used, ensure that the mishap victim can self-rescue or can be rescued promptly should a fall occur. Prepare a Rescue and Evacuation Plan and include a detailed discussion of the following: methods of rescue; methods of self-rescue or assisted-rescue; equipment used; training requirement; specialized training for the rescuers; procedures for requesting rescue and medical assistance; and transportation routes to a medical facility. Include the Rescue and Evacuation Plan within the Activity Hazard Analysis (AHA) for the phase of work, in the Fall Protection and Prevention (FP&P) Plan, and the Accident Prevention Plan (APP). The plan must comply with the requirements of EM 385-1-1, ASSP Z359.2, and ASSP Z359.4.

3.6 WORK PLATFORMS

3.6.1 Scaffolding

Provide employees with a safe means of access to the work area on the scaffold. Climbing of any scaffold braces or supports not specifically designed for access is prohibited. Comply with the following requirements:

- a. Scaffold platforms greater than 20 feet in height must be accessed by use of a scaffold stair system.
- b. Ladders commonly provided by scaffold system manufacturers are prohibited for accessing scaffold platforms greater than 20 feet maximum in height.
- c. An adequate gate is required.
- d. Employees performing scaffold erection and dismantling must be qualified.
- e. Scaffold must be capable of supporting at least four times the maximum intended load, and provide appropriate fall protection as delineated in the accepted fall protection and prevention plan.
- f. Stationary scaffolds must be attached to structural building components to safeguard against tipping forward or backward.
- g. Special care must be given to ensure scaffold systems are not overloaded.
- h. Side brackets used to extend scaffold platforms on self-supported scaffold systems for the storage of material are prohibited. The first tie-in must be at the height equal to 4 times the width of the smallest dimension of the scaffold base.
- i. Scaffolding other than suspended types must bear on base plates upon wood mudsills (2 in x 10 in x 8 in minimum) or other adequate firm

foundation.

- j. Scaffold or work platform erectors must have fall protection during the erection and dismantling of scaffolding or work platforms that are more than 6 feet.
- k. Delineate fall protection requirements when working above 6 feet or above dangerous operations in the Fall Protection and Prevention (FP&P) Plan and Activity Hazard Analysis (AHA) for the phase of work.

3.6.2 Elevated Aerial Work Platforms (AWPs)

Workers must be anchored to the basket or bucket in accordance with manufacturer's specifications and instructions (anchoring to the boom may only be used when allowed by the manufacturer and permitted by the CP). Lanyards used must be sufficiently short to prohibit worker from climbing out of basket. The climbing of rails is prohibited. Lanyards with built-in shock absorbers are acceptable. Self-retracting devices are not acceptable. Tying off to an adjacent pole or structure is not permitted unless a safe device for 100 percent tie-off is used for the transfer.

Use of AWP's must be operated, inspected, and maintained as specified in the operating manual for the equipment and delineated in the AHA. Operators of AWP's must be designated as qualified operators by the Prime Contractor. Maintain proof of qualifications on site for review and include in the AHA.

3.7 EQUIPMENT

3.7.1 Material Handling Equipment (MHE)

- a. Material handling equipment such as forklifts must not be modified with work platform attachments for supporting employees unless specifically delineated in the manufacturer's printed operating instructions. Material handling equipment fitted with personnel work platform attachments are prohibited from traveling or positioning while personnel are working on the platform.
- b. The use of hooks on equipment for lifting of material must be in accordance with manufacturer's printed instructions. Material Handling Equipment Operators must be trained in accordance with OSHA 29 CFR 1910, Subpart N.
- c. Operators of forklifts or power industrial trucks must be licensed in accordance with OSHA.

3.7.2 Load Handling Equipment (LHE)

The following requirements apply. In exception, these requirements do not apply to commercial truck mounted and articulating boom cranes used solely to deliver material and supplies (not prefabricated components, structural steel, or components of a systems-engineered metal building) where the lift consists of moving materials and supplies from a truck or trailer to the ground; to cranes installed on mechanics trucks that are used solely in the repair of shore-based equipment; to crane that enter the activity but are not used for lifting; nor to other machines not used to lift loads suspended by rigging equipment. However, LHE accidents occurring during such operations must be reported.

- a. Equip cranes and derricks as specified in EM 385-1-1, Section 16.
- b. Notify the Contracting Officer 15 working days in advance of any LHE entering the activity, in accordance with EM 385-1-1, Section 16.A.02, so that necessary quality assurance spot checks can be coordinated. Prior to cranes entering federal activities, a Crane Access Permit must be obtained from the Contracting Officer. A copy of the permitting process will be provided at the Preconstruction Conference. Contractor's operator must remain with the crane during the spot check. Rigging gear must comply with OSHA, ASME B30.9 Standards safety standards.
- c. Comply with the LHE manufacturer's specifications and limitations for erection and operation of cranes and hoists used in support of the work. Perform erection under the supervision of a designated person (as defined in ASME B30.5). Perform all testing in accordance with the manufacturer's recommended procedures.
- d. Comply with ASME B30.5 for mobile and locomotive cranes, ASME B30.22 for articulating boom cranes, ASME B30.3 for construction tower cranes, ASME B30.8 for floating cranes and floating derricks, ASME B30.9 for slings, ASME B30.20 for below the hook lifting devices and ASME B30.26 for rigging hardware.
- e. When operating in the vicinity of overhead transmission lines, operators and riggers must be alert to this special hazard and follow the requirements of EM 385-1-1 Section 11, and ASME B30.5 or ASME B30.22 as applicable.
- f. Do not use crane suspended personnel work platforms (baskets) unless the Contractor proves that using any other access to the work location would provide a greater hazard to the workers or is impossible. Do not lift personnel with a line hoist or friction crane. Additionally, submit a specific AHA for this work to the Contracting Officer. Ensure the activity and AHA are thoroughly reviewed by all involved personnel.
- g. Inspect, maintain, and recharge portable fire extinguishers as specified in NFPA 10, Standard for Portable Fire Extinguishers.
- h. All employees must keep clear of loads about to be lifted and of suspended loads, except for employees required to handle the load.
- i. Use cribbing when performing lifts on outriggers.
- j. The crane hook/block must be positioned directly over the load. Side loading of the crane is prohibited.
- k. A physical barricade must be positioned to prevent personnel access where accessible areas of the LHE's rotating superstructure poses a risk of striking, pinching or crushing personnel.
- l. Maintain inspection records in accordance by EM 385-1-1, Section 16.D, including shift, monthly, and annual inspections, the signature of the person performing the inspection, and the serial number or other identifier of the LHE that was inspected. Records must be available for review by the Contracting Officer.
- m. Maintain written reports of operational and load testing in accordance

with EM 385-1-1, Section 16.F, listing the load test procedures used along with any repairs or alterations performed on the LHE. Reports must be available for review by the Contracting Officer.

- n. Certify that all LHE operators have been trained in proper use of all safety devices (e.g. anti-two block devices).
- o. Take steps to ensure that wind speed does not contribute to loss of control of the load during lifting operations. At wind speeds greater than 20 mph, the operator, rigger and lift supervisor must cease all crane operations, evaluate conditions and determine if the lift may proceed. Base the determination to proceed or not on wind calculations per the manufacturer and a reduction in LHE rated capacity if applicable. Include this maximum wind speed determination as part of the activity hazard analysis plan for that operation.
- p. On mobile cranes, lifts where the load weight is greater than 90 percent of the equipment's capacity are prohibited.

3.7.3 Machinery & Mechanized Equipment

- a. Proof of qualifications for operator must be kept on the project site for review.
- b. Manufacture specifications or owner's manual for the equipment must be on-site and reviewed for additional safety precautions or requirements that are sometimes not identified by OSHA or USACE EM 385-1-1. Incorporate such additional safety precautions or requirements into the AHAs.

3.7.4 Base Mounted Drum Hoists

- a. Operation of base mounted drum hoists must comply with EM 385-1-1 and ASSP A10.22.
- b. Rigging gear must comply with applicable ASME/OSHA standards
- c. When used on telecommunication towers, base mounted drum hoists must comply with TIA-1019, TIA-222, ASME B30.7, 29 CFR 1926.552, and 29 CFR 1926.553.
- d. When used to hoist personnel, the AHA must include a written standard operating procedure. Operators must have a physical examination in accordance with EM 385-1-1 Section 16.B.05 and trained, at a minimum, in accordance with EM 385-1-1 Section 16.U and 16.T. The base mounted drum hoist must also comply with OSHA Instruction CPL 02-01-056 and ASME B30.23.
- e. Material and personnel must not be hoisted simultaneously.
- f. Personnel cage must be marked with the capacity (in number of persons) and load limit in pounds.
- g. Construction equipment must not be used for hoisting material or personnel or with trolley/tag lines. Construction equipment may be used for towing and assisting with anchoring guy lines.

3.7.5 Use of Explosives

Explosives must not be used or brought to the project site without prior written approval from the Contracting Officer. Such approval does not relieve the Contractor of responsibility for injury to persons or for damage to property due to blasting operations.

3.8 EXCAVATIONS

Soil classification must be performed by a competent person in accordance with 29 CFR 1926 and EM 385-1-1.

3.8.1 Utility Locations

Provide a third party, independent, private utility locating company to positively identify underground utilities in the work area in addition to any station locating service and coordinated with the station utility department.

3.8.2 Utility Location Verification

Physically verify underground utility locations, including utility depth, by hand digging using wood or fiberglass handled tools when any adjacent construction work is expected to come within 3 feet of the underground system.

3.8.3 Utilities Within and Under Concrete, Bituminous Asphalt, and Other Impervious Surfaces

Utilities located within and under concrete slabs or pier structures, bridges, parking areas, and the like, are extremely difficult to identify. Whenever contract work involves chipping, saw cutting, or core drilling through concrete, bituminous asphalt or other impervious surfaces, the existing utility location must be coordinated with station utility departments in addition to location and depth verification by a third party, independent, private locating company. The third party, independent, private locating company must locate utility depth by use of Ground Penetrating Radar (GPR), X-ray, bore scope, or ultrasound prior to the start of demolition and construction. Outages to isolate utility systems must be used in circumstances where utilities are unable to be positively identified. The use of historical drawings does not alleviate the Contractor from meeting this requirement.

3.9 ELECTRICAL

Perform electrical work in accordance with EM 385-1-1, Appendix A, Sections 11 and 12.

3.9.1 Conduct of Electrical Work

As delineated in EM 385-1-1, electrical work is to be conducted in a de-energized state unless there is no alternative method for accomplishing the work. In those cases obtain an energized work permit from the Contracting Officer. The energized work permit application must be accompanied by the AHA and a summary of why the equipment/circuit needs to be worked energized. Underground electrical spaces must be certified safe for entry before entering to conduct work. Cables that will be cut must be positively identified and de-energized prior to performing each cut. Attach temporary grounds in accordance with ASTM F855 and IEEE 1048.

Perform all high voltage cable cutting remotely using hydraulic cutting tool. When racking in or live switching of circuit breakers, no additional person other than the switch operator is allowed in the space during the actual operation. Plan so that work near energized parts is minimized to the fullest extent possible. Use of electrical outages clear of any energized electrical sources is the preferred method.

When working in energized substations, only qualified electrical workers are permitted to enter. When work requires work near energized circuits as defined by NFPA 70, high voltage personnel must use personal protective equipment that includes, as a minimum, electrical hard hat, safety shoes, insulating gloves and electrical arc flash protection for personnel as required by NFPA 70E. Insulating blankets, hearing protection, and switching suits may also be required, depending on the specific job and as delineated in the Contractor's AHA. Ensure that each employee is familiar with and complies with these procedures and 29 CFR 1910.147.

3.9.2 Qualifications

Electrical work must be performed by QP personnel with verifiable credentials who are familiar with applicable code requirements. Verifiable credentials consist of State, National and Local Certifications or Licenses that a Master or Journeyman Electrician may hold, depending on work being performed, and must be identified in the appropriate AHA. Journeyman/Apprentice ratio must be in accordance with State, Local requirements applicable to where work is being performed.

3.9.3 Arc Flash

Conduct a hazard analysis/arc flash hazard analysis whenever work on or near energized parts greater than 50 volts is necessary, in accordance with NFPA 70E.

All personnel entering the identified arc flash protection boundary must be QPs and properly trained in NFPA 70E requirements and procedures. Unless permitted by NFPA 70E, no Unqualified Person is permitted to approach nearer than the Limited Approach Boundary of energized conductors and circuit parts. Training must be administered by an electrically qualified source and documented.

3.9.4 Grounding

Ground electrical circuits, equipment and enclosures in accordance with NFPA 70 and IEEE C2 to provide a permanent, continuous and effective path to ground unless otherwise noted by EM 385-1-1.

Check grounding circuits to ensure that the circuit between the ground and a grounded power conductor has a resistance low enough to permit sufficient current flow to allow the fuse or circuit breaker to interrupt the current.

3.9.5 Testing

Temporary electrical distribution systems and devices must be inspected,

tested and found acceptable for Ground-Fault Circuit Interrupter (GFCI) protection, polarity, ground continuity, and ground resistance before initial use, before use after modification and at least monthly. Monthly inspections and tests must be maintained for each temporary electrical distribution system, and signed by the electrical CP or QP.

-- End of Section --

This page left blank.

SECTION 01 42 00

SOURCES FOR REFERENCE PUBLICATIONS

02/19

PART 1 GENERAL

1.1 REFERENCES

Various publications are referenced in other sections of the specifications to establish requirements for the work. These references are identified in each section by document number, date and title. The document number used in the citation is the number assigned by the standards producing organization (e.g., ASTM B564 Standard Specification for Nickel Alloy Forgings). However, when the standards producing organization has not assigned a number to a document, an identifying number has been assigned for reference purposes.

1.2 ORDERING INFORMATION

The addresses of the standards publishing organizations whose documents are referenced in other sections of these specifications are listed below, and if the source of the publications is different from the address of the sponsoring organization, that information is also provided.

AACE INTERNATIONAL (AACE)
1265 Suncrest Towne Centre Drive
Morgantown, WV 26505-1876 USA
Ph: 304-296-8444
Fax: 304-291-5728
Internet: <https://web.aacei.org/>

ACOUSTICAL SOCIETY OF AMERICA (ASA)
1305 Walt Whitman Road, Suite 300
Melville, NY 11747-4300
Ph: 516-576-2360
Fax: 631-923-2875
E-mail: asa@acousticalsociety.org
Internet: <https://acousticalsociety.org/>

AEROSPACE INDUSTRIES ASSOCIATION OF AMERICA, INC. (AIA/NAS)
1000 Wilson Blvd, Suite 1700
Arlington, VA 22209-3928
Ph: 703-358-1000
E-mail: aia@aia-aerospace.org
Internet: <https://www.aia-aerospace.org/>

AIR BARRIER ASSOCIATION OF AMERICA (ABAA)
1600 Boston-Providence Hwy
Walpole, MA 02081
Ph: 1-866-956-5888
Fax: 1-866-956-5819
Internet: <https://www.airbarrier.org/>

AIR CONDITIONING CONTRACTORS OF AMERICA (ACCA)
2800 Shirlington Road, Suite 300
Arlington, VA 22206
Ph: 703-575-4477

Internet: <https://www.acca.org/>

AIR DUCT COUNCIL (ADC)
1901 N. Roselle Road, Suite 800
Schaumburg, IL 60195
Ph: 847-706-6750
Fax: 847-706-6751
E-mail: info@flexibleduct.org
Internet: <https://flexibleduct.org/>

AIR MOVEMENT AND CONTROL ASSOCIATION INTERNATIONAL, INC. (AMCA)
30 West University Drive
Arlington Heights, IL 60004-1893
Ph: 847-394-0150
Fax: 847-253-0088
E-mail: communications@amca.org
Internet: <http://www.amca.org>

AIR-CONDITIONING, HEATING AND REFRIGERATION INSTITUTE (AHRI)
2111 Wilson Blvd, Suite 400
Arlington, VA 22201
Ph: 703-524-8800
Internet: <http://www.ahrinet.org>

ALLIANCE FOR TELECOMMUNICATIONS INDUSTRY SOLUTIONS (ATIS)
1200 G Street, NW, Suite 500
Washington, D.C. 20005
Ph: 202-628-6380
E-mail: nbutler@atis.org
Internet: <http://www.atis.org>

ALUMINUM ASSOCIATION (AA)
1400 Crystal Drive
Suite 430
Arlington, VA 22202
Ph: 703-358-2960
E-Mail: info@aluminum.org
Internet: <https://www.aluminum.org/>

AMERICAN ARCHITECTURAL MANUFACTURERS ASSOCIATION (AAMA)
1900 E Golf Rd, Suite 1250
Schaumburg, IL 60173
Ph: 847-303-5664
E-mail: customerservice@aamanet.org
Internet: <https://aamanet.org/>

AMERICAN ASSOCIATION OF RADON SCIENTISTS AND TECHNOLOGISTS (AARST)
475 South Church Street - Suite 600
Hendersonville, NC 28792
Ph: 800-269-4174
Fax: 828-214-6299
E-mail: info@aarst.org
Internet: <http://aarst-nrpp.com/wp/>

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS
(AASHTO)
444 North Capital Street, NW, Suite 249
Washington, DC 20001
Ph: 202-624-5800

Fax: 202-624-5806
E-Mail: info@aaashto.org
Internet: <https://www.transportation.org/>

AMERICAN ASSOCIATION OF TEXTILE CHEMISTS AND COLORISTS (AATCC)
1 Davis Drive
P.O. Box 12215
Research Triangle Park, NC 27709-2215
Ph: 919-549-8141
Fax: 919-549-8933
Internet: <https://www.aatcc.org/>

AMERICAN BEARING MANUFACTURERS ASSOCIATION (ABMA)
330 N. Wabash Ave., Suite 2000
Chicago, IL 60611
Ph: 202-367-1155
E-mail: info@americanbearings.org
Internet: <https://www.americanbearings.org/>

AMERICAN BOILER MANUFACTURERS ASSOCIATION (ABMA/BOIL)
8221 Old Courthouse Road, Suite 380
Vienna, VA 22182
Ph: 703-356-7172
E-mail: info@abma.com
Internet: <https://www.abma.com/>

AMERICAN BUREAU OF SHIPPING (ABS)
ABS Plaza
1701 City Plaza Drive
Spring, TX 77389 United States
Ph: 281-877-6000
Fax: 281-877-5976
E-Mail: ABS-WorldHQ@eagle.org
Internet: <https://ww2.eagle.org/>

AMERICAN COLLEGE OF RADIOLOGY (ACR)
1891 Preston White Dr.
Reston, VA 20191
Ph: 703-648-8900
E-mail: info@acr.org
Internet: <https://www.acr.org/>

AMERICAN COMPOSITES MANUFACTURER'S ASSOCIATION (ACMA)
2000 N. 15th St, Suite 250
Arlington, VA 22201
Ph: 703-525-0511
Fax: 703-525-0743
Internet: <https://acmanet.org>

AMERICAN CONCRETE INSTITUTE (ACI)
38800 Country Club Drive
Farmington Hills, MI 48331-3439
Ph: 248-848-3700
Fax: 248-848-3701
Internet: <https://www.concrete.org/>

AMERICAN CONCRETE PIPE ASSOCIATION (ACPA)
8445 Freeport Parkway, Suite 350
Irving, TX 75063-2595

Ph: 972-506-7216
Fax: 972-506-7682
E-mail: info@concrete-pipe.org
Internet: <https://www.concretepipe.org/>

AMERICAN CONFERENCE OF GOVERNMENTAL INDUSTRIAL HYGIENISTS (ACGIH)
1330 Kemper Meadow Drive
Cincinnati, OH 45240
Ph: 513-742-2020
Fax: 513-742-3355
Internet: <https://www.acgih.org/>

AMERICAN FOREST FOUNDATION (AFF)
American Tree Farm System
2000 M Street, NW, Suite 550
Washington, DC 20036
Ph: 202-765-3660
Fax: 202-827-7924
Email: info@forestfoundation.org
Internet: <https://www.treefarmssystem.org>

AMERICAN FOREST AND PAPER ASSOCIATION (AF&PA)
American Wood Council
Public Policy Office
1101 K Street NW, Suite 700
Washington, DC 20005
Ph: 800-890-7732 or 202-463-2766
Fax: 412-741-0609
E-mail: publications@awc.org
Internet: <https://www.awc.org/>

AMERICAN GAS ASSOCIATION (AGA)
400 North Capitol Street, NW
Suite 450
Washington, D.C. 20001
Ph: 202-824-7000
Internet: <https://www.aga.org/>

AMERICAN GEAR MANUFACTURERS ASSOCIATION (AGMA)
1001 N. Fairfax Street, Suite 500
Alexandria, VA 22314-1587
Ph: 703-684-0211
Fax: 703-684-0242
E-mail: tech@agma.org
Internet: <https://www.agma.org/>

AMERICAN HARDBOARD ASSOCIATION (AHA)
1210 West Northwest Highway
Palatine, IL 60067
Ph: 847-934-8800
Fax: 847-934-8803
E-mail: aha@hardboard.org
Internet: <http://domensino.com/AHA/>

AMERICAN INDUSTRIAL HYGIENE ASSOCIATION (AIHA)
3141 Fairview Park Dr, Suite 777
Falls Church, VA 22042
Tel: 703-849-8888
Fax: 703-207-3561

E-mail: infonet@aiha.org
Internet: <https://www.aiha.org/>

AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC)
130 East Randolph, Suite 2000
Chicago, IL 60601
Ph: 312-670-5444
Fax: 312-670-5403
Steel Solutions Center: 866-275-2472
E-mail: solutions@aisc.org
Internet: <https://www.aisc.org/>

AMERICAN INSTITUTE OF TIMBER CONSTRUCTION (AITC)
7012 South Revere Parkway, Suite 140
Centennial, CO 80112
Ph: 503-639-0651
Fax: 503-684-8928
E-mail: mschoen@wclib.org
Internet: <http://www.aitc-glulam.org>

AMERICAN IRON AND STEEL INSTITUTE (AISI)
25 Massachusetts Avenue, NW Suite 800
Washington, DC 20001
Ph: 202-452-7100
Internet: <https://www.steel.org/>

AMERICAN LADDER INSTITUTE (ALI)
330 N. Wabash, Suite 2000
Chicago, IL 60611
Ph: 312-321-6806
Fax: 312-673-6929
E-mail: info@americanladderinstitute.org
Internet: <https://www.americanladderinstitute.org>

AMERICAN LUMBER STANDARDS COMMITTEE (ALSC)
7470 New Technology Way, Suite F
Frederick, MD 21703
Ph: 301-972-1700
Fax: 301-540-8004
E-mail: alsc@alsc.org
Internet: <http://www.alsc.org>

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)
1899 L Street, NW, 11th Floor
Washington, DC 20036
Ph: 202-293-8020
Fax: 202-293-9287
E-mail: storemanager@ansi.org
Internet: <https://www.ansi.org/>

AMERICAN PETROLEUM INSTITUTE (API)
1220 L Street, NW
Washington, DC 20005-4070
Ph: 202-682-8000
Internet: <https://www.api.org/>

AMERICAN RAILWAY ENGINEERING AND MAINTENANCE-OF-WAY ASSOCIATION
(AREMA)
4501 Forbes Blvd., Suite 130

Lanham, MD 20706
Ph: 301-459-3200
E-mail: info@arema.org
Internet: <https://www.arema.org>

AMERICAN SOCIETY FOR NONDESTRUCTIVE TESTING (ASNT)
P.O. Box 28518
1711 Arlingate Lane
Columbus, OH 43228-0518
Ph: 800-222-2768 or 614-274-6003
Fax: 614-274-6899
E-mail: tjones@asnt.org
Internet: <https://www.asnt.org/>

AMERICAN SOCIETY FOR QUALITY (ASQ)
600 North Plankinton Avenue
Milwaukee, WI 53203
-or-
P.O. Box 3005
Milwaukee, WI 53201-3005
Ph: 800-248-1946; 414-272-8575
Fax: 414-272-1734
E-mail: help@asq.org
Internet: <https://asq.org/>

AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)
1801 Alexander Bell Drive
Reston, VA 20191
Ph: 800-548-2723; 703-295-6300
Internet: <https://www.asce.org/>

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING
ENGINEERS (ASHRAE)
1791 Tullie Circle, NE
Atlanta, GA 30329
Ph: 404-636-8400 or 800-527-4723
Fax: 404-321-5478
E-mail: ashrae@ashrae.org
Internet: <https://www.ashrae.org/>

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)
Two Park Avenue
New York, NY 10016-5990
Ph: 800-843-2763
Fax: 973-882-1717
E-mail: customercare@asme.org
Internet: <https://www.asme.org/>

AMERICAN SOCIETY OF SAFETY PROFESSIONALS (ASSP)
520 N. Northwest Highway
Park Ridge, IL 60068
Ph: 847-699-2929
E-mail: customerservice@assp.org
Internet: <https://www.assp.org/>

AMERICAN SOCIETY OF SANITARY ENGINEERING (ASSE)
18927 Hickory Creek Drive, Suite 220
Mokena, IL 60448
Ph: 708-995-3019

Fax: 708-479-6139
Internet: <http://www.asse-plumbing.org>

AMERICAN WATER WORKS ASSOCIATION (AWWA)
6666 W. Quincy Avenue
Denver, CO 80235 USA
Ph: 303-794-7711 or 800-926-7337
Fax: 303-347-0804
Internet: <https://www.awwa.org/>

AMERICAN WELDING SOCIETY (AWS)
8669 NW 36 Street, #130
Miami, FL 33166-6672
Ph: 800-443-9353
Internet: <https://www.aws.org/>

AMERICAN WIND ENERGY ASSOCIATION (AWEA)
1501 M St. NW, Suite 900
Washington, DC 20005
Ph: 202-383-2500
Internet: <https://www.awea.org/>

AMERICAN WOOD COUNCIL (AWC)
222 Catoctin Circle SE, Suite 201
Leesburg, VA 20175
Ph: 800-890-7732
Fax: 412-741-0609
E-mail: publications@awc.org
Internet: <https://www.awc.org/>

AMERICAN WOOD PROTECTION ASSOCIATION (AWPA)
P.O. Box 361784
Birmingham, AL 35236-1784
Ph: 205-733-4077
Fax: 205-733-4075
Internet: <http://www.awpa.com>

AmericanHort (AH)
2130 Stella Court
Columbus, OH 43215
Ph: 614-487-1117 OH
Ph: 202-789-2900 DC
Internet: <https://www.americanhort.org/>

APA - THE ENGINEERED WOOD ASSOCIATION (APA)
7011 South 19th St.
Tacoma, WA 98466-5333
Ph: 253-565-6600
Fax: 253-565-7265
Internet: <https://www.apawood.org/>

ARCHITECTURAL WOODWORK INSTITUTE (AWI)
46179 Westlake Drive, Suite 120
Potomac Falls, VA 20165
Ph: 571-323-3636
Fax: 571-323-3630
E-mail: info@awinet.org
Internet: <http://www.awinet.org>

ARCNET TRADE ASSOCIATION (ATA)
E-mail: info@arcnet.com
Internet: <http://www.arcnet.com/index.htm></URL

ASM INTERNATIONAL (ASM)
9639 Kinsman Road
Materials Park, OH 44073-0002
Ph: 440-338-5151 (US), 440-462-0292 (International)
E-mail: memberservicecenter@asminternational.org
Internet: <https://www.asminternational.org/>

ASPHALT INSTITUTE (AI)
2696 Research Park Drive
Lexington, KY 40511-8480
Ph: 859-288-4960
Fax: 859-288-4999
E-mail: info@asphaltinstitute.org
Internet: <http://www.asphaltinstitute.org>

ASPHALT RECYCLING AND RECLAIMING ASSOCIATION (ARRA)
800 Roosevelt Road, Building C-312
Glen Ellyn, IL 60137
Ph: 630-942-6578
E-mail: annew@cmservices.com
Internet: <https://www.arra.org/>

ASPHALT ROOFING MANUFACTURER'S ASSOCIATION (ARMA)
750 National Press Building
529 14th Street, NW
Washington, DC 20045
Ph: 202-591-2450
Fax: 202-591-2445
Internet: <https://asphaltroofing.org/>

ASSOCIATED AIR BALANCE COUNCIL (AABC)
1220 19th St NW, Suite 410
Washington, DC 20036
Ph: 202-737-0202
Fax: 202-315-0285
E-mail: info@aabc.com
Internet: <https://www.aabc.com/>

ASSOCIATION FOR IRON AND STEEL TECHNOLOGY (AIST)
186 Thorn Hill Road
Warrendale, PA 15086
Ph: 724-814-3000
Fax: 724-814-3001
E-Mail: memberservices@aist.org
Internet: <https://www.aist.org/publications-advertising>

ASSOCIATION FOR THE ADVANCEMENT OF MEDICAL INSTRUMENTATION (AAMI)
901 N. Glebe Road, Suite 300
Arlington, VA 22203
Ph: 703-525-4890
Fax: 703-276-0793
E-mail: customerservice@aami.org
Internet: <http://www.aami.org>

ASSOCIATION OF EDISON ILLUMINATING COMPANIES (AEIC)
600 North 18th Street
P.O. Box 2641
Birmingham, AL 35291
Ph: 205-257-3839
Fax: 205-257-2540
Internet: <https://aeic.org/>

ASSOCIATION OF HOME APPLIANCE MANUFACTURERS (AHAM)
1111 19th Street NW, Suite 402
Washington, DC 20036
Ph: 202-872-5955
E-mail: info@aham.org
Internet: <http://www.aham.org>

ASSOCIATION OF POOL & SPA PROFESSIONALS (APSP)
2111 Eisenhower Avenue, Suite 500
Alexandria, VA 22314-4679
Ph: 703-838-0083
Fax: 703-549-0493
E-mail: memberservices@apsp.org
Internet: <https://apsp.org/>

ASSOCIATION OF THE WALL AND CEILING INDUSTRY (AWCI)
513 West Broad Street, Suite 210
Falls Church, VA 22046
Ph: 703-538-1600
Fax: 703-534-8307
Internet: <https://www.awci.org/>

ASTM INTERNATIONAL (ASTM)
100 Barr Harbor Drive, P.O. Box C700
West Conshohocken, PA 19428-2959
Ph: 610-832-9500
Fax: 610-832-9555
E-mail: service@astm.org
Internet: <https://www.astm.org/>

AUDIOVISUAL AND INTEGRATED EXPERIENCE ASSOCIATION (AVIXA)
11242 Waples Mill Road
Suite 200
Fairfax, VA 22030
Ph: 703-273-7200/800-659-7469
E-mail: membership@avixa.org
Internet: <https://www.avixa.org/>

BACNET INTERNATIONAL (BTL)
BACnet Testing Laboratories
1827 Powers Ferry Road
Building 14, Suite 100
Atlanta, GA 30339
Ph: 770-971-6003
Fax: 678-229-2777
E-mail: info@bacnetinternational.org
Internet: <https://www.bacnetlabs.org/>

BAY AREA AIR QUALITY MANAGEMENT DISTRICT (BAAQMD)
375 Beale Street, Suite 600
San Francisco, CA 94105

Ph: 415-749-4900
Fax: 415-928-8560
Internet: <http://www.baaqmd.gov/>

BICSI International Standards Program (BICSI)
8610 Hidden River Parkway
Tampa, FL 33637, USA
Ph: +1 813-979-1991 or 800-242-7405 (USA and Canada toll-free)
Fax: +1 813-971-4311
Email: bicsi@bicsi.org
Internet: <https://www.bicsi.org/>

BIFMA INTERNATIONAL (BIFMA)
678 Front Ave. NW, Suite 150
Grand Rapids, MI 49504-5368
Ph: 616-285-3963
E-mail: email@bifma.org
Internet: <https://www.bifma.org/>

BIOCYCLE, JOURNAL OF COMPOSTING AND RECYCLING (BIOCYCLE)
Ph: 610-967-4135
Internet: <https://www.biocycle.net/>

BRITISH STANDARDS INSTITUTE (BSI)
Ph: +44 345-086-9001
E-mail: cservices@bsigroup.com
Internet: <https://www.bsigroup.com/>

BUILDERS HARDWARE MANUFACTURERS ASSOCIATION (BHMA)
355 Lexington Avenue, 15th Floor
New York, NY 10017
Ph: 212-297-2122
Fax: 212-370-9047
Internet: <https://www.buildershardware.com/>

CALIFORNIA AIR RESOURCES BOARD (CARB)
1001 I Street
Sacramento, CA 95814
Ph: 800-242-4450
Email: helpline@arb.ca.gov
Internet: <https://ww2.arb.ca.gov/>

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)
PO Box 997377, MS 0500
Sacramento, CA 95899-7377
Ph: 916-558-1784
Internet: <https://www.cdph.ca.gov/>

CALIFORNIA ENERGY COMMISSION (CEC)
Media and Public Communications Office
1516 Ninth Street, MS-29
Sacramento, CA 95814-5512
Ph: 916-654-5106
E-mail: appliances@energy.ca.gov
Internet: <https://www.energy.ca.gov/>

CARPET AND RUG INSTITUTE (CRI)
P.O. Box 2048

Dalton, GA 30722-2048
Ph: 706-278-3176
Fax: 706-278-8835
Internet: <https://carpet-rug.org/>

CAST IRON SOIL PIPE INSTITUTE (CISPI)
2401 Fieldcrest Drive
Mundelein, IL 60060
Ph: 224-864-2910
Internet: <https://www.cispi.org/>

CEILINGS AND INTERIOR SYSTEMS CONSTRUCTION ASSOCIATION (CISCA)
1010 Jorie Blvd, Suite 30
Oak Brook, IL 60523
Ph: 630-584-1919
Fax: 866-560-8537
E-mail: cisca@cisca.org
Internet: <https://www.cisca.org>

CENTERS FOR DISEASE CONTROL AND PREVENTION (CDC)
1600 Clifton Road
Atlanta, GA 30329-4027
Ph: 800-232-4636
TTY: 888-232-6348
Internet: <https://www.cdc.gov>

CHEMICAL FABRICS AND FILM ASSOCIATION (CFFA)
1300 Sumner Avenue
Cleveland OH 44115-2851
Ph: 216-241-7333
Fax: 216-241-0105
E-mail: cffa@chemicalfabricsandfilm.com
Internet: <https://www.chemicalfabricsandfilm.com/>

CHLORINE INSTITUTE (CI)
1300 Wilson Boulevard, Suite 525
Arlington, VA 22209
Ph: 703-894-4140
Fax: 703-894-4130
E-mail: pubs@cl2.com
Internet: <https://www.chlorineinstitute.org>

COMPOSITE PANEL ASSOCIATION (CPA)
19465 Deerfield Avenue, Suite 306
Leesburg, VA 20176
Ph: 703-724-1128
Fax: 703-724-1588
Internet: <https://www.compositepanel.org/>

COMPRESSED AIR AND GAS INSTITUTE (CAGI)
1300 Sumner Avenue
Cleveland OH 44115
Ph: 216-241-7333
Fax: 216-241-0105
E-mail: cagi@cagi.org
Internet: <https://www.cagi.org/>

COMPRESSED GAS ASSOCIATION (CGA)
14501 George Carter Way, Suite 103

Chantilly, VA 20151-1788
Ph: 703-788-2700
Fax: 703-961-1831
E-mail: cga@cganet.com
Internet: <https://www.cganet.com/>

CONCRETE REINFORCING STEEL INSTITUTE (CRSI)
933 North Plum Grove Road
Schaumburg, IL 60173-4758
Ph: 847-517-1200
Fax: 847-517-1206
Internet: <http://www.crsi.org/>

CONCRETE SAWING AND DRILLING ASSOCIATION (CSDA)
100 2nd Ave South, Ste 402N
St. Petersburg, FL 33701
PH: 727-577-5004
E-mail: info@csda.org
Internet: <https://www.csda.org>

CONSUMER ELECTRONICS ASSOCIATION (CEA)
1919 South Eads St.
Arlington, VA 22202
Ph: 703-907-7600
E-mail: CTA@CTA.tech
Internet: <https://www.cta.tech/>

CONSUMER TECHNOLOGY ASSOCIATION (CTA)
1919 South Eads St.
Arlington, VA 22202
Ph: 703-907-7600
E-mail: CTA@CTA.tech
Internet: <https://www.cta.tech/>

CONSUMER PRODUCT SAFETY COMMISSION (CPSC)
4330 East West Highway
Bethesda, MD 20814
Ph: 800-638-2772
Fax: 301-504-0124 or 301-504-0025
Internet: <https://www.cpsc.gov>

CONVEYOR EQUIPMENT MANUFACTURERS ASSOCIATION (CEMA)
5672 Strand Ct., Suite 2
Naples, Florida 34110
Ph: 239-514-3441
Fax: 239-514-3470
E-mail: karen@cemanet.org
Internet: <https://www.cemanet.org/>

COOLING TECHNOLOGY INSTITUTE (CTI)
3845 Cypress Creek Parkway, Suite 420
Houston, TX 77068
Ph: 281-583-4087
E-mail: vmanser@cti.org
Internet: <https://www.coolingtechnology.org/>

COPPER DEVELOPMENT ASSOCIATION (CDA)
Internet: <https://www.copper.org/>

COUNCIL ON ENVIRONMENTAL QUALITY (CEQ) (WHITE HOUSE)
722 Jackson Place
Washington DC 20506
Internet: <https://www.whitehouse.gov/administration/eop/ceq>

CRANE MANUFACTURERS ASSOCIATION OF AMERICA (CMAA)
8720 Red Oak Boulevard, Suite 201
Charlotte, NC 28217-3992
Ph: 704-676-1190
Fax: 704-676-1199
Internet: <http://www.mhi.org/cmaa>

CSA GROUP (CSA)
178 Rexdale Blvd.
Toronto, ON, Canada M9W 1R3
Ph: 416-747-4044
Fax: 416-747-2510
E-mail: member@csagroup.org
Internet: <https://www.csagroup.org/>

DEPARTMENT OF DEFENSE EXPLOSIVES SAFETY BOARD (DDESB)
Internet: <https://denix.osd.mil/dde/home/>

DISTRICT OF COLUMBIA MUNICIPAL REGULATIONS (DCMR)
1350 Pennsylvania Avenue, NW, Suite 419
Washington DC 20004
Ph: 202-727-6306
Fax: 202-727-3582
TTY: 711
E-mail: secretary@dc.gov
Internet:
<https://os.dc.gov/service/publication-and-regulatory-services>

DOOR AND ACCESS SYSTEM MANUFACTURERS ASSOCIATION (DASMA)
1300 Summer Avenue
Cleveland, OH 44115-2851
Ph: 216-241-7333
Fax: 216-241-0105
Internet: <https://www.dasma.com/>

DUCTILE IRON PIPE RESEARCH ASSOCIATION (DIPRA)
245 Riverchase Pkwy E
Birmingham, AL 35244
Ph: 205-402-8700
Internet: <https://www.dipra.org/>

ELECTRICAL GENERATING SYSTEMS ASSOCIATION (EGSA)
1650 South Dixie Highway, Suite 400
Boca Raton, FL 33432-7462
Ph: 561-750-5575
Fax: 561-395-8557
Internet: <http://www.egsa.org>

ELECTRIFICATION AND CONTROLS MANUFACTURERS ASSOCIATION (ECMA)
8720 Red Oak Blvd., Suite 201
Charlotte, NC 28217
Ph: 704-676-1190
E-mail: askidmore@mhi.org
Internet: www.mhi.org/ecma

ELECTRONIC COMPONENTS INDUSTRY ASSOCIATION (ECIA)
310 Maxwell Road, Suite 200
Alpharetta, GA 30009
Ph: 678-393-9990
Fax: 678-393-9998
E-mail: emikoski@ecianow.org
Internet: <https://www.ecianow.org>

ELECTRONIC INDUSTRIES ALLIANCE (EIA)
EIA has become part of the ELECTRONIC COMPONENTS INDUSTRY
ASSOCIATION (ECIA)

ELECTROSTATIC DISCHARGE ASSOCIATION (ESD)
7900 Turin Road, Building 3
Rome, NY 13440-2069
Ph: 315-339-6937
Fax: 315-339-6793
E-mail: info@esda.org
<https://www.esda.org/>

ENERGY INSTITUTE (EI)
Publications Team
Energy Institute
61 New Cavendish Street
London
W1G 7AR, UK
Ph: +44 (0)20 7467 7100
Fax: +44 (0)20 7255 1472
E-mail: pubs@energyinst.org.uk
Internet: <https://publishing.energyinst.org/>

ETL TESTING LABORATORIES (ETL)
Intertek
Ph: 800-967-5352
Internet: <http://www.intertek.com/>

EUROPEAN COMMITTEE FOR STANDARDIZATION (CEN/CENELEC)
CEN-CENELEC Management Centre
Rue de la Science 23
B - 1040 Brussels, Belgium
Ph: 32-2-550-08-11
Fax: 32-2-550-08-19
Internet: <https://www.cen.eu/>

EUROPEAN UNION (EU)
European Commission
Rue de la Loi 200
1000 Bruxelles
Belgium
Ph: +32 2 299 96 96
Internet: https://ec.europa.eu/info/index_en

EXPANSION JOINT MANUFACTURERS ASSOCIATION (EJMA)
25 North Broadway
Tarrytown, NY 10591
Fax: 914-332-1541
E-mail: inquiries@ejma.org
Internet: <http://www.ejma.org>

EXTRON ELECTRONICS (EE)
Extron USA West
Worldwide Headquarters
1025 E. Ball Road
Anaheim, CA 92805
Ph: 800-633-9876
Fax: 714-491-1517
Internet: <https://www.extron.com/>

FEDERAL EMERGENCY MANAGEMENT AGENCY (FEMA)
615 Chestnut Street
One Independence Mall, Sixth Floor
Philadelphia, PA 19106-4404
Ph: 215-931-5597
E-mail: femar3newsdesk@fema.dhs.gov
Internet: <https://www.fema.gov/>

FEDERAL REMEDIATION TECHNOLOGIES ROUNDTABLE (FRTR)
Ph: 703-487-4650
Internet: <https://frtr.gov/>

FLORIDA ADMINISTRATIVE CODE (FAC), WEEKLY AND LAWS
Florida Administrative Register
R.A. Gray Building
500 South Bronough Street
Tallahassee, FL 32399-0250
Ph: 850-245-6270
E-mail: AdministrativeCode@dos.myflorida.com
Internet: <https://www.flrules.org/>

FLUID CONTROLS INSTITUTE (FCI)
1300 Sumner Avenue
Cleveland, OH 44115
Ph: 216-241-7333
Fax: 216-241-0105
E-mail: fcifluidcontrolsinstitute.org
Internet: <https://fluidcontrolsinstitute.org/>

FLUID SEALING ASSOCIATION (FSA)
994 Old Eagle School Rd. #1019
Wayne, PA 19087-1866
Ph: 610-971-4850
E-mail: info@fluidsealing.com
Internet: www.fluidsealing.com

FM GLOBAL (FM)
270 Central Avenue
Johnston, RI 02919-4949
Ph: 401-275-3000
Fax: 401-275-3029
Internet: <https://www.fmglobal.com/>

FOREST STEWARDSHIP COUNCIL (FSC)
708 First Street North, Suite 235
Minneapolis, MN 55401
Ph: 612-353-4511
E-mail: info@us.fsc.org
Internet: <https://us.fsc.org/>

FORESTRY SUPPLIERS INC. (FSUP)
205 West Rankin Street
P.O. Box 8397
Jackson, MS 39284-8397
Ph: 800-752-8460
Internet: <https://www/forestry-suppliers.com>

FOUNDATION FOR CROSS-CONNECTION CONTROL AND HYDRAULIC RESEARCH
(FCCCHR)
USC Foundation Office
Research Annex 219
Los Angeles, CA 90089-7700
Ph: 866-545-6340
Fax: 213-740-8399
E-mail: fccchr@usc.edu
Internet: <https://fccchr.usc.edu/>

FPInnovations (FPI)
570 Saint-Jean Blvd.
Pointe-Claire, QC
Canada H9R 3J9
Ph: 514-630-4100
Internet: <https://fpinnovations.ca/Pages/index.aspx>
Download: <http://www.masstimber.com>
Hard copy: <http://www.awc.org>

GEOLOGICAL SOCIETY OF AMERICA (GeoSA)
P.O. Box 9140
Boulder, CO 80301-9140
Ph: 303-357-1000
Fax: 303-357-1070
E-mail: gsaservice@geosociety.org
Internet: <http://www.geosociety.org>

GEOSYNTHETIC INSTITUTE (GSI)
475 Kedron Avenue
Folsom, PA 19033-1208
Ph: 610-522-8440
Fax: 610-522-8441
Internet: <https://geosynthetic-institute.org/>

GERMAN INSTITUTE FOR STANDARDIZATION (DIN)
Americas
Englewood, CO, US
Ph: +1 800-447-2273 (Toll Free), +1 303-736-3001 (US/Canada)

GLASS ASSOCIATION OF NORTH AMERICA (GANA)
National Glass Association
1945 Old Gallows Rd., Suite 750
Vienna, VA 22182
Ph: 866-342-5642
Ph: 703-442-4890
Fax: 703-442-0630
Internet: <http://www.glasswebsite.com>

GREEN BUSINESS CERTIFICATION INC. (GBCI)
Washington, D.C.

Ph: 1-800-795-1747
Internet: <https://www.gbci.org>

GREEN BUILDING INITIATIVE (GBI)
7805 SW 40th Ave. #80010
Portland, Oregon 97219
Ph: 503-274-0448
Email: info@thegbi.org
Internet: <https://www.thegbi.org/>

GREEN SEAL (GS)
1001 Connecticut Avenue, NW
Suite 827
Washington, DC 20036-5525
Ph: 202-872-6400
Fax: 202-872-4324
E-mail: green seal@green seal.org
Internet: <https://www.green seal.org/>

GYP SUM ASSOCIATION (GA)
962 Wayne Ave., Suite 620
Silver Spring, MD 20910
Ph: 301-277-8686
Fax: 301-277-8747
E-mail: info@gyp sum.org
Internet: <https://www.gyp sum.org/>

H.P. WHITE LABORATORY (HPW)
3114 Scarboro Road
Street, MD 21154
Ph: 410-838-6550
Fax: 410-838-2802
Internet: <http://www.hp white.com>

HARDWOOD PLYWOOD AND VENEER ASSOCIATION (HPVA)
Decorative Hardwoods Association
42777 Trade West Dr.
Sterling, VA 20166
Ph: 703-435-2900
Fax: 703-435-2537
E-mail: Resources@decorativehardwoods.ort
Internet: <https://www.decorativehardwoods.org/>

HEAT EXCHANGE INSTITUTE (HEI)
1300 Sumner Avenue
Cleveland, OH 44115
Ph: 216-241-7333
Fax: 216-241-0105
E-mail: hei@heatexchange.org
Internet: <https://www.heatexchange.org/>

HYDRAULIC INSTITUTE (HI)
6 Campus Drive, First Floor North
Parsippany, NJ 07054-4405
Ph: 973-267-9700
Fax: 973-267-9055
Internet: <http://www.pumps.org>

HYDRONICS INSTITUTE DIVISION OF AHRI (HYI)
2311 Wilson Blvd, Suite 400
Arlington, VA 22201
Ph: 703-524-8800
Internet: <http://www.ahrinet.org>

ICC EVALUATION SERVICE, INC. (ICC-ES)
3060 Saturn Street, Suite 100
Brea, CA 92821
Ph: 800-423-6587
Fax: 562-695-4694
E-mail: es@icc-es.org
Internet: <https://icc-es.org/>

ILLUMINATING ENGINEERING SOCIETY (IES)
120 Wall Street, Floor 17
New York, NY 10005-4001
Ph: 212-248-5000
Fax: 212-248-5018
E-mail: membership@ies.org
Internet: <https://www.ies.org/>

INDUSTRIAL FASTENERS INSTITUTE (IFI)
6363 Oak Tree Boulevard
Independance, OH 44131
Ph: 216-241-1482
E-mail: techinfo@indfast.org
Internet: <https://www.indfast.org/>

INSTITUTE OF CLEAN AIR COMPANIES (ICAC)
2200 Wilson Blvd., Suite 310
Arlington, VA 22201
Ph: 202-478-6188
Internet: <https://www.icac.com>

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)
445 and 501 Hoes Lane
Piscataway, NJ 08854-4141
Ph: 732-981-0060 or 800-701-4333
Fax: 732-981-9667
E-mail: onlinesupport@ieee.org
Internet: <https://www.ieee.org/>

INSTITUTE OF ENVIRONMENTAL SCIENCES AND TECHNOLOGY (IEST)
1827 Walden Office Square, Suite 400
Schaumburg, IL 60173
Ph: 847-981-0100
Fax: 847-981-4130
E-mail: information@iest.org
Internet: <https://www.iest.org/>

INSTITUTE OF INSPECTION, CLEANING, AND RESTORATION CERTIFICATION
(IICRC)
IICRC Global Resource Center
4043 S. Eastern Ave.
Las Vegas, NV 89119
Ph: 844-464-4272
E-mail: Marketing@iicrcnet.org
Internet: <https://www.iicrc.org/>

INSTITUTE OF TRANSPORTATION ENGINEERS (ITE)
1627 Eye Street, NW, Suite 600
Washington, DC 20006
Ph: 202-785-0060
Fax: 202-785-0609
E-mail: ite_staff@ite.org
Internet: <https://www.ite.org/>

INSTRUCTIONS AND STANDARDS FOR NAVBASE GUANTANAMO BAY CUBA
(COMNAVBASEGTMOINST)
Naval Station Guantanamo Bay
c/o Admin Department
PSC 1005 Box 25
FPO AE Guantanamo Bay, 09593
Ph: (011) 5399-4511
Internet: <http://www.cnic.navy.mil/Guantanamo>

INSULATED CABLE ENGINEERS ASSOCIATION (ICEA)
P.O. Box 493
Miamitown, OH 45041-9998
E-mail: info@icea.net
Internet: <https://www.icea.net/>

INSULATING GLASS MANUFACTURERS ALLIANCE (IGMA)
27 N. Wacker Dr. Suite 365
Chicago, IL 60606-2800
Ph: 613-233-1510
Fax: 613-482-9436
E-mail: enquiries@igmaonline.org
Internet: <https://www.igmaonline.org/>

INTELLIGENCE COMMUNITY STANDARD (ICS)
Homeland Security Digital Library
Ph: 831-272-2437
E-mail: hsdl@nps.edu
Internet: <https://www.hsdl.org/c/>

INTERNATIONAL AIR TRANSPORT ASSOCIATION (IATA)
800 Place Victoria
PO Box 113
Montréal, Quebec, H4Z 1M1
Ph: 514-390-6726 or 800-716-6326
Fax: 514-874-9659
E-mail: custserv@iata.org
Internet: <https://www.iata.org/>

INTERNATIONAL ASSOCIATION OF PLUMBING AND MECHANICAL OFFICIALS
(IAPMO)
4755 E. Philadelphia St.
Ontario, CA 91761
Ph: 909-472-4100
Fax: 909-472-4150
E-mail: iapmo@iapmo.org
Internet: <http://www.iapmo.org>

INTERNATIONAL CAST POLYMER ASSOCIATION (ICPA)
4949 Old Brownsboro Rd, Ste. 232
Louisville, KY 40222

Ph: 470-219-8139
Internet: <https://theicpa.com/>

INTERNATIONAL CODE COUNCIL (ICC)
500 New Jersey Avenue, NW
6th Floor, Washington, DC 20001
Ph: 800-786-4452 or 888-422-7233
Fax: 202-783-2348
E-mail: order@iccsafe.org
Internet: <https://www.iccsafe.org/>

INTERNATIONAL CONCRETE REPAIR INSTITUTE (ICRI)
1000 Westgate Drive, Suite 252
St. Paul, MN 55114
Ph: 651-366-6095
Fax: 651-290-2266
E-mail: info@icri.org
Internet: <https://www.icri.org/>

INTERNATIONAL ELECTRICAL TESTING ASSOCIATION (NETA)
3050 Old Centre Ave. Suite 101
Portage, MI 49024
Ph: 269-488-6382
Fax: 269-488-6383
Internet: <https://www.netaworld.org/>

INTERNATIONAL ELECTROTECHNICAL COMMISSION (IEC)
3, rue de Varembe, 1st floor
P.O. Box 131
CH-1211 Geneva 20, Switzerland
Ph: 41-22-919-02-11
Fax: 41-22-919-03-00
E-mail: info@iec.ch
Internet: <https://www.iec.ch/>

INTERNATIONAL FEDERATION FOR STRUCTURAL CONCRETE (fib)
Chemin du Barrage, Station 18
CH-105
Lausanne, Switzerland
Ph: +41 21 693 27 47
Fax: +41 21 693 62 45
Internet: <https://www.fib-international.org/>

INTERNATIONAL GROUND SOURCE HEAT PUMP ASSOCIATION (IGSHPA)
1201 S Innovation Way, Suite 400
Stillwater, OK 74074
Ph: 800-626-4747 or 405-744-5175
Fax: 405-744-5283
E-mail: igshpa@okstate.edu
Internet: <https://igshpa.org/>

INTERNATIONAL INSTITUTE OF AMMONIA REFRIGERATION (IIAR)
1001 N. Fairfax Street, Suite 503
Alexandria, VA 22314
Ph: 703-312-4200
Fax: 703-312-0065
E-mail: info@iiar.org
Internet: <https://www.iiar.org>

INTERNATIONAL MUNICIPAL SIGNAL ASSOCIATION (IMSA)
597 Haverty Court, Suite 100
Rockledge, FL 32955
Ph: 321-392-0500 and 800-723-4672
Fax: 315-806-1400
E-mail: orders@imsasafety.org
Internet: <http://www.imsasafety.org/>

INTERNATIONAL NAVIGATION ASSOCIATION (PIANC)
General Secretariat
Blvd. du Roi Albert II
20 - Boite 3
B-1000 Brussels
Belgium
Ph: +32 2 553 71 61
E-mail: info@pianc.org
Internet: <https://www.pianc.org/>

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION (ISO)
ISO Central Secretariat
BIBC II
Chemin de Blandonnet 8
CP 401 - 1214 Vernier, Geneva
Switzerland
Ph: 41-22-749-01-11
E-mail: central@iso.ch
Internet: <https://www.iso.org>

INTERNATIONAL SAFETY EQUIPMENT ASSOCIATION (ISEA)
1901 North Moore Street
Arlington, VA 22209-1762
Ph: 703-525-1695
Fax: 703-528-2148
Internet: <https://safetyequipment.org/>

INTERNATIONAL SOCIETY OF AUTOMATION (ISA)
67 T.W. Alexander Drive
PO Box 12277
Research Triangle Park, NC 27709
Ph: 919-549-8411
Fax: 919-549-8288
E-mail: info@isa.org
Internet: <https://www.isa.org/>

INTERNATIONAL SOCIETY OF EXPLOSIVES ENGINEERS (ISEE)
26500 Renaissance Parkway
Cleveland, OH 44128
Ph: 440-349-4400
Fax: 440-349-3788
E-mail: isee.org/contact-us
Internet: <https://www.isee.org/>

INTERNATIONAL TELECOMMUNICATION UNION (ITU)
Place des Nations
1211 Geneve 20 Switzerland
Ph: 41-22-730-6141
Fax: 41-22-730-5194
E-mail: sales@itu.int
Internet: <https://www.itu.int>

INTERNATIONAL WINDOW CLEANING ASSOCIATION (IWCA)
7918 Jones Branch Dr, Ste 300
McLean, VA 22102
Ph: 800-875-4922
Internet: <https://www.iwca.org/>

INTERNET ENGINEERING TASK FORCE (IETF)
c/o Association Management Solutions, LLC (AMS)
5177 Brandin Court
Fremont, California 94538
Ph: 510-492-4080
Fax: 510-492-4001
E-mail: ietf-info@ietf.org
Internet: <https://www.ietf.org/>

IPC - ASSOCIATION CONNECTING ELECTRONICS INDUSTRIES (IPC)
3000 Lakeside Drive, Suite 105 N
Bannockburn, IL 60015
Ph: 847-615-7100
Fax: 847-615-7105
E-mail: answers@ipc.org
Internet: <http://www.ipc.org>

ITALIAN LAWS AND DECREES (D.M.)
Internet: <http://www.nyulawglobal.org/globalex/Italy1.html>

JAPANESE STANDARDS ASSOCIATION (JSA)
c/o MITA MT Bldg., 3-13-12 Mita
Minato-ku, Tokyo 108-0073, JAPAN
Fax: 81-3-4231-8650
E-mail: po@jsa.or.jp
Internet: <https://www.jsa.or.jp/en/>

KITCHEN CABINET MANUFACTURERS ASSOCIATION (KCMA)
1899 Preston White Drive
Reston, VA 20191-5435
Ph: 703-264-1690
Fax: 703-620-6530
E-mail: info@kcma.org
Internet: <https://www.kcma.org/>

L.H. BAILEY HORTORIUM (LHBH)
Plant Biology Units
The L.H. Bailey Hortorium and Herbarium
440 Mann Library Building
Ithaca, NY 14853
Ph: 607-255-1052
Fax: 607-254-5407
Internet: <https://plantbio.cals.cornell.edu/hortorium/>

LOCKHEED MARTIN CORPORATION (LM)
6801 Rockledge Drive
Bethesda, MD 20817 U.S.A.
Ph: 301-897-6000
Internet: <https://www.lockheedmartin.com/us.html>

LONMARK INTERNATIONAL (LonMark)
3600 Peterson Way

Santa Clara, CA 95054
Ph: 866-566-6275 or 408-790-3247
Fax: 408-790-3838
Internet: <http://www.lonmark.org>

MANUFACTURERS STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS
INDUSTRY (MSS)
127 Park Street, NE
Vienna, VA 22180-4602
Ph: 703-281-6613
E-mail: info@msshq.org
Internet: <http://msshq.org>

MAPLE FLOORING MANUFACTURERS ASSOCIATION (MFMA)
One Parkview Plaza, Suite 800
Oakbrook Terrace, IL 60181
Ph: 888-480-9138
Fax: 847-686-2251
E-mail: mfma@maplefloor.org
Internet: <http://www.maplefloor.org>

MARBLE INSTITUTE OF AMERICA (MIA)
Natural Stone Institute
380 E. Lorain Street
Oberlin, OH 44074
Ph: 440-250-9222
Fax: 440-774-9222
E-mail: info@naturalstoneinstitute.org
Internet: <https://www.naturalstoneinstitute.org/>

MASTER PAINTERS INSTITUTE (MPI)
2800 Ingleton Avenue
Burnaby, BC CANADA V5C 6G7
Ph: 1-888-674-8937
Fax: 1-888-211-8708
E-mail: info@paintinfo.com or techservices@mpi.net
Internet: <http://www.mpi.net/>

MATERIAL HANDLING INDUSTRY OF AMERICA (MHI)
8720 Red Oak Blvd., Suite 201
Charlotte, NC 28217-3996
Ph: 704-676-1190
Fax: 704-676-1199
Internet: <http://www.mhi.org>

METAL BUILDING MANUFACTURERS ASSOCIATION (MBMA)
1300 Sumner Avenue
Cleveland, OH 44115-2851
Ph: 216-241-7333
Fax: 216-241-0105
Internet: <https://www.mbma.com/>

METAL FRAMING MANUFACTURERS ASSOCIATION (MFMA)
330 N. Wabash Avenue
Chicago, IL 60611
Ph: 312-644-6610
E-mail: MFMAstats@smithbucklin.com
Internet: <http://www.metalframingmfg.org/>

MIDDLE ATLANTIC PRODUCTS (MA)
a Brand of Legrand AV
300 Fairfield Road
Fairfield, NJ 07004
Ph: 800-266-7225
Fax: 800-392-3955
Internet: <https://www.legrand.us/middle-atlantic-products>

MIDWEST INSULATION CONTRACTORS ASSOCIATION (MICA)
16712 Elm Circle
Omaha, NE 68130
Ph: 402-342-3463 or 800-747-6422
Fax: 402-330-9702
Internet: <https://www.micainsulation.org/>

MIDWEST ROOFING CONTRACTORS ASSOCIATION (MRCA)
2077 Embury Park Road
Dayton, OH 45414
Ph: 800-497-6722
Fax: 937-278-0317
E-mail: info@mrca.org
Internet: General Information: <http://www.mrca.org>

MODBUS ORGANIZATION, INC (MODBUS)
PO Box 628
Hopkinton, MA 01748
Ph: 508-435-7170
Fax: 508-435-7172
Internet: <http://www.modbus.org>

NACE INTERNATIONAL (NACE)
15835 Park Ten Place
Houston, TX 77084
Ph: 281-228-6200
Fax: 281-228-6300
E-mail: firstservice@nace.org
Internet: <https://www.nace.org>

NATIONAL AERONAUTICS AND SPACE ADMINISTRATION (NASA)
NASA Headquarters
300 E. Street SW, Suite 5R30
Washington, DC 20546
Ph: 202-358-0001
Fax: 202-358-4338
Internet: <https://www.nasa.gov/>

NATIONAL AIR DUCT CLEANERS ASSOCIATION (NADCA)
1120 Route 73, Suite 200
Mt. Laurel, NJ 08054
Toll Free: 855-GO-NADCA
Ph: (856) 380-6810
Fax: (856) 439-0525
Internet: <https://nadca.com/>

NATIONAL ASSOCIATION OF ARCHITECTURAL METAL MANUFACTURERS (NAAMM)
800 Roosevelt Road, Bldg C, Suite 312
Glen Ellyn, IL 60137
Ph: 630-942-6591

Fax: 630-790-3095
E-mail: info@naamm.org
Internet: <http://www.naamm.org>

NATIONAL BOARD OF BOILER AND PRESSURE VESSEL INSPECTORS (NBBI)
1055 Crupper Avenue
Columbus, OH 43229-1183
Ph: 614-888-8320
Fax: 614-888-0750
E-mail: information@nationalboard.org
Internet: <https://www.nationalboard.org>

NATIONAL CABLE AND TELECOMMUNICATIONS ASSOCIATION (NCTA)
25 Massachusetts Avenue, NW, Suite 100
Washington, DC 20001
Ph: 202-222-2300
E-mail: info@ncta.com
Internet: <https://www.ncta.com/>

NATIONAL CONCRETE MASONRY ASSOCIATION (NCMA)
13750 Sunrise Valley Drive
Herndon, VA 20171
Ph: 703-713-1900
Fax: 703-713-1910
E-mail: info@ncma.org
Internet: <https://ncma.org/>

NATIONAL COUNCIL ON RADIATION PROTECTION AND MEASUREMENTS (NCRP)
7910 Woodmont Avenue, Suite 400
Bethesda, MD 20814-3095
Ph: 301-657-2652
Fax: 301-907-8768
E-mail: ncrppubs@ncrpponline.org
Internet: <https://ncrponline.org/>

NATIONAL DRILLING ASSOCIATION (NDA)
4036 Center Rd, Suite B
Brunswick, OH 44212
Ph: 877-632-4748
Fax: 216-803-9900
E-mail: info@nda4u.com
Internet: <https://www.nda4u.com/>

NATIONAL ELECTRICAL CONTRACTORS ASSOCIATION (NECA)
3 Bethesda Metro Center, Suite 1100
Bethesda, MD 20814
Ph: 301-657-3110
Fax: 301-215-4500
Internet: <https://www.necanet.org/>

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)
1300 North 17th Street, Suite 900
Arlington, VA 22209
Ph: 703-841-3200
Internet: <https://www.nema.org>

NATIONAL ELEVATOR INDUSTRY, INC. (NEII)
5003 Westfield Blvd.
P.O. Box 231137

Centreville, VA 20120
Ph: 703-589-9985
E-Mail: info@neii.org
Internet: <http://www.neii.org>

NATIONAL ENVIRONMENTAL BALANCING BUREAU (NEBB)
8575 Grovemont Circle
Gaithersburg, MD 20877
Ph: 301-977-3698
Fax: 301-977-9589
Internet: <http://www.nebb.org>

NATIONAL FENESTRATION RATING COUNCIL (NFRC)
6305 Ivy Lane, Suite 140
Greenbelt, MD 20770
Ph: 301-589-1776
Fax: 301-589-3884
E-Mail: info@nfr.org
Internet: <http://www.nfrc.org>

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)
1 Batterymarch Park
Quincy, MA 02169-7471
Ph: 800-344-3555
Fax: 800-593-6372
Internet: <https://www.nfpa.org>

NATIONAL FLUID POWER ASSOCIATION (NFLPA)
6737 W. Washington Street, Suite 2350
Milwaukee, WI 53214
Ph: 414-778-3344
Fax: 414-778-3361
E-mail: nfpa@nfpa.com
Internet: <https://www.nfpa.com>

NATIONAL HARDWOOD LUMBER ASSOCIATION (NHLA)
6830 Raleigh LaGrange Road
PO Box 34518
Memphis, TN 38184
Ph: 901-377-1818
Internet: <https://nhla.com/>

NATIONAL INSTITUTE FOR CERTIFICATION IN ENGINEERING TECHNOLOGIES
(NICET)
1420 King Street
Alexandria, VA 22314-2794
Ph: 888-476-4238 (1-888 IS-NICET)
E-mail: tech@nicet.org
Internet: <https://www.nicet.org/>

NATIONAL INSTITUTE FOR OCCUPATIONAL SAFETY AND HEALTH (NIOSH)
Patriots Plaza 1
395 E Street, SW, Suite 9200
Washington, DC 20201
Ph: 800-232-4636
Fax: 513-533-8347
Internet: <https://www.cdc.gov/niosh/>

NATIONAL INSTITUTE OF BUILDING SCIENCES (NIBS)
1090 Vermont Avenue NW, Suite 700
Washington, DC 20005
Ph: 202-289-7800
Fax: 202-289-1092
Internet: <http://www.wbdg.org>

NATIONAL INSTITUTE OF JUSTICE (NIJ)
Justice Technology Information Center
700 N. Frederick Ave.
Bldg. 181, Rm 1L30
Gaithersburg, MD 20879
Ph: 800-248-2742 or 301-240-7770
E-mail: asknlectc@justnet.org
Internet: <https://www.justnet.org/>

NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY (NIST)
100 Bureau Drive
Gaithersburg, MD 20899
Ph: 301-975-2000
Internet: <https://www.nist.gov/>

NATIONAL LIME ASSOCIATION (NLA)
200 North Glebe Road, Suite 800
Arlington, VA 22203
Ph: 703-243-5463
Fax: 703-243-5489
Internet: <https://www.lime.org/>

NATIONAL PARK SERVICE (NPS)
National Park Service
1849 C Street, NW
Washington, DC 20240
Ph: 202-208-6843
Internet: <https://www.nps.gov/>

NATIONAL PRECAST CONCRETE ASSOCIATION (NPCA)
1320 City Center Drive, Suite 200
Carmel, IN 46032
Ph: 800 366 7731
Fax: 317-571-0041
Internet: <https://precast.org/>

NATIONAL READY MIXED CONCRETE ASSOCIATION (NRMCA)
Manager, Customer Service
900 Spring Street
Silver Spring, MD 20910
Ph: 240-485-1165
E-mail: jjenkins@nrmca.org (Jacques Jenkins)
Internet: <https://www.nrmca.org/>

NATIONAL ROOFING CONTRACTORS ASSOCIATION (NRCA)
10255 West Higgins Road, Suite 600
Rosemont, IL 60018-5607
Ph: 847-299-9070
Fax: 847-299-1183
Internet: <http://www.nrca.net>

NATIONAL SECURITY TELECOMMUNICATIONS AND INFORMATION SYSTEMS
SECURITY (NSTISS)
CNSS Secretariat
National Security Agency
9800 Savage Road, Ste 6716
Fort George G. Meade, MD 20755-6716
Ph: 410-854-6805
Fax: 410-854-6814
E-mail: cnss@radium.ncsc.mil
Publication available on the internet: <http://www.dtic.mil/dtic/>

NATIONAL TERRAZZO AND MOSAIC ASSOCIATION (NTMA)
P.O. Box 2605
Fredericksburg, TX 78624
Ph: 800-323-9736
Fax: 888-362-2770
E-mail: tech-info@ntma.com
Internet: <https://www.ntma.com/>

NAVAL FACILITIES ENGINEERING AND EXPEDITIONARY WARFARE CENTER
(NAVFAC EXWC)
1000 23rd Avenue
Port Hueneme, CA 93043-4301
Internet:
https://www.navfac.navy.mil/navfac_worldwide/specialty_centers/exwc.html

NATIONAL WOOD FLOORING ASSOCIATION (NWFA) (formerly NOFMA)
111 Chesterfield Industrial Boulevard, Suite B
Chesterfield, MO 63005
Ph: 800-422-4556
Fax: 636-519-9664
Internet: <https://www.nwfa.org/>

NAVY AND MARINE CORPS PUBLIC HEALTH CENTER (NMCPHC)
620 John Paul Jones Circle, Suite 1100
Portsmouth, VA 23708-2103
Ph: 757-953-0700
Internet: <https://www.med.navy.mil/sites/nmcphc/Pages/Home.aspx>

NEW YORK STATE DEPARTMENT OF TRANSPORTATION MATERIALS BUREAU
(NYSDOT)
50 Wolf Road
Albany, NY 12232
Ph: 518-457-6195
Internet:
<https://www.dot.ny.gov/divisions/engineering/technical-services/materials-bureau>

NORDTEST (NT)
Slettetoften 9
DK-2630 Taastrup
Denmark
Ph: +45 21 21 44 44
E-mail: nordtest@nordtest.info
Internet: <http://www.nordtest.info/>

NORTH AMERICAN INSULATION MANUFACTURERS ASSOCIATION (NAIMA)
11 Canal Center Plaza, Suite 103
Alexandria, VA 22314

Ph: 703-684-0084
Fax: 703-684-0427
Internet: <https://insulationinstitute.org>

NORTH ATLANTIC TREATY ORGANIZATION (NATO)
Internet: <https://www.nato.int/>
Obtain documents through the Acquisition Streamlining and
Standardization Information System (ASSIST)
<https://assist.dla.mil/online/start/>; account registration required

NORTHEASTERN LUMBER MANUFACTURERS ASSOCIATION (NELMA)
272 Tuttle Road
Cumberland, ME 04021
Ph: 207-829-6901
Fax: 207-829-4293
E-mail: info@nelma.org
Internet: <https://www.nelma.org/>

NSF INTERNATIONAL (NSF)
789 North Dixboro Road
P.O. Box 130140
Ann Arbor, MI 48105
Ph: 734-769-8010 or 800-NSF-MARK
Fax: 734-769-0109
E-mail: info@nsf.org
Internet: <http://www.nsf.org>

OPC FOUNDATION (OPC)
16101 N. 82nd Street
Suite 3B
Scottsdale, AZ 85260-1868
Ph: 480-483-6644
Fax: 480-483-7202
Internet: <https://opcfoundation.org/>

OPEN NETWORK VIDEO INTERFACE FORUM (ONVIF)
2400 Camino Ramon, Suite 375
San Ramon, CA 94583
Ph: 925-275-6621
Fax: 925-275-6691
Internet: <https://www.onvif.org/>

ORGANISATION FOR ECONOMIC CO-OPERATION AND DEVELOPMENT (OECD)
2, rue Andre Pascal
75775 Paris Cedex 16, France
Ph: + 33 1 45 24 82 00
Fax: 33 1 45 24 85 00
Internet: <http://www.oecd.org>
U.S. Contact Center
OECD Washington Center
1776 I Street, NW, Suite 450
Washington, DC 20006
Ph: 202-785-6323
E-mail: washington.contact@oecd.org

PASSIVE HOUSE INSTITUTE INTERNATIONAL (PHI)
Rheinstraße 44/46
64283 Darmstadt, Germany

Ph: +49 (0)6151 / 82699-0
E-mail: mail@passiv.de
Internet: <https://passivehouse.com/>

PASSIVE HOUSE INSTITUTE - US (PHIUS)
116 West Illinois Street, Suite 5E
Chicago, IL 60654, USA
Ph: 312-561-4588
E-mail: info@passivehouse.us
Internet: <http://phius.org/home-page>

PETROLEUM EQUIPMENT INSTITUTE (PEI)
P.O. Box 2380
Tulsa, OK 74101-2380
Ph: 918-494-9696
Fax: 918-491-9895
Internet: <https://www.pei.org/>

PILE DRIVING CONTRACTORS ASSOCIATION (PDCA)
33 Knight Boxx Road, Suite 1
Orange Park, FL 32065
Ph: 888-311-7322 or 904-215-4771
Fax: 904-215-2977
Internet: <http://www.piledrivers.org/>

PIPE FABRICATION INSTITUTE (PFI)
511 Avenue of America's, #601
New York, NY 10011
Ph: 514-634-3434
Fax: 514-634-9736
E-mail: pfi@pfi-institute.org
Internet: <https://pfi-institute.org/>

PLANT AND LIFE SCIENCES PUBLISHING (PALS)
Cooperative Extension
34 Plant Science Building
Ithaca, NY 14853
Ph: 607-255-7654
Fax: 607-254-8770
E-mail: palspublishing@cornell.edu
Internet: <http://palspublishing.cals.cornell.edu/>

PLASTIC PIPE AND FITTINGS ASSOCIATION (PPFA)
800 Roosevelt Road
Building C, Suite 312
Glen Ellyn, IL 60137
Ph: 630-858-6540
Fax: 630-790-3095
Internet: <https://www.ppfahome.org/>

PLASTICS PIPE INSTITUTE (PPI)
105 Decker Court, Suite 825
Irving, TX 75062
Ph: 469-499-1044
Fax: 469-499-1063
Internet: <https://plasticpipe.org/>

PLUMBING AND DRAINAGE INSTITUTE (PDI)
800 Turnpike Street, Suite 300

North Andover, MA 01845
Ph: 978-557-0720 or 800-589-8956
E-Mail: pdi@PDIONline.org
Internet: <http://www.pdionline.org>

PLUMBING AND MECHANICAL CONTRACTORS ASSOCIATION (PMCA)
14695 SW Millikan Way
Beaverton, OR 97006
Ph: 503-626-6666
Fax: 503-626-6630
Internet: <http://www.pmcaoregon.com/>

PLUMBING-HEATING-COOLING CONTRACTORS ASSOCIATION (PHCC)
180 South Washington Street, Suite 100
Falls Church, VA 22046
Ph: 800-533-7694 or 703-237-8100
Fax: 703-237-7442
E-mail: customercare@naphcc.org
Internet: <https://www.phccweb.org/>

PORCELAIN ENAMEL INSTITUTE (PEI)
PO Box 920220
Norcross, GA 30010
Ph: 770-676-9366
Fax: 770-409-7280
E-mail: penamel@aol.com
Internet: <http://www.porcelainenamel.com>

POST-TENSIONING INSTITUTE (PTI)
38800 Country Club Drive
Farmington Hills, MI 48331
Ph: 248-848-3180
Bookstore: 248-848-3182
E-mail: technical.inquiries@post-tensioning.org
Internet: <https://www.post-tensioning.org/>

PRECAST/PRESTRESSED CONCRETE INSTITUTE (PCI)
200 West Adams St., 2100
Chicago, IL 60606
Ph: 312-786-0300
Bookstore: 312-428-4946
Internet: <https://www.pci.org/>

PROGRAMME FOR ENDORSEMENT OF FOREST CERTIFICATION (PEFC)
10, Route de l'Aeroport
Case Postale 638
1215 Geneva - Switzerland
Ph: +41 (22) 799-4540
Fax: +41 (22) 799-4550
Internet: <https://www.pefc.org/>

PUGET SOUND CLEAN AIR AGENCY (PSCAA)
1904 Third Street
Suite 105
Seattle, WA 98101
Ph: 206-343-8800
Internet: www.pscleanair.org

REDWOOD INSPECTION SERVICE (RIS) OF THE CALIFORNIA REDWOOD
ASSOCIATION (CRA)
818 Grayson Road, Suite 201
Pleasant Hill, CA 94523
Ph: 925-935-1499
Fax: 925-935-1496
Internet:
<https://www.wwpa.org/about-wwpa/redwood-inspection-service>

RESEARCH COUNCIL ON STRUCTURAL CONNECTIONS (RCSC)
E-Mail: boltcouncil@gmail.com
Internet: <http://www.boltcouncil.org>

RESILIENT FLOOR COVERING INSTITUTE (RFCI)
115 Broad Street
Suite 201
LaGrange, Georgia 30240
Internet: <https://rfci.com/>

RUBBER MANUFACTURERS ASSOCIATION (RMA)
U.S. Tire Manufacturers Association
1400 K Street, NW, Suite 900
Washington, DC 20005
Ph: 202-682-4800
E-mail: info@ustires.org
Internet: <https://www.ustires.org/>

SANDIA NATIONAL LABORATORIES (SAND)
P.O. Box 5800
Albuquerque, NM 87185
or
P.O. Box 969
Livermore, CA 94551-0969
Ph: 505-844-8066 or 925-294-3000
Internet: <https://energy.sandia.gov/>

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)
2000 Powell Street, Suite 600
Emeryville, CA 94608
Ph: 510-452-8000
Fax: 510-452-8001
E-mail: info@SCSglobalservices.com
Internet: <https://www.scsglobalservices.com/>

SCIENTIFIC EQUIPMENT AND FURNITURE ASSOCIATION (SEFA)
65 Hilton Avenue
Garden City, N.Y. 11530
Ph: 877-294-5424 or 516-294-5424
Fax: 516-294-2758
E-mail: info@sefalabs.com
Internet: <https://www.sefalabs.com/>

SCREEN MANUFACTURERS ASSOCIATION (SMA)
Ph: 773-636-0672
E-mail: Kathryn@SMAinfo.org
Internet: <http://smainfo.org>

SEMICONDUCTOR EQUIPMENT AND MATERIALS INTERNATIONAL (SEMI)
673 South Milpitas Blvd.
Milpitas, CA 95035
Ph: 408-943-6900
E-mail: semihq@semi.org
Internet: <https://www.semi.org/>

SHEET METAL AND AIR CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION
(SMACNA)
4201 Lafayette Center Drive
Chantilly, VA 20151-1219
Ph: 703-803-2980
Fax: 703-803-3732
Internet: <https://www.smacna.org/>

SINGLE PLY ROOFING INDUSTRY (SPRI)
465 Waverley Oaks Road, Suite 421
Waltham, MA 02452
Ph: 781-647-7026
Fax: 781-647-7222
E-mail: info@spri.org
Internet: <https://www.spri.org/>

SOCIETY FOR PROTECTIVE COATINGS (SSPC)
800 Trumbull Drive
Pittsburgh, PA 15205
Ph: 877-281-7772 or 412-281-2331
Fax: 412-444-3591
E-mail: customerservice@sspc.org
Internet: <http://www.sspc.org>

SOCIETY OF AUTOMOTIVE ENGINEERS INTERNATIONAL (SAE)
400 Commonwealth Drive
Warrendale, PA 15096
Ph: 877-606-7323 or 724-776-4841
Fax: 724-776-0790
E-mail: customerservice@sae.org
Internet: <https://www.sae.org/>

SOCIETY OF CABLE TELECOMMUNICATIONS ENGINEERS (SCTE)
140 Philips Road
Exton, PA 19341-1318
Ph: 800-542-5040 or 610-363-6888
Fax: 610-884-7237
E-Mail: info@scte.org
Internet: <https://www.scte.org/>

SOLAR RATING AND CERTIFICATION CORPORATION (SRCC)
ICC-SRCC
3060 Saturn Street, Suite 100
Brea, CA 92821
Ph: 888-422-7233 Ext. 3273
E-mail: srcc@solar-rating.org
Internet: <http://www.solar-rating.org>

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)
21865 Copley Drive
Diamond Bar, CA 91765
Ph: 909-396-2000

E-mail: webinquiry@aqmd.gov
Internet: <http://www.aqmd.gov>

SOUTHERN CYPRESS MANUFACTURERS ASSOCIATION (SCMA)
665 Rodi Road, Suite 305
Pittsburgh, PA 15235
Ph: 412-244-0440
Fax: 412-244-9090
Internet: <http://www.cypressinfo.org>

SOUTHERN PINE INSPECTION BUREAU (SPIB)
P.O. Box 10915
Pensacola, FL 32524-0915
Ph: 850-434-2611 or 800-995-7742
Fax: 850-434-1290
E-mail: spib@spib.org
Internet: <https://www.spib.org/>

SPRAY POLYURETHANE FOAM ALLIANCE (SPFA)
3927 Old Lee Hwy. #101B
Fairfax, VA 22030
Ph: 800-523-6154
Fax: 703-222-5816
Internet: <http://www.sprayfoam.org>

STATE OF CALIFORNIA, DEPARTMENT OF CONSUMER AFFAIRS, BUREAU OF
HOME FURNISHINGS AND THERMAL INSULATION (CTB)
4244 South Market Court, Suite D
Sacramento, CA 95834-1243
Ph: 916-999-2041
Fax: 916-921-7279
E-mail: HomeProducts@dca.ca.gov
Internet: <https://bhgs.dca.ca.gov/>

STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION (CALTRANS)
Publication Distribution Unit
1801 30th Street
Sacramento, CA 95816-8041
Ph: 916-227-5966
E-mail: chris.moorring@dot.ca.gov
Internet: <http://www.dot.ca.gov/des/techpubs/>

STATE OF CALIFORNIA DEPARTMENT OF CONSUMER AFFAIRS, BUREAU OF
ELECTRICAL AND APPLIANCE REPAIR, HOME FURNISHINGS AND THERMAL
INSULATION (BEARHFTI)
4244 South Market Court, Suite D
Sacramento, CA 95834-1243
Ph: 916-999-2041
Fax: 916-921-7279
E-mail: HomeProducts@dca.ca.gov
Internet: <https://www.bearhfti.ca.gov/>

STATE OF MARYLAND CODE OF MARYLAND REGULATIONS (COMAR)
Division of State Documents
16 Francis Street - Wineland Building
Annapolis, MD 21401
Ph: 410-974-2486
Fax: 410-280-5647
E-mail: support@sos.state.md.us

Internet: <http://www.dsd.state.md.us/COMAR/ComarHome.html>

STATE OF VIRGINIA ADMINISTRATIVE CODE (VAC)
900 E. Main Street
Pocahontas Building
Richmond, Virginia 23219
Ph: 804-698-1810
E-mail: codes@dls.virginia.gov
Internet: <http://register.dls.virginia.gov>

STEEL DECK INSTITUTE (SDI)
P.O. Box 426
Glenshaw, PA 15116
Ph: 412-487-3325
Fax: 412-487-3326
Internet: <https://www.sdi.org/>

STEEL DOOR INSTITUTE (SDI/DOOR)
30200 Detroit Road
Westlake, OH 44145
Ph: 440-899-0010
Fax: 440-892-1404
E-mail: info@steeldoors.org
Internet: <https://www.steeldoors.org/>

STEEL JOIST INSTITUTE (SJI)
234 W. Cheves Street
Florence, SC 29501
Ph: 843-407-4091
Internet: <https://steeljoist.org/>

STEEL TANK INSTITUTE (STI)
944 Donata Ct.
Lake Zurich, IL 60047
Ph: 847-438-8265
Fax: 847-438-8766
E-mail: info@steeltank.com
Internet: <https://www.steeltank.com/>

STEEL WINDOW INSTITUTE (SWI)
1300 Sumner Avenue
Cleveland, OH 44115-2851
Ph: 216-241-7333
Fax: 216-241-0105
E-mail: swi@steelwindows.com
Internet: <https://www.steelwindows.com/>

SUSTAINABLE FOREST INITIATIVE (SFI)
2121 K Street NW
Suite 750
Washington, DC 20037
Ph: 202-596-3450
Fax: 202-596-3451
E-mail: info@sfi-program.org
Internet: <http://www.sfi-program.org>

TECHNICAL ASSOCIATION OF THE PULP AND PAPER INDUSTRY (TAPPI)
15 Technology Parkway South, Suite 115
Peachtree Corners, GA 30092

Ph: 800-332-8686 or 770-446-1400
Fax: 770-446-6947
E-mail: memberconnection@tappi.org
Internet: <http://www.tappi.org>

TELECOMMUNICATIONS INDUSTRY ASSOCIATION (TIA)
1320 North Courthouse Road, Suite 200
Arlington, VA 22201
Ph: 703-907-7700
Fax: 703-907-7727
E-mail: marketing@tiaonline.org
Internet: <https://www.tiaonline.org/>

THE MASONRY SOCIETY (TMS)
105 South Sunset Street, Suite Q
Longmont, CO 80501-6172
Ph: 303-939-9700
Fax: 303-541-9215
E-mail: info@masonrysociety.org
<https://masonrysociety.org/>

TILE COUNCIL OF NORTH AMERICA (TCNA)
100 Clemson Research Boulevard
Anderson, SC 29625
Ph: 864-646-8453
Fax: 864-646-2821
E-mail: info@tileusa.com
Internet: <https://www.tcnatile.com/>

TREE CARE INDUSTRY ASSOCIATION (TCIA)
136 Harvey Road, Suite 101
Londonderry, NH 03053
Ph: 603-314-5380 or 800-733-2622
Fax: 603-314-5386
Internet: <https://tcia.org/>

TRIDIUM, INC (TRIDIUM)
3951 Westerre Parkway, Suite 350
Richmond, VA 23233
Ph: 804-747-4771
Fax: 804-747-5204
E-mail: support@tridium.com
Internet: <https://www.tridium.com/>

TRUSS PLATE INSTITUTE (TPI)
218 N. Lee Street, Suite 312
Alexandria, VA 22314
Ph: 703-683-1010
Fax: 866-501-4012
E-mail: info@tpinst.org
Internet: <https://www.tpinst.org/>

TUBULAR EXCHANGER MANUFACTURERS ASSOCIATION (TEMA)
25 North Broadway
Tarrytown, NY 10591
Ph: 914-332-0040
Fax: 914-332-1541
E-mail: tema@tema.org
Internet: <http://www.tema.org>

TURFGRASS PRODUCERS INTERNATIONAL (TPI)
444 E. Roosevelt Road
#346
Lombard, IL 60148
Ph: 800-405-8873 or 847-649-5555
Fax: 847-649-5678
E-mail: info@turfgrassod.org
Internet: <http://www.turfgrassod.org>

U.S. AIR FORCE (USAF)
E-mail: usaf.pentagon.saf-aa.mbx.AFDPO-PPL@mail.mil
Internet: <https://www.e-publishing.af.mil/>

U.S. ARMY (DA)
Army Publishing Directorate
9301 Chapek Rd., Bldg 1458
Fort Belvoir, VA 22060-5447
Ph: 703-614-3727
E-mail: usarmy.pentagon.hqda-apd.mbx.customer-service@mail.mil
Internet: <https://armypubs.army.mil/>

U.S. ARMY CENTER FOR HEALTH PROMOTION AND PREVENTIVE MEDICINE
(USACHPPM)
5158 Blackhawk Road
Aberdeen Proving Ground, MD 21010-5403
Ph: 800-222-9698
Fax: 1 (410) 436-7142
E-mail: chppmhhc@AMEDD.ARMY.MIL
Internet: <http://chppm-www.apgea.army.mil>

U.S. ARMY CORPS OF ENGINEERS (USACE)
CRD-C DOCUMENTS available on Internet:
<http://www.wbdg.org/ffc/army-coe/standards>
Order Other Documents from:
Official Publications of the Headquarters, USACE
E-mail: hqpublications@usace.army.mil
Internet: <http://www.publications.usace.army.mil/>
or
<https://www.hnc.usace.army.mil/Missions/Engineering-Directorate/TECHINFO/>

U.S. ARMY ENVIRONMENTAL COMMAND (USAEC)
2450 Connell Road, Bldg 2264
Fort Sam Houston, TX 78234
Ph: 855-846-3940 or 210-466-1590
E-mail: usarmy.jbsa.aec.mbx@mail.mil
Internet: <https://aec.army.mil/>
Order from:
Defense Technical Information Center (DTIC)
Internet: <https://discover.dtic.mil/>
or
National Technical Information Service (NTIS)
5301 Shawnee Road
Alexandria, VA 22312
Ph: 703-605-6060 or 1-800-363-2068
Fax: 703-605-6880
TDD: 703-487-4639
E-mail: info@ntis.gov
Internet: <https://www.ntis.gov/>

U.S. CODE (USC)
Office of the Law Revision Counsel
U.S. House of Representatives
H2-308 Ford House Office Building
Washington, DC 20515
Ph: 202-226-2411
E-mail: uscode@mail.house.gov
Internet: <http://uscode.house.gov/>

U.S. DEFENSE INTELLIGENCE AGENCY (DIA)
Defense Intelligence Agency
7400 Pentagon
Office of Corporate Communications
Washington DC 20301-2400
Ph: 202-231-5554
Fax: 202-231-0851
E-mail: DIA-PAO@dodiis.mil
Internet: <http://www.dia.mil>

U.S. DEFENSE LOGISTICS AGENCY (DLA)
Andrew T. McNamara Building
8725 John J. Kingman Road
Fort Belvoir, VA 22060-6221
Ph: 877-352-2255
E-mail: dlacontactcenter@dla.mil
Internet: <http://www.dla.mil>

U.S. DEPARTMENT OF AGRICULTURE (USDA)
Order AMS Publications from:
AGRICULTURAL MARKETING SERVICE (AMS)
Seed Regulatory and Testing Branch
801 Summit Crossing Place, Suite C
Gastonia, NC 28054-2193
Ph: 704-810-8884
E-mail: PA@ams.usda.gov
Internet: <https://www.ams.usda.gov/>
Order Other Publications from:
USDA Rural Development
Rural Utilities Service
STOP 1510, Rm 5135
1400 Independence Avenue SW
Washington, DC 20250-1510
Phone: (202) 720-9540
Internet:
<https://www.rd.usda.gov/about-rd/agencies/rural-utilities-service>

U.S. DEPARTMENT OF COMMERCE (DOC)
1401 Constitution Avenue, NW
Washington, DC 20230
Ph: 202-482-2000
Internet: <https://www.commerce.gov/>
Order Publications From:
National Technical Information Service (NTIS)
5301 Shawnee Road
Alexandria, VA 22312
Ph: 703-605-6060 or 1-800-363-2068
Fax: 703-605-6880
TDD: 703-487-4639

E-mail: info@ntis.gov
Internet: <https://www.ntis.gov/>

U.S. DEPARTMENT OF DEFENSE (DOD)
Order DOD Documents from:
Room 3A750-The Pentagon
1400 Defense Pentagon
Washington, DC 20301-1400
Ph: 703-571-3343
Fax: 215-697-1462
E-mail: customerservice@ntis.gov
Internet: <https://www.ntis.gov/>
Obtain Military Specifications, Standards and Related Publications
from:
Acquisition Streamlining and Standardization Information System
(ASSIST)
Department of Defense Single Stock Point (DODSSP)
Document Automation and Production Service (DAPS)
Building 4/D
700 Robbins Avenue
Philadelphia, PA 19111-5094
Ph: 215-697-6396 - for account/password issues
Internet: <https://assist.dla.mil/online/start/>; account
registration required
Obtain Unified Facilities Criteria (UFC) from:
Whole Building Design Guide (WBDG)
National Institute of Building Sciences (NIBS)
1090 Vermont Avenue NW, Suite 700
Washington, DC 20005
Ph: 202-289-7800
Fax: 202-289-1092
Internet:
<https://www.wbdg.org/ffc/dod/unified-facilities-criteria-ufc>

U.S. DEPARTMENT OF ENERGY (DOE)
1000 Independence Avenue Southwest
Washington, D.C. 20585
Ph: 202-586-5000
Fax: 202-586-4403
E-mail: The.Secretary@hq.doe.gov
Internet: <https://www.energy.gov/>

U.S. DEPARTMENT OF ENERGY FEDERAL ENERGY MANAGEMENT PROGRAM (FEMP)
Forrestal Building
1000 Independence Avenue, SW
Washington, DC 20585
Internet:
<https://www.energy.gov/eere/femp/federal-energy-management-program>

U.S. DEPARTMENT OF HOUSING AND URBAN DEVELOPMENT (HUD)
HUD User
P.O. Box 23268
Washington, DC 20026-3268
Ph: 800-245-2691 or 202-708-3178
TDD: 800-927-7589
Fax: 202-708-9981
E-mail: helpdesk@huduser.gov
Internet: <https://www.huduser.gov>

U.S. DEPARTMENT OF THE NAVY (DON)
Chief of Information
Attn: US Navy
1200 Navy Pentagon
Washington, DC 20350-1200
Internet: <https://www.navy.mil/>

U.S. DEPARTMENT OF STATE (SD)
2201 C Street, NW
Washington, DC 20520
Ph: 202-647-4000
Internet: <https://www.state.gov/>

U.S. DEPARTMENT OF TRANSPORTATION (DOT)
1200 New Jersey Ave., SE
Washington, DC 20590
Ph: 202-366-4000
Internet: <https://www.transportation.gov/>

U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA)
1200 Pennsylvania Avenue, N.W.
Washington, DC 20004
Ph: 202-564-4700
Internet: <https://www.epa.gov>
--- Some EPA documents are available only from:
National Technical Information Service (NTIS)
5301 Shawnee Road
Alexandria, VA 22312
Ph: 703-605-6060 or 1-800-363-2068
Fax: 703-605-6880
TDD: 703-487-4639
E-mail: info@ntis.gov
Internet: <https://www.ntis.gov/>

U.S. FEDERAL AVIATION ADMINISTRATION (FAA)
Order for sale documents from:
Superintendent of Documents
U.S. Government Publishing Office (GPO)
732 N. Capitol Street, NW
Washington, DC 20401
Ph: 202-512-1800 or 866-512-1800
Bookstore: 202-512-0132
Internet: <https://www.gpo.gov/>
Order free documents from:
U.S. Department of Transportation
Federal Aviation Administration
800 Independence Avenue, SW
Washington, DC 20591
Ph: 866-835-5322
Internet: <https://www.faa.gov/>

U.S. FEDERAL COMMUNICATIONS COMMISSION (FCC)
445 12th Street SW
Washington, DC 20554
Ph: 888-225-5322
TTY: 888-835-5322
Fax: 866-418-0232
Internet: <https://www.fcc.gov/>
Order Publications From:

Superintendent of Documents
U.S. Government Publishing Office (GPO)
732 N. Capitol Street, NW
Washington, DC 20401
Ph: 202-512-1800 or 866-512-1800
Bookstore: 202-512-0132
Internet: <https://www.gpo.gov/>

U.S. FEDERAL HIGHWAY ADMINISTRATION (FHWA)
1200 New Jersey Ave., SE
Washington, DC 20590
Ph: 202-366-4000
E-mail: ExecSecretariat.FHWA@dot.gov
Internet: <https://www.fhwa.dot.gov/>
Order from:

Superintendent of Documents
U.S. Government Publishing Office (GPO)
732 N. Capitol Street, NW
Washington, DC 20401
Ph: 202-512-1800 or 866-512-1800
Bookstore: 202-512-0132
Internet: <https://www.gpo.gov/>

U.S. GENERAL SERVICES ADMINISTRATION (GSA)
General Services Administration
1800 F Street, NW
Washington, DC 20405
Ph: 1-844-472-4111
Internet: <https://www.gsa.eLibrary.gsa.gov/ElibMain/home.do>
Obtain documents from:
Acquisition Streamlining and Standardization Information System
(ASSIST)
Internet: <https://assist.dla.mil/online/start/>; account
registration required

U. S. GREEN BUILDING COUNCIL (USGBC)
2101 L St NW, Suite 500
Washington, DC 20037
Ph: 202-828-7422
Internet: <https://new.usgbc.org/>

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)
8601 Adelphi Road
College Park, MD 20740-6001
Ph: 866-272-6272
Internet: <https://www.archives.gov/>
Order documents from:
Superintendent of Documents
U.S. Government Publishing Office (GPO)
732 N. Capitol Street, NW
Washington, DC 20401
Ph: 202-512-1800 or 866-512-1800
Bookstore: 202-512-0132
Internet: <https://www.gpo.gov/>

U.S. NAVAL FACILITIES ENGINEERING COMMAND (NAVFAC)
1322 Patterson Ave. SE, Suite 1000
Washington Navy Yard, DC 20374-5065
Ph: 202-685-9387

Internet: <http://www.navfac.navy.mil>

U.S. NAVAL SEA SYSTEMS COMMAND (NAVSEA)
Commander Naval Sea Systems Command
1333 Isaac Hull Ave., SE
Washington Navy Yard, DC 20376
Ph: 202-781-0000
Internet: <https://www.navsea.navy.mil/>

UL ENVIRONMENT (ULE)
2211 Newmarket Parkway, Suite 106
Marietta, GA 30067
Ph: 888-485-4733
E-mail: environment@ul.com
Intertet: <https://industries.ul.com/environment/>

UNDERWRITERS LABORATORIES (UL)
2600 N.W. Lake Road
Camas, WA 98607-8542
Ph: 877-854-3577 or 360-817-5500
E-mail: CustomerExperienceCenter@ul.com
Internet: <https://www.ul.com/>
UL Directories available through IHS at <https://ihsmarkit.com/>

UNDERWRITERS LABORATORIES OF CANADA (ULC)
7 Underwriters Road
Toronto, Ontario, Canada M1R 3A9
Ph: 866-937-3852
Fax: 416.757.8727
E-mail: cec@ul.com
Internet: <https://canada.ul.com/>

UNI-BELL PVC PIPE ASSOCIATION (UBPPA)
Corporate Headquarters
2711 LBJ Freeway, Suite 1000
Dallas, TX 75234
Ph: 972-243-3902
Fax: 972-243-3907
E-mail: info@uni-bell.org
Internet: <https://www.uni-bell.org/>

VIBRATION ISOLATION AND SEISMIC CONTROL MANUFACTURERS ASSOCIATION
(VISCMA)
994 Old Eagle School Road
Suite 1019
Wayne, PA 19087-1866
Ph: 610-971-4850
E-mail: info@viscma.com
Internet: <http://www.viscma.com>

WALLCOVERINGS ASSOCIATION (WA)
330 N. Wabash Avenue
Suite 2000
Chicago, IL 60611
Ph: 312-321-5166
E-mail: info@wallcoverings.org
Internet: <https://www.wallcoverings.org>

WASHINGTON STATE ADMINISTRATIVE CODE (WAC)
Legislative Information Center
Cheri Randich, Manager
110 Legislative Building
Olympia, WA 98504-0600
Ph: 360-786-7573
E-mail: support@leg.wa.gov
Internet: <https://app.leg.wa.gov/wac/>

WASHINGTON STATE DEPARTMENT OF ECOLOGY (WSDE)
300 Desmond Drive, SE
Lacey, WA 98503
Ph: 360-407-6000
Fax: 360-407-6989
Internet:
<https://ecology.wa.gov/About-us/Online-tools-publications/Publications-forms>

WATER ENVIRONMENT FEDERATION (WEF)
601 Wythe Street
Alexandria, VA 22314
Ph: 800-666-0206
Fax: 703-684-2400
E-mail: csc@wef.org
Internet: <https://www.wef.org/>

WATER QUALITY ASSOCIATION (WQA)
4151 Naperville Road
Lisle, IL 60532-3696
Ph: 630-505-0160
Fax: 630-505-9637
Internet: <https://www.wqa.org/>

WEST COAST LUMBER INSPECTION BUREAU (WCLIB)
6980 S.W. Varns
Tigard, OR 97223
Ph: 503-639-0651
Fax: 503-684-8928
E-mail: info@wclib.org
Internet: <http://www.wclib.org>

WESTERN WOOD PRESERVERS INSTITUTE (WWPI)
12503 SE Mill Plain Blvd, Ste 205
Vancouver, WA 98684
Ph: 360-693-9958
Internet: <https://wwpinstitute.org/>

WESTERN WOOD PRODUCTS ASSOCIATION (WWPA)
1500 SW First Ave., Suite 870
Portland, OR 97201
Ph: 503-224-3930
E-mail: info@wwpa.org
Internet: <http://www.wwpa.org>

WINDOW AND DOOR MANUFACTURERS ASSOCIATION (WDMA)
2025 M Street, NW, Suite 800
Washington, DC 20036-3309
Ph: 202-367-1157
or
330 N Wabash Avenue, Suite 2000

Chicago, IL 60611
Ph: 312-321-6802
E-mail: membersupport@wdma.com
Internet: <https://www.wdma.com/>

WIRE ROPE TECHNICAL BOARD (WRTB)
PO Box 151387
Alexandria, VA 22315-8550
Ph: 703-299-8550
Fax: 703-299-9253
E-mail: wrtb@usa.net
Internet: <http://www.wireropetechnicalboard.org>

WOOD MOULDING AND MILLWORK PRODUCERS ASSOCIATION (WMPA)
507 First Street
Woodland, CA 95695
Ph: 530-661-9591
Fax: 530-661-9586
E-mail: info@wmpa.com
Internet: <https://www.wmpa.com/>

WOODWORK INSTITUTE (WI)
3188 Industrial Blvd.
West Sacramento, CA 95691
Ph: 916-372-9943
Fax: 916-372-9950
E-mail: info@woodinst.com
Internet: <https://woodworkinstitute.com>

WOOLMARK COMPANY (WBI)
NeueHouse
110 East 25th Street, 3rd Floor
New York, NY 10010
or
WeWork One Culver
10000 Washington Blvd
Culver City, CA 90232
Ph: 347-767-3160
E-mail: woolmark.americas@wool.com
internet: <https://www.woolmark.com/>

PART 2 PRODUCTS

Not used

PART 3 EXECUTION

Not used

-- End of Section --

SECTION 01 45 00.00 10

QUALITY CONTROL
11/16

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM D3740 (2019) Minimum Requirements for Agencies Engaged in the Testing and/or Inspection of Soil and Rock as Used in Engineering Design and Construction

ASTM E329 (2021) Standard Specification for Agencies Engaged in Construction Inspection, Testing, or Special Inspection

U.S. ARMY CORPS OF ENGINEERS (USACE)

ER 1110-1-12 (2006; Change 1) Engineering and Design -- Quality Management

1.2 PAYMENT

Separate payment will not be made for providing and maintaining an effective Quality Control program. Include all associated costs in the applicable BidSchedule item.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Contractor Quality Control (CQC) Plan; G

Additional Requirements for Design Quality Control (DQC) Plan; G,
DO

SD-05 Design Data

Discipline-Specific Checklists

Design Quality Control

SD-06 Test Reports

Verification Statement

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

3.1 GENERAL REQUIREMENTS

Establish and maintain an effective quality control (QC) system that complies with FAR 52.246-12 Inspection of Construction. QC consist of plans, procedures, and organization necessary to produce an end product which complies with the Contract requirements. The QC system covers all design and construction operations, both onsite and offsite, and be keyed to the proposed design and construction sequence. The project superintendent will be held responsible for the quality of work and is subject to removal by the Contracting Officer for non-compliance with the quality requirements specified in the Contract. In this context the highest level manager responsible for the overall construction activities at the site, including quality and production is the project superintendent. The project superintendent maintains a physical presence at the site at all times and is responsible for all construction and related activities at the site, except as otherwise acceptable to the Contracting Officer.

3.2 CONTRACTOR QUALITY CONTROL (CQC) PLAN

Submit no later than 15 days after receipt of notice to proceed, the Contractor Quality Control (CQC) Plan proposed to implement the requirements FAR 52.246-12 Inspection of Construction. The Government will consider an interim plan for the first 15 days of operation. ConstructionDesign and construction will be permitted to begin only after acceptance of the CQC Plan or acceptance of an interim plan applicable to the particular feature of work to be started. Work outside of the accepted interim plan will not be permitted to begin until acceptance of a CQC Plan or another interim plan containing the additional work.

3.2.1 Content of the CQC Plan

Include, as a minimum, the following to cover all design and construction-operations, both onsite and offsite, including work by subcontractors designers of record, consultants, architect/engineers (AE), fabricators, suppliers and purchasing agents:

- a. A description of the quality control organization, including a chart showing lines of authority and acknowledgment that the CQC staff will implement the three phase control system for all aspects of the work specified. Include a CQC System Manager that reports to the project superintendent.
- b. The name, qualifications (in resume format), duties, responsibilities, and authorities of each person assigned a CQC function.
- c. A copy of the letter to the CQC System Manager signed by an authorized official of the firm which describes the responsibilities and delegates sufficient authorities to adequately perform the functions

of the CQC System Manager, including authority to stop work which is not in compliance with the Contract. Letters of direction to all other various quality control representatives outlining duties, authorities, and responsibilities will be issued by the CQC System Manager. Furnish copies of these letters to the Contracting Officer.

- d. Procedures for scheduling, reviewing, certifying, and managing submittals, including those of subcontractors, designers of record, consultants, architect engineers (AE), offsite fabricators, suppliers, and purchasing agents. These procedures must be in accordance with Section 01 33 00 SUBMITTAL PROCEDURES.
- e. Control, verification, and acceptance testing procedures for each specific test to include the test name, specification paragraph requiring test, feature of work to be tested, test frequency, and person responsible for each test. (Laboratory facilities approved by the Contracting Officer are required to be used.)
- f. Procedures for tracking preparatory, initial, and follow-up control phases and control, verification, and acceptance tests including documentation.
- g. Procedures for tracking design and construction deficiencies from identification through acceptable corrective action. Establish verification procedures that identified deficiencies have been corrected.
- h. Reporting procedures, including proposed reporting formats.
- i. A list of the definable features of work. A definable feature of work is a task which is separate and distinct from other tasks, has separate control requirements, and is identified by different trades or disciplines, or it is work by the same trade in a different environment. Although each section of the specifications can generally be considered as a definable feature of work, there are frequently more than one definable features under a particular section. This list will be agreed upon during the coordination meeting.
- j. Coordinate scheduled work with Special Inspections required by UFC 3-301-01. Where the applicable Code issue by the International Code Council (ICC) calls for inspections by the Building Official, the Contractor must include the inspections in the Quality Control Plan and must perform the inspections required by the applicable ICC. The Contractor must perform these inspections using independent qualified inspectors. Include the Special Inspection Plan requirements in the QC Plan.

3.2.2 Additional Requirements for Design Quality Control (DQC) Plan

The following additional requirements apply to the Design Quality Control (DQC) plan:

- a. Submit and maintain a Design Quality Control (DQC) Plan as an effective quality control program which assures that all services required by this contract are performed and provided in a manner that meets professional architectural and engineering quality standards. As a minimum, all documents must be technically reviewed by competent, independent reviewers identified in the DQC Plan. The same element

that produced the product may not perform the independent technical review (ITR). Correct errors and deficiencies in the design documents prior to submitting them to the Government.

- b. Include the design schedule in the master project schedule, showing the sequence of events involved in carrying out the project design tasks within the specific Contract period. This should be at a detailed level of scheduling sufficient to identify all major design tasks, including those that control the flow of work. Include review and correction periods associated with each item. This should be a forward planning as well as a project monitoring tool. The schedule reflects calendar days and not dates for each activity. If the schedule is changed, submit a revised schedule reflecting the change within 7 calendar days. Include in the DQC Plan the discipline-specific checklists to be used during the design and quality control of each submittal. Submit at each design phase as part of the project documentation these completed discipline-specific checklists. ER 1110-1-12 provides some useful information in developing checklists.
- c. Implement the DQC Plan by a Design Quality Control Manager who has the responsibility of being cognizant of and assuring that all documents on the project have been coordinated. This individual must be a person who has verifiable engineering or architectural design experience and is a registered professional engineer or architect. Notify the Contracting Officer, in writing, of the name of the individual, and the name of an alternate person assigned to the position.

The Contracting Officer will notify the Contractor in writing of the acceptance of the DQC Plan. After acceptance, any changes proposed by the Contractor are subject to the acceptance of the Contracting Officer.

3.2.3 Acceptance of Plan

Acceptance of the Contractor's plan is required prior to the start of design and construction. Acceptance is conditional and will be predicated on satisfactory performance during the design and construction. The Government reserves the right to require the Contractor to make changes in the Contractor Quality Control (CQC) Plan and operations including removal of personnel, as necessary, to obtain the quality specified.

3.2.4 Notification of Changes

After acceptance of the CQC Plan, notify the Contracting Officer in writing of any proposed change. Proposed changes are subject to acceptance by the Contracting Officer.

3.3 COORDINATION MEETING

After the Preconstruction Conference, Postaward Conference, before start of design or construction, and prior to acceptance by the Government of the CQC Plan, meet with the Contracting Officer and discuss the Contractor's quality control system. Submit the CQC Plan a minimum of 14 calendar days prior to the Coordination Meeting. During the meeting, a mutual understanding of the system details must be developed, including the forms for recording the CQC operations, design activities, control activities, testing, administration of the system for both onsite and offsite work, and the interrelationship of Contractor's Management and control with the

Government's Quality Assurance. Minutes of the meeting will be prepared by the Government, signed by both the Contractor and the Contracting Officer and will become a part of the contract file. There can be occasions when subsequent conferences will be called by either party to reconfirm mutual understandings or address deficiencies in the CQC system or procedures which can require corrective action by the Contractor.

3.4 QUALITY CONTROL ORGANIZATION

3.4.1 Personnel Requirements

The requirements for the CQC organization are a Safety and Health Manager, CQC System Manager, a Design Quality Manager, and sufficient number of additional qualified personnel to ensure safety and Contract compliance. The Safety and Health Manager reports directly to a senior project (or corporate) official independent from the CQC System Manager. The Safety and Health Manager will also serve as a member of the CQC Staff Personnel identified in the technical provisions as requiring specialized skills to assure the required work is being performed properly will also be included as part of the CQC organization. The Contractor's CQC staff maintains a presence at the site at all times during progress of the work and have complete authority and responsibility to take any action necessary to ensure Contract compliance. The CQC staff will be subject to acceptance by the Contracting Officer. Provide adequate office space, filing systems and other resources as necessary to maintain an effective and fully functional CQC organization. Promptly complete and furnish all letters, material submittals, shop drawing submittals, schedules and all other project documentation to the CQC organization. The CQC organization is responsible to maintain these documents and records at the site at all times, except as otherwise acceptable to the Contracting Officer.

3.4.2 CQC System Manager

Identify as CQC System Manager an individual within the onsite work organization that is responsible for overall management of CQC and has the authority to act in all CQC matters for the Contractor. The CQC System Manager is required to be a construction person with a minimum of 10 years in related work. This CQC System Manager is on the site at all times during construction and is employed by the prime Contractor. The CQC System Manager is assigned as CQC System Manager but has duties as project superintendent in addition to quality control as long as there is an alternate CQC System Manager/Superintendent on site as well. Identify in the plan an alternate to serve in the event of the CQC System Manager's absence. The requirements for the alternate are the same as the CQC System Manager.

3.4.3 CQC Personnel

In addition to CQC personnel specified elsewhere in the contract, provide as part of the CQC organization specialized personnel to assist the CQC System Manager for the following areas: electrical, mechanical, civil, structural, environmental, architectural, materials technician, and submittals clerk. These individuals or specialized technical companies are employees of the prime or subcontractor; be responsible to the CQC System Manager; be physically present at the construction site during work on the specialized personnel's areas of responsibility; have the necessary education or experience in accordance with the experience matrix listed herein. These individuals can perform other duties but need to be allowed sufficient time to perform the specialized personnel's assigned quality

control duties as described in the Quality Control Plan. A single person can cover more than one area provided that the single person is qualified to perform quality control activities in each designated and that workload allows.

Experience Matrix	
Area	Qualifications
Civil	Graduate Civil Engineer or Construction Manager with 2 years experience in the type of work being performed on this project or technician with 5 yrs related experience
Mechanical	Graduate Mechanical Engineer with 2 yrs experience or person with 5 years of experience supervising mechanical features of work in the field with a construction company
Electrical	Graduate Electrical Engineer with 2 years related experience or person 5 years of experience supervising electrical features of work in the field with a construction company
Structural	Graduate Civil Engineer (with Structural Track or Focus) or Construction Manager with 2 years experience or person 5 years of experience supervising structural features of work in the field with a construction company
Architectural	Graduate Architect with 2 years experience or person with 5 years related experience
Environmental	Graduate Environmental Engineer with 3 years experience
Submittals	Submittal Clerk with 1 year experience
Concrete, Pavements and Soils	Materials Technician with 2 years experience for the appropriate area
Testing, Adjusting and Balancing (TAB) Personnel	Specialist must be a member of AABC or an experienced technician of the firm certified by the NEBB

3.4.4 Additional Requirement

In addition to the above experience and education requirements, the

Contractor Quality Control(CQC) System Manager and Alternate CQC System Manager are required to have completed the Construction Quality Management (CQM) for Contractors course. If the CQC System Manager does not have a current certification, obtain the CQM for Contractors course certification within 90 days of award. This course is periodically offered by the Naval Facilities Engineering Command and the Army Corps of Engineers. Contact the Contracting Officer for information on the next scheduled class.

The Construction Quality Management Training certificate expires after 5 years. If the CQC System Manager's certificate has expired, retake the course to remain current.

3.4.5 Organizational Changes

Maintain the CQC staff at full strength at all times. When it is necessary to make changes to the CQC staff, revise the CQC Plan to reflect the changes and submit the changes to the Contracting Officer for acceptance.

3.5 SUBMITTALS AND DELIVERABLES

Submittals, if needed, have to comply with the requirements in Section 01 33 00SUBMITTAL PROCEDURES. The CQC organization is responsible for certifying that all submittals and deliverables are in compliance with the contract requirements. When Section 01 91 00.15 10 TOTAL BUILDING COMMISSIONING are included in the contract, the submittals required by those sections have to be coordinated with Section 01 33 00 SUBMITTAL PROCEDURES to ensure adequate time is allowed for each type of submittal required.

3.6 CONTROL

CQC is the means by which the Contractor ensures that the construction, to include that of subcontractors and suppliers, complies with the requirements of the contract. At least three phases of control are required to be conducted by the CQC System Manager for each definable feature of the construction work as follows:

3.6.1 Preparatory Phase

This phase is performed prior to beginning work on each definable feature of work, after all required plans/documents/materials are approved/accepted, and after copies are at the work site. This phase includes:

- a. A review of each paragraph of applicable specifications, reference codes, and standards. Make available during the preparatory inspection a copy of those sections of referenced codes and standards applicable to that portion of the work to be accomplished in the field. Maintain and make available in the field for use by Government personnel until final acceptance of the work.
- b. Review of the Contract drawings.
- c. Check to assure that all materials and equipment have been tested, submitted, and approved.
- d. Review of provisions that have been made to provide required control inspection and testing.
- e. Review Special Inspections required by UFC 3-301-01

- f. Examination of the work area to assure that all required preliminary work has been completed and is in compliance with the Contract.
- g. Examination of required materials, equipment, and sample work to assure that they are on hand, conform to approved shop drawings or submitted data, and are properly stored.
- h. Review of the appropriate activity hazard analysis to assure safety requirements are met.
- i. Discussion of procedures for controlling quality of the work including repetitive deficiencies. Document construction tolerances and workmanship standards for that feature of work.
- j. Check to ensure that the portion of the plan for the work to be performed has been accepted by the Contracting Officer.
- k. Discussion of the initial control phase.
- l. The Government needs to be notified at least 48 hours in advance of beginning the preparatory control phase. Include a meeting conducted by the CQC System Manager and attended by the superintendent, other CQC personnel (as applicable), and the foreman responsible for the definable feature. Document the results of the preparatory phase actions by separate minutes prepared by the CQC System Manager and attach to the daily CQC report. Instruct applicable workers as to the acceptable level of workmanship required in order to meet contract specifications.

3.6.2 Initial Phase

This phase is accomplished at the beginning of a definable feature of work. Accomplish the following:

- a. Check work to ensure that it is in full compliance with contract requirements. Review minutes of the preparatory meeting.
- b. Verify adequacy of controls to ensure full contract compliance. Verify required control inspection and testing are in compliance with the contract.
- c. Establish level of workmanship and verify that it meets minimum acceptable workmanship standards. Compare with required sample panels as appropriate.
- d. Resolve all differences.
- e. Check safety to include compliance with and upgrading of the safety plan and activity hazard analysis. Review the activity analysis with each worker.
- f. The Government needs to be notified at least 48 hours in advance of beginning the initial phase for definable feature of work. Prepare separate minutes of this phase by the CQC System Manager and attach to the daily CQC report. Indicate the exact location of initial phase for definable feature of work for future reference and comparison with follow-up phases.

- g. The initial phase for each definable feature of work is repeated for each new crew to work onsite, or any time acceptable specified quality standards are not being met.
- h. Coordinate scheduled work with Special Inspections required by UFC 3-301-01.

3.6.3 Follow-up Phase

Perform daily checks to assure control activities, including control testing, are providing continued compliance with contract requirements, until completion of the particular feature of work. Record the checks in the CQC documentation. Conduct final follow-up checks and correct all deficiencies prior to the start of additional features of work which may be affected by the deficient work. Do not build upon nor conceal non-conforming work. Coordinate scheduled work with Special Inspections required by UFC 3-301-01.

3.6.4 Additional Preparatory and Initial Phases

Conduct additional preparatory and initial phases on the same definable features of work if: the quality of on-going work is unacceptable; if there are changes in the applicable CQC staff, onsite production supervision or work crew; if work on a definable feature is resumed after a substantial period of inactivity; or if other problems develop.

3.7 TESTS

3.7.1 Testing Procedure

Perform specified or required tests to verify that control measures are adequate to provide a product which conforms to contract requirements. Upon request, furnish to the Government duplicate samples of test specimens for possible testing by the Government. Testing includes operation and acceptance tests when specified. Procure the services of a Corps of Engineers approved testing laboratory or establish an approved testing laboratory at the project site. Perform the following activities and record and provide the following data:

- a. Verify that testing procedures comply with contract requirements.
- b. Verify that facilities and testing equipment are available and comply with testing standards.
- c. Check test instrument calibration data against certified standards.
- d. Verify that recording forms and test identification control number system, including all of the test documentation requirements, have been prepared.
- e. Record results of all tests taken, both passing and failing on the CQC report for the date taken. Specification paragraph reference, location where tests were taken, and the sequential control number identifying the test. If approved by the Contracting Officer, actual test reports are submitted later with a reference to the test number and date taken. Provide an information copy of tests performed by an offsite or commercial test facility directly to the Contracting Officer. Failure to submit timely test reports as stated results in nonpayment for related work performed and disapproval of the test

facility for this Contract.

3.7.2 Testing Laboratories

All testing laboratories must be validated by the USACE Material Testing Center (MTC) for the tests to be performed. Information on the USACE MTC with web-links to both a list of validated testing laboratories and for the laboratory inspection request for can be found at:

3.7.2.1 Capability Check

The Government reserves the right to check laboratory equipment in the proposed laboratory for compliance with the standards set forth in the contract specifications and to check the laboratory technician's testing procedures and techniques. Laboratories utilized for testing soils, concrete, asphalt, and steel is required to meet criteria detailed in ASTM D3740 and ASTM E329.

3.7.2.2 Capability Recheck

If the selected laboratory fails the capability check, the Contractor will be assessed a charge of \$500 to reimburse the Government for each succeeding recheck of the laboratory or the checking of a subsequently selected laboratory. Such costs will be deducted from the Contract amount due the Contractor.

3.7.3 Onsite Laboratory

The Government reserves the right to utilize the Contractor's control testing laboratory and equipment to make assurance tests, and to check the Contractor's testing procedures, techniques, and test results at no additional cost to the Government.

3.8 COMPLETION INSPECTION

3.8.1 Punch-Out Inspection

Conduct an inspection of the work by the CQC System Manager near the end of the work, or any increment of the work established by a time stated in FAR 52.211-10 Commencement, Prosecution, and Completion of Work, or by the specifications. Prepare and include in the CQC documentation a punch list of items which do not conform to the approved drawings and specifications, as required by paragraph DOCUMENTATION. Include within the list of deficiencies the estimated date by which the deficiencies will be corrected. Make a second inspection the CQC System Manager or staff to ascertain that all deficiencies have been corrected. Once this is accomplished, notify the Government that the facility is ready for the Government Pre-Final inspection.

3.8.2 Pre-Final Inspection

The Government will perform the pre-final inspection to verify that the facility is complete and ready to be occupied. A Government Pre-Final Punch List may be developed as a result of this inspection. Ensure that all items on this list have been corrected before notifying the Government, so that a Final inspection with the customer can be scheduled. Correct any items noted on the Pre-Final inspection in a timely manner. These inspections and any deficiency corrections required by this paragraph need to be accomplished within the time slated for

completion of the entire work or any particular increment of the work if the project is divided into increments by separate completion dates.

3.8.3 Final Acceptance Inspection

The Contractor's Quality Control Inspection personnel, plus the superintendent or other primary management person, and the Contracting Officer's Representative is required to be in attendance at the final acceptance inspection. Additional Government personnel including, but not limited to, those from Base/Post Civil Facility Engineer user groups, and major commands can also be in attendance. The final acceptance inspection will be formally scheduled by the Contracting Officer based upon results of the Pre-Final inspection. Notify the Contracting Officer at least 14 days prior to the final acceptance inspection and include the Contractor's assurance that all specific items previously identified to the Contractor as being unacceptable, along with all remaining work performed under the Contract, will be complete and acceptable by the date scheduled for the final acceptance inspection. Failure of the Contractor to have all contract work acceptably complete for this inspection will be cause for the Contracting Officer to bill the Contractor for the Government's additional inspection cost in accordance FAR 52.246-12 Inspection of Construction.

3.9 DOCUMENTATION

3.9.1 Quality Control Activities

Maintain current records providing factual evidence that required quality control activities and tests have been performed. Include in these records the work of subcontractors and suppliers on an acceptable form that includes, as a minimum, the following information:

- a. The name and area of responsibility of the Contractor/Subcontractor.
- b. Operating plant/equipment with hours worked, idle, or down for repair.
- c. Work performed each day, giving location, description, and by whom. When Network Analysis (NAS) is used, identify each phase of work performed each day by NAS activity number.
- d. Test and control activities performed with results and references to specifications/drawings requirements. Identify the control phase (Preparatory, Initial, Follow-up). List of deficiencies noted, along with corrective action.
- e. Quantity of materials received at the site with statement as to acceptability, storage, and reference to specifications/drawings requirements.
- f. Submittals and deliverables reviewed, with Contract reference, by whom, and action taken.
- g. Offsite surveillance activities, including actions taken.
- h. Job safety evaluations stating what was checked, results, and instructions or corrective actions.
- i. Instructions given/received and conflicts in plans and specifications.

- j. Provide documentation of design quality control activities. For independent design reviews, provide, as a minimum, identification of the Independent Technical Review (ITR) team, the ITR review comments, responses and the record of resolution of the comments.

3.9.2 Verification Statement

Indicate a description of trades working on the project; the number of personnel working; weather conditions encountered; and any delays encountered. Cover both conforming and deficient features and include a statement that equipment and materials incorporated in the work and workmanship comply with the Contract. Furnish the original and one copy of these records in report form to the Government daily within 48 hours after the date covered by the report, except that reports need not be submitted for days on which no work is performed. As a minimum, prepare and submit one report for every 7 days of no work and on the last day of a no work period. All calendar days need to be accounted for throughout the life of the contract. The first report following a day of no work will be for that day only. Reports need to be signed and dated by the Contractor Quality Control (CQC) System Manager. Include copies of test reports and copies of reports prepared by all subordinate quality control personnel within the CQC System Manager Report.

3.10 SAMPLE FORMS

Sample forms enclosed at the end of this section.

3.11 NOTIFICATION OF NONCOMPLIANCE

The Contracting Officer will notify the Contractor of any detected noncompliance with the foregoing requirements. Take immediate corrective action after receipt of such notice. Such notice, when delivered to the Contractor at the work site, will be deemed sufficient for the purpose of notification. If the Contractor fails or refuses to comply promptly, the Contracting Officer can issue an order stopping all or part of the work until satisfactory corrective action has been taken. No part of the time lost due to such stop orders will be made the subject of claim for extension of time or for excess costs or damages by the Contractor.

-- End of Section --

SECTION 01 45 35

SPECIAL INSPECTIONS

11/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

INTERNATIONAL CODE COUNCIL (ICC)

ICC IBC (2021) International Building Code

1.2 GENERAL REQUIREMENTS

Perform Special Inspections in accordance with the Statement of Special Inspections, Schedule of Special Inspections and Chapter 17 of ICC IBC. The Statement of Special Inspections and Schedule of Special Inspections are included as an attachment to this specification. Special Inspections are to be performed by an independent third party and are intended to ensure that the work of the Prime Contractor is in accordance with the Contract Documents and applicable building codes. Special inspections do not take the place of the three phases of control inspections performed by the Contractor's QC Manager or any testing and inspections required by other sections of the specifications.

1.3 DEFINITIONS

1.3.1 Continuous Special Inspections

Continuous Special Inspections is the constant monitoring of specific tasks by a special inspector. These inspections must be carried out continuously over the duration of the particular tasks.

1.3.2 Perform

Perform these Special Inspections tasks for each joint or member.

1.3.3 Observe

Observe these Special Inspections items on a periodic daily basis. Operations need not be delayed pending these inspections.

1.3.4 Special Inspector (SI)

A qualified person retained by the Contractor and approved by the Contracting Officer as having the competence necessary to inspect a particular type of construction requiring Special Inspections. The SI must be an independent third party hired directly by the Prime Contractor.

1.3.5 Associate Special Inspector (ASI)

A qualified person who assists the SI in performing Special Inspections but must perform inspection under the direct supervision of the SI and

cannot perform inspections without the SI on site.

1.3.6 Third Party

A Special inspector must not be an employee of the Contractor or of any Sub-Contractor performing the work to be inspected.

1.3.7 Special Inspector of Record (SIOR)

A licensed engineer in responsible charge of supervision of all special inspectors for the project and approved by the Contracting Officer. The SIOR must be an independent third party entity hired directly by the Prime Contractor.

1.3.8 Contracting Officer

The Government official having overall authority for administrative contracting actions. Certain contracting actions may be delegated to the Contracting Officer's Representative (COR).

1.3.9 Contractor's Quality Control (QC) Manager

An individual retained by the Prime Contractor and qualified in accordance with the Section 01 45 00 QUALITY CONTROL having the overall responsibility for the Contractor's QC organization.

1.3.10 Structural Engineer of Record (SER)

A registered design professional responsible for the overall design and review of submittal documents prepared by others. The SER is registered or licensed to practice their respective design profession as defined by the statutory requirements of the professional registration laws in the state in which the design professional works. The SER is also referred to as the Engineer of Record (EOR) in design code documents.

1.3.11 Statement of Special Inspections (SSI)

A document developed by the SER identifying the material, systems, components and work required to have Special Inspections. This statement is included at the end of this specification.

1.3.12 Schedule of Special Inspections (SSI)

A schedule which lists each of the required Special Inspections, the extent to which each Special Inspection is to be performed, and the required frequency for each in accordance with ICC IBC Chapter 17. This schedule is included at the end of this specification.

1.3.13 Definable Feature of Work (DFOW)

An inspection group that is separate and distinct from other inspection groups, having inspection requirements or inspectors that are unique.

1.4 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

SIOR Letter of Acceptance; G

Special Inspections Project Manual; G

Special Inspections Agency's Written NDT Practices with method and evidence of regular equipment calibration where applicable

SD-06 Test Reports

Special Inspections Daily Reports

Special Inspections Biweekly Reports

SD-07 Certificates

AISC Certified Steel Fabricator

Steel Truss Plant Quality Assurance Program

AC472 Accreditation

Steel Joist Institute Membership

Special Inspector of Record Qualifications; G

Special Inspector Qualifications; G

Qualification Records for NDT technicians

SD-11 Closeout Submittals

Interim Report of Special Inspections for Each DFOW; G

Comprehensive Final Report of Special Inspections; G

1.5 SPECIAL INSPECTOR QUALIFICATIONS

Submit qualifications for each special inspector and the special inspector of record.

1.5.1 Steel Construction and High Strength Bolting

1.5.1.1 Special Inspector

- a. ICC Structural Steel and Bolting Special Inspector certificate with one year of related experience, or
- b. Registered Professional Engineer with three years of related experience

1.5.1.2 Associate Special Inspector

Engineer-In-Training with one year of related experience.

1.5.2 Welding Structural Steel

1.5.2.1 Special Inspector

- a. ICC Structural Welding Special Inspector certificate with one year of related experience, or
- b. AWS Certified Welding Inspector

1.5.2.2 Associate Special Inspector

AWS Certified Associate Welding Inspector

1.5.3 Nondestructive Testing of Welds

1.5.3.1 Special Inspector

NDT Level III Certificate

1.5.3.2 Associate Special Inspector

NDT Level II Certificate plus one year of related experience

1.5.4 Cold Formed Steel Framing

1.5.4.1 Special Inspector

- a. ICC Structural Steel and Bolting Special Inspector certificate with one year of related experience, or
- b. ICC Commercial Building Inspector with one year of experience, or
- c. ICC Residential Building Inspector with one year of experience, or
- d. Registered Professional Engineer with three years related experience

1.5.4.2 Associate Special Inspector

Engineer-In-Training with one year of related experience.

1.5.5 Concrete Construction

1.5.5.1 Special Inspector

- a. ICC Reinforced Concrete Special Inspector Certificate with one year of related experience, or
- b. ACI Concrete Construction Special Inspector, or
- c. Registered Professional Engineer with three years of related experience

1.5.5.2 Associate Special Inspector

- a. ACI Concrete Construction Special Inspector in Training, or
- b. Engineer-In-Training with one year of related experience

1.5.6 Prestressed Concrete Construction

1.5.6.1 Special Inspector

- a. ICC Pre-stressed Special Inspector Certificate with one year of related experience, or
- b. PCI Quality Control Technician/ Inspector Level II Certificate with one year of related experience, or
- c. Registered Professional Engineer with three years of related experience

1.5.6.2 Associate Special Inspector

- a. PCI Quality Control Technician/ Inspector Level I Certificate with one year of related experience, or
- b. Engineer-In-Training with one year of related experience

1.5.7 Post-tensioned Concrete Construction

1.5.7.1 Special Inspector

- a. PTI Level 2 Unbonded PT Inspector Certificate, or
- b. Registered Professional Engineer with three years of related experience

1.5.7.2 Associate Special Inspector

- a. PTI Level 1 Unbonded PT Inspector Certificate with one year of related experience, or
- b. Engineer-In-Training with one year of related experience

1.5.8 Masonry Construction

1.5.8.1 Special Inspector

- a. ICC Structural Masonry Special Inspector Certificate with one year of related experience, or
- b. Registered Professional Engineer with three years of related experience

1.5.8.2 Associate Special Inspector

Engineer-In-Training with one year of related experience.

1.5.9 Wood

1.5.9.1 Special Inspector

- a. ICC Commercial Building Inspector Certificate with one year of related experience, or
- b. ICC Residential Building Inspector with one year of experience, or
- c. Registered Professional Engineer with three years of related experience

1.5.9.2 Associate Special Inspector

Engineer-In-Training with one year of related experience.

1.5.10 Verification of Site Soil Condition, Fill Placement and
Load-Bearing Requirements

1.5.10.1 Special Inspector

- a. ICC Soils Special Inspector Certificate with one year of related experience, or
- b. NICET Soils Technician Level II Certificate in Construction Material Testing, or
- c. Geologist-In-Training with three years of related experience, or
- d. Registered Professional Engineer with three years of related experience

1.5.10.2 Associate Special Inspector

- a. NICET Soils Technician Level I Certificate in Construction Material Testing with one year of related experience, or
- b. Engineer-In-Training with one year of related experience

1.5.11 Deep Foundations

1.5.11.1 Special Inspector

- a. NICET Soils Technician Level II Certificate in Construction Material Testing, or
- b. Geologist-In-Training with three years of related experience, or
- c. Registered Professional Engineer with three years of related experience

1.5.11.2 Associate Special Inspector

- a. NICET Soils Technician Level I Certificate in Construction Material Testing with one year of related experience, or
- b. NICET Geotechnical Engineering Technician Level I Construction or Generalist Certificate with one year of related experience, or
- c. Engineer-In-Training with one year of related experience

1.5.12 Sprayed Fire Resistant Material

1.5.12.1 Special Inspector

- a. ICC Spray-applied Fireproofing Special Inspector Certificate, or
- b. ICC Fire Inspector I Certificate with one year of related experience, or
- c. Registered Professional Engineer or Architect with related experience

1.5.12.2 Associate Special Inspector

Engineer-In-Training with one year of related experience

1.5.13 Mastic and Intumescent Fire Resistant Coatings

1.5.13.1 Special Inspector

- a. ICC Spray-applied Fireproofing Special Inspector Certificate, or
- b. ICC Fire Inspector I Certificate with one year of related experience,
or
- c. Registered Professional Engineer or Architect with related experience

1.5.13.2 Associate Special Inspector

Engineer-In-Training with one year of related experience.

1.5.14 Exterior Insulation and Finish System (EIFS)

1.5.14.1 Special Inspector

- a. AWCI EIFS Inspector Certificate, or
- b. Exterior Design Institute Certificate, or
- c. Registered Professional Engineer or Architect with related experience

1.5.14.2 Associate Special Inspector

Engineer-In-Training with one year of related experience.

1.5.15 Fire-Resistant Penetrations and Joints

1.5.15.1 Special Inspector

- a. Passed the UL Firestop Exam with one year of related experience, or
- b. Passed the FM Firestop Exam with one year of related experience, or
- c. Registered Professional Engineer with related experience

1.5.15.2 Associate Special Inspector

Engineer-In-Training with one year of related experience.

1.5.16 Smoke Control

1.5.16.1 Special Inspector

- a. AABC Technician Certification with one year of related experience, or
- b. Registered Professional Engineer with related experience

1.5.16.2 Associate Special Inspector

Engineer-In-Training with one year of related experience.

PART 2 PRODUCTS

2.1 FABRICATOR SPECIAL INSPECTIONS

Special Inspections of fabricator's work performed in the fabricator's shop is required to be inspected in accordance with the Statement of Special Inspections and the Schedule of Special Inspections unless the fabricator is certified by the approved agency to perform such work without Special Inspections. Submit the following certifications to the Contracting Officer for information to allow work performed in the fabricator's shop to not be subjected to Special Inspections.

AISC Certified Steel Fabricator.

Steel Joist Institute Membership

At the completion of fabrication, submit a certificate of compliance, to be included with the comprehensive final report of Special Inspections, stating that the materials supplied and work performed by the fabricator are in accordance with the construction documents.

PART 3 EXECUTION

3.1 RESPONSIBILITIES

3.1.1 Quality Control Manager

- a. Supervise all Special Inspectors required by the Contract Documents and the IBC.
- b. Verify the qualifications of all of the Special Inspectors.
- c. Verify the qualifications of fabricators.
- d. Maintain a 3-ring binder for the Special Inspector's daily and biweekly reports. This file must be located in a conspicuous place in the project trailer/office to allow review by the Contracting Officer and the SER.
- e. Maintain a rework items list that includes discrepancies noted on the Special Inspectors daily report.

3.1.2 Special Inspectors

- a. Inspect all elements of the project for which the special inspector is qualified to inspect and are identified in the Schedule of Special Inspections.
- b. Attend preparatory phase meetings related to the Definable Feature of Work (DFOW) for which the special inspector is qualified to inspect.
- c. Submit Special Inspections agency's written NDT practices for the monitoring and control of the agency's operations to include the following:
 - (1) The agency's procedures for the selection and administration of inspection personnel, describing the training, experience and examination requirements for qualifications and certification of

inspection personnel.

- (2) The agency's inspection procedures, including general inspection, material controls, and visual welding inspection.
- d. Submit qualification records for nondestructive testing (NDT) technicians designated for the project.
- e. Submit NDT procedures and equipment calibration records for NDT to be performed and equipment to be used for the project.
- f. Submit a copy of the daily reports to the QC Manager.
- g. Report discrepancies that are observed during Special Inspections to the QC Manager for correction. If discrepancies are not corrected before the special inspector leaves the site the observed discrepancies must be documented in the daily report.
- h. Submit a biweekly Special Inspection Report until all inspections are complete. A report is required for each biweekly period in which Special Inspections activity occurs, and must include the following:
 - (1) A brief summary of the work performed during the reporting time frame.
 - (2) Changes and discrepancies with the drawings, specifications that were observed during the reporting period.
 - (3) Discrepancies which were resolved or corrected.
 - (4) A list of nonconforming items requiring resolution.
 - (5) All applicable test result including nondestructive testing reports.
- i. At the completion of each DFOW requiring Special Inspections, submit an interim report of Special Inspections that documents the Special Inspections completed for that DFOW. Identify the inspector responsible for each item inspected and corrections of all discrepancies noted in the daily reports. The interim report of Special Inspections must be signed, dated and indicate the certification of the special inspector qualifying them to conduct the inspection.
- j. At the completion of the project submit a comprehensive final report of Special Inspections that documents the Special Inspections completed for the project and corrections of all discrepancies noted in the daily reports. The comprehensive final report of Special Inspections must be signed, dated and indicate the certification of the special inspector qualifying them to conduct the inspection.

3.2 DEFECTIVE WORK

Check work as it progresses, but failure to detect any defective work or materials must in no way prevent later rejection if defective work or materials are discovered, nor obligate the Contracting Officer to accept such work.

-- End of Section --

This page left blank.

Project: D51 Hangar Conversion
 Location: Eglin AFB
 Project #:
 Date: 4/21/2024



STATEMENT OF SPECIAL INSPECTIONS

Project Seismic Design Category: B

Project Risk Category: II

Project Design Wind Speed (mph): 145

Number of Stories: 1

Structure Height Above Grade (ft): 31

Hazardous Occupancy or attached to such? No Group H Occupancies

Special Inspector of Record (SIOR)

A Special Inspector of Record (SIOR) IS NOT required (per UFGS 01 45 35, Section 1.3.8)

Lateral Force Resisting System (LFRS)

2018 IBC 1704.3.2 and 1704.3.3

Following is a listing of critical main wind/seismic force resisting systems for this structure. Carefully inspect these elements as part of the roles and responsibilities of the Special Inspector (reference the Schedule of Special Inspections for inspection checklists).

Vertical LFRS Elements	Notes
Steel Ordinary Concentric Braced Frames	Existing pre-engineered metal building cable x-bracing
Steel Ordinary Moment frames	Existing pre-engineered metal building rigid frames
Ordinary Reinforced masonry shearwalls	Addition
Horizontal LFRS Elements	Notes
Chord Elements	Steel angle at roof
Metal Roof Deck & Related Fastening System	See Roof Plan
Out of Plane Wall Connections	CMU bond beam to joist seat and to deck

Project: D51 Hangar Conversion
Location: Eglin AFB
Project #: 0
Date: 4/21/2024

Designated Seismic Systems (DSS)

(2018 IBC 1705.13.3) (ASCE 7-16, 13.2.2, C13.2.2) (UFC 3-301-1, 2-5.3)

DESIGNATED SEISMIC SYSTEMS DO NOT APPLY TO THIS PROJECT, due to the Seismic Design Category being less than C.

ELECTRICAL Designated Seismic Systems (DSS) Requiring a Certificate of Compliance
N/A
N/A
N/A
N/A
N/A

If additional space is required, append an additional sheet listing the remaining DSS

MECHANICAL/PLUMBING Designated Seismic Systems (DSS) Requiring a Certificate of Compliance
N/A
N/A
N/A
N/A
N/A
N/A

If additional space is required, append an additional sheet listing the remaining DSS

OTHER Designated Seismic Systems (DSS) Requiring a Certificate of Compliance
N/A
N/A
N/A
N/A
N/A
N/A

Final Walk Down Inspection and Report

(UFC 3 301 01 SECTION 2-5.4)

Final Walk Down Inspection of non-structural Designated Seismic Systems does not apply to this project (no Designated Seismic Systems)

SCHEDULE OF SPECIAL INSPECTIONS

Reference UFGS 01 45 35 for all requirements not noted as part of this schedule.

INSPECTION DEFINITIONS:

- PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and noted verification.
- OBSERVE:** Observe these items randomly during the course of each work day to insure that applicable requirements are being met. Operations need not be delayed pending these inspections at contractor’s risk.
- DOCUMENT:** Document, with a report, that the work has been performed in accordance with the contract documents. This is in addition to any other reports required in the Special Inspections guide specification.
- CONTINUOUS:** Constant monitoring of identified tasks by a special inspector over the duration of performance of said tasks.

The Seismic Design Category for this project is: A, B, C, D, E, F (check appropriate box)

STRUCTURAL - STEEL – WELDING SECTION

ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:

STEEL INSPECTION <u>PRIOR TO WELDING</u> – VERIFY THE FOLLOWING ARE IN COMPLIANCE 2018 IBC 1705.2.1, AISC 360-16: Table C-N5.4-1		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Verify that the welding procedures specification (WPS) is available	PERFORM	
2. Verify manufacturer certifications for welding consumables are available	PERFORM	
3. Verify material identification	PERFORM	Type and grade.
4. Welder Identification System	PERFORM	The fabricator or erector, as applicable, shall maintain a system by which a welder who has welded a joint or member can be identified. Stamps, if used, shall be the low-stress type.
5. Fit-up of groove welds (including joint geometry)	OBSERVE	<ul style="list-style-type: none"> ✓ Joint preparation ✓ Dimensions (alignment, root opening, root face, bevel) ✓ Cleanliness (condition of steel surfaces) ✓ Tacking (tack weld quality and location)

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.

		✓ Backing type and fit (if applicable)
6. Configuration and finish of access holes	OBSERVE	
7. Fit-up of fillet welds	OBSERVE	<ul style="list-style-type: none"> ✓ Dimensions (alignment, gaps at root) ✓ Cleanliness (condition of steel surfaces) ✓ Tacking (tack weld quality and location)
STEEL INSPECTION DURING WELDING – VERIFY THE FOLLOWING ARE IN COMPLIANCE 2018 IBC 1705.2.1, AISC 360-16: Table C-N5.4-2		
TASK	INSPECTION TYPE	DESCRIPTION
8. Use of qualified welders	PERFORM	Welding by welders, welding operators, and tack welders who are qualified in conformance with requirements.
9. Control and handling of welding consumables	OBSERVE	<ul style="list-style-type: none"> ✓ Packaging ✓ Electrode atmospheric exposure control
10. No welding over cracked tack welds	OBSERVE	
11. Environmental conditions	OBSERVE	<ul style="list-style-type: none"> ✓ Wind speed within limits ✓ Precipitation and temperature
12. Welding Procedures Specification followed	OBSERVE	<ul style="list-style-type: none"> ✓ Settings on welding equipment ✓ Travel speed ✓ Selected welding materials ✓ Shielding gas type/flow rate ✓ Preheat applied ✓ Interpass temperature maintained (min./max.) ✓ Proper position (F, V, H, OH) ✓ Intermix of filler metals avoided
13. Welding techniques	OBSERVE	<ul style="list-style-type: none"> ✓ Interpass and final cleaning ✓ Each pass within profile limitations ✓ Each pass meets quality requirements

STRUCTURAL - STEEL – WELDING SECTION (CONTINUED)

STEEL INSPECTION AFTER WELDING – VERIFY THE FOLLOWING ARE IN COMPLIANCE 2018 IBC 1705.2.1, AISC 360-16: Table C-N5.4-3		
TASK	INSPECTION TYPE ¹	DESCRIPTION
14. Welds cleaned	OBSERVE	
15. Size, length, and location of all welds	PERFORM	Size, length, and location of all welds conform to the requirements of the detail drawings.
16. Welds meet visual acceptance criteria	PERFORM AND DOCUMENT	<ul style="list-style-type: none"> ✓ Crack prohibition ✓ Weld/base-metal fusion ✓ Crater cross section ✓ Weld profiles ✓ Weld size ✓ Undercut ✓ Porosity
17. Arc strikes	PERFORM	
18. k-area	PERFORM	When welding of doubler plates, continuity plates or stiffeners has been performed in the k-area, visually inspect the web k-area for cracks.
19. Backing removed, weld tabs removed and finished, and fillet welds added where required	PERFORM	
20. Repair activities	PERFORM AND DOCUMENT	
21. Document acceptance or rejection of welded joint or member	PERFORM	

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.

DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

STRUCTURAL - STEEL – BOLTING SECTION

ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:

STEEL INSPECTION TASKS PRIOR TO BOLTING – VERIFY THE FOLLOWING ARE IN COMPLIANCE 2018 IBC 1705.2.1, AISC 360-16: Table C-N5.6-1		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Manufacture’s certifications available for fastener materials	PERFORM	
2. Fasteners marked in accordance with ASTM requirements	OBSERVE	
3. Proper fasteners selected for joint detail (grade, type, bolt length if threads are to be excluded from shear plane)	OBSERVE	
4. Proper bolting procedure selected for joint detail	OBSERVE	
5. Connecting elements, including appropriate faying surface condition and hole preparation, if specified, meet applicable requirements	OBSERVE	
6. Proper storage provided for bolts, nuts, washers, and other fastener components	OBSERVE	
STEEL INSPECTION TASKS DURING BOLTING – VERIFY THE FOLLOWING ARE IN COMPLIANCE 2018 IBC 1705.2.1, AISC 360-16: Table C-N5.6-2		
TASK	INSPECTION TYPE ¹	DESCRIPTION
7. Fastener assemblies of suitable condition, placed in all holes and washers (if required) are positioned as required	OBSERVE	
8. Joint brought to the snug-tight condition prior to pretensioning operation	OBSERVE	
9. Fastener component not turned by the wrench prevented from rotating	OBSERVE	
10. Bolts are pretensioned in accordance with RCSC Specification, progressing systematically from the most rigid point toward the free edges	OBSERVE	
STEEL INSPECTION TASKS AFTER BOLTING – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.2.1, AISC 360-10: Table C-N5.6-3		
TASK	INSPECTION TYPE ¹	DESCRIPTION
11. Document acceptance or rejection of all bolted connections	DOCUMENT	

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

STRUCTURAL - STEEL - NON DESTRUCTIVE TESTING SECTION**ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:**

NONDESTRUCTIVE TESTING OF WELDED JOINTS – VERIFY THE FOLLOWING ARE IN COMPLIANCE 2018 IBC 1705.2.1, AISC 360-16: Section N5.5		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Use of qualified nondestructive testing personnel	PERFORM	Visual weld inspection and nondestructive testing (NDT) shall be conducted by personnel qualified in accordance with AWS D1.8 clause 7.2
2. CJP groove welds	OBSERVE	[NOTE: DOR must delete this row if section D (SEISMIC PROVISIONS SECTION) is checked] Dye penetrant testing (DT) and ultrasonic testing (UT) shall be performed on 20% of CJP groove welds for materials greater than 5/16" (8mm) thick. Testing rate must be increased to 100% if greater than 5% of welds tested have unacceptable defects.
3. Welded joints subject to fatigue	OBSERVE	Dye penetrant testing (DT) and Ultrasonic testing (UT) shall be performed on 100% of welded joints identified on contract drawings as being subject to fatigue.
4. Weld tab removal sites	OBSERVE	At the end of welds where weld tabs have been removed, magnetic particle testing shall be performed on the same beam-to-column joints receiving UT

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.

OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor's risk.

STRUCTURAL - STEEL – AISC 341 REQUIREMENTS (SEISMIC PROVISIONS) SECTION

ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:

NONDESTRUCTIVE TESTING OF WELDED JOINTS – VERIFY THE FOLLOWING ARE IN COMPLIANCE 2018 IBC 1705.2.1, AISC 341-16: Section J6.2		
TASK	INSPECTION TYPE ¹	DESCRIPTION
[NOTE: DOR may uncheck this section for projects NOT designed in accordance with AISC 341 (Seismic Provisions) or for projects designed according to AISC 341, but using an R value equal to 3]		
5. CJP groove welds	OBSERVE	Dye penetrant testing (DT) and ultrasonic testing (UT) shall be performed on 100% of CJP groove welds for materials greater than 5/16” thick (8mm).
6. Beam cope and access hole.	OBSERVE	At welded splices and connections, thermally cut surfaces of beam copes and access holes shall be tested using magnetic particle testing (MT) or dye penetrant testing (DT), when the flange thickness exceeds 1 1/2 in. for rolled shapes, or when the web thickness exceeds 1 1/2 in. for built-up shapes.
7. K-area NDT (AISC 341)	PERFORM	Where welding of doubler plates, continuity plates or stiffeners has been performed in the k-area, the web shall be tested for cracks using magnetic particle testing (MT). The MT inspection area shall include the k-area base metal within 3-inches of the weld. The MT shall be performed no sooner than 48 hours following completion of the welding.
8. Placement of reinforcing or contouring fillet welds	DOCUMENT	

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

STRUCTURAL - STEEL - OTHER INSPECTIONS

ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:

OTHER STEEL INSPECTIONS – VERIFY THE FOLLOWING ARE IN COMPLIANCE 2018 IBC 1705.2.1, AISC 341-16: Tables J8.1 & J10.1		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Anchor rods and other embedments supporting structural steel	PERFORM	Verify the diameter, grade, type, and length of the anchor rod or embedded item, and the extent or depth of embedment prior to placement of concrete.
2. Fabricated steel or erected steel frame	OBSERVE	Verify compliance with the details shown on the construction documents, such as braces, stiffeners, member locations and proper application of joint details at each connection.
3. Reduced beam sections (RBS) where/if occurs	DOCUMENT	✓ Contour and finish ✓ Dimensional tolerances
4. Protected zones	DOCUMENT	No holes or unapproved attachments made by fabricator or erector
5. H-piles where/if occurs	DOCUMENT	No holes or unapproved attachments made by the responsible contractor

END SECTION

STRUCTURAL - COLD-FORMED METAL DECK - PLACEMENT SECTION

ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:

METAL DECK INSPECTION <u>PRIOR TO</u> DECK PLACEMENT – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2011, Appendix 1, Table 1.1		
TASK	INSPECTION TYPE ²	DESCRIPTION
1. Verify compliance of materials (deck and all deck accessories) with construction documents, including profiles, material properties, and base metal thickness	PERFORM	
2. Document acceptance or rejection of deck and deck accessories	DOCUMENT	
METAL DECK INSPECTION <u>DURING</u> DECK PLACEMENT – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2011, Appendix 1, Table 1.2		
TASK	INSPECTION TYPE ¹	DESCRIPTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

² **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

3. Verify compliance of deck and all deck accessories installation with construction documents	PERFORM	
4. Verify deck materials are represented by the mill certifications that comply with the construction documents	PERFORM	
5. Document acceptance or rejection of installation of deck and deck accessories	DOCUMENT	
METAL DECK INSPECTION AFTER DECK PLACEMENT – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2011, Appendix 1, Table 1.3		
TASK	INSPECTION TYPE ¹	DESCRIPTION
6. Welding procedure specification (WPS) available	PERFORM	
7. Manufactures certifications for welding consumables available	OBSERVE	
8. Material identification (type/grade)	OBSERVE	
9. Check welding equipment	OBSERVE	

END SECTION

STRUCTURAL - COLD-FORMED METAL DECK – WELDING SECTION

ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:

METAL DECK INSPECTION <u>DURING</u> WELDING – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2011, Appendix 1, Table 1.4		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Use of qualified welders	OBSERVE	
2. Control and handling of welding consumables	OBSERVE	
3. Environmental conditions (wind speed, moisture, temperature)	OBSERVE	
4. WPS followed	OBSERVE	
METAL DECK INSPECTION <u>AFTER</u> WELDING – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2011, Appendix 1, Table 1.5		
TASK	INSPECTION TYPE ¹	DESCRIPTION
5. Verify size and location of welds, including support, sidelap, and perimeter welds.	PERFORM	
6. Welds meet visual acceptance criteria	PERFORM	
7. Verify repair activities	PERFORM	
8. Document acceptance or rejection of welds	DOCUMENT	

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

STRUCTURAL - COLD-FORMED METAL DECK – FASTENING SECTION

ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:

METAL DECK INSPECTION <u>BEFORE</u> MECHANICAL FASTENING – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2011, Appendix 1, Table 1.6		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Manufacturer installation instructions available for mechanical fasteners	OBSERVE	
2. Proper tools available for fastener installation	OBSERVE	
METAL DECK INSPECTION <u>DURING</u> MECHANICAL FASTENING – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2011, Appendix 1, Table 1.7		
TASK	INSPECTION TYPE ¹	DESCRIPTION
3. Fasteners are positioned as required	OBSERVE	
4. Fasteners are installed in accordance with manufacturer's instructions	OBSERVE	
METAL DECK INSPECTION <u>AFTER</u> MECHANICAL FASTENING – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2011, Appendix 1, Table 1.8		
TASK	INSPECTION TYPE ¹	DESCRIPTION
5. Check spacing, type, and installation of support fasteners	PERFORM	
6. Check spacing, type, and installation of sidelap fasteners	PERFORM	
7. Check spacing, type, and installation of perimeter fasteners	PERFORM	
8. Verify repair activities	PERFORM	
9. Document acceptance or rejection of mechanical fasteners	DOCUMENT	

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

STRUCTURAL - OPEN-WEB STEEL JOISTS SECTION**ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:**

OPEN-WEB STEEL JOISTS AND JOIST GIRDERS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC TABLE 1705.2.3		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Installation of open-web steel joists and joist girders	OBSERVE	✓ End connections – welded or bolted ✓ Bridging – horizontal and diagonal

END SECTION

STRUCTURAL - CONCRETE CONSTRUCTION SECTION

ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:

CONCRETE CONSTRUCTION, INCLUDING COMPOSITE DECK – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC TABLE 1705.3 (ACI 318 REFERENCES NOTED IN IBC TABLE)		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Inspect reinforcement, including prestressing tendons, and verify placement.	OBSERVE	Verify prior to placing concrete that reinforcing is of specified type, grade and size; that it is free of oil, dirt and unacceptable rust; that it is located and spaced properly; that hooks, bends, ties, stirrups and supplemental reinforcement are placed correctly; that lap lengths, stagger and offsets are provided; and that all mechanical connections are installed per the manufacturer’s instructions and/or evaluation report.
2. Reinforcing bar welding	OBSERVE	✓ Verify weldability of reinforcing bars other than ASTM A 706 ✓ Inspect single-pass fillet welds, maximum 5/16” in accordance with AWS D1.4
3. All other welding	CONTINUOUS	Visually inspect all welds in accordance with AWS D1.4
4. Cast in place anchors and post installed drilled anchors (downward inclined)	OBSERVE	Verify prior to placing concrete that cast in place anchors and post installed drilled anchors have proper embedment, spacing and edge distance.
5. Post-installed adhesive anchors in horizontal or upward inclined orientations	CONTINUOUS AND DOCUMENT	✓ Inspect as required per approved ICC-ES report ✓ Verify that installer is certified for installation of horizontal and overhead installation applications ✓ Inspect proof loading as required by the contract documents
6. Verify use of required mix design	OBSERVE	Verify that all mixes used comply with the approved construction documents
7. Prior to concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete	CONTINUOUS	At the time fresh concrete is sampled to fabricate specimens for strength test verify these tests are performed by qualified technicians.
8. Inspect concrete and/or shotcrete placement for proper application techniques	CONTINUOUS	Verify proper application techniques are used during concrete conveyance and depositing avoids segregation or contamination. Verify that concrete is properly consolidated.
9. Verify maintenance of specified curing temperature and technique	OBSERVE	Inspect curing, cold weather protection, and hot weather protection procedures.
10. Pre-stressed concrete	CONTINUOUS	Verify application of prestressing forces and grouting of bonded prestressing tendons.

CONTINUED ON FOLLOWING PAGE

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.
CONTINUOUS: Constant monitoring of identified tasks by a special inspector over the duration of performance of said tasks.

STRUCTURAL - CONCRETE CONSTRUCTION (CONTINUED)

CONCRETE CONSTRUCTION, INCLUDING COMPOSITE DECK – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC TABLE 1705.3 (ACI 318 REFERENCES NOTED IN IBC TABLE)		
TASK	INSPECTION TYPE ¹	DESCRIPTION
11. Inspect erection of precast concrete members	OBSERVE	
12. Verify in-situ concrete strength, prior to stressing of tendons in post-tensioned concrete and prior to removal of shores and forms from beams and structural slabs.	OBSERVE	
13. Inspect formwork for shape, location and dimensions of the concrete member being formed.	OBSERVE	

END SECTION

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor's risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.
CONTINUOUS: Constant monitoring of identified tasks by a special inspector over the duration of performance of said tasks.

STRUCTURAL - MASONRY CONSTRUCTION SECTION (ALL RISK CATEGORIES)

ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:

MASONRY CONSTRUCTION – VERIFY THE FOLLOWING ARE IN COMPLIANCE <u>AT START</u> OF CONSTRUCTION IBC 1705.4 (ACI 530-13 TABLE 3.1.2 & 3.1.3)		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Compliance with approved submittals prior to start	OBSERVE	
2. Proportions of site-mixed mortar.	OBSERVE	
3. Grade and type of reinforcement, anchor bolts, and prestressing tendons and anchorages	OBSERVE	
4. Prestressing technique	OBSERVE	
5. Properties of thin bed mortar for AAC masonry	OBSERVE	
MASONRY CONSTRUCTION – VERIFY THE FOLLOWING ARE IN COMPLIANCE <u>PRIOR TO</u> GROUTING IBC 1705.4 (ACI 530-13 TABLE 3.1.2 & 3.1.3)		
TASK	INSPECTION TYPE ¹	DESCRIPTION
6. Grout space	OBSERVE	
7. Proportions of site-prepared grout and prestressing grout for bonded tendons	OBSERVE	
8. Proportions of site-mixed grout and prestressing grout for bonded tendons	OBSERVE	
9. Placement of masonry units and mortar joints	OBSERVE	
10. Welding of reinforcement	CONTINUOUS	
MASONRY CONSTRUCTION – VERIFY THE FOLLOWING ARE IN COMPLIANCE <u>DURING</u> CONSTRUCTION IBC 1705.4 (ACI 530-13 TABLE 3.1.2 & 3.1.3)		
TASK	INSPECTION TYPE ¹	DESCRIPTION
11. Size and location of structural elements is in compliance	OBSERVE	
12. Preparation, construction, and protection of masonry during cold weather (temperature below 40°F (4.4°C) or hot weather (temp above 90°F (32.2°C))	OBSERVE	
13. Application and measurement of prestressing force	CONTINUOUS	
14. Placement of grout and prestressing grout for bonded tendons	CONTINUOUS	
15. Placement of AAC masonry units and construction of thin bed mortar joints	CONTINUOUS	Continuous for first 5000 square feet only (465 square meters).
16. Observe preparation of grout specimens, mortar specimens, and/or prisms	OBSERVE	
17. Type, size and placement of reinforcement, connectors, anchor bolts and prestressing tendons and anchorages, including details of anchorage of masonry to structural members, frames, or other construction	OBSERVE	

END SECTION

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.

CONTINUOUS: Constant monitoring of identified tasks by a special inspector over the duration of performance of said tasks.

GEOTECHNICAL - SOILS INSPECTION SECTION**ALL OR PORTIONS OF THIS SECTION ARE APPLICABLE IF BOX IS CHECKED:**

SOILS INSPECTION – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.6		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Materials below shallow foundations are adequate to achieve the design bearing capacity.	OBSERVE	
2. Excavations are extended to proper depth and have reached proper material	OBSERVE	
3. Perform classification and testing of compacted fill materials	OBSERVE	
4. Verify use of proper materials, densities and lift thicknesses during placement and compaction of compacted fill	CONTINUOUS	
5. Prior to placement of compacted fill, inspect subgrade and verify that site has been prepared properly.	OBSERVE	During fill placement, the special inspector shall verify that proper materials and procedures are used in accordance with the provisions of the approved geotechnical report

END SECTION

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor's risk.

CONTINUOUS: Constant monitoring of identified tasks by a special inspector over the duration of performance of said tasks.

This page left blank.

SECTION 01 50 00

TEMPORARY CONSTRUCTION FACILITIES AND CONTROLS
05/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

FOUNDATION FOR CROSS-CONNECTION CONTROL AND HYDRAULIC RESEARCH
(FCCCHR)

FCCCHR List (continuously updated) List of Approved
Backflow Prevention Assemblies

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 241 (2022) Standard for Safeguarding
Construction, Alteration, and Demolition
Operations

NFPA 70 (2020; TIA 22-1; ERTA 1 2022) National
Electrical Code

U.S. ARMY CORPS OF ENGINEERS (USACE)

EM 385-1-1 (2014) Safety -- Safety and Health
Requirements Manual

U.S. FEDERAL HIGHWAY ADMINISTRATION (FHWA)

MUTCD (2009; Rev 2012) Manual on Uniform Traffic
Control Devices

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00
SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Construction Site Plan; G

Traffic Control Plan; G

1.3 CONSTRUCTION SITE PLAN

Prior to the start of work, submit a site plan showing the locations and dimensions of temporary facilities (including layouts and details, equipment and material storage area (onsite and offsite), and access and

haul routes, avenues of ingress/egress to the fenced area and details of the fence installation. Identify any areas which may have to be graveled to prevent the tracking of mud. Indicate if the use of a supplemental or other staging area is desired. Show locations of safety and construction fences, site trailers, construction entrances, trash dumpsters, temporary sanitary facilities, and worker parking areas.

1.4 BACKFLOW PREVENTERS CERTIFICATE

Certificate of Full Approval from FCCCHR List, University of Southern California, attesting that the design, size and make of each backflow preventer has satisfactorily passed the complete sequence of performance testing and evaluation for the respective level of approval. Certificate of Provisional Approval will not be acceptable.

1.4.1 Backflow Tester Certificate

Prior to testing, submit to the Contracting Officer certification issued by the State or local regulatory agency attesting that the backflow tester has successfully completed a certification course sponsored by the regulatory agency. Tester must not be affiliated with any company participating in any other phase of this Contract.

1.4.2 Backflow Prevention Training Certificate

Submit a certificate recognized by the State or local authority that states the Contractor has completed at least 10 hours of training in backflow preventer installations. The certificate must be current.

1.5 DOD CONDITION OF READINESS (COR)

DOD will set the Condition of Readiness (COR) based on the weather forecast for sustained winds 50 knots (60mph or 95 km/hr) or greater. Contact the Contracting Officer for the current COR setting.

Monitor weather conditions a minimum of twice a day and take appropriate actions according to the approved Emergency Plan in the accepted Accident Prevention Plan, EM-385-1-1 Section 01 Emergency Planning and the instructions below.

Unless otherwise directed by the Contracting Officer, comply with:

- a. Condition FOUR (Sustained winds of 50 knots or greater expected within 72 hours): Normal daily jobsite cleanup and good housekeeping practices. Collect and store in piles or containers scrap lumber, waste material, and rubbish for removal and disposal at the close of each work day. Maintain the construction site including storage areas, free of accumulation of debris. Stack form lumber in neat piles less than 4 feet high. Remove all debris, trash, or objects that could become missile hazards.
- b. Condition THREE (Sustained winds of 50 knots or greater expected within 48 hours): Maintain "Condition FOUR" requirements and commence securing operations necessary for "Condition ONE" which cannot be completed within 18 hours. Cease all routine activities which might interfere with securing operations. Commence securing and stow all gear and portable equipment. Make preparations for securing buildings. Review requirements pertaining to "Condition TWO" and continue action as necessary to attain "Condition THREE" readiness.

- c. Condition TWO (Sustained winds of 50 knots or greater expected within 24 hours): Curtail or cease routine activities until securing operation is complete. Reinforce or remove form work and scaffolding. Secure machinery, tools, equipment, materials, or remove from the jobsite. Expend every effort to clear all missile hazards and loose equipment from general base areas.
- d. Condition ONE. (Sustained winds of 50 knots or greater expected within 12 hours): Secure the jobsite, and leave Government premises.

PART 2 PRODUCTS

2.1 TEMPORARY SIGNAGE

2.1.1 Bulletin Board

Within one calendar day of mobilization on site and prior to the commencement of work activities, provide a clear weatherproof covered bulletin board not less than 36 by 48 inches in size for displaying the Equal Employment Opportunity poster, a copy of the wage decision contained in the contract, Wage Rate Information poster, Safety and Health Information as required by EM 385-1-1 Section 01 and other information approved by the Contracting Officer. Coordinate requirements herein with 01 35 26 GOVERNMENTAL SAFETY REQUIREMENTS.

2.2 TEMPORARY TRAFFIC CONTROL

2.2.1 Barricades

Erect and maintain temporary barricades to limit public access to hazardous areas. Whenever safe public access to paved areas such as roads, parking areas or sidewalks is prevented by construction activities or as otherwise necessary to ensure the safety of both pedestrian and vehicular traffic barricades will be required. Securely place barricades clearly visible with adequate illumination to provide sufficient visual warning of the hazard during both day and night.

2.3 FENCING

Provide fencing along the construction site and at all open excavations and tunnels to control access by unauthorized personnel. Safety fencing must be highly visible to be seen by pedestrians and vehicular traffic. Specific fencing requirements are as described herein. All fencing will meet the requirements of EM 385-1-1.

2.3.1 Polyethylene Mesh Safety Fencing

Temporary safety fencing must be a high visibility orange colored, high density polyethylene grid, a minimum of 48 inches high and maximum mesh size of 2 inches. Fencing must extend from the grade to a minimum of 48 inches above the grade and be tightly secured to T-posts spaced as necessary to maintain a rigid and taut fence. Fencing must remain rigid and taut with a minimum of 200 pounds of force exerted on it from any direction with less than 4 inches of deflection.

2.4 TEMPORARY WIRING

Provide temporary wiring in accordance with EM 385-1-1 Section 11, NFPA 241

and NFPA 70. Include monthly inspection and testing of all equipment and apparatus.

PART 3 EXECUTION

3.1 EMPLOYEE PARKING

Construction contract employees will park privately owned vehicles in an area designated by the Contracting Officer. This area will be within reasonable walking distance of the construction site. Employee parking must not interfere with existing and established parking requirements of the government installation.

3.2 TEMPORARY BULLETIN BOARD

Locate the bulletin board at the project site in a conspicuous place easily accessible to all employees, as approved by the Contracting Officer.

3.3 AVAILABILITY AND USE OF UTILITY SERVICES

3.3.1 Temporary Utilities

Provide temporary utilities required for construction. Materials may be new or used, must be adequate for the required usage, not create unsafe conditions, and not violate applicable codes and standards.

3.3.2 Sanitation

Provide and maintain within the construction area minimum field-type sanitary facilities approved by the Contracting Officer and periodically empty wastes into a municipal, district, or station sanitary sewage system, or remove waste to a commercial facility. Obtain approval from the system owner prior to discharge into any municipal, district, or commercial sanitary sewer system. Any penalties or fines associated with improper discharge will be the responsibility of the Contractor. Coordinate with the Contracting Officer and follow station regulations and procedures when discharging into the station sanitary sewer system. Maintain these conveniences at all times. Include provisions for pest control and elimination of odors. Government toilet facilities will not be available to Contractor's personnel.

3.3.3 Telephone

Make arrangements and pay all costs for telephone facilities desired.

3.3.4 Fire Protection

Provide temporary fire protection equipment for the protection of personnel and property during construction. Remove debris and flammable materials weekly to minimize potential hazards.

3.4 TRAFFIC PROVISIONS

3.4.1 Maintenance of Traffic

a. Conduct operations in a manner that will not close any thoroughfare or interfere in any way with traffic on railways or highways except with written permission of the Contracting Officer at least 15 calendar days prior to the proposed modification date, and provide a Traffic

Control Plan detailing the proposed controls to traffic movement for approval. The plan must be in accordance with State and local regulations and the MUTCD, Part VI. Make all notifications and obtain any permits required for modification to traffic movements outside Station's jurisdiction.. Contractor may move oversized and slow-moving vehicles to the worksite provided requirements of the highway authority have been met.

- b. Conduct work so as to minimize obstruction of traffic, and maintain traffic on at least half of the roadway width at all times. Obtain approval from the Contracting Officer prior to starting any activity that will obstruct traffic.
- c. Provide, erect, and maintain, at contractors expense, lights, barriers, signals, passageways, detours, and other items, that may be required by the Life Safety Signage, overhead protection authority having jurisdiction.

3.4.2 Protection of Traffic

Maintain and protect traffic on all affected roads during the construction period except as otherwise specifically directed by the Contracting Officer. Measures for the protection and diversion of traffic, including the provision of watchmen and flagmen, erection of barricades, placing of lights around and in front of equipment the work, and the erection and maintenance of adequate warning, danger, and direction signs, will be as required by the State and local authorities having jurisdiction. Protect the traveling public from damage to person and property. Minimize the interference with public traffic on roads selected for hauling material to and from the site. Investigate the adequacy of existing roads and their allowable load limit. Contractor is responsible for the repair of any damage to roads caused by construction operations.

3.4.3 Dust Control

Dust control methods and procedures must be approved by the Contracting Officer.

3.5 CONTRACTOR'S TEMPORARY FACILITIES

3.5.1 Safety Systems

Protect the integrity of any installed safety systems or personnel safety devices. Obtain prior approval from Contracting Officer if entrance into systems serving safety devices is required. If it is temporarily necessary to remove or disable personnel safety devices in order to accomplish contract requirements, provide alternative means of protection prior to removing or disabling any permanently installed safety devices or equipment and obtain approval from the Contracting Officer.

3.5.2 Administrative Field Offices

Provide and maintain administrative field office facilities within the construction area at the designated site. Government office and warehouse facilities will not be available to the Contractor's personnel.

3.5.3 Storage Area

When required by Contract Documents, construct a temporary 6 foot high

chain link fence around trailers and materials. Include plastic strip inserts, colored brown, so that visibility through the fence is obstructed. Fence posts may be driven, in lieu of concrete bases, where soil conditions permit. Do not place or store trailers, materials, or equipment outside the fenced area unless such trailers, materials, or equipment are assigned a separate and distinct storage area by the Contracting Officer away from the vicinity of the construction site but within the installation boundaries. Trailers, equipment, or materials must not be open to public view with the exception of those items which are in support of ongoing work on any given day. Do not stockpile materials outside the fence in preparation for the next day's work. Park mobile equipment, such as tractors, wheeled lifting equipment, cranes, trucks, and like equipment within the fenced area at the end of each work day.

3.5.4 Supplemental Storage Area

Upon request, and pending availability, the Contracting Officer will designate another or supplemental area for the use and storage of trailers, equipment, and materials. This area may not be in close proximity of the construction site but will be within the installation boundaries. The area will be maintained in an clean and orderly fashion and secured if needed to protect supplies and equipment. Utilities will not be provided to this area by the Government.

3.5.5 Appearance of Trailers

Trailers which are rusted, have peeling paint or are otherwise in need of repair will not be allowed on Installation property. Trailers must present a clean and neat exterior appearance and be in a state of good repair. Trailers which, in the opinion of the Contracting Officer, require exterior painting or maintenance will not be allowed on installation property.

3.5.6 Maintenance of Storage Area

Keep fencing in a state of good repair and proper alignment.

3.5.7 Security Provisions

Provide adequate outside security lighting at the temporary facilities. The Contractor will be responsible for the security of its own equipment.

3.5.8 Weather Protection of Temporary Facilities and Stored Materials

Take necessary precautions to ensure that roof openings and other critical openings in the building are monitored carefully. Take immediate actions required to seal off such openings when rain or other detrimental weather is imminent, and at the end of each workday. Ensure that the openings are completely sealed off to protect materials and equipment in the building from damage.

3.5.8.1 Building and Site Storm Protection

When a warning of gale force winds is issued, take precautions to minimize danger to persons, and protect the work and nearby Government property. Precautions must include, but are not limited to, closing openings; removing loose materials, tools and equipment from exposed locations; and removing or securing scaffolding and other temporary work. Close openings

in the work when storms of lesser intensity pose a threat to the work or any nearby Government property.

3.6 PLANT COMMUNICATIONS

Whenever the individual elements of the plant are located so that operation by normal voice between these elements is not satisfactory, install a satisfactory means of communication, such as telephone or other suitable devices and make available for use by Government personnel.

3.7 TEMPORARY PROJECT SAFETY FENCING

As soon as practicable, but not later than 15 days after the date established for commencement of work, furnish and erect temporary project safety fencing at the work site. Maintain the safety fencing during the life of the contract and, upon completion and acceptance of the work, remove from the work site.

3.8 DUMPSTERS

Equip dumpsters with a secure cover and paint the standard installation color. Keep dumpster closed, except when being loaded with trash and debris. Empty site dumpsters at least once a week, or as needed to keep the site free of debris and trash. If necessary, provide 55 gallon trash containers painted the darker installation color to collect debris in the construction site area. For large demolitions, large dumpsters without lids are acceptable, but must not have debris higher than the sides before emptying.

3.9 CLEANUP

Remove construction debris, waste materials, packaging material and the like from the work site daily. Any dirt or mud which is tracked onto paved or surfaced roadways must be cleaned away. Store any salvageable materials resulting from demolition activities within the fenced area described above or at the supplemental storage area. Neatly stack stored materials not in trailers, whether new or salvaged.

3.10 RESTORATION OF STORAGE AREA

Upon completion of the project remove the bulletin board, signs, barricades, haul roads, and any other temporary products from the site. After removal of trailers, materials, and equipment from within the fenced area, remove the fence. Restore areas used during the performance of the contract to the original or better condition.

-- End of Section --

This page left blank.

SECTION 01 57 19

TEMPORARY ENVIRONMENTAL CONTROLS - EGLIN STANDARD

04/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA)

EPA SW-846 (Third Edition; Update IV) Test Methods
for Evaluating Solid Waste:
Physical/Chemical Methods

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1910.120 Hazardous Waste Operations and Emergency
Response

40 CFR 112 Oil Pollution Prevention

40 CFR 122.26 Storm Water Discharges (Applicable to
State NPDES Programs, see section 123.25)

40 CFR 241 Guidelines for Disposal of Solid Waste

40 CFR 243 Guidelines for the Storage and Collection
of Residential, Commercial, and
Institutional Solid Waste

40 CFR 258 Subtitle D Landfill Requirements

40 CFR 260 Hazardous Waste Management System: General

40 CFR 261 Identification and Listing of Hazardous
Waste

40 CFR 261.7 Residues of Hazardous Waste in Empty
Containers

40 CFR 262 Standards Applicable to Generators of
Hazardous Waste

40 CFR 262.31 Standards Applicable to Generators of
Hazardous Waste-Labeling

40 CFR 262.34 Standards Applicable to Generators of
Hazardous Waste-Accumulation Time

40 CFR 263 Standards Applicable to Transporters of
Hazardous Waste

40 CFR 264 Standards for Owners and Operators of

	Hazardous Waste Treatment, Storage, and Disposal Facilities
40 CFR 265	Interim Status Standards for Owners and Operators of Hazardous Waste Treatment, Storage, and Disposal Facilities
40 CFR 266	Standards for the Management of Specific Hazardous Wastes and Specific Types of Hazardous Waste Management Facilities
40 CFR 268	Land Disposal Restrictions
40 CFR 273	Standards for Universal Waste Management
40 CFR 273.2	Standards for Universal Waste Management - Batteries
40 CFR 273.3	Standards for Universal Waste Management - Pesticides
40 CFR 273.4	Standards for Universal Waste Management - Mercury Containing Equipment
40 CFR 273.5	Standards for Universal Waste Management - Lamps
40 CFR 279	Standards for the Management of Used Oil
40 CFR 300	National Oil and Hazardous Substances Pollution Contingency Plan
40 CFR 300.125	National Oil and Hazardous Substances Pollution Contingency Plan - Notification and Communications
40 CFR 355	Emergency Planning and Notification
40 CFR 403	General Pretreatment Regulations for Existing and New Sources of Pollution
40 CFR 50	National Primary and Secondary Ambient Air Quality Standards
40 CFR 60	Standards of Performance for New Stationary Sources
40 CFR 61	National Emission Standards for Hazardous Air Pollutants
40 CFR 63	National Emission Standards for Hazardous Air Pollutants for Source Categories
40 CFR 64	Compliance Assurance Monitoring
40 CFR 745	Lead-Based Paint Poisoning Prevention in Certain Residential Structures
40 CFR 761	Polychlorinated Biphenyls (PCBs)

	Manufacturing, Processing, Distribution in Commerce, and Use Prohibitions
49 CFR 171	General Information, Regulations, and Definitions
49 CFR 172	Hazardous Materials Table, Special Provisions, Hazardous Materials Communications, Emergency Response Information, and Training Requirements
49 CFR 172.101	Hazardous Material Regulation-Purpose and Use of Hazardous Material Table
49 CFR 173	Shippers - General Requirements for Shipments and Packagings
49 CFR 178	Specifications for Packagings

1.2 DEFINITIONS

1.2.1 Class I and II Ozone Depleting Substance (ODS)

Class I ODS is defined in Section 602(a) of The Clean Air Act. A list of Class I ODS can be found on the EPA website at the following weblink.
<http://www.epa.gov/ozone/science/ods/classone.html>.

Class II ODS is defined in Section 602(s) of The Clean Air Act. A list of Class II ODS can be found on the EPA website at the following weblink.
<http://www.epa.gov/ozone/science/ods/classtwo.html>.

1.2.2 Contractor Generated Hazardous Waste

Contractor generated hazardous waste is materials that, if abandoned or disposed of, may meet the definition of a hazardous waste. These waste streams would typically consist of material brought on site by the Contractor to execute work, but are not fully consumed during the course of construction. Examples include, but are not limited to, excess paint thinners (i.e., methyl ethyl ketone, toluene), waste thinners, excess paints, excess solvents, waste solvents, excess pesticides, and contaminated pesticide equipment rinse water.

1.2.3 Electronics Waste

Electronics waste is discarded electronic devices intended for salvage, recycling, or disposal.

1.2.4 Environmental Pollution and Damage

Environmental pollution and damage is the presence of chemical, physical, or biological elements or agents which adversely affect human health or welfare; unfavorably alter ecological balances of importance to human life; affect other species of importance to humankind; or degrade the environment aesthetically, culturally or historically.

1.2.5 Environmental Protection

Environmental protection is the prevention/control of pollution and habitat disruption that may occur to the environment during construction.

The control of environmental pollution and damage requires consideration of land, water, and air; biological and cultural resources; and includes management of visual aesthetics; noise; solid, chemical, gaseous, and liquid waste; radiant energy and radioactive material as well as other pollutants.

1.2.6 Hazardous Debris

As defined in paragraph SOLID WASTE, debris that contains listed hazardous waste (either on the debris surface, or in its interstices, such as pore structure) in accordance with 40 CFR 261. Hazardous debris also includes debris that exhibits a characteristic of hazardous waste in accordance with 40 CFR 261.

1.2.7 Hazardous Materials

Hazardous materials as defined in 49 CFR 171 and listed in 49 CFR 172.

Hazardous material is any material that: Is regulated as a hazardous material in accordance with 49 CFR 173; or requires a Safety Data Sheet (SDS) in accordance with 29 CFR 1910.120; or during end use, treatment, handling, packaging, storage, transportation, or disposal meets or has components that meet or have potential to meet the definition of a hazardous waste as defined by 40 CFR 261 Subparts A, B, C, or D. Designation of a material by this definition, when separately regulated or controlled by other sections or directives, does not eliminate the need for adherence to that hazard-specific guidance which takes precedence over this section for "control" purposes. Such material includes ammunition, weapons, explosive actuated devices, propellants, pyrotechnics, chemical and biological warfare materials, medical and pharmaceutical supplies, medical waste and infectious materials, bulk fuels, radioactive materials, and other materials such as asbestos, mercury, and polychlorinated biphenyls (PCBs).

1.2.8 Hazardous Waste

Hazardous Waste is any material that meets the definition of a solid waste and exhibit a hazardous characteristic (ignitability, corrosivity, reactivity, or toxicity) as specified in 40 CFR 261, Subpart C, or contains a listed hazardous waste as identified in 40 CFR 261, Subpart D.

1.2.9 Land Application

Land Application means spreading or spraying discharge water at a rate that allows the water to percolate into the soil. No sheeting action, soil erosion, discharge into storm sewers, discharge into defined drainage areas, or discharge into the "waters of the United States" must occur. Comply with federal, state, and local laws and regulations.

1.2.10 Municipal Separate Storm Sewer System (MS4) Permit

MS4 permits are those held by installations to obtain NPDES permit coverage for their stormwater discharges.

1.2.11 National Pollutant Discharge Elimination System (NPDES)

The NPDES permit program controls water pollution by regulating point sources that discharge pollutants into waters of the United States.

1.2.12 Oily Waste

Oily waste are those materials that are, or were, mixed with Petroleum, Oils, and Lubricants (POLs) and have become separated from that POLs. Oily wastes also means materials, including wastewaters, centrifuge solids, filter residues or sludges, bottom sediments, tank bottoms, and sorbents which have come into contact with and have been contaminated by, POLs and may be appropriately tested and discarded in a manner which is in compliance with other state and local requirements.

This definition includes materials such as oily rags, "kitty litter" sorbent clay and organic sorbent material. These materials may be land filled provided that: It is not prohibited in other state regulations or local ordinances; the amount generated is "de minimus" (a small amount); it is the result of minor leaks or spills resulting from normal process operations; and free-flowing oil has been removed to the practicable extent possible. Large quantities of this material, generated as a result of a major spill or in lieu of proper maintenance of the processing equipment, are a solid waste. As a solid waste, perform a hazardous waste determination prior to disposal. As this can be an expensive process, it is recommended that this type of waste be minimized through good housekeeping practices and employee education.

1.2.13 Regulated Waste

Regulated waste are solid wastes that have specific additional federal, state, or local controls for handling, storage, or disposal.

1.2.14 Sediment

Sediment is soil and other debris that have eroded and have been transported by runoff water or wind.

1.2.15 Solid Waste

Solid waste is a solid, liquid, semi-solid or contained gaseous waste. A solid waste can be a hazardous waste, non-hazardous waste, or non-Resource Conservation and Recovery Act (RCRA) regulated waste. Types of solid waste typically generated at construction sites may include:

1.2.15.1 Debris

Debris is non-hazardous solid material generated during the construction, demolition, or renovation of a structure that exceeds 2.5-inch particle size that is: a manufactured object; plant or animal matter; or natural geologic material (for example, cobbles and boulders), broken or removed concrete, masonry, and rock asphalt paving; ceramics; roofing paper and shingles. Inert materials may be reinforced with or contain ferrous wire, rods, accessories and weldments. A mixture of debris and other material such as soil or sludge is also subject to regulation as debris if the mixture is comprised primarily of debris by volume, based on visual inspection.

1.2.15.2 Green Waste

Green waste is the vegetative matter from landscaping, land clearing and grubbing, including, but not limited to, grass, bushes, scrubs, small trees and saplings, tree stumps and plant roots. Marketable trees, grasses and plants that are indicated to remain, be re-located, or be

re-used are not included.

1.2.15.3 Material not regulated as solid waste

Material not regulated as solid waste is nuclear source or byproduct materials regulated under the Federal Atomic Energy Act of 1954 as amended; suspended or dissolved materials in domestic sewage effluent or irrigation return flows, or other regulated point source discharges; regulated air emissions; and fluids or wastes associated with natural gas or crude oil exploration or production.

1.2.15.4 Non-Hazardous Waste

Non-hazardous waste is waste that is excluded from, or does not meet, hazardous waste criteria in accordance with 40 CFR 263.

1.2.15.5 Recyclables

Recyclables are materials, equipment and assemblies such as doors, windows, door and window frames, plumbing fixtures, glazing and mirrors that are recovered and sold as recyclable, wiring, insulated/non-insulated copper wire cable, wire rope, and structural components. It also includes commercial-grade refrigeration equipment with Freon removed, household appliances where the basic material content is metal, clean polyethylene terephthalate bottles, cooking oil, used fuel oil, textiles, high-grade paper products and corrugated cardboard, stackable pallets in good condition, clean crating material, and clean rubber/vehicle tires. Metal meeting the definition of lead contaminated or lead based paint contaminated may not be included as recyclable if sold to a scrap metal company. Paint cans that meet the definition of empty containers in accordance with 40 CFR 261.7 may be included as recyclable if sold to a scrap metal company.

1.2.15.6 Surplus Soil

Surplus soil is existing soil that is in excess of what is required for this work, including aggregates intended, but not used, for on-site mixing of concrete, mortars, and paving. Contaminated soil meeting the definition of hazardous material or hazardous waste is not included and must be managed in accordance with paragraph HAZARDOUS MATERIAL MANAGEMENT.

1.2.15.7 Scrap Metal

This includes scrap and excess ferrous and non-ferrous metals such as reinforcing steel, structural shapes, pipe, and wire that are recovered or collected and disposed of as scrap. Scrap metal meeting the definition of hazardous material or hazardous waste is not included.

1.2.15.8 Wood

Wood is dimension and non-dimension lumber, plywood, chipboard, hardboard. Treated or painted wood that meets the definition of lead contaminated or lead based contaminated paint is not included. Treated wood includes, but is not limited to, lumber, utility poles, crossties, and other wood products with chemical treatment.

1.2.16 Surface Discharge

Surface discharge means discharge of water into drainage ditches, storm

sewers, creeks or "waters of the United States". Surface discharges are discrete, identifiable sources and require a permit from the governing agency. Comply with federal, state, and local laws and regulations.

1.2.17 Wastewater

Wastewater is the used water and solids from a community that flow to a treatment plant.

1.2.17.1 Stormwater

Stormwater is any precipitation in an urban or suburban area that does not evaporate or soak into the ground, but instead collects and flows into storm drains, rivers, and streams.

1.2.18 Waters of the United States

Waters of the United States means Federally jurisdictional waters, including wetlands, that are subject to regulation under Section 404 of the Clean Water Act or navigable waters, as defined under the Rivers and Harbors Act.

1.2.19 Wetlands

Wetlands are those areas that are inundated or saturated by surface or groundwater at a frequency and duration sufficient to support, and that under normal circumstances do support, a prevalence of vegetation typically adapted for life in saturated soil conditions.

1.2.20 Universal Waste

The universal waste regulations streamline collection requirements for certain hazardous wastes in the following categories: batteries, pesticides, mercury-containing equipment (for example, thermostats), and lamps (for example, fluorescent bulbs). The rule is designed to reduce hazardous waste in the municipal solid waste (MSW) stream by making it easier for universal waste handlers to collect these items and send them for recycling or proper disposal. These regulations can be found at 40 CFR 273.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Preconstruction Survey

Solid Waste Management Permit; G, RO

Regulatory Notifications

Environmental Protection Plan; G, RO

Stormwater Notice of Intent (for NPDES coverage under the general

permit for construction activities); G, RO

Dirt and Dust Control Plan; G, RO

Employee Training Records; G, RO

Environmental Manager Qualifications

SD-06 Test Reports

Laboratory Analysis

Inspection Reports

Solid Waste Management Report

SD-07 Certificates

Employee Training Records

Certificate of Competency

Erosion and Sediment Control Inspector Qualifications

SD-11 Closeout Submittals

Stormwater Pollution Prevention Plan Compliance Notebook; G, RO

Stormwater Notice of Termination (for NPDES coverage under the
general permit for construction activities); G, RO

Waste Determination Documentation; G, RO

Disposal Documentation for Hazardous and Regulated Waste; G, RO

Assembled Employee Training Records; G

Solid Waste Management Permit

Solid Waste Management Report; G

Hazardous Waste/Debris Management

Regulatory Notifications; G

Sales Documentation; G

Contractor Certification

As-Built Topographic Survey

1.4 ENVIRONMENTAL PROTECTION REQUIREMENTS

Provide and maintain, during the life of the contract, environmental protection as defined. Plan for and provide environmental protective measures to control pollution that develops during construction practice. Plan for and provide environmental protective measures required to correct conditions that develop during the construction of permanent or temporary environmental features associated with the project. Protect the

environmental resources within the project boundaries and those affected outside the limits of permanent work during the entire duration of this Contract. Comply with federal, state, and local regulations pertaining to the environment, including water, air, solid waste, hazardous waste and substances, oily substances, and noise pollution.

See <https://em.eglin.af.mil/emc/> for environmental compliance and pollution prevention requirements for Eglin AFB.

Tests and procedures assessing whether construction operations comply with Applicable Environmental Laws may be required. Analytical work must be performed by qualified laboratories; and where required by law, the laboratories must be certified.

1.4.1 Conformance with the Environmental Management System

Perform work under this contract consistent with the policy and objectives identified in the installation's Environmental Management System (EMS). Perform work in a manner that conforms to objectives and targets of the environmental programs and operational controls identified by the EMS. Support Government personnel when environmental compliance and EMS audits are conducted by escorting auditors at the Project site, answering questions, and providing proof of records being maintained. Provide monitoring and measurement information as necessary to address environmental performance relative to environmental, energy, and transportation management goals. In the event an EMS nonconformance or environmental noncompliance associated with the contracted services, tasks, or actions occurs, take corrective and preventative actions. In addition, employees must be aware of their roles and responsibilities under the installation EMS and of how these EMS roles and responsibilities affect work performed under the contract.

See <https://em.eglin.af.mil/emc/> for environmental compliance and pollution prevention requirements for Eglin AFB.

Coordinate with the installation's EMS coordinator to identify training needs associated with environmental aspects and the EMS, and arrange training or take other action to meet these needs. Provide training documentation to the Contracting Officer. The Installation Environmental Office will retain associated environmental compliance records. Make EMS Awareness training completion certificates available to Government auditors during EMS audits and include the certificates in the Employee Training Records. See paragraph EMPLOYEE TRAINING RECORDS.

1.5 QUALITY ASSURANCE

1.5.1 Preconstruction Survey and Protection of Features

This paragraph supplements the Contract Clause PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS. Prior to start of any onsite construction activities, perform a Preconstruction Survey of the project site with the Contracting Officer, and take photographs showing existing environmental conditions in and adjacent to the site. Submit a report for the record. Include in the report a plan describing the features requiring protection under the provisions of the Contract Clauses, which are not specifically identified on the drawings as environmental features requiring protection along with the condition of trees, shrubs and grassed areas immediately adjacent to the site of work and adjacent to the Contractor's assigned storage area and access

route(s), as applicable. The Contractor and the Contracting Officer will sign this survey report upon mutual agreement regarding its accuracy and completeness. Protect those environmental features included in the survey report and any indicated on the drawings, regardless of interference that their preservation may cause to the work under the Contract.

1.5.2 Regulatory Notifications

Provide regulatory notification requirements in accordance with federal, state and local regulations. In cases where the Government will also provide public notification (such as stormwater permitting), coordinate with the Contracting Officer. Submit copies of regulatory notifications to the Contracting Officer at least 30 days prior to commencement of work activities. Typically, regulatory notifications must be provided for the following (this listing is not all-inclusive): demolition, renovation, NPDES defined site work, construction, removal or use of a permitted air emissions source, and remediation of controlled substances (asbestos, hazardous waste, lead paint).

1.5.3 Environmental Brief

Attend an environmental brief to be included in the preconstruction meeting. Provide the following information: types, quantities, and use of hazardous materials that will be brought onto the installation; and types and quantities of wastes/wastewater that may be generated during the Contract. Discuss the results of the Preconstruction Survey at this time.

Prior to initiating any work on site, meet with the Contracting Officer and installation Environmental Office to discuss the proposed Environmental Protection Plan (EPP). Develop a mutual understanding relative to the details of environmental protection, including measures for protecting natural and cultural resources, required reports, required permits, permit requirements (such as mitigation measures), and other measures to be taken.

1.5.4 Environmental Manager

Appoint in writing an Environmental Manager for the project site. The Environmental Manager is directly responsible for coordinating contractor compliance with federal, state, local, and installation requirements. The Environmental Manager must ensure compliance with Hazardous Waste Program requirements (including hazardous waste handling, storage, manifesting, and disposal); implement the EPP; ensure environmental permits are obtained, maintained, and closed out; ensure compliance with Stormwater Program requirements; ensure compliance with Hazardous Materials (storage, handling, and reporting) requirements; and coordinate any remediation of regulated substances (lead, asbestos, PCB transformers). This can be a collateral position; however, the person in this position must be trained to adequately accomplish the following duties: ensure waste segregation and storage compatibility requirements are met; inspect and manage Satellite Accumulation areas; ensure only authorized personnel add wastes to containers; ensure Contractor personnel are trained in 40 CFR requirements in accordance with their position requirements; coordinate removal of waste containers; and maintain the Environmental Records binder and required documentation, including environmental permits compliance and close-out. Submit Environmental Manager Qualifications to the Contracting Officer.

1.5.5 Employee Training Records

Prepare and maintain Employee Training Records throughout the term of the contract meeting applicable 40 CFR requirements. Provide Employee Training Records in the Environmental Records Binder. Ensure every employee completes a program of classroom instruction or on-the-job training that teaches them to perform their duties in a way that ensures compliance with federal, state and local regulatory requirements for RCRA Large Quantity Generator. Provide a Position Description for each employee, by subcontractor, based on the Davis-Bacon Wage Rate designation or other equivalent method, evaluating the employee's association with hazardous and regulated wastes. This Position Description will include training requirements as defined in 40 CFR 265 for a Large Quantity Generator facility. Submit these Assembled Employee Training Records to the Contracting Officer at the conclusion of the project, unless otherwise directed.

Train personnel to meet EPA and state requirements. Conduct environmental protection/pollution control meetings for personnel prior to commencing construction activities. Contact additional meetings for new personnel and when site conditions change. Include in the training and meeting agenda: methods of detecting and avoiding pollution; familiarization with statutory and contractual pollution standards; installation and care of devices, vegetative covers, and instruments required for monitoring purposes to ensure adequate and continuous environmental protection/pollution control; anticipated hazardous or toxic chemicals or wastes, and other regulated contaminants; recognition and protection of archaeological sites, artifacts, waters of the United States, and endangered species and their habitat that are known to be in the area. Provide copy of the Erosion and Sediment Control Inspector Qualifications as defined by EPA or Certification as required by state.

1.5.6 Non-Compliance Notifications

The Contracting Officer will notify the Contractor in writing of any observed noncompliance with federal, state or local environmental laws or regulations, permits, and other elements of the Contractor's EPP. After receipt of such notice, inform the Contracting Officer of the proposed corrective action and take such action when approved by the Contracting Officer. The Contracting Officer may issue an order stopping all or part of the work until satisfactory corrective action has been taken. No time extensions will be granted or equitable adjustments allowed for any such suspensions. This is in addition to any other actions the Contracting Officer may take under the contract, or in accordance with the Federal Acquisition Regulation or Federal Law. The Prime Contractor will have the sole responsibility to ensure all their subcontractors comply with all environmental protection requirements of this specification section.

1.6 ENVIRONMENTAL PROTECTION PLAN

The purpose of the EPP is to present an overview of known or potential environmental issues that must be considered and addressed during construction. Incorporate construction related objectives and targets from the installation's EMS into the EPP. Include in the EPP measures for protecting natural and cultural resources, required reports, and other measures to be taken. Meet with the Contracting Officer or Contracting Officer Representative to discuss the EPP and develop a mutual understanding relative to the details for environmental protection including measures for protecting natural resources, required reports, and

other measures to be taken. Submit the EPP within 15 days after Contract award and not less than 10 days before the preconstruction meeting. Revise the EPP throughout the project to include any reporting requirements, changes in site conditions, or contract modifications that change the project scope of work in a way that could have an environmental impact. No requirement in this section will relieve the Contractor of any applicable federal, state, and local environmental protection laws and regulations. During Construction, identify, implement, and submit for approval any additional requirements to be included in the EPP. Maintain the current version onsite.

The EPP includes, but is not limited to, the following elements:

1.6.1 General Overview and Purpose

1.6.1.1 Descriptions

A brief description of each specific plan required by environmental permit or elsewhere in this Contract such as stormwater pollution prevention plan, spill control plan, solid waste management plan, wastewater management plan, air pollution control plan, contaminant prevention plan, pesticide treatment plan, traffic control plan, Non-Hazardous Solid Waste Disposal Plan, and borrowing material plan.

1.6.1.2 Duties

The duties and level of authority assigned to the person(s) on the job site who oversee environmental compliance, such as who is responsible for adherence to the EPP, who is responsible for spill cleanup and training personnel on spill response procedures, who is responsible for manifesting hazardous waste to be removed from the site (if applicable), and who is responsible for training the Contractor's environmental protection personnel.

1.6.1.3 Procedures

A copy of any standard or project-specific operating procedures that will be used to effectively manage and protect the environment on the project site.

1.6.1.4 Communications

Communication and training procedures that will be used to convey environmental management requirements to Contractor employees and subcontractors.

1.6.1.5 Contact Information

Emergency contact information contact information (office phone number, cell phone number, and e-mail address).

1.6.2 General Site Information

1.6.2.1 Drawings

Drawings showing locations of proposed temporary excavations or embankments for haul roads, stream crossings, jurisdictional wetlands, material storage areas, structures, sanitary facilities, storm drains and conveyances, and stockpiles of excess soil.

1.6.2.2 Work Area

Work area plan showing the proposed activity in each portion of the area and identify the areas of limited use or nonuse. Include measures for marking the limits of use areas, including methods for protection of features to be preserved within authorized work areas and methods to control runoff and to contain materials on site, and a traffic control plan.

1.6.2.3 Documentation

A letter signed by an officer of the firm appointing the Environmental Manager and stating that person is responsible for managing and implementing the Environmental Program as described in this contract. Include in this letter the Environmental Manager's authority to direct the removal and replacement of non-conforming work.

1.6.3 Management of Natural Resources

- a. Land resources.
- b. Tree protection.
- c. Replacement of damaged landscape features.
- d. Temporary construction.
- e. Stream crossings.
- f. Fish and wildlife resources.
- g. Wetland areas.

1.6.4 Protection of Historical and Archaeological Resources

- a. Objectives.
- b. Methods.

1.6.5 Stormwater Management and Control

- a. Ground cover.
- b. Erodible soils.
- c. Temporary measures.
 - (1) Structural Practices.
 - (2) Temporary and permanent stabilization.
- d. Effective selection, implementation and maintenance of Best Management Practices (BMPs).

1.6.6 Protection of the Environment from Waste Derived from Contractor Operations

Control and disposal of solid and sanitary waste. Control and disposal of

hazardous waste.

This item consist of the management procedures for hazardous waste to be generated. The elements of those procedures will coincide with the Installation Hazardous Waste Management Plan. The Contracting Officer will provide a copy of the Installation Hazardous Waste Management Plan. As a minimum, include the following:

- a. List of the types of hazardous wastes expected to be generated.
- b. Procedures to ensure a written waste determination is made for appropriate wastes that are to be generated.
- c. Sampling/analysis plan, including laboratory method(s) that will be used for waste determinations and copies of relevant laboratory certifications.
- d. Methods and proposed locations for hazardous waste accumulation/storage (that is, in tanks or containers).
- e. Management procedures for storage, labeling, transportation, and disposal of waste (treatment of waste is not allowed unless specifically noted). The contractor shall provide applicable landfill tipping fee(s) and the projected cost of disposing of all project waste in the landfill(s).
- f. Management procedures and regulatory documentation ensuring disposal of hazardous waste complies with Land Disposal Restrictions (40 CFR 268).
- g. Management procedures for recyclable hazardous materials such as lead-acid batteries, used oil, and similar.
- h. Used oil management procedures in accordance with 40 CFR 279; Hazardous waste minimization procedures.
- i. Plans for the disposal of hazardous waste by permitted facilities; and Procedures to be employed to ensure required employee training records are maintained.

1.6.7 Prevention of Releases to the Environment

Procedures to prevent releases to the environment,

Notifications in the event of a release to the environment,

1.6.8 Regulatory Notification and Permits

List what notifications and permit applications must be made. Some permits require up to 180 days to obtain. Demonstrate that those permits have been obtained or applied for by including copies of applicable environmental permits. The EPP will not be approved until the permits have been obtained.

1.6.9 Clean Air Act Compliance

1.6.9.1 Haul Route

Submit truck and material haul routes along with a Dirt and Dust Control

Plan for controlling dirt, debris, and dust on Installation roadways. As a minimum, identify in the plan the subcontractor and equipment for cleaning along the haul route and measures to reduce dirt, dust, and debris from roadways.

1.6.9.2 Pollution Generating Equipment

Identify air pollution generating equipment or processes that may require federal, state, or local permits under the Clean Air Act. Determine requirements based on any current installation permits and the impacts of the project. Provide a list of all fixed or mobile equipment, machinery or operations that could generate air emissions during the project to the Installation Environmental Office (Air Program Manager).

If emergency generators, boilers, or other sources of air pollutants will be associated with this facility, coordinate with the 96 CEG/CEIEC Air Quality Program Manager Mr. Harry Fortenberry, 882-7677 - a Title V permit revision may be required. Complete the appropriate registration form(s) at the following website, https://em.eglin.af.mil/emc/emce/emcea/aqpweb/inventory_registration_forms.asp and return completed form(s) to Mr. Fortenberry BEFORE source installation. Ensure generator engines are certified to meet 40 CFR Part 60 Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines or CFR Part 60 Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines. Comply with Eglin Title V permit (Appendix TV-34) Refrigerant Requirements. Any facility having refrigeration equipment, including air conditioning equipment, which uses a Class I or II substance (listed at 40 CFR 82, Subpart A, Appendices A and B), and any facility which maintains, services, or repairs motor vehicles using a Class I or Class II substance as refrigerant must comply with all requirements of 40 CFR 82, Subparts B and F, and with Chapter 62-281, F.A.C. Any refrigerant recycle/recovery equipment must be registered with the Air Quality Program manager. Contact Harry Fortenberry, 882-7677 if you have further questions.

1.6.9.3 Stationary Internal Combustion Engines

Identify portable and stationary internal combustion engines that will be supplied, used or serviced. Comply with 40 CFR 60 Subpart IIII, 40 CFR 60 Subpart JJJJ, 40 CFR 63 Subpart ZZZZ, and local regulations as applicable. At minimum, include the make, model, serial number, manufacture date, size (engine brake horsepower), and EPA emission certification status of each engine. Maintain applicable records and log hours of operation and fuel use. Logs must include reasons for operation and delineate between emergency and non-emergency operation.

1.6.9.4 Refrigerants

Identify management practices to ensure that heating, ventilation, and air conditioning (HVAC) work involving refrigerants complies with 40 CFR 82 requirements. Technicians must be certified, maintain copies of certification on site, use certified equipment and log work that requires the addition or removal of refrigerant. Any refrigerant reclaimed is the property of the Government, coordinate with the Installation Environmental Office to determine the appropriate turn in location.

1.6.9.5 Air Pollution-engineering Processes

Identify planned air pollution-generating processes and management control

measures (including, but not limited to, spray painting, abrasive blasting, demolition, material handling, fugitive dust, and fugitive emissions). Log hours of operations and track quantities of materials used.

1.6.9.6 Compliant Materials

Provide the Government a list of and SDSs for all hazardous materials proposed for use on site. Materials must be compliant with all Clean Air Act regulations for emissions including solvent and volatile organic compound contents, and applicable National Emission Standards for Hazardous Air Pollutants requirements. The Government may alter or limit use of specific materials as needed to meet installation permit requirements for emissions.

1.7 LICENSES AND PERMITS

Obtain licenses and permits required for the construction of the project and in accordance with FAR 52.236-7. Notify the Government of all general use permitted equipment the Contractor plans to use on site.

1.8 ENVIRONMENTAL RECORDS BINDER

Maintain on-site a separate three-ring Environmental Records Binder and submit at the completion of the project. Make separate parts within the binder that correspond to each submittal listed under paragraph CLOSEOUT SUBMITTALS in this section.

1.9 SOLID WASTE MANAGEMENT PERMIT

Provide the Contracting Officer with written notification of the quantity of anticipated solid waste or debris that is anticipated or estimated to be generated by construction. Include in the report the locations where various types of waste will be disposed or recycled. Include letters of acceptance from the receiving location or as applicable; submit one copy of the receiving location state and local Solid Waste Management Permit or license showing such agency's approval of the disposal plan before transporting wastes off Government property.

1.9.1 Solid Waste Management Report

Monthly, submit a solid waste disposal report to the Contracting Officer. For each waste, the report will state the classification (using the definitions provided in this section), amount, location, and name of the business receiving the solid waste.

1.10 FACILITY HAZARDOUS WASTE GENERATOR STATUS

Eglin AFB is designated as a Large Quantity Generator. Meet the regulatory requirements of this generator designation for any work conducted within the boundaries of this Installation. Comply with provisions of federal, state, and local regulatory requirements applicable to this generator status regarding training and storage, handling, and disposal of construction derived wastes.

PART 2 PRODUCTS

Not Used.

PART 3 EXECUTION

3.1 ENVIRONMENTAL PERMITS AND COMMITMENTS

The Contractor shall ensure that required environmental permits are obtained prior to start of construction and/or installing or operating any new or modified equipment or processes or disturbing any land area. The contractor shall coordinate with the Contracting Officer and Eglin AFB 96 CEG/CEIEC to determine when permits are required. Where environmental permits are thought to be required, the Contractor shall coordinate with the Contracting Officer and Eglin AFB 96 CEG/CEIEC, prepare any required technical documentation for the permit application, and submit to the Contracting Officer and Eglin AFB 96 CEG/CEIEC. Eglin AFB 96 CEG/CEIEC will sign and forward applications to the appropriate regulatory authority. The Contractor shall be responsible for operating within permit limits and abiding by all permit conditions. The Contracting Officer and Eglin AFB 96 CEG/CEIEC shall be notified immediately of any exceedances of permit limits or violation of permit conditions. The Contractor shall immediately notify the Contracting Officer and Eglin AFB 96 CEG/CEIEC of any unforeseen environmental conditions, which may conflict with approved permits. Any certifications required by permits shall be the responsibility of the Contractor. Copies of all permits and certifications shall be submitted to the Contracting Officer and Eglin AFB 96 CEG/CEIEC.

The Contractor shall be responsible for obtaining and complying with all environmental permits and commitments required by Federal, State, Regional, and local environmental laws and regulations.

Assurance that subcontractors comply with all environmental protection requirements of this section will be the sole responsibility of the prime Contractor.

3.2 PROTECTION OF NATURAL RESOURCES

Minimize interference with, disturbance to, and damage to fish, wildlife, and plants, including their habitats. Prior to the commencement of activities, consult with the Installation Environmental Office, regarding rare species or sensitive habitats that need to be protected. The protection of rare, threatened, and endangered animal and plant species identified, including their habitats, is the Contractor's responsibility.

Preserve the natural resources within the project boundaries and outside the limits of permanent work. Restore to an equivalent or improved condition upon completion of work that is consistent with the requirements of the Installation Environmental Office or as otherwise specified. Confine construction activities to within the limits of the work indicated or specified.

In accordance with Section 7 of the Endangered Species Act (ESA), a consultation with the United States Fish and Wildlife Service (USFWS) has been completed. Their concurrence with our Biological Assessment (BA) was received 09 Dec 2013. This consultation describes guidelines under which the project must be completed to minimize potential impacts to threatened and endangered species. A copy of this document is attached. In accordance with this document, the following requirements must be followed: (A) Gopher Tortoise Survey is required. Contact Eglin Natural Resources to arrange for the survey to take place within 30 days of ground disturbing activities. If tortoise burrows are found to conflict with the proposed

project site, and burrows cannot be avoided by at least 25 ft, the tortoise(s) must be relocated. POC: Rodney Felix, 96 CEG/CEIEC, 883-1153 or Wayne Pittman, 96 CEG/CEIEC, 883-6975. (B) If any trees are to be removed, a red-cockaded woodpecker (RCW) survey is required. This survey will determine suitability of habitat and location(s) of possible cavity trees in the area. Contact Natural Resources at least one month prior to tree removal to arrange the survey. POC: Kathy Gault, 96 CEG/CEIEC, 883-1145. (C) Proponent will also be provided with Eastern Indigo Snake Signs and personnel would be given instructions not to harass, injure, harm, or kill this species. Should an indigo snake be sighted, personnel would be directed to cease any activities and allow the eastern indigo snake sufficient time to move away from the site on its own before resuming such activities. Personnel would contact Eglin Natural Resources immediately if an indigo snake is sighted. POC: Jeremy Preston, 96 CEG/CEIEC, 883-1155. (D) If any trees are to be removed as a result of this project, contact Al Sutsko, 96 CEG/CEIEC, 883-1126 or Ryan Campbell, CEG/CEIEC, 883-1169, prior to tree removal as trees may be merchantable.

3.2.1 Flow Ways

Do not alter water flows or otherwise significantly disturb the native habitat adjacent to the project and critical to the survival of fish and wildlife, except as specified and permitted.

3.2.2 Vegetation

Except in areas to be cleared, do not remove, cut, deface, injure, or destroy trees or shrubs without the Contracting Officer's permission. Do not fasten or attach ropes, cables, or guys to existing nearby trees for anchorages unless authorized by the Contracting Officer. Where such use of attached ropes, cables, or guys is authorized, the Contractor is responsible for any resultant damage.

Protect existing trees that are to remain to ensure they are not injured, bruised, defaced, or otherwise damaged by construction operations. Remove displaced rocks from uncleared areas. Coordinate with the Contracting Officer and Installation Environmental Office to determine appropriate action for trees and other landscape features scarred or damaged by equipment operations.

3.2.3 Streams

Stream crossings must allow movement of materials or equipment without violating water pollution control standards of the federal, state, and local governments. Construction of stream crossing structures must be in compliance with any required permits including, but not limited to, Clean Water Act Section 404, and Section 401 Water Quality.

The Contracting Officer's approval and appropriate permits are required before any equipment will be permitted to ford live streams. In areas where frequent crossings are required, install temporary culverts or bridges. Obtain Contracting Officer's approval prior to installation. Remove temporary culverts or bridges upon completion of work, and repair the area to its original condition unless otherwise required by the Contracting Officer.

3.3 STORMWATER

Do not discharge stormwater from construction sites to the sanitary

sewer. Discharge of hazardous substances will not be permitted under any circumstances. Construction site runoff will be prevented from entering any storm drain by the use of best management practices from the Florida Stormwater Erosion and Sedimentation Control Inspector's Manual. Prior to any project that disturbs greater than one acre, the contractor must complete a Notice of Intent with the Florida Department of Environmental Protection (FDEP) and have a Stormwater Pollution Prevention Plan approved by the Contracting Officer and Eglin AFB 96 CEG/CEIEC. A notice of termination must also be filed at the conclusion of the project.

3.3.1 Construction General Permit

Comply with State of Florida Department of Environmental Protection Generic Permit for Stormwater Discharge from Large and Small Construction Activities. Under the terms and conditions of the permit, install, inspect, maintain BMPs, prepare stormwater erosion and sediment control inspection reports, and submit SWPPP inspection reports. Maintain construction operations and management in compliance with the terms and conditions of the general permit for stormwater discharges from construction activities.

3.3.1.1 Stormwater Pollution Prevention Plan

Submit a project-specific Stormwater Pollution Prevention Plan (SWPPP) to the Contracting Officer for approval, prior to the commencement of work. The SWPPP must meet the requirements of 40 CFR 122.26 and the EPA General Permit and the State of Florida General Permit for stormwater discharges from construction sites.

Include the following:

- a. Comply with terms of the state general permit for stormwater discharges from large and small construction activities. Prepare SWPPP in accordance with state requirements. Use state guide Developing your Stormwater Pollution Prevention Plan located at <http://water.epa.gov/polwaste/npdes/stormwater/Stormwater-Pollution-Prevention-Plans-for-Construction-Activities.cfm> to prepare the SWPPP.
- b. Select applicable BMPs from EPA Fact Sheets located at <http://water.epa.gov/polwaste/npdes/swbmp/Construction-Site-StormWater-Run-Off-Control.cfm> or in accordance with applicable state or local requirements.
- c. Include a completed copy of the Notice of Intent, BMP Inspection Report Template, and Stormwater Notice of Termination, except for the effective date.

3.3.1.2 Stormwater Notice of Intent for Construction Activities

Prepare and submit a Stormwater Notice of Intent for NPDES coverage under the general permit for construction activities to the Contracting Officer for review and approval. Create a Stormwater Pollution Prevention Plan (SWPPP) for the project meeting the Florida General Permit for Stormwater Discharge from Large and Small Construction Activities for stormwater discharges from construction sites.

Prepare and submit a Notice of Intent as a co-permittee to the Contracting Officer, for review and approval.

Submit the approved NOI and appropriate permit fees onto the appropriate federal or state agency for approval. No land disturbing activities may commence without permit coverage. Maintain an approved copy of the SWPPP at the onsite construction office, and continually update as regulations require, reflecting current site conditions.

3.3.1.3 Inspection Reports

Submit "Inspection Reports" to the Contracting Officer in accordance with the State of Florida Construction General Permit.

3.3.1.4 Stormwater Pollution Prevention Plan Compliance Notebook

Create and maintain a three ring binder of documents that demonstrate compliance with the Construction General Permit. Include a copy of the permit Notice of Intent, proof of permit fee payment, SWPPP and SWPPP update amendments, inspection reports and related corrective action records, copies of correspondence with the State Permitting Agency, and a copy of the permit Notice of Termination in the binder. At project completion, the notebook becomes property of the Government. Provide the compliance notebook to the Contracting Officer.

3.3.1.5 Stormwater Notice of Termination for Construction Activities

Submit a Notice of Termination to the Contracting Officer for approval once construction is complete and final stabilization has been achieved on all portions of the site for which the permittee is responsible. Once approved, submit the Notice of Termination to the appropriate state or federal agency.

3.3.2 Erosion and Sediment Control Measures

Provide erosion and sediment control measures in accordance with state and local laws and regulations. Preserve vegetation to the maximum extent practicable.

Erosion control inspection reports may be compiled as part of a stormwater pollution prevention plan inspection reports.

3.3.2.1 Erosion Control

Prevent erosion by mulching, Compost Blankets, Geotextiles, temporary slope drains, and/or silt fence. Stabilize slopes by sodding, seeding, or such combination of these methods necessary for effective erosion control. Use of hay bales is prohibited.

3.3.2.2 Sediment Control Practices

Implement sediment control practices to divert flows from exposed soils, temporarily store flows, or otherwise limit runoff and the discharge of pollutants from exposed areas of the site. Implement sediment control practices prior to soil disturbance and prior to creating areas with concentrated flow, during the construction process to minimize erosion and sediment laden runoff. Include the following devices: silt fence, temporary diversion dikes, and/or storm drain inlet protection.

3.3.3 Work Area Limits

Mark the areas that need not be disturbed under this Contract prior to

commencing construction activities. Mark or fence isolated areas within the general work area that are not to be disturbed. Protect monuments and markers before construction operations commence. Where construction operations are to be conducted during darkness, any markers must be visible in the dark. Personnel must be knowledgeable of the purpose for marking and protecting particular objects.

3.3.4 Contractor Facilities and Work Areas

Place field offices, staging areas, stockpile storage, and temporary buildings in areas designated on the drawings or as directed by the Contracting Officer. Move or relocate the Contractor facilities only when approved by the Government. Provide erosion and sediment controls for onsite borrow and spoil areas to prevent sediment from entering nearby waters. Control temporary excavation and embankments for plant or work areas to protect adjacent areas.

3.3.5 Environmental Resource Permit

The Contractor shall comply with all Environmental Resource Permit requirements in accordance with FL Admin Code 62-330.

3.4 SURFACE AND GROUNDWATER

3.4.1 Dewatering

Construction operations for dewatering must be constantly controlled to maintain compliance with existing state water quality standards and designated uses of the surface water body. Comply with the State of Florida water quality standards and anti-degradation provisions. Do not discharge excavation ground water to the sanitary sewer, storm drains, or to surface waters without prior specific authorization in writing from the Installation Environmental Office. Discharge of hazardous substances will not be permitted under any circumstances. Use sediment control BMPs to prevent construction site runoff from directly entering any storm drain or surface waters.

If the construction dewatering is noted or suspected of being contaminated, it may only be released to the storm drain system if the discharge is specifically permitted. Obtain authorization for any contaminated groundwater release in advance from the Installation Environmental Officer and the federal or state authority, as applicable. Discharge of hazardous substances will not be permitted under any circumstances.

3.4.2 Waters of the United States

Do not enter, disturb, destroy, or allow discharge of contaminants into waters of the United States.

3.5 PROTECTION OF CULTURAL RESOURCES

3.5.1 Archaeological Resources

If, during excavation or other construction activities, any previously unidentified or unanticipated historical, archaeological, and cultural resources are discovered or found, activities that may damage or alter such resources will be suspended. Resources covered by this paragraph include, but are not limited to: any human skeletal remains or burials;

artifacts; shell, midden, bone, charcoal, or other deposits; rock or coral alignments, pavings, wall, or other constructed features; and any indication of agricultural or other human activities. Upon such discovery or find, immediately notify the Contracting Officer so that the appropriate authorities may be notified and a determination made as to their significance and what, if any, special disposition of the finds should be made. Cease all activities that may result in impact to or the destruction of these resources. Secure the area and prevent employees or other persons from trespassing on, removing, or otherwise disturbing such resources. The Government retains ownership and control over archaeological resources.

3.6 AIR RESOURCES

Equipment operation, activities, or processes will be in accordance with 40 CFR 64 and state air emission and performance laws and standards.

3.6.1 Preconstruction Air Permits

Notify the Air Program Manager, through the Contracting Officer, at least 6 months prior to bringing equipment, assembled or unassembled, onto the Installation, so that air permits can be secured. Necessary permitting time must be considered in regard to construction activities. Clean Air Act (CAA) permits must be obtained prior to bringing equipment, assembled or unassembled, onto the Installation.

Confirm that these permits have been obtained.

3.6.2 Oil or Dual-fuel Boilers and Furnaces

Provide product data and details for new, replacement, or relocated fuel fired boilers, heaters, or furnaces to the Installation Environmental Office (Air Program Manager) through the Contracting Officer. Data to be reported include: equipment purpose (water heater, building heat, process), manufacturer, model number, serial number, fuel type (oil type, gas type) size (MMBTU heat input). Provide in accordance with paragraph PRECONSTRUCTION AIR PERMITS.

3.6.3 Burning

Burning is prohibited on the Government premises.

3.6.4 Class I and II ODS Prohibition

Class I and II ODS are Government property and must be returned to the Government for appropriate management. Coordinate with the Installation Environmental Office to determine the appropriate location for turn in of all reclaimed refrigerant.

3.6.5 Accidental Venting of Refrigerant

Accidental venting of a refrigerant is a release and must be reported immediately to the Contracting Officer.

3.6.6 EPA Certification Requirements

Heating and air conditioning technicians must be certified through an EPA-approved program. Maintain copies of certifications at the employees' places of business; technicians must carry certification wallet cards, as

provided by environmental law.

3.6.7 Dust Control

Keep dust down at all times, including during nonworking periods. Sprinkle or treat, with dust suppressants, the soil at the site, haul roads, and other areas disturbed by operations. Dry power brooming will not be permitted. Instead, use vacuuming, wet mopping, wet sweeping, or wet power brooming. Air blowing will be permitted only for cleaning nonparticulate debris such as steel reinforcing bars. Only wet cutting will be permitted for cutting concrete blocks, concrete, and bituminous concrete. Do not unnecessarily shake bags of cement, concrete mortar, or plaster.

3.6.7.1 Particulates

Dust particles, aerosols and gaseous by-products from construction activities, and processing and preparation of materials (such as from asphaltic batch plants) must be controlled at all times, including weekends, holidays, and hours when work is not in progress. Maintain excavations, stockpiles, haul roads, permanent and temporary access roads, plant sites, spoil areas, borrow areas, and other work areas within or outside the project boundaries free from particulates that would exceed 40 CFR 50, state, and local air pollution standards or that would cause a hazard or a nuisance. Sprinkling, chemical treatment of an approved type, baghouse, scrubbers, electrostatic precipitators, or other methods will be permitted to control particulates in the work area. Sprinkling, to be efficient, must be repeated to keep the disturbed area damp. Provide sufficient, competent equipment available to accomplish these tasks. Perform particulate control as the work proceeds and whenever a particulate nuisance or hazard occurs. Comply with state and local visibility regulations.

3.6.7.2 Abrasive Blasting

Blasting operations cannot be performed without prior approval of the Installation Air Program Manager. The use of silica sand is prohibited in sandblasting.

Provide tarpaulin drop cloths and windscreens to enclose abrasive blasting operations to confine and collect dust, abrasive agent, paint chips, and other debris. Perform work involving removal of hazardous material in accordance with 29 CFR 1910.

3.6.8 Odors

Control odors from construction activities. The odors must be in compliance with state regulations and local ordinances and may not constitute a health hazard.

3.7 WASTE MINIMIZATION

Minimize the use of hazardous materials and the generation of waste. Include procedures for pollution prevention/ hazardous waste minimization in the Hazardous Waste Management Section of the EPP. Obtain a copy of the installation's Pollution Prevention/Hazardous Waste Minimization Plan for reference material when preparing this part of the EPP. If no written plan exists, obtain information by contacting the Contracting Officer. Describe the anticipated types of the hazardous materials to be used in

the construction when requesting information.

3.7.1 Salvage, Reuse and Recycle

Identify anticipated materials and waste for salvage, reuse, and recycling. Describe actions to promote material reuse, resale or recycling. To the extent practicable, all scrap metal must be sent for reuse or recycling and will not be disposed of in a landfill.

Include the name, physical address, and telephone number of the hauler, if transported by a franchised solid waste hauler. Include the destination and, unless exempted, provide a copy of the state or local permit (cover) or license for recycling.

3.7.2 Nonhazardous Solid Waste Diversion Report

Maintain an inventory of nonhazardous solid waste diversion and disposal of construction and demolition debris. Submit a report to the Contracting Officer on the first working day after each fiscal year quarter, starting the first quarter that nonhazardous solid waste has been generated. Include the following in the report:

Construction and Demolition (C&D) Debris Disposed	cubic yards or tons as appropriate
C&D Debris Recycled	cubic yards or tons as appropriate
Total C&D Debris Generated	cubic yards or tons as appropriate
Waste Sent to Waste-To-Energy Incineration Plant (This amount should not be included in the recycled amount)	cubic yards or tons as appropriate

3.8 WASTE MANAGEMENT AND DISPOSAL

3.8.1 Waste Determination Documentation

Complete a Waste Determination form (provided at the pre-construction conference) for Contractor-derived wastes to be generated. All potentially hazardous solid waste streams that are not subject to a specific exclusion or exemption from the hazardous waste regulations (e.g., scrap metal, domestic sewage) or subject to special rules, (lead-acid batteries and precious metals) must be characterized in accordance with the requirements of 40 CFR 261 or corresponding applicable state or local regulations. Base waste determination on user knowledge of the processes and materials used, and analytical data when necessary. Consult with the Installation environmental staff for guidance on specific requirements. Attach support documentation to the Waste Determination form. As a minimum, provide a Waste Determination form for the following waste (this listing is not inclusive): oil- and latex -based painting and caulking products, solvents, adhesives, aerosols, petroleum products, and containers of the original materials.

3.8.1.1 Sampling and Analysis of Waste

3.8.1.1.1 Waste Sampling

Sample waste in accordance with EPA SW-846. Clearly mark each sampled drum or container with the Contractor's identification number, and cross reference to the chemical analysis performed.

3.8.1.1.2 Laboratory Analysis

Follow the analytical procedure and methods in accordance with the 40 CFR 261. Provide analytical results and reports performed to the Contracting Officer.

3.8.1.1.3 Analysis Type

Identify hazardous waste by analyzing for the following characteristics: ignitability, corrosivity, reactivity, or toxicity based on TCLP results.

3.8.2 Solid Waste Management

3.8.2.1 Solid Waste Management Report

Provide copies of the waste handling facilities' weight tickets, receipts, bills of sale, and other sales documentation. In lieu of sales documentation, a statement indicating the disposal location for the solid waste that is signed by an employee authorized to legally obligate or bind the firm may be submitted. The Contractor certification must include the receiver's tax identification number and business, EPA or state registration number, along with the receiver's delivery and business addresses and telephone numbers. For each solid waste retained for the Contractor's own use, submit the information previously described in this paragraph on the solid waste disposal report. Prices paid or received do not have to be reported to the Contracting Officer unless required by other provisions or specifications of this Contract or public law.

3.8.2.2 Control and Management of Solid Wastes

Pick up solid wastes, and place in covered containers that are regularly emptied. Do not prepare or cook food on the project site. Prevent contamination of the site or other areas when handling and disposing of wastes. At project completion, leave the areas clean. Employ segregation measures so that no hazardous or toxic waste will become co-mingled with non-hazardous solid waste. Transport solid waste off Government property and dispose of it in compliance with 40 CFR 260, state, and local requirements for solid waste disposal. A Subtitle D RCRA permitted landfill is the minimum acceptable offsite solid waste disposal option. Verify that the selected transporters and disposal facilities have the necessary permits and licenses to operate. Segregate and separate treated wood components disposed at a lined landfill approved to accept this waste in accordance with local and state regulations. Solid waste disposal offsite must comply with most stringent local, state, and federal requirements, including 40 CFR 241, 40 CFR 243, and 40 CFR 258.

Manage hazardous material used in construction, including but not limited to, aerosol cans, waste paint, cleaning solvents, contaminated brushes, and used rags, in accordance with 49 CFR 173.

3.8.3 Control and Management of Hazardous Waste

Do not dispose of hazardous waste on Government property. Do not discharge any waste to a sanitary sewer, storm drain, or to surface waters or conduct waste treatment or disposal on Government property without written approval of the Contracting Officer.

3.8.3.1 Hazardous Waste/Debris Management

Identify construction activities that will generate hazardous waste or debris. Provide a documented waste determination for resultant waste streams. Identify, label, handle, store, and dispose of hazardous waste or debris in accordance with federal, state, and local regulations, including 40 CFR 261, 40 CFR 262, 40 CFR 263, 40 CFR 264, 40 CFR 265, 40 CFR 266, and 40 CFR 268.

Manage hazardous waste in accordance with the approved Hazardous Waste Management Section of the EPP. Store hazardous wastes in approved containers in accordance with 49 CFR 173 and 49 CFR 178. Hazardous waste generated within the confines of Government facilities is identified as being generated by the Government. Prior to removal of any hazardous waste from Government property, hazardous waste manifests must be signed by personnel from the Installation Environmental Office. Do not bring hazardous waste onto Government property. Provide the Contracting Officer with a copy of waste determination documentation for any solid waste streams that have any potential to be hazardous waste or contain any chemical constituents listed in 40 CFR 372-SUBPART D.

3.8.3.2 Waste Storage/Satellite Accumulation/90 Day Storage Areas

Accumulate hazardous waste at satellite accumulation points and in compliance with 40 CFR 262.34 and applicable state or local regulations. Individual waste streams will be limited to 55 gallons of accumulation (or 1 quart for acutely hazardous wastes). If the Contractor expects to generate hazardous waste at a rate and quantity that makes satellite accumulation impractical, the Contractor may request a temporary 90 day accumulation point be established. Submit a request in writing to the Contracting Officer and provide the following information (Attach Site Plan to the Request):

Contract Number	
Contractor	
Haz/Waste or Regulated Waste POC	
Phone Number	
Type of Waste	
Source of Waste	
Emergency POC	
Phone Number	

Contract Number	
Location of the Site	

Attach a Waste Determination form for the expected waste streams. Allow 10 working days for processing this request. Additional compliance requirements (e.g., training and contingency planning) that may be required are the responsibility of the Contractor. Barricade the designated area where waste is being stored and post a sign identifying as follows:

"DANGER - UNAUTHORIZED PERSONNEL KEEP OUT"

3.8.3.3 Hazardous Waste Disposal

3.8.3.3.1 Responsibilities for Contractor's Disposal

Provide hazardous waste manifest to the Installations Environmental Office for review, approval, and signature prior to shipping waste off Government property.

3.8.3.3.1.1 Services

Provide service necessary for the final treatment or disposal of the hazardous material or waste in accordance with 40 CFR 260, local, and state, laws and regulations, and the terms and conditions of the Contract within 60 days after the materials have been generated. These services include necessary personnel, labor, transportation, packaging, detailed analysis (if required for disposal or transportation, include manifesting or complete waste profile sheets, equipment, and compile documentation).

3.8.3.3.1.2 Samples

Obtain a representative sample of the material generated for each job done to provide waste stream determination.

3.8.3.3.1.3 Analysis

Analyze each sample taken and provide analytical results to the Contracting Officer. See paragraph WASTE DETERMINATION DOCUMENTATION.

3.8.3.3.1.4 Labeling

Determine the Department of Transportation's (DOT's) proper shipping names for waste (each container requiring disposal) and demonstrate to the Contracting Officer how this determination is developed and supported by the sampling and analysis requirements contained herein. Label all containers of hazardous waste with the words "Hazardous Waste" or other words to describe the contents of the container in accordance with 40 CFR 262.31 and applicable state or local regulations.

3.8.3.3.2 Contractor Disposal Turn-In Requirements

Hazardous waste generated must be disposed of in accordance with the following conditions to meet installation requirements:

- a. Drums must be compatible with waste contents and drums must meet DOT requirements for 49 CFR 173 for transportation of materials.
- b. Band drums to wooden pallets.
- c. No more than three 55 gallon drums or two 85 gallon over packs are to be banded to a pallet.
- d. Band using 1-1/4 inch minimum band on upper third of drum.
- e. Provide label in accordance with 49 CFR 172.101.
- f. Leave 3 to 5 inches of empty space above volume of material.

3.8.3.4 Universal Waste Management

Manage the following categories of universal waste in accordance with federal, state, and local requirements and installation instructions:

- a. Batteries as described in 40 CFR 273.2.
- b. Lamps as described in 40 CFR 273.5.
- c. Mercury-containing equipment as described in 40 CFR 273.4.
- d. Pesticides as described in 40 CFR 273.3 and Armed Forces Management Board (AFPMD) standard pesticides list.

Mercury is prohibited in the construction of this facility, unless specified otherwise, and with the exception of mercury vapor lamps and fluorescent lamps. Dumping of mercury-containing materials and devices such as mercury vapor lamps, fluorescent lamps, and mercury switches, in rubbish containers is prohibited. Remove without breaking, pack to prevent breakage, and transport out of the activity in an unbroken condition for disposal as directed.

3.8.3.5 Electronics End-of-Life Management

Recycle or dispose of electronics waste, including, but not limited to, used electronic devices such computers, monitors, hard-copy devices, televisions, mobile devices, in accordance with 40 CFR 260-262, state, and local requirements, and installation instructions.

3.8.3.6 Disposal Documentation for Hazardous and Regulated Waste

Contact the Contracting Officer for the facility RCRA identification number that is to be used on each manifest.

3.8.4 Releases/Spills of Oil and Hazardous Substances

3.8.4.1 Response and Notifications

Exercise due diligence to prevent, contain, and respond to spills of hazardous material, hazardous substances, hazardous waste, sewage, regulated gas, petroleum, lubrication oil, and other substances regulated in accordance with 40 CFR 300. Maintain spill cleanup equipment and materials at the work site. In the event of a spill, take prompt, effective action to stop, contain, curtail, or otherwise limit the amount,

duration, and severity of the spill/release. In the event of any releases of oil and hazardous substances, chemicals, or gases; immediately (within 15 minutes) notify the Installation Fire Department, the Installation Command Duty Officer, the Installation Environmental Office, the Contracting Officer and the state or local authority.

Submit verbal and written notifications as required by the federal (40 CFR 300.125 and 40 CFR 355), state, local regulations and instructions. Provide copies of the written notification and documentation that a verbal notification was made within 20 days. Spill response must be in accordance with 40 CFR 300 and applicable state and local regulations. Contain and clean up these spills without cost to the Government.

3.8.4.2 Clean Up

Clean up hazardous and non-hazardous waste spills. Reimburse the Government for costs incurred including sample analysis materials, clothing, equipment, and labor if the Government will initiate its own spill cleanup procedures, for Contractor- responsible spills, when: Spill cleanup procedures have not begun within one hour of spill discovery/occurrence; or, in the Government's judgment, spill cleanup is inadequate and the spill remains a threat to human health or the environment.

3.8.5 Mercury Materials

Immediately report to the Environmental Office and the Contracting Officer instances of breakage or mercury spillage. Clean mercury spill area to the satisfaction of the Contracting Officer.

Do not recycle a mercury spill cleanup; manage it as a hazardous waste for disposal.

3.8.6 Wastewater

3.8.6.1 Disposal of wastewater must be as specified below.

3.8.6.1.1 Treatment

Do not allow wastewater from construction activities, such as onsite material processing, concrete curing, foundation and concrete clean-up, water used in concrete trucks, and forms to enter water ways or to be discharged prior to being treated to remove pollutants. Dispose of the construction- related waste water off-Government property in accordance with 40 CFR 403, state, regional, and local laws and regulations.

3.8.6.1.2 Surface Discharge

For discharge of ground water, obtain a state or federal permit specific for pumping and discharging ground water prior to surface discharging. Surface discharge in accordance with the requirements of the NPDES or state STORMWATER DISCHARGES FROM CONSTRUCTION SITES permit.

3.8.6.1.3 Land Application

Water generated from the flushing of lines after disinfection or disinfection in conjunction with hydrostatic testing must be discharged into the sanitary sewer with prior approval and notification to the

Wastewater Treatment Plant's Operator.

3.9 HAZARDOUS MATERIAL MANAGEMENT

Address procedures and proper handling of hazardous materials, including the appropriate transportation requirements. Do not bring hazardous material onto Government property that does not directly relate to requirements for the performance of this contract. Submit an SDS and estimated quantities to be used for each hazardous material to the Contracting Officer prior to bringing the material on the installation. Typical materials requiring SDS and quantity reporting include, but are not limited to, oil and latex based painting and caulking products, solvents, adhesives, aerosol, and petroleum products. Use hazardous materials in a manner that minimizes the amount of hazardous waste generated. Containers of hazardous materials must have National Fire Protection Association labels or their equivalent. Certify that hazardous materials removed from the site are hazardous materials and do not meet the definition of hazardous waste, in accordance with 40 CFR 261.

3.9.1 Hazardous Material (HM)

For the purposes of the document, Hazardous Materials (HM) are defined as any product, material, chemical or substance listed in 49 CFR 172.101 (revised) and 40 CFR 302-304 (revised). Specifically, a HM is any substance or material, in any quantity or form that has the potential to harm human health or the environment or displays specific characteristics (reactive, corrosive, ignitable, and toxic).

Absolutely NO HM shall be brought onto Eglin AFB until that material is registered with the Hazardous Materials Pharmacy (HAZMART) per Eglin AFB. See <https://em.eglin.af.mil/emc/> for environmental compliance and pollution prevention requirements for Eglin AFB. This requirement shall apply for all HM that the Contractor intends to bring onto government property for any/all processes or applications. The Contractor shall submit a complete hazardous material inventory list including Material Safety Data Sheets and any other supporting documentation for each HM used prior to contract start or introduction of that material to Eglin AFB. The HM inventory shall include the contract number, performance period, and a Contractor point of contact for HM matters. All excess material and empty containers are the responsibility of the Contractor and shall be removed accordingly at the end of the contract. Should Contractor HM requirements change during the performance period, the Contractor shall immediately notify the HAZMART of such changes in writing. The Contractor shall observe HM storage practices in accordance with regulations, policies, plans and procedures employed by the base.

Reference EGLINAFB 32-7003 Hazardous Waste Management and AFI 32-7042 Solid and Hazardous Waste Compliance.

3.9.2 Hazardous Waste (Includes Special and Universal Waste)

The Contractor shall be considered the primary co-generator for all hazardous wastes generated throughout the duration of the contract. However, all hazardous waste management activities shall be coordinated and approved by the Contracting Officer and Eglin. The Contractor shall identify what wastes are hazardous using specific and technical knowledge and/or sampling and analysis. This responsibility also includes preparation of waste profile sheets, packaging, marking and labeling of wastes in accordance with 49 CFR Subchapter C.

Hazardous and special waste include, but are not limited to:

1. Fuels and oils of all types
2. Used tires
3. Computer monitors
4. Lighting ballast
5. Exit signs and lighting (batteries)
6. Asbestos (survey required)
7. Lead roof vent flashing
8. All electronic devices
9. Aerosol spray cans (including empties)
10. Paints
11. Adhesives
12. Corrosives
13. Non-flammable and non-corrosive cleaners
14. Fertilizer
15. Hydraulic fluid
16. Antifreeze

Universal waste include, but are not limited to:

1. Spent fluorescent lamps
2. High Intensity Discharge (HID) lamps
3. Batteries (except alkaline)
4. Mercury thermostats
5. Silent switches
6. Mechanical switches
7. Relays and contacts

All hazardous, special, and universal waste items mentioned-above shall be managed IAW local, state, federal, and Eglin AFB Hazardous Waste Management Plan. The CO shall contact the Eglin AFB 96 CEG/CEIEC if handling procedures for hazardous waste and materials is unclear. **Under no circumstances shall hazardous, special, or universal waste be disposed of in the dumpster.** In addition, the contractor shall ensure that all employees, including their subs, comply with the rules and procedures outlined in this specification and the Eglin AFB Hazardous Waste Management Plan.

The contractor shall be familiar with and have immediate access to the following publications and regulations:

1. Environmental Protection Agency (EPA): Title 40 Code of Federal Regulations, Parts 260-279
2. Occupational Safety and Health Administration (OSHA): 29 Code of Federal Regulations Parts 1910 and 1926
3. Department of Transportation (DOT): Title 49 Code of Federal Regulations, Parts 171-177
4. Eglin AFB Hazardous Waste Management Plan

The contractor shall manage all hazardous waste, special waste, and universal waste IAW the HFLD Hazardous Waste Management Plan. In addition, the contractor shall ensure that all employees, including their subs, comply with the rules and procedures outlined in the Eglin AFB Hazardous Waste Management Plan.

If transportation of Hazardous Wastes is required, the contractor shall

possess or ensure the transportation of hazardous waste has a valid state and federal identification number and provide such identification to the Contracting Officer and Eglin AFB 96 CEG/CEIEC prior to any waste movement. The contractor shall ensure a designated representative from Eglin AFB 96 CEG/CEIEC signs the hazardous waste/non-hazardous waste manifest.

3.9.3 Toxic Waste

A. Asbestos: All asbestos work must be accomplished in accordance with federal, state, and local laws and the Eglin AFB Asbestos Management Plan.

1. Notice of Asbestos Renovation or Demolition, DEP Form 62-257.900(1) must be submitted to Florida Department of Environmental Protection at least 10 working days prior to any demolition and/or renovation regardless of whether asbestos is present or not. A copy of this notification must be provided to the Contracting Officer and Eglin AFB 96 CEG/CEIEC prior to performing any work.

2. A copy of all submittals must be provided to the Contracting Officer and Eglin AFB 96 CEG/CEIEC with adequate time built in for review.

3. The use of materials, products or equipment containing asbestos is not allowed. See sample list below.

4. Prior to the commencement of construction, the prime Contractor, each subcontractor and material/equipment supplier shall provide the Contracting Officer and Eglin AFB 96 CEG/CEIEC with a Notarized statement that to the best of their knowledge, no asbestos will be used in the construction of this project. Additionally, the Contractor must have available the most current Material Data Safety Sheet proving the materials contain no asbestos.

5. Sample list of Asbestos Containing Materials (ACM):

Note: The following list does not include every product/material that may contain asbestos. It is intended as a general guide to show which types of materials may contain asbestos:

- | | |
|---------------------------------|------------------------------------|
| (1) Cement Pipes | (2) Cement Wallboard |
| (3) Cement Siding | (4) Asphalt Floor Tile |
| (5) Vinyl Floor Tile | (6) Vinyl Sheet Flooring |
| (7) Flooring Backing | (8) Construction Mastics |
| (9) Acoustical Plaster | (10) Decorative Plaster |
| (11) Textured Paints/Coatings | (12) Ceiling Tiles & Lay-in-Panels |
| (13) Spray-Applied Insulation | (14) Blown-in Insulation |
| (15) Fireproofing Materials | (16) Taping Compounds |
| (17) Packing Materials | (18) High Temperature Gaskets |
| (19) Laboratory Hoods | (20) Laboratory Gloves |
| (21) Fire Blankets & Table Tops | (22) Fire Curtains |
| (23) Elevator Equipment Panels | (24) Elevator Brake Shoes |
| (25) HVAC Duct Insulation | (26) Boiler Insulation |
| (27) Breeching Insulation | (28) Ductwork Flexible Fabric |
| (29) Cooling Towers | (30) Pipe Insulation |
| (31) Heating and Electrical | (32) Electrical Panel Partitions |
| (33) Electrical Cloth ducts | (34) Spackling compounds |
| (35) Chalkboards | (36) Roofing Shingles |
| (37) Roofing Felt | (38) Base Flashing |

- | | |
|-----------------------------|-----------------------------------|
| (39) Thermal Paper Products | (40) Fire doors |
| (41) Caulking/putties | (42) Adhesives |
| (43) Wallboard | (44) Joint Compounds |
| (45) Vinyl Wall Coverings | (46) Electrical Wiring Insulation |

Caution needs to be taken to ensure materials purchased do not contain one or more % asbestos by volume.

B. **Lighting Ballast:** When fluorescent and mercury vapor fixtures are removed, the ballast shall be examined for PCB labeling. Ballast is presumed to contain PCBs unless they are clearly labeled "NO PCBs". Suspected ballasts shall be removed and disposed of IAW Eglin AFB directives.

C. **Lead Based Paint:** No paint containing lead shall be used during the course of this contract. The Occupational Health and Safety Act (OSHA) Lead Construction Standard, 29 CFR 1926.62 is in effect whenever materials are disturbed that contain any amount of lead. This will require contractors disturbing lead-based paint to institute medical surveillance, training, engineering controls, worker protection measures and employee monitoring until monitoring results per the lead paint standard demonstrate that employee exposure is below the action level and permissible exposure limit. The Contractor on site must maintain all documentation regarding lead exposure by either historical data or project data. **This data shall also be made available to the Contracting Officer and Eglin AFB 96 CEG/CEIEC upon completion of the project.**

1. Prior to the commencement of construction, the prime Contractor, each subcontractor and material/equipment supplier shall provide to the Contracting Officer and Eglin AFB 96 CEG/CEIEC with a Notarized statement that to the best of their knowledge, no lead based paint will be used in the construction of this project. Additionally, the Contractor must have available the most current *Material Data Safety Sheet* proving that the paint does not have any lead content.

2. The contractor shall be responsible for collection and disposal of all lead paint chips and lead paint-contaminated materials, and for accumulation of these chips/materials on site. The contractor shall test the paint materials, provide containers for proper disposal, and transport any resulting hazardous waste to an appropriate hazardous waste accumulation area should it test positive as hazardous waste. All necessary accumulation, disposal activities and documentation shall be coordinated with the Contracting Officer and Eglin AFB 96 CEG/CEIEC .

3. A copy of contractor's exposure assessment data shall be provided to the Contracting Officer and Eglin AFB 96 CEG/CEIEC.

4. Copies of all lead paint-related documentation generated from this project, including lead testing, air monitoring and hazardous waste manifests, shall be provided by the the Contractor to the Contracting Officer. A copy shall be forwarded to Eglin AFB 96 CEG/CEIEC within 10 working days of test completion.

5. **On Military Family Housing Projects,** there shall be in-depth coordination with the Contracting Officer and Eglin AFB 96 CEG/CEIEC to allow for resident notification and necessary arrangements.

The contractor is strongly encouraged to coordinate closely with Eglin AFB 96 CEG/CEIEC for any required guidance on this critical issue. The Contracting Officer may request documentation for any spills or releases, environmental reports, or off-site transfers.

3.10 PREVIOUSLY USED EQUIPMENT

Clean previously used construction equipment prior to bringing it onto the project site. Equipment must be free from soil residuals, egg deposits from plant pests, noxious weeds, and plant seeds. Consult with the U.S. Department of Agriculture jurisdictional office for additional cleaning requirements.

3.11 CONTROL AND MANAGEMENT OF ASBESTOS-CONTAINING MATERIAL (ACM)

Manage and dispose of asbestos- containing waste in accordance with 40 CFR 61. Manifest asbestos-containing waste and provide the manifest to the Contracting Officer. Notifications to the state and Installation Air Program Manager are required before starting any asbestos work.

3.12 CONTROL AND MANAGEMENT OF LEAD-BASED PAINT (LBP)

Manage and dispose of lead-contaminated waste in accordance with 40 CFR 745. Manifest any lead-contaminated waste and provide the manifest to the Contracting Officer.

3.13 CONTROL AND MANAGEMENT OF LIGHTING BALLAST AND LAMPS CONTAINING PCBS

Manage and dispose of contaminated waste in accordance with 40 CFR 761.

3.14 PETROLEUM, OIL, LUBRICANT (POL) STORAGE AND FUELING

POL products include flammable or combustible liquids, such as gasoline, diesel, lubricating oil, used engine oil, hydraulic oil, mineral oil, and cooking oil. Store POL products and fuel equipment and motor vehicles in a manner that affords the maximum protection against spills into the environment. Manage and store POL products in accordance with EPA 40 CFR 112, and other federal, state, regional, and local laws and regulations. Use secondary containments, dikes, curbs, and other barriers, to prevent POL products from spilling and entering the ground, storm or sewer drains, stormwater ditches or canals, or navigable waters of the United States. Describe in the EPP (see paragraph ENVIRONMENTAL PROTECTION PLAN) how POL tanks and containers must be stored, managed, and inspected and what protections must be provided. Storage of fuel on the project site must be in accordance with EPA, state, and local laws and regulations and paragraph OIL STORAGE INCLUDING FUEL TANKS. The COR and Eglin AFB 96 CEG/CEIEC must approve the use of fuel storage tanks on base, and the contractor must ensure adequate spill containment (spill kits) for any tanks approved for use on Eglin AFB. The contractor must have written spill procedures for tanks and heavy equipment that they use on base. Temporary gasoline is NOT permitted on base.

POL/Storage Tanks: Storage tanks and POL can be a source of contamination if not managed appropriately. Contractor personnel obtaining fuels from Storage Tanks agrees to follow all 62-761 FAC and the following list of Air Force Technical Order's to ensure compliance: 37-1-1, 37A-1-101, 42B-1-1, 42B-1-1S-2, 42B-1-16, 42B-1-22, 42B-1-23, and 42C-1-12.

All fuel, oil, and chemical spills that occur on Eglin AFB (regardless of amount) must be immediately reported to the base fire department (911).

3.14.1 Used Oil Management

Manage used oil generated on site in accordance with 40 CFR 279. Determine if any used oil generated while onsite exhibits a characteristic of hazardous waste. Used oil containing 1,000 parts per million of solvents is considered a hazardous waste and disposed of at the Contractor's expense. Used oil mixed with a hazardous waste is also considered a hazardous waste. Dispose in accordance with paragraph HAZARDOUS WASTE DISPOSAL.

3.14.2 Oil Storage Including Fuel Tanks

Provide secondary containment and overflow protection for oil storage tanks. A berm used to provide secondary containment must be of sufficient size and strength to contain the contents of the tanks plus 5 inches freeboard for precipitation. Construct the berm to be impervious to oil for 72 hours that no discharge will permeate, drain, infiltrate, or otherwise escape before cleanup occurs. Use drip pans during oil transfer operations; adequate absorbent material must be onsite to clean up any spills and prevent releases to the environment. Cover tanks and drip pans during inclement weather. Provide procedures and equipment to prevent overfilling of tanks. If tanks and containers with an aggregate aboveground capacity greater than 1320 gallons will be used onsite (only containers with a capacity of 55 gallons or greater are counted), provide and implement a SPCC plan meeting the requirements of 40 CFR 112. Do not bring underground storage tanks to the installation for Contractor use during a project. Submit the SPCC plan to the Contracting Officer for approval.

Monitor and remove any rainwater that accumulates in open containment dikes or berms. Inspect the accumulated rainwater prior to draining from a containment dike to the environment, to determine there is no oil sheen present.

3.15 INADVERTENT DISCOVERY OF PETROLEUM-CONTAMINATED SOIL OR HAZARDOUS WASTES

If petroleum-contaminated soil, or suspected hazardous waste is found during construction that was not identified in the Contract documents, immediately notify the Contracting Officer. Do not disturb this material until authorized by the Contracting Officer.

3.16 CHLORDANE

Evaluate excess soils and concrete foundation debris generated during the demolition of housing units or other wooden structures for the presence of chlordane or other pesticides prior to reuse or final disposal.

3.17 SOUND INTRUSION

Make the maximum use of low-noise emission products, as certified by the EPA. Blasting or use of explosives are not permitted without written permission from the Contracting Officer, and then only during the designated times. Confine pile-driving operations to the period between 8 a.m. and 4 p.m., Monday through Friday, exclusive of holidays, unless otherwise specified.

Keep construction activities under surveillance and control to minimize environment damage by noise. Comply with the provisions of the State of

Florida rules.

3.18 POST CONSTRUCTION CLEANUP

Clean up areas used for construction in accordance with Contract Clause: "Cleaning Up". Unless otherwise instructed in writing by the Contracting Officer, remove traces of temporary construction facilities such as haul roads, work area, structures, foundations of temporary structures, stockpiles of excess or waste materials, and other vestiges of construction prior to final acceptance of the work. Grade parking area and similar temporarily used areas to conform with surrounding contours.

3.19 INSTALLATION RESTORATION PROGRAM (IRP)

A. Contractors and Project Managers (PM) planning projects on Eglin AFB should be aware of the potential to encounter soil/groundwater contamination throughout many areas of the base. The following guidance has been developed to assist in the planning, designing and construction of projects in possibly contaminated areas (IRP sites). The first set of guidance is the most stringent and involves projects planned in an area that has known contamination and regulatory Land Use Controls. The second set of guidance applies to projects near a known IRP site with suspected contamination. The last set of guidance is general and applies to any areas of the base where contamination has not been confirmed. It is imperative that planners, designers, and contractors involve Eglin AFB 96 CEG/CEIEC early and often in the planning, designing, and construction process to minimize the impact that contaminated soils/groundwater may have on their project.

B. Projects located on a site with known soil and/or groundwater contamination with land use controls:

1. There are land use controls on this area imposed by an environmental regulatory agency designed to protect public health.
2. Project Manager should investigate and plan to ensure all monitor wells/cleanup systems are avoided.
3. Project Manager should submit detailed work plans to Eglin AFB 96 CEG/CEIEC early in planning stages so Eglin AFB 96 CEG/CEIEC can obtain concurrence from the regulatory agencies on project details.
4. Project Manager should educate workers on potential to encounter contamination and also should ensure workers are adequately protected with personal protective equipment.
5. If unusual soil or groundwater color/odor is encountered during subsurface work, contact Eglin AFB 96 CEG/CEIEC .

C. Projects located near a site with known or suspected soil and/or groundwater contamination without land use controls:

1. If unusual soil or groundwater color/odor is encountered during subsurface work, contact Eglin AFB 96 CEG/CEIEC .
2. Project Manager should investigate and plan to ensure all monitor wells/cleanup systems are avoided.
3. Project Manager should educate workers on potential to encounter contamination and also should ensure workers are adequately protected with personal protective equipment.

D. Sites without land use controls and not in close proximity to known contamination or IRP site:

1. If unusual soil or groundwater color/odor is encountered during subsurface work, contact Eglin AFB 96 CEG/CEIEC .
2. Project Manager should educate workers on potential to encounter

contamination and also should ensure workers are adequately protected with personal protective equipment.

Be aware that the regulatory agency can halt the project for long periods of time due to the discovery of contamination but Eglin AFB 96 CEG/CEIEC is committed to expediting projects with IRP compliance related issues.

-- End of Section --

This page left blank.

waste as defined in paragraph entitled, "Hazardous Waste," resulting from industrial, commercial, and agricultural operations and from community activities.

1.2.3 Rubbish

Combustible and noncombustible wastes including paper, boxes, glass, crockery, metal, lumber, cans, and bones.

1.2.4 Debris

Combustible and noncombustible wastes such as ashes and waste materials resulting from construction or maintenance and repair work, leaves, and tree trimmings.

1.2.5 Chemical Wastes

Salts, acids, alkalies, herbicides, pesticides, and organic chemicals.

1.2.6 Hazardous Wastes

Hazardous substances as defined in 40 CFR 261 or as defined by applicable state and local regulations. (FAC 17-761)

1.2.7 Oily Wastes

Petroleum products and bituminous materials.

1.2.8 Landscape Features

Trees, plants, shrubs and ground covers.

1.2.9 Hazardous Substances

As defined in EPA PL 96-510.

1.2.10 Hazardous Materials

As defined in 49 CFR 172, and FAC 17-761.

1.3 SCOPE

This section covers environmental protection in general. Specific environmental requirements are included in other appropriate sections of the specifications. Additional general environmental requirements are included in the General Provisions of the contract. The provisions of this section are in addition to the aforementioned requirements. Where the general provisions of this section conflict with specific requirements elsewhere, the specific requirements shall control.

1.4 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Hazardous materials; G

SD-07 Certificates

Environmental Protection Plan; G

Management Plan; G

Disposal permit for hazardous wastes; G

Hazardous waste certification; G

1.5 GENERAL

The contractor shall comply with all applicable local, state, federal, and Air Force environmental regulations. These items include, but are not limited to, the following:

1.5.1 Vehicles and Other Powered Equipment

Vehicles and other powered equipment will meet all applicable air quality regulations for emissions. Equipment shall be mechanically sound and have all seals, grease rings, and other containment systems in place to prevent leakage. Drip pans shall be maintained such that overflow and spills do not occur. Associated waste shall be handled in accordance with all applicable regulations. There shall be no activities for equipment maintenance including oil changes, filter replacements, or hydraulic equipment repair performed on base without prior approval by the Contracting Officer.

1.5.2 Solid Waste

All solid waste shall be collected and disposed of on a daily basis. There shall be no accumulation of solid waste unless properly containerized or put within a fenced area to prevent material being blown about by the wind. No liquids shall be put into base dumpsters. This includes paints, oils, chemicals, compressed gas, or pesticides, and other similar materials. Dried paint cans will be allowed in dumpsters only if such can contain no lead, chromium or cadmium, or other hazardous materials.

1.5.3 Hazardous Waste

All hazardous wastes such as sandblast media, chlorinated solvents, paint, paint thinners, cleaners, and fuels will be labeled and an inventory management system will be initiated to ensure timely removal and proper disposal. No on-base disposal will be allowed.

- a. All drums must be labeled with a hazardous waste label. The label shall include the proper DOT shipping name, UN or NA, EPA waste number, generator information, and accumulation start date. The label shall be placed on the side of the drum.
- b. All drums used to store hazardous waste shall be nonleaking and safe to handle. Drums that are rusty, dented, or leaking will be overpacked. Drums and/or overpacks shall be provided by the Contractor. All drums shall be DOT approved containers.
- c. Storage of drums will be approved by the Hazardous Waste Branch of

the Environmental Management Directorate (96 CEG/CEIEC) prior to the generation of hazardous waste. The Contractor shall document inspection of drums for leaks on a daily basis or if not working in the area daily, then a weekly inspection will suffice. A drum shall be disposed within 90 days of the first drop in the container. A copy of the inspection checklist will be forwarded to CEIEC every Friday.

- d. Hazardous waste drums shall be stored at an approved accumulation site. A sign identifying the site as an accumulation site with two points of contact will be placed in a highly visible position.
- e. Hazardous Waste transportation and disposal shall be coordinated through CEIEC. The transporters and disposal facilities will be approved by the CEIEC prior to their use. Manifests will be signed only by the CEIEC.

1.5.4 Hazardous Materials

The Contractor shall submit to the Contracting Officer a list of all hazardous materials to be brought onto Eglin AFB property prior to the onset of any work. The list shall include all paints, solvents, POL products, pesticides, etc to be used during the duration of the contract. All newly identified requirements for hazardous materials shall be coordinated with and approved by the Compliance Division of the Environmental Management Directorate (96 CEG/CEIE) prior to bringing the material on Eglin property.

1.5.5 Fuel Storage

Fuel storage will be limited to 500 gallons and shall be contained in a government approved portable tank. The site of the tanks shall be approved by the Contracting Officer.

1.5.6 Oil Storage

Storage of oils, greases, chemicals, or other liquids shall require a fully contained facility for spill prevention and security. A minimum of 40 pounds of absorbent material per 44 gallons of chemical/oil/grease will be on hand for spill control.

1.5.7 Spills

All spills shall immediately be reported to the Eglin Consolidated Command Post (882-3278) and the Department dispatch desk (911). Information as to spill location, type of material, and estimated time when the spill occurred shall be provided. The Contractor shall ensure appropriate personnel protective equipment (PPE) is available to take care of spill cleanup and handling of residues of materials under their control.

1.5.8 Spray Painting

Spray painting shall be conducted by using low-volatile organic chemical (VOC) paint technology or water base paints.

1.5.9 Contractor Sites

Contractor sites (i.e. trailer and storage sites) shall be properly maintained at all times. Repair of all damage due to improper erosion

control shall be the responsibility of the Contractor. Release of the site by the Contractor will be accompanied by a final Contractor site review, at which time site efficiencies will be noted. The Contractor shall have 14 calendar days (beyond the contract completion date if necessary) to correct all deficiencies. The contract completion date will not be changed due to any of the required site review actions.

1.5.10 Asbestos

Asbestos: If the Contractor encounters unforeseen site conditions including, but not limited to suspected asbestos containing materials during the performance of this contract, the Contractor shall cease operations in the suspect area, immediately evacuate all personnel, and notify the Contracting Officer and the construction inspector. Samples will be taken and analyzed by the Government.

1.5.11 Refrigerants

The Release of ODCs is Prohibited: All refrigerants will be recycled or recovered in accordance with EPA standards. The recycle/recovery equipment must be certified by an approved equipment testing organization to meet the standards in CFR 82.158 (b) or (d), equipment pursuant to 40 CFR 82.36 (a), or equipment manufactured before Nov 15, 1993, that meets the standards in 40 CFR 82.158 (c), (e), or (g). In addition the equipment operator or technician must meet the certification requirements for Universal Technician as required by EPA Regulation 40 CFR 82, Subpart F

1.5.12 Banned Ozone Depleting Chemicals

All equipment using any Class 1 ozone depleting chemicals (ODCs) for a fire suppressant, refrigerant or solvent is banned from acquisition or use unless it has an Air Force waiver. This includes, but is not limited to systems using Class 1 ODCs such as halon 1211, halon 1301, R-11 (trichloromonofluoromethane), R-12 (dichlorodifluoromethane), R-113 (trichlorotrifluoroethane), R-114 (dichlorodifluoromethane), R-115 (chloropentafluoroethane), and all azeotropic mixtures containing controlled chemicals such as CFC 500, 501, 502, and 504.

1.5.13 Ground Contamination

If suspected contamination is encountered during excavation activities (often indicated by unusual colors or odors), the Contractor shall contact the Contracting Officer immediately.

1.5.14 Environmental Training

Specific Contractor personnel may be required to attend Hazard Communications (HazCom) Training and Hazard Waste Seminars held bi-annually at Eglin AFB at no expense to the Contractor. If the Contractor has a HazCom Program in place and can provide proof of such program, then the HazCom Training can be waived. Proof of an existing HazCom Program shall be provided to the environmental management representative at the pre-construction meeting and updated annually.

1.6 QUALITY ASSURANCE

1.6.1 Environmental Protection Requirements

Provide and maintain, during the life of the contract, environmental

protection as specified. Plan for and provide environmental protective measures to control pollution that develops during normal construction practice. Plan for and provide environmental protective measures required to correct conditions that develop during the construction of permanent or temporary environmental features associated with the project. Comply with Federal, state, and local regulations pertaining to the environment, including water, air, solid waste, hazardous waste and substances, oily substances and noise pollution. The Florida Department of Environmental Regulation (FDER) requirements must be met.

1.7 PROJECT CONDITIONS

1.7.1 Environmental Protection Plan

: Submit the proposed environmental protection plan including appropriate information from the preconstruction survey.

1.7.2 Management Plan

Identify the hazardous wastes expected to be generated and submit a management plan before commencing work.

1.7.3 Solid Wastes Disposal Permit

Submit one copy of a state or local permit or license showing such agency's approval of the disposal plan before transporting wastes off government property

1.7.4 Disposal Permit for Hazardous Wastes

Submit a copy of the applicable EPA or state permits or licenses for transportation, treatment, storage, and disposal of hazardous wastes by permitted facilities before transporting wastes off government property.

1.7.5 Hazardous Waste Certification

Submit written certification that hazardous wastes turned-in for disposal were generated on government property and are identified, packaged and labeled in accordance with 49 CFR 172.

1.7.6 Laboratory Analysis of Soils

Submit a copy of laboratory analysis of soils collected as a result from excavation operations before disposing of soils.

1.8 NATURAL RESOURCES

Preserve the natural resources within the project boundaries and outside the limits of permanent work. Restore to an equivalent or improved condition upon completion of work. Confine construction activities to within the limits of the work indicated or specified.

1.8.1 Landscape Features

Except in areas to be cleared, do not remove, cut, deface, injure, or destroy existing landscape features without the Contracting Officer's permission. Do not fasten or attach ropes, cables, or guys to existing trees, unless authorized by the Contracting Officer. Where use of attach ropes, cables, or guys is authorized, the Contractor shall be responsible

for damage to trees.

1.8.1.1 Protection

Protect existing landscape features which are to remain and which may be injured, bruised, defaced, or otherwise damaged by construction operations. By approved excavation, remove trees with 30 percent or more of their root systems destroyed.

1.8.1.2 Replacement

Remove existing landscape features scarred or damaged by equipment operations, and replace with equivalent, undamaged features. Obtain the Contracting Officer's approval before replacement.

1.8.2 Water Resources

1.8.2.1 Oily and Hazardous Substances

Prevent oily or other hazardous substances from entering the ground, drainage areas, or local bodies of water. Take precautions to ensure that no oil or other hazardous material is released to the water, land, sanitary sewer system, or storm sewer system. Environmental requirements for the prevention of oil spills are contained in 40 CFR 112. For oil and hazardous substance spills which may be large enough to violate Federal, state or local regulations, verbally notify the Contracting Officer immediately. Immediately clean up spills of oil or hazardous substances which result from the Contractor's operations. If the Contractor fails to clean up spills in a timely manner, the government will perform the cleanup at the Contractor's expense.

1.8.3 Fish and Wildlife Resources

Do not disturb fish and wildlife. Do not alter water flows or otherwise disturb the native habitat on or adjacent to the project, which is critical to the survival of fish and wildlife, except as indicated or specified.

1.9 HISTORICAL AND ARCHAEOLOGICAL RESOURCES

Preserve, and verbally report immediately to the Contracting Officer, items having possible historical or archaeological interest which are discovered in the course of work.

1.10 EROSION AND SEDIMENT CONTROL

1.10.1 Protection of Erodible Soils

Immediately finish the earthwork brought to a final grade, as indicated or specified. Immediately protect the side slopes upon completion of rough grading. Plan and conduct earthwork to minimize the duration of exposure of unprotected soils.

1.10.2 Temporary Protection of Erodible Soils

Provide the following methods to prevent erosion and control sedimentation.

1.10.2.1 Mechanical Retardation and Control of Runoff

Mechanically retard and control the rate of runoff from the construction site. Provide diversion ditches, benches, and berms to retard and divert runoff to protected drainage courses.

1.10.2.2 Sediment Basins

Trap sediment in temporary sediment basins. Pump dry and remove the accumulated sediment, after each storm. Use a paved weir or vertical overflow pipe for overflow. Remove collected sediment from the site. Institute effluent quality monitoring programs.

1.10.2.3 Borrow

Permitted only in areas where suitable environmental controls are possible.

1.10.2.4 Vegetation and Mulch

Provide temporary protection on sides and back slopes as soon as rough grading is completed or sufficient soil is exposed to require erosion protection. Protect slopes by accelerated growth of permanent vegetation, temporary vegetation, mulching, or netting. Stabilize slopes by hydroseeding, anchoring mulch in place, covering with anchored netting, sodding, or such combination of these and other methods necessary for effective erosion control.

1.11 SOLID AND SANITARY WASTES

Pick up solid wastes, and place in containers which are regularly emptied. Prevent contamination of the site and other areas when handling and disposing wastes. On completion, leave the areas clean. Control and dispose of wastes.

1.11.1 Disposal of Solid Wastes

Dispose of solid wastes in accordance with the requirements specified.

1.12 HAZARDOUS WASTES

1.12.1 Waste

Hazardous wastes shall be handled, labeled, and stored in accordance with Federal, state and local regulations, including 40 CFR 261, 40 CFR 262, and 40 CFR 263. Hazardous wastes shall be identified and shall not be removed from government property but shall be delivered to a site specified by the Contracting Officer. No hazardous wastes shall be brought onto government property. For hazardous waste spills, verbally notify the Contracting Officer immediately.

1.12.2 Petroleum Products

Conduct the fueling and lubricating of equipment and motor vehicles to protect against spills and evaporation. Dispose of lubricants and excess oils.

1.13 TEMPORARY CONSTRUCTION

Remove temporary construction facilities including work areas, and

stockpiles of excess or waste materials. Grade temporary roads, parking areas, and temporarily used areas to conform with surrounding contours.

PART 2 PRODUCTS

NOT USED

PART 3 EXECUTION

NOT USED

-- End of Section --

This page left blank.

SECTION 01 74 19

CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL
02/19

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

40 CFR 273	Standards for Universal Waste Management
49 CFR 173	Shippers - General Requirements for Shipments and Packagings
49 CFR 178	Specifications for Packagings

1.2 DEFINITIONS

1.2.1 Co-mingle

The practice of placing unrelated materials together in a single container, usually for benefits of convenience and speed.

1.2.2 Construction Waste

Waste generated by construction activities, such as scrap materials, damaged or spoiled materials, temporary and expendable construction materials, and other waste generated by the workforce during construction activities.

1.2.3 Demolition Debris/Waste

Waste generated from demolition activities, including minor incidental demolition waste materials generated as a result of intentional dismantling of all or portions of a building, to include clearing of building contents that have been destroyed or damaged.

1.2.4 Disposal

Depositing waste in a solid waste disposal facility, usually a managed landfill, regulated in the US under the Resource Conservation and Recovery Act (RCRA).

1.2.5 Diversion

The practice of diverting waste from disposal in a landfill, by means of eliminating or minimizing waste, or reuse of materials.

1.2.6 Final Construction Waste Diversion Report

A written assertion by a material recovery facility operator identifying

constituent materials diverted from disposal, usually including summary tabulations of materials, weight in short-ton.

1.2.7 Recycling

The series of activities, including collection, separation, and processing, by which products or other materials are diverted from the solid waste stream for use in the form of raw materials in the manufacture of new products sold or distributed in commerce, or the reuse of such materials as substitutes for goods made of virgin materials, other than fuel.

1.2.8 Reuse

The use of a product or materials again for the same purpose, in its original form or with little enhancement or change.

1.2.9 Salvage

Usable, salable items derived from buildings undergoing demolition or deconstruction, parts from vehicles, machinery, other equipment, or other components.

1.2.10 Source Separation

The practice of administering and implementing a management strategy to identify and segregate unrelated waste at the first opportunity.

1.3 CONSTRUCTION WASTE (INCLUDES DEMOLITION DEBRIS/WASTE)

Divert a minimum of 60 percent by weight of the project construction waste and demolition debris/waste from the landfill. Follow applicable industry standards in the management of waste. Apply sound environmental principles in the management of waste. (1) Practice efficient waste management when sizing, cutting, and installing products and materials and (2) use all reasonable means to divert construction waste and demolition debris/waste from landfills and incinerators and to facilitate the recycling or reuse of excess construction materials.

1.4 CONSTRUCTION WASTE MANAGEMENT

Implement a construction waste management program for the project. Take a pro-active, responsible role in the management of construction construction waste, recycling process, disposal of demolition debris/waste, and require all subcontractors, vendors, and suppliers to participate in the construction waste management program. Establish a process for clear tracking, and documentation of construction waste and demolition debris/waste.

1.4.1 Implementation of Construction Waste Management Program

Develop and document how the construction waste management program will be implemented in a construction waste management plan. Submit a Construction Waste Management Plan to the Contracting Officer for approval. Construction waste and demolition debris/waste materials include un-used construction materials not incorporated in the final work, as well as demolition debris/waste materials from demolition activities or deconstruction activities. In the management of waste, consider the availability of viable markets, the condition of materials, the ability to

provide material in suitable condition and in a quantity acceptable to available markets, and time constraints imposed by internal project completion mandates.

1.4.2 Oversight

The Quality Control Manager, as specified in Section 01 45 00.00 10 QUALITY CONTROL, is responsible for overseeing and documenting results from executing the construction waste management plan for the project.

1.4.3 Special Programs

Implement any special programs involving rebates or similar incentives related to recycling of construction waste and demolition debris/waste materials. Retain revenue or savings from salvaged or recycling, unless otherwise directed. Ensure firms and facilities used for recycling, reuse, and disposal are permitted for the intended use to the extent required by federal, state, and local regulations.

1.4.4 Special Instructions

Provide on-site instruction of appropriate separation, handling, recycling, salvage, reuse, and return methods to be used by all parties at the appropriate stages of the projects. Designation of single source separating or commingling will be clearly marked on the containers.

1.4.5 Waste Streams

Delineate waste streams and characterization, including estimated material types and quantities of waste, in the construction waste management plan. Manage all waste streams associated with the project. Typical waste streams are listed below. Include additional waste streams not listed:

- a. Land Clearing Debris
- b. Asphalt
- c. Masonry and CMU
- d. Concrete
- e. Metals (e.g. banding, stud trim, ductwork, piping, rebar, roofing, other trim, steel, iron, galvanized, stainless steel, aluminum, copper, zinc, bronze, etc.)
- f. Wood (nails and staples allowed)
- g. Glass
- h. Paper
- i. Plastics (PET, HDPE, PVC, LDPE, PP, PS, Other)
- j. Gypsum
- k. Non-hazardous paint and paint cans
- l. Carpet
- m. Ceiling Tiles
- n. Insulation
- o. Beverage Containers

1.5 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Construction Waste Management Plan; G

SD-06 Test Reports

Quarterly Reports

Annual Report

SD-11 Closeout Submittals

Final Construction Waste Diversion Report; S

1.6 MEETINGS

Conduct Construction Waste Management meetings. After award of the Contract and prior to commencement of work, schedule and conduct a meeting with the Contracting Officer to discuss the proposed construction waste management plan and to develop a mutual understanding relative to the management of the construction waste management program and how waste diversion requirements will be met.

The requirements of this meeting may be fulfilled during the coordination and mutual Understanding meeting outlined in Section 01 45 00.00 10 QUALITY CONTROL. At a minimum, discuss and document waste management goals at following meetings:

- a. Preconstruction, Pre-demolition meeting.
- b. Regular site meetings.
- c. Work safety meeting (if applicable).

1.7 CONSTRUCTION WASTE MANAGEMENT PLAN

Submit Construction Waste Management Plan within 15 days after contract award. Revise and resubmit Construction Waste Management Plan until it receives final approval from the Contracting Officer, in order for construction to begin. Execute demolition or deconstruction activities in accordance with Section 02 41 00 DEMOLITION. Manage demolition debris/waste or deconstruction materials in accordance with the approved construction waste management plan.

An approved construction waste management plan will not relieve the Contractor of responsibility for compliance with applicable environmental regulations or meeting project cumulative waste diversion requirement. Ensure all subcontractors receive a copy of the approved Construction Waste Management Plan. The plan demonstrates how to meet the project waste diversion requirement. Also, include the following in the plan:

- a. Identify the names of individuals responsible for waste management and waste management tracking, along with roles and responsibilities on the project..
- b. Actions that will be taken to reduce solid waste generation, including coordination with subcontractors to ensure awareness and participation.

- c. Description of the regular meetings to be held to address waste management.
- d. Description of the specific approaches to be used in recycling/reuse of the various materials generated, including the areas on site and equipment to be used for processing, sorting, and temporary storage of materials.
- e. Name of landfill and/or incinerator to be used.
- f. Identification of local and regional re-use programs, including non-profit organizations such as schools, local housing agencies, and organization that accept used materials such as material exchange networks and resale stores. Include the name, location, phone number for each re-use facility identified, and provide a copy of the permit or license for each facility.
- g. List of specific materials, by type and quantity, that will be salvaged for resale, salvaged and reused on the current project, salvaged and stored for reuse on a future project, or recycled. Identify the recycling facilities by name, address, and phone number.
- h. Identification of materials that cannot be recycled or reused with an explanation or justification, to be approved by the Contracting Officer.
- i. Description of the means by which any materials identified in item (g) above will be protected from contamination.
- j. Description of the means of transportation of the recyclable materials (whether materials will be site-separated and self-hauled to designated centers, or whether mixed materials will be collected by a waste hauler and removed from the site).
- k. Copy of training plan for subcontractors and other services to prevent contamination by co-mingling materials identified for diversion and waste materials.
- l. Facilities or subcontractors offering construction waste transport on-site or off-site must ensure that proper shipping orders, bill of lading, manifests, or other shipping documents containing waste diversion information meet requirements of 40 CFR 273 Universal Waste Management, 49 CFR 173 Shippers - General Requirements for Shipments and Packagings, and 49 CFR 178 Specifications for Packaging. Individuals signing manifests or other shipping documents should meet the minimum training requirements.
- m. List each supplier who deliver construction materials, in bulk, or package products in returnable containers or returnable packaging, or have take-back programs. List each program and the applicable material to actively monitor and track to assist in meeting waste diversion requirements on the project.
- n. Identify any local jurisdiction requirements for waste management. Include those requirements, points of contact, etc.

Distribute copies of the waste management plan to each subcontractor, Quality Control Manager, and the Contracting Officer.

1.8 RECORDS (DOCUMENTATION)

1.8.1 General

Maintain records to document the types and quantities of waste generated and diverted through re-use, recycling and/or sale to third parties; through disposal to a landfill or incinerator facility. Provide explanations for any materials not recycled, reused or sold. Collect and retain manifests, weight tickets, sales receipts, and invoices specifically identifying diverted project waste materials or disposed materials.

1.8.2 Accumulated

Maintain a running record of materials generated and diverted from landfill disposal, including accumulated diversion rates for the project. Make records available to the Contracting Officer during construction or incidental demolition activities. Provide a copy of the diversion records to the Contracting Officer upon completion of the construction, incidental demolitions or minor deconstruction activities.

1.9 REPORTS

1.9.1 General

Maintain current construction waste diversion information on site for periodic inspection by the Contracting Officer. Include in the quarterly reports, annual reports and final reports: the project name, contract information, information for waste generated, diverted and disposed of for the current reporting period and show cumulative totals for the project. Reports must identify quantities of waste by type and disposal method. Also include in each report, supporting documentation to include manifests, weigh tickets, receipts, and invoices specifically identifying the project and waste material type and weighted sum.

1.9.2 Quarterly Reporting

Provide cumulative reports at the end of each quarter (December, March, June, and September, corresponding with the federal fiscal year for reporting purposes). Submit quarterly reports not later than 15 calendar days after the preceding quarter has ended. Submit Quarterly Reports to the appropriate office or identified point of contact.

1.9.3 Annual Reporting

Provide a cumulative construction waste diversion report annually. Submit annual report not later than 30 calendar days after the preceding fourth quarter has ended. Provide copy of annual construction waste diversion report to the installation POC.

1.10 FINAL CONSTRUCTION WASTE DIVERSION REPORT

A Final Construction Waste Diversion Report is required at the end of the project. Provide Final Construction Waste Diversion Report 60 days prior to the Beneficial Occupancy Date (BOD).

1.11 COLLECTION

Collect, store, protect, and handle reusable and recyclable materials at

the site in a manner which prevents contamination, and provides protection from the elements to preserve their usefulness and monetary value. Provide receptacles and storage areas designated specifically for recyclable and reusable materials and label them clearly and appropriately to prevent contamination from other waste materials. Keep receptacles or storage areas neat and clean.

Train subcontractors and other service providers to either separate waste streams or use the co-mingling method as described in the construction waste management plan. Handle hazardous waste and hazardous materials in accordance with applicable regulations and coordinate with Section 01 57 19 TEMPORARY ENVIRONMENTAL CONTROLS. Separate materials by one of the following methods described herein:

1.11.1 Source Separation Method

Separate waste products and materials that are recyclable from trash and sort as described below into appropriately marked separate containers and then transport to the respective recycling facility for further processing. Deliver materials in accordance with recycling or reuse facility requirements (e.g., free of dirt, adhesives, solvents, petroleum contamination, and other substances deleterious to the recycling process). Separate materials into the category types as defined in the construction waste management plan.

1.11.2 Co-Mingled Method

Place waste products and recyclable materials into a single container and then transport to an authorized recycling facility, which meets all applicable requirements to accept and dispose of recyclable materials in accordance with all applicable local, state and federal regulations. The Co-mingled materials must be sorted and processed in accordance with the approved construction waste management plan.

1.11.3 Other Methods

Other methods proposed by the Contractor may be used when approved by the Contracting Officer.

1.12 DISPOSAL

Control accumulation of waste materials and trash. Recycle or dispose of collected materials off-site at intervals approved by the Contracting Officer and in compliance with waste management procedures as described in the waste management plan. Except as otherwise specified in other sections of the specifications, dispose of in accordance with the following:

1.12.1 Reuse

Give first consideration to reusing construction and demolition materials as a disposition strategy. Recover for reuse materials, products, and components as described in the approved construction waste management plan. Coordinate with the Contracting Officer to identify onsite reuse opportunities or material sales or donation available through Government resale or donation programs.

1.12.2 Recycle

Recycle non-hazardous construction and demolition/debris materials that are not suitable for reuse. Track rejection of contaminated recyclable materials by the recycling facility. Rejected recyclables materials will not be counted as a percentage of diversion calculation. Recycle all fluorescent lamps, HID lamps, mercury (Hg) -containing thermostats and ampoules, and PCBs-containing ballasts and electrical components as directed by the Contracting Officer. Do not crush lamps on site as this creates a hazardous waste stream with additional handling requirements.

1.12.3 Waste

Dispose by landfill or incineration only those waste materials with no practical use, economic benefit, or recycling opportunity.

PART 2 PRODUCTS

Not used.

PART 3 EXECUTION

Not used. -- End of Section --

SECTION 01 78 00

CLOSEOUT SUBMITTALS
05/19

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM E1971 (2005; R 2011) Standard Guide for Stewardship for the Cleaning of Commercial and Institutional Buildings

GREEN SEAL (GS)

GS-37 (2017) Cleaning Products for Industrial and Institutional Use

U.S. ARMY CORPS OF ENGINEERS (USACE)

ERDC/ITL TR-12-1 (2015) A/E/C Graphics Standard, Release 2.0

ERDC/ITL TR-12-6 (2015) A/E/C CAD Standard - Release 6.0

U.S. DEPARTMENT OF DEFENSE (DOD)

FC 1-300-09N (2014; with Change 4, 2018) Navy and Marine Corps Design

UFC 1-300-08 (2009, with Change 2, 2011) Criteria for Transfer and Acceptance of DoD Real Property

1.2 DEFINITIONS

1.2.1 As-Built Drawings

As-built drawings are the marked-up drawings, maintained by the Contractor on-site, that depict actual conditions and deviations from the Contract Documents. These deviations and additions may result from coordination required by, but not limited to: contract modifications; official responses to submitted Requests for Information (RFI's); direction from the Contracting Officer; design that is the responsibility of the Contractor, and differing site conditions. Maintain the as-builts throughout construction as red-lined hard copies on site or red-lined PDF files. These files serve as the basis for the creation of the record drawings.

1.2.2 Record Drawings

The record drawings are the final compilation of actual conditions

reflected in the as-built drawings.

1.3 SOURCE DRAWING FILES

Request the full set of electronic drawings, in the source format, for Record Drawing preparation, after award and at least 30 days prior to required use.

1.3.1 Terms and Conditions

Data contained on these electronic files must not be used for any purpose other than as a convenience in the preparation of construction drawings and data for the referenced project. Any other use or reuse shall be at the sole risk of the Contractor and without liability or legal exposure to the Government. The Contractor must make no claim and waives to the fullest extent permitted by law, any claim or cause of action of any nature against the Government, its agents or sub consultants that may arise out of or in connection with the use of these electronic files. The Contractor must, to the fullest extent permitted by law, indemnify and hold the Government harmless against all damages, liabilities or costs, including reasonable attorney's fees and defense costs, arising out of or resulting from the use of these electronic files.

These electronic CAD drawing files are not construction documents. Differences may exist between the CAD files and the corresponding construction documents. The Government makes no representation regarding the accuracy or completeness of the electronic CAD files, nor does it make representation to the compatibility of these files with the Contractor hardware or software. In the event that a conflict arises between the signed and sealed construction documents prepared by the Government and the furnished Source drawing files, the signed and sealed construction documents govern. The Contractor is responsible for determining if any conflict exists. Use of these Source Drawing files does not relieve the Contractor of duty to fully comply with the contract documents, including and without limitation, the need to check, confirm and coordinate the work of all contractors for the project. If the Contractor uses, duplicates or modifies these electronic source drawing files for use in producing construction drawings and data related to this contract, remove all previous indicia of ownership (seals, logos, signatures, initials and dates).

1.4 RECORD DRAWINGS

The Government will provide an optical disc (CD or DVD) at the preconstruction conference that contains one set of "as-designed" electronic CAD files in the specified software and format revised to reflect all amendments and the final contract PDF drawings. The CAD files are provided to enable preparation of as-built or as-constructed drawings. If discrepancies exist between the CAD files and the contract PDF drawings, correct the CAD files to show the contract PDF drawings.

1.4.1 Variation with Contract Drawings

The electronic files provided are not part of the contract documents. If there is any discrepancy between the electronic files and the contract drawings, the contract drawings govern. The Government has no responsibility to modify any GFM due to changes in the design that occur after award.

Evaluate the content and quality of the GFM upon receipt. If major

discrepancies or omissions occur in the GFM, notify the Contracting Officer and indicate the nature of such variations.

1.4.2 Data Loss, Corruption, and Error

Transfer of GFM files may result in corrupted files resulting in data loss and errors. Use of GFM files at own risk. Verify data integrity upon receipt and request a replacement if necessary. Make any adjustment in file structure, format, or software version as needed to make GFM compatible with computer systems and/or software to meet the requirements of the contract.

1.5 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Warranty Management Plan

Warranty Tags

Final Cleaning

Spare Parts Data

SD-08 Manufacturer's Instructions

Posted Instructions

SD-10 Operation and Maintenance Data

Operation and Maintenance Manuals; G

SD-11 Closeout Submittals

As-Built Drawings; G

Record Drawings; G

As-Built Record of Equipment and Materials

Final Approved Shop Drawings

Construction Contract Specifications

Interim DD FORM 1354; G

Checklist for DD FORM 1354; G

1.6 SPARE PARTS DATA

Submit two copies of the Spare Parts Data list.

- a. Indicate manufacturer's name, part number, nomenclature, and stock level required for maintenance and repair. List those items that may be standard to the normal maintenance of the system.
- b. Supply one item of each part for spare parts inventory. Provision of spare parts does not relieve the Contractor of responsibilities listed under the contract guarantee provisions.

1.7 QUALITY CONTROL

Additions and corrections to the contract drawings must be equal in quality and detail to that of the originals. Line colors, line weights, lettering, layering conventions, and symbols must be the same as the original line colors, line weights, lettering, layering conventions, and symbols.

1.8 WARRANTY MANAGEMENT

1.8.1 Warranty Management Plan

Develop a warranty management plan which contains information relevant to FAR 52.246-21 Warranty of Construction. At least 30 days before the planned pre-warranty conference, submit one set of the warranty management plan. Include within the warranty management plan all required actions and documents to assure that the Government receives all warranties to which it is entitled. The plan narrative must contain sufficient detail to render it suitable for use by future maintenance and repair personnel, whether tradesmen, or of engineering background, not necessarily familiar with this contract. The term "status" as indicated below must include due date and whether item has been submitted or was accomplished. Submit warranty information, made available during the construction phase, to the Contracting Officer for approval prior to each monthly pay estimate. Assemble approved information in a binder and turn over to the Government upon acceptance of the work. The construction warranty period must begin on the date of project acceptance and continue for the full product warranty period. Conduct a joint 4 month and 9 month warranty inspection, measured from time of acceptance; with the Contractor, Contracting Officer and the Customer Representative. The warranty management plan must include, but is not limited to, the following:

- a. Roles and responsibilities of personnel associated with the warranty process, including points of contact and telephone numbers within the organizations of the Contractors, subcontractors, manufacturers or suppliers involved.
- b. For each warranty, the name, address, telephone number, and email of each of the guarantor's representatives nearest to the project location.
- c. A list and status of delivery of Certificates of Warranty for extended warranty items, including roofs, HVAC balancing, pumps, motors, transformers, and for commissioned systems, such as fire protection and alarm systems, sprinkler systems, and lightning protection systems.
- d. As-Built Record of Equipment and Materials list for each warranted equipment, item, feature of construction or system indicating:
 - (1) Name of item.
 - (2) Model and serial numbers.

- (3) Location where installed.
 - (4) Name and phone numbers of manufacturers or suppliers.
 - (5) Names, addresses and telephone numbers of sources of spare parts.
 - (6) Warranties and terms of warranty. Include one-year overall warranty of construction, including the starting date of warranty of construction. Items which have extended warranties must be indicated with separate warranty expiration dates.
 - (7) Cross-reference to warranty certificates as applicable.
 - (8) Starting point and duration of warranty period.
 - (9) Summary of maintenance procedures required to continue the warranty in force.
 - (10) Cross-reference to specific pertinent Operation and Maintenance manuals.
 - (11) Organization, names and phone numbers of persons to call for warranty service.
 - (12) Typical response time and repair time expected for various warranted equipment.
- e. The plans for attendance at the 4 and 9 month post-construction warranty inspections conducted by the Government.
- f. Procedure and status of tagging of equipment covered by extended warranties.
- g. Copies of instructions to be posted near selected pieces of equipment where operation is critical for warranty or safety reasons.

1.8.2 Performance Bond

The Performance Bond must remain effective throughout the construction period.

- a. In the event the Contractor fails to commence and diligently pursue any construction warranty work required, the Contracting Officer will have the work performed by others, and after completion of the work, will charge the remaining construction warranty funds of expenses incurred by the Government while performing the work, including, but not limited to administrative expenses.
- b. In the event sufficient funds are not available to cover the construction warranty work performed by the Government at the Contractor's expense, the Contracting Officer will have the right to recoup expenses from the bonding company.
- c. Following oral or written notification of required construction warranty repair work, respond in a timely manner. Written verification will follow oral instructions. Failure to respond will be cause for the Contracting Officer to proceed against the Contractor.

1.8.3 Pre-Warranty Conference

Prior to contract completion, and at a time designated by the Contracting Officer, meet with the Contracting Officer to develop a mutual understanding with respect to the requirements of this section. At this meeting, establish and review communication procedures for Contractor notification of construction warranty defects, priorities with respect to the type of defect, reasonable time required for Contractor response, and other details deemed necessary by the Contracting Officer for the execution of the construction warranty. In connection with these

requirements and at the time of the Contractor's quality control completion inspection, furnish the name, telephone number and address of a licensed and bonded company which is authorized to initiate and pursue construction warranty work action on behalf of the Contractor. This point of contact must be located within the local service area of the warranted construction, be continuously available, and be responsive to Government inquiry on warranty work action and status. This requirement does not relieve the Contractor of any of its responsibilities in connection with other portions of this provision.

1.8.4 Contractor's Response to Construction Warranty Service Requirements

Following oral or written notification by the Contracting Officer, respond to construction warranty service requirements in accordance with the "Construction Warranty Service Priority List" and the three categories of priorities listed below. Submit a report on any warranty item that has been repaired during the warranty period. Include within the report the cause of the problem, date reported, corrective action taken, and when the repair was completed. If the Contractor does not perform the construction warranty within the timeframe specified, the Government will perform the work and back charge the construction warranty payment item established.

- a. First Priority Code 1. Perform onsite inspection to evaluate situation, and determine course of action within 4 hours, initiate work within 6 hours and work continuously to completion or relief.
- b. Second Priority Code 2. Perform onsite inspection to evaluate situation, and determine course of action within 8 hours, initiate work within 24 hours and work continuously to completion or relief.
- c. Third Priority Code 3. All other work to be initiated within 3 work days and work continuously to completion or relief.
- d. The "Construction Warranty Service Priority List" is as follows:

Code 1-Life Safety Systems

- (1) Fire suppression systems.
- (2) Fire alarm system(s) in place in the building.

Code 1-Air Conditioning Systems

- (1) Recreational support.
- (2) Air conditioning leak in part of building, if causing damage.
- (3) Air conditioning system not cooling properly.

Code 1-Doors

- (1) Overhead doors not operational, causing a security, fire, or safety problem.
- (2) Interior, exterior personnel doors or hardware, not functioning properly, causing a security, fire, or safety problem.

Code 3-Doors

- (1) Overhead doors not operational.
- (2) Interior/exterior personnel doors or hardware not functioning properly.

Code 1-Electrical

- (1) Power failure (entire area or any building operational after 1600 hours).
- (2) Security lights

(3) Smoke detectors

Code 2-Electrical

- (1) Power failure (no power to a room or part of building).
- (2) Receptacle and lights (in a room or part of building).

Code 3-Electrical

Street lights.

Code 1-Gas

- (1) Leaks and breaks.
- (2) No gas to family housing unit or cantonment area.

Code 1-Heat

- (1) Area power failure affecting heat.
- (2) Heater in unit not working.

Code 2-Kitchen Equipment

- (1) Dishwasher not operating properly.
- (2) All other equipment hampering preparation of a meal.

Code 1-Plumbing

- (1) Hot water heater failure.
- (2) Leaking water supply pipes.

Code 2-Plumbing

- (1) Flush valves not operating properly.
- (2) Fixture drain, supply line to commode, or any water pipe leaking.
- (3) Commode leaking at base.

Code 3 -Plumbing

Leaky faucets.

Code 3-Interior

- (1) Floors damaged.
- (2) Paint chipping or peeling.
- (3) Casework.

Code 1-Roof Leaks

Temporary repairs will be made where major damage to property is occurring.

Code 2-Roof Leaks

Where major damage to property is not occurring, check for location of leak during rain and complete repairs on a Code 2 basis.

Code 2-Water (Exterior)

No water to facility.

Code 2-Water (Hot)

No hot water in portion of building listed.

Code 3-All other work not listed above.

1.8.5 Warranty Tags

At the time of installation, tag each warranted item with a durable, oil and water resistant tag approved by the Contracting Officer. Attach each tag with a copper wire and spray with a silicone waterproof coating.

Also, submit two record copies of the warranty tags showing the layout and design. The date of acceptance and the QC signature must remain blank until the project is accepted for beneficial occupancy. Show the following information on the tag.

Type of product/material	
Model number	
Serial number	
Contract number	
Warranty period from/to	
Inspector's signature	
Construction Contractor	
Address	
Telephone number	
Warranty contact	
Address	
Telephone number	
Warranty response time priority code	
WARNING - PROJECT PERSONNEL TO PERFORM ONLY OPERATIONAL MAINTENANCE DURING THE WARRANTY PERIOD.	

PART 2 PRODUCTS

2.1 RECORD DRAWINGS

Prepare the CAD drawing files in AutoCAD Release 2013 format compatible with a Windows 7 operating system.

2.1.1 Additional Drawings

If additional drawings are required, prepare them using the specified electronic file format applying the same graphic standards specified for original drawings. The title block and drawing border to be used for any new final record drawings must be identical to that used on the contract drawings.

2.1.1.1 Sheet Numbers and File Names

If a sheet needs to be added between two sequential sheets, append a Supplemental Drawing Designator in accordance with ERDC/ITL TR-12-6 Adding a drawing sheet, and ERDC/ITL TR-12-1 Adding or deleting drawing sheets and index sheet procedures.

2.2 PDF AS-BUILT FILES

Provide electronic PDF "plots" of all contract drawings sheets associated with the as-built drawing submittal. Compile and organize the PDF set to match the contract drawings. Bookmark and label the pages of the PDF file to match contract drawings.

2.3 REDLINES AND MARKUPS

Provide PDFs of the current working redlines and/or markups complying with the as-builts drawing and markup requirements contained in this specification.

2.4 AS-BUILT RE-SUBMISSION REQUIREMENTS

If elements of an as-built submittal or advanced modeling package are rejected, provide the following for each re-submission, in addition to any information required in Section 01 33 00 SUBMITTAL PROCEDURES:

- a. Re-submit all components required under paragraph As-Builts or Advanced Modeling Package, including a new Advanced Modeling Submittal Checklist and updated content in response to Government comments.
- b. Provide a copy of all Government review comments.
- c. Provide a disposition/response to each Government review comment for a back-check of the re-submission deliverable.

PART 3 EXECUTION

3.1 AS-BUILT DRAWINGS

Provide and maintain two black line print copies of the PDF contract drawings for As-Built Drawings. Maintain the as-builts throughout construction as red-lined hard copies on site or red-lined PDF files. Submit As-Built Drawings 30 days prior to Beneficial Occupance Date (BOD).

3.1.1 Markup Guidelines

Make comments and markup the drawings complete without reference to letters, memos, or materials that are not part of the As-Built drawing. Show what was changed, how it was changed, where item(s) were relocated and change related details. These working as-built markup prints must be neat, legible and accurate as follows:

- a. Use base colors of red, green, and blue. Color code for changes as follows:
 - (1) Special (Blue) - Items requiring special information, coordination, or special detailing or detailing notes.
 - (2) Deletions (Red) - Over-strike deleted graphic items (lines),

lettering in notes and leaders.

(3) Additions (Green) - Added items, lettering in notes and leaders.

- b. Provide a legend if colors other than the "base" colors of red, green, and blue are used.
- c. Add and denote any additional equipment or material facilities, service lines, incorporated under As-Built Revisions if not already shown in legend.
- d. Use frequent written explanations on markup drawings to describe changes. Do not totally rely on graphic means to convey the revision.
- e. Use legible lettering and precise and clear digital values when marking prints. Clarify ambiguities concerning the nature and application of change involved.
- f. Wherever a revision is made, also make changes to related section views, details, legend, profiles, plans and elevation views, schedules, notes and call out designations, and mark accordingly to avoid conflicting data on all other sheets.
- g. For deletions, cross out all features, data and captions that relate to that revision.
- h. For changes on small-scale drawings and in restricted areas, provide large-scale inserts, with leaders to the applicable location.
- i. Indicate one of the following when attaching a print or sketch to a markup print:
 - 1) Add an entire drawing to contract drawings
 - 2) Change the contract drawing to show
 - 3) Provided for reference only to further detail the initial design.
- j. Incorporate all shop and fabrication drawings into the markup drawings.

3.1.2 As-Built Drawings Content

Revise As-Built Drawings in accordance with ERDC/ITL TR-12-1. Keep these working as-built markup drawings current on a weekly basis and at least one set available on the jobsite at all times. Changes from the contract drawings which are made during construction or additional information which might be uncovered in the course of construction must be accurately and neatly recorded as they occur by means of details and notes. Submit the working as-built markup drawings for approval prior to submission of each monthly pay estimate. For failure to maintain the working and final record drawings as specified herein, the Contracting Officer will withhold 10 percent of the monthly progress payment until approval of updated drawings. Show on the as-built drawings, but not limited to, the following information:

- a. The actual location, kinds and sizes of all sub-surface utility lines. In order that the location of these lines and appurtenances may be determined in the event the surface openings or indicators become covered over or obscured, show by offset dimensions to two

permanently fixed surface features the end of each run including each change in direction on the record drawings. Locate valves, splice boxes and similar appurtenances by dimensioning along the utility run from a reference point. Also record the average depth below the surface of each run.

- b. The location and dimensions of any changes within the building structure.
- c. Layout and schematic drawings of electrical circuits and piping.
- d. Correct grade, elevations, cross section, or alignment of roads, earthwork, structures or utilities if any changes were made from contract plans.
- e. Changes in details of design or additional information obtained from working drawings specified to be prepared or furnished by the Contractor; including but not limited to shop drawings, fabrication, erection, installation plans and placing details, pipe sizes, insulation material, dimensions of equipment, and foundations.
- f. The topography, invert elevations and grades of drainage installed or affected as part of the project construction.
- g. Changes or Revisions which result from the final inspection.
- h. Where contract drawings or specifications present options, show only the option selected for construction on the working as-built markup drawings.
- i. If borrow material for this project is from sources on Government property, or if Government property is used as a spoil area, furnish a contour map of the final borrow pit/spoil area elevations.
- j. Systems designed or enhanced by the Contractor, such as HVAC controls, fire alarm, fire sprinkler, and irrigation systems.
- k. Changes in location of equipment and architectural features.
- j. Modifications (include within change order price the cost to change working as-built markup drawings to reflect modifications) and compliance with FC 1-300-09N procedures.
- l. Actual location of anchors, construction and control joints, etc., in concrete.
- m. Unusual or uncharted obstructions that are encountered in the contract work area during construction.
- n. Location, extent, thickness, and size of stone protection particularly where it will be normally submerged by water.

3.2 RECORD DRAWING FILES

If additional drawings are required, prepare them using the specified electronic file format applying the same graphic standards specified for original drawings. The title block and drawing border to be used for any new final record drawings must be identical to that used on the contract drawings. Accomplish additions and corrections to the contract drawings

using CAD files. Provide all program files and hardware necessary to prepare final PDF record drawings. The Contracting Officer will review final PDF record drawings for accuracy and return them to the Contractor for required corrections, changes, additions, and deletions.

3.2.1 Rename the CAD Drawing files

Rename the CAD Drawing files using the contract number as the Project Code field, (e.g., W91238-15-C-10A-102.DWGDGN) as instructed in the Pre-Construction conference. Use only those renamed files for the Marked-up changes. Make all changes on the layer/level as the original item.

- a. For AutoCAD files (DWG), enter all as-built delta changes and notations on the AS-BUILT layer. MicroStation files (DGN), enter all as-built delta changes and notations on:
 - Level #63
 - Level/Layer Name contains: ANNO-REVS
 - Level/Layer Description: Revisions
- c. When final revisions have been completed, show the wording "RECORD DRAWING AS-BUILTS" followed by the name of the Contractor in letters at least 3/16 inch high on the cover sheet drawing. Date RECORD DRAWING AS-BUILTS" drawing revisions in the revision block.
- d. Within 1020 days after Government approval of all of the working record drawings for a phase of work, prepare the final CAD record drawings for that phase of work and submit PDF drawing files and two sets of prints for review and approval. The Government will promptly return one set of prints annotated with any necessary corrections. Within 710 days revise the CAD files accordingly at no additional cost and submit one set of final prints for the completed phase of work to the Government. Within 1020 days of substantial completion of all phases of work, submit the final record drawing package for the entire project. Submit one set of electronic CAD files, and one set of the approved working record PDF files on an optical disc with two sets of prints. The CAD files must be complete in all details and identical in form and function to the CAD drawing files supplied by the Government. Prepare AutoCAD files for transmittal using e-Transmit. Prepare MicroStation files for transmittal using the Packager (Archive). Make any transactions or adjustments necessary to accomplish this. The Government reserves the right to reject any drawing files it deems incompatible with the customer's CAD system. Paper prints, drawing files and storage media submitted will become the property of the Government upon final approval. Failure to submit final record PDF drawing files, CAD files and marked prints as specified will be cause for withholding any payment due under this contract. Approval and acceptance of final record drawings must be accomplished before final payment is made.

3.3 RECORD DRAWINGS

Prepare and provide Record Drawings and Source Documents in accordance with FC 1-300-09N. Provide four copies of Record Drawings and Documents on separate CDs or DVDs 30 days after BOD.

Prepare final record drawings after the completion of each definable phase

of work as listed in the Contractor Quality Control Plan (such as Foundations, Utilities, or Structural Steel as appropriate for the project). Transfer the changes from the approved working as-built markup drawings to the original electronic CAD drawing files. Modify the as-built CAD drawing files to correctly show the features of the project as-built by bringing the working CAD drawing set into agreement with approved working as-built markup drawings, and adding such additional drawings as may be necessary. Refer to ERDC/ITL TR-12-1. Jointly review the working as-built markup drawings with printouts from working as-built CAD drawing PDF files for accuracy and completeness. Monthly review of working as-built CAD drawing PDF file printouts must cover all sheets revised since the previous review. These PDF drawing files are part of the permanent records of this project. Any drawings damaged or lost must be satisfactorily replaced at no expense to the Government.

Drawing revisions (include within change order price the cost to change working and final record drawings to reflect revisions) and compliance with the following procedures.

- a. Follow directions in the revision for posting descriptive changes.
- b. The revision delta size must be 5/16 inch unless the area where the delta is to be placed is crowded. Use a smaller size delta for crowded areas.
- c. Place a revision delta at the location of each deletion.
- d. For new details or sections which are added to a drawing, place a revision delta by the detail or section title.
- e. For minor changes, place a revision delta by the area changed on the drawing (each location).
- f. For major changes to a drawing, place a revision delta by the title of the affected plan, section, or detail at each location.
- g. For changes to schedules or drawings, place a revision delta either by the schedule heading or by the change in the schedule.

3.3.1 Final Record Drawing Package

Submit the final record PDF and CAD drawings package for the entire project within 20 days of substantial completion of all phases of work. Submit one set of ANSI D size PDF and CAD files on optical disc, read-only memory (ROM), two sets of ANSI D size prints and one set of the approved working record drawings. The package must be complete in all details and identical in form and function to the contract drawing files supplied by the Government.

3.4 FINAL APPROVED SHOP DRAWINGS

Submit final approved project shop drawings 30 days after transfer of the completed facility.

3.5 CONSTRUCTION CONTRACT SPECIFICATIONS

Submit final PDF file record construction contract specifications, including revisions thereto, 30 days after transfer of the completed facility.

3.6 AS-BUILT RECORD OF EQUIPMENT AND MATERIALS

Furnish one copy of preliminary record of equipment and materials used on the project 15 days prior to final inspection. This preliminary submittal will be reviewed and returned 2 days after final inspection with Government comments. Submit Two sets of final record of equipment and materials 10 days after final inspection. Key the designations to the related area depicted on the contract drawings. List the following data:

RECORD OF DESIGNATED EQUIPMENT AND MATERIALS DATA				
Description	Specification Section	Manufacturer and Catalog, Model, and Serial Number	Composition and Size	Where Used

3.7 OPERATION AND MAINTENANCE MANUALS

Provide project operation and maintenance manuals as specified in Section 01 78 23 OPERATION AND MAINTENANCE MANUALS DATA. Provide four electronic copies of the Operation and Maintenance Manual files and one hard copy of the Operation and Maintenance Manuals. Submit to the Contracting Officer for approval within 30 calendar days of the Beneficial Occupancy Date (BOD). Update and resubmit files for final approval at BOD.

3.8 CLEANUP

Provide final cleaning in accordance with ASTM E1971 and submit two copies of the listing of completed final clean-up items. Leave premises "broom clean." Comply with GS-37 for general purpose cleaning and bathroom cleaning. Use only nonhazardous cleaning materials, including natural cleaning materials, in the final cleanup. Clean interior and exterior glass surfaces exposed to view; remove temporary labels, stains and foreign substances; polish transparent and glossy surfaces; vacuum carpeted and soft surfaces. Clean equipment and fixtures to a sanitary condition. Replace filters of operating equipment and comply with the Indoor Air Quality (IAQ) Management Plan. Clean debris from roofs, gutters, downspouts and drainage systems. Sweep paved areas and rake clean landscaped areas. Remove waste and surplus materials, rubbish and construction facilities from the site. Recycle, salvage, and return construction and demolition waste from project in accordance with Section 01 57 19 TEMPORARY ENVIRONMENTAL CONTROLS, and 01 74 19 CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL.

3.9 REAL PROPERTY RECORD

Near the completion of Project, but a minimum of 60 days prior to final acceptance of the work, complete and submit an accounting of all installed property with Interim DD FORM 1354. Include any additional assets, improvements, and alterations from the Draft DD FORM 1354. Contact the Contracting Officer for any project specific information necessary to

complete the DD FORM 1354. Refer to UFC 1-300-08 for instruction on completing the DD FORM 1354. Attach the Real Property receiving Component's completed High Performance and Sustainable Building (HPSB) Checklist for each applicable building to the completed DD 1354. For convenience, a blank fillable PDF DD FORM 1354 may be obtained at the following link:

www.esd.whs.mil/Portals/54/Documents/DD/forms/dd/dd1354.pdf

Submit the completed Checklist for DD FORM 1354 of Installed Building Equipment items. Attach this list to the updated DD FORM 1354.

-- End of Section --

This page left blank.

SECTION 01 78 23

OPERATION AND MAINTENANCE DATA

08/15

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM E1971 (2005; R 2011) Standard Guide for Stewardship for the Cleaning of Commercial and Institutional Buildings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-10 Operation and Maintenance Data

O&M Database ; G

Training Plan ; G

Training Outline ; G

Training Content ; G

SD-11 Closeout Submittals

Training Video Recording ; G

Validation of Training Completion ; G

1.3 OPERATION AND MAINTENANCE DATA

Submit Operation and Maintenance (O&M) Data for the provided equipment, product, or system, defining the importance of system interactions, troubleshooting, and long-term preventive operation and maintenance. Compile, prepare, and aggregate O&M data to include clarifying and updating the original sequences of operation to as-built conditions. Organize and present information in sufficient detail to clearly explain O&M requirements at the system, equipment, component, and subassembly level. Include an index preceding each submittal. Submit in accordance with this section and Section 01 33 00 SUBMITTAL PROCEDURES.

1.3.1 Package Quality

Documents must be fully legible. Operation and Maintenance data must be consistent with the manufacturer's standard brochures, schematics, printed instructions, general operating procedures, and safety precautions.

1.3.2 Package Content

Provide data package content in accordance with paragraph SCHEDULE OF OPERATION AND MAINTENANCE DATA PACKAGES. Comply with the data package requirements specified in the individual technical sections, including the content of the packages and addressing each product, component, and system designated for data package submission, except as follows. Use Data Package 3 for commissioned items without a specified data package requirement in the individual technical sections. Provide a Data Package 3 instead of Data Package 1 or 2, as specified in the individual technical section, for items that are commissioned.

1.3.3 Changes to Submittals

Provide manufacturer-originated changes or revisions to submitted data if a component of an item is so affected subsequent to acceptance of the O&M Data. Submit changes, additions, or revisions required by the Contracting Officer for final acceptance of submitted data within 30 calendar days of the notification of this change requirement.

1.3.4 Commissioning Authority Review and Approval

Submit the commissioned systems and equipment submittals to the Commissioning Authority (CxA) to review for completeness and applicability. Obtain validation from the CxA that the systems and equipment provided meet the requirements of the Contract documents and design intent, particularly as they relate to functionality, energy performance, water performance, maintainability, sustainability, system cost, indoor environmental quality, and local environmental impacts. The CxA communicates deficiencies to the Contracting Officer. Submit the O&M manuals to the Contracting Officer upon a successful review of the corrections, and with the CxA recommendation for approval and acceptance of these O&M manuals. This work is in addition to the normal review procedures for O&M data.

1.4 O&M DATABASE

Develop an editable, electronic spreadsheet based on the equipment in the Operation and Maintenance Manuals that contains the information required to start a preventive maintenance program. As a minimum, provide list of system equipment, location installed, warranty expiration date, manufacturer, model, and serial number.

1.5 OPERATION AND MAINTENANCE MANUAL FILE FORMAT

Assemble data packages into electronic Operation and Maintenance Manuals. Assemble each manual into a composite electronically indexed file using the most current version of Adobe Acrobat or similar software capable of producing PDF file format. Provide compact disks (CD) or data digital versatile disk (DVD) as appropriate, so that each one contains operation, maintenance and record files, project record documents, and training videos. Include a complete electronically linked operation and maintenance directory.

1.5.1 Organization

Bookmark Product and Drawing Information documents using the current version of CSI Masterformat numbering system, and arrange submittals using the specification sections as a structure. Use CSI Masterformat and UFGS numbers along with descriptive bookmarked titles that explain the content of the information that is being bookmarked.

1.5.2 CD or DVD Label and Disk Holder or Case

Provide the following information on the disk label and disk holder or case:

- a. Building Number
- b. Project Title
- c. Activity and Location
- d. Construction Contract Number
- e. Prepared For: (Contracting Agency)
- f. Prepared By: (Name, title, phone number and email address)
- g. Include the disk content on the disk label
- h. Date
- i. Virus scanning program used

1.6 TYPES OF INFORMATION REQUIRED IN O&M DATA PACKAGES

The following are a detailed description of the data package items listed in paragraph SCHEDULE OF OPERATION AND MAINTENANCE DATA PACKAGES.

1.6.1 Operating Instructions

Provide specific instructions, procedures, and illustrations for the following phases of operation for the installed model and features of each system:

1.6.1.1 Safety Precautions and Hazards

List personnel hazards and equipment or product safety precautions for operating conditions. List all residual hazards identified in the Activity Hazard Analysis provided under Section 01 35 26 GOVERNMENT SAFETY REQUIREMENTS. Provide recommended safeguards for each identified hazard.

1.6.1.2 Operator Prestart

Provide procedures required to install, set up, and prepare each system for use.

1.6.1.3 Startup, Shutdown, and Post-Shutdown Procedures

Provide narrative description for Startup, Shutdown and Post-shutdown operating procedures including the control sequence for each procedure.

1.6.1.4 Normal Operations

Provide Control Diagrams with data to explain operation and control of systems and specific equipment. Provide narrative description of Normal Operating Procedures.

1.6.1.5 Emergency Operations

Provide Emergency Procedures for equipment malfunctions to permit a short period of continued operation or to shut down the equipment to prevent further damage to systems and equipment. Provide Emergency Shutdown Instructions for fire, explosion, spills, or other foreseeable contingencies. Provide guidance and procedures for emergency operation of utility systems including required valve positions, valve locations and zones or portions of systems controlled.

1.6.1.6 Operator Service Requirements

Provide instructions for services to be performed by the operator such as lubrication, adjustment, inspection, and recording gauge readings.

1.6.1.7 Environmental Conditions

Provide a list of Environmental Conditions (temperature, humidity, and other relevant data) that are best suited for the operation of each product, component or system. Describe conditions under which the item equipment should not be allowed to run.

1.6.1.8 Operating Log

Provide forms, sample logs, and instructions for maintaining necessary operating records.

1.6.1.9 Additional Requirements for HVAC Control Systems

Provide Data Package 5 and the following for control systems:

- a. Narrative description on how to perform and apply functions, features, modes, and other operations, including unoccupied operation, seasonal changeover, manual operation, and alarms. Include detailed technical manual for programming and customizing control loops and algorithms.
- b. Full as-built sequence of operations.
- c. Copies of checkout tests and calibrations performed by the Contractor (not Cx tests).
- d. Full points list. Provide a listing of rooms with the following information for each room:
 - (1) Floor
 - (2) Room number
 - (3) Room name
 - (4) Air handler unit ID

- (5) Reference drawing number
- (6) Air terminal unit tag ID
- (7) Heating or cooling valve tag ID
- (8) Minimum cfm
- (9) Maximum cfm
- e. Full print out of all schedules and set points after testing and acceptance of the system.
- f. Full as-built print out of software program.
- g. Marking of system sensors and thermostats on the as-built floor plan and mechanical drawings with their control system designations.

1.6.2 Preventive Maintenance

Provide the following information for preventive and scheduled maintenance to minimize repairs for the installed model and features of each system. Include potential environmental and indoor air quality impacts of recommended maintenance procedures and materials.

1.6.2.1 Lubrication Data

Include the following preventive maintenance lubrication data, in addition to instructions for lubrication required under paragraph OPERATOR SERVICE REQUIREMENTS:

- a. A table showing recommended lubricants for specific temperature ranges and applications.
- b. Charts with a schematic diagram of the equipment showing lubrication points, recommended types and grades of lubricants, and capacities.
- c. A Lubrication Schedule showing service interval frequency.

1.6.2.2 Preventive Maintenance Plan, Schedule, and Procedures

Provide manufacturer's schedule for routine preventive maintenance, inspections, condition monitoring (predictive tests) and adjustments required to ensure proper and economical operation and to minimize repairs. Provide instructions stating when the systems should be retested. Provide manufacturer's projection of preventive maintenance work-hours on a daily, weekly, monthly, and annual basis including craft requirements by type of craft. For periodic calibrations, provide manufacturer's specified frequency and procedures for each separate operation.

- a. Define the anticipated time required to perform each of each test (work-hours), test apparatus, number of personnel identified by responsibility, and a testing validation procedure permitting the record operation capability requirements within the schedule. Provide a remarks column for the testing validation procedure referencing operating limits of time, pressure, temperature, volume, voltage, current, acceleration, velocity, alignment, calibration, adjustments, cleaning, or special system notes. Delineate procedures for

preventive maintenance, inspection, adjustment, lubrication and cleaning necessary to minimize repairs.

- b. Repair requirements must inform operators how to check out, troubleshoot, repair, and replace components of the system. Include electrical and mechanical schematics and diagrams and diagnostic techniques necessary to enable operation and troubleshooting of the system after acceptance.

1.6.2.3 Cleaning Recommendations

Provide environmentally preferable cleaning recommendations in accordance with ASTM E1971.

1.6.3 Repair

Provide manufacturer's recommended procedures and instructions for correcting problems and making repairs for the installed model and features of each system. Include potential environmental and indoor air quality impacts of recommended maintenance procedures and materials.

1.6.3.1 Troubleshooting Guides and Diagnostic Techniques

Provide step-by-step procedures to promptly isolate the cause of typical malfunctions. Describe clearly why the checkout is performed and what conditions are to be sought. Identify tests or inspections and test equipment required to determine whether parts and equipment may be reused or require replacement.

1.6.3.2 Wiring Diagrams and Control Diagrams

Provide point-to-point drawings of wiring and control circuits including factory-field interfaces. Provide a complete and accurate depiction of the actual job specific wiring and control work. On diagrams, number electrical and electronic wiring and pneumatic control tubing and the terminals for each type, identically to actual installation configuration and numbering.

1.6.3.3 Repair Procedures

Provide instructions and a list of tools required to repair or restore the product or equipment to proper condition or operating standards.

1.6.3.4 Removal and Replacement Instructions

Provide step-by-step procedures and a list of required tools and supplies for removal, replacement, disassembly, and assembly of components, assemblies, subassemblies, accessories, and attachments. Provide tolerances, dimensions, settings and adjustments required. Use a combination of text and illustrations.

1.6.3.5 Spare Parts and Supply Lists

Provide lists of spare parts and supplies required for repair to ensure continued service or operation without unreasonable delays. Special consideration is required for facilities at remote locations. List spare parts and supplies that have a long lead-time to obtain.

1.6.3.6 Repair Work-Hours

Provide manufacturer's projection of repair work-hours including requirements by type of craft. Identify, and tabulate separately, repair that requires the equipment manufacturer to complete or to participate.

1.6.4 Real Property Equipment

Provide a list of installed equipment furnished under this contract. Include all information usually listed on manufacturer's name plate. In the "EQUIPMENT-IN-PLACE LIST" include, as applicable, the following for each piece of equipment installed: description of item, location (by room number), model number, serial number, capacity, name and address of manufacturer, name and address of equipment supplier, condition, spare parts list, manufacturer's catalog, and warranty. Submit the final list 30 days after transfer of the completed facility.

Key the designations to the related area depicted on the contract drawings. List the following data:

RECORD OF DESIGNATED EQUIPMENT AND MATERIALS DATA				
Description	Specification Section	Manufacturer and Catalog, Model, and Serial Number	Composition and Size	Where Used
—				

1.6.5 Appendices

Provide information required below and information not specified in the preceding paragraphs but pertinent to the maintenance or operation of the product or equipment. Include the following:

1.6.5.1 Product Submittal Data

Provide a copy of SD-03 Product Data submittals documented with the required approval.

1.6.5.2 Manufacturer's Instructions

Provide a copy of SD-08 Manufacturer's Instructions submittals documented with the required approval.

1.6.5.3 O&M Submittal Data

Provide a copy of SD-10 Operation and Maintenance Data submittals documented with the required approval.

1.6.5.4 Parts Identification

Provide identification and coverage for the parts of each component, assembly, subassembly, and accessory of the end items subject to replacement. Include special hardware requirements, such as requirement to use high-strength bolts and nuts. Identify parts by make, model, serial number, and source of supply to allow reordering without further identification. Provide clear and legible illustrations, drawings, and

exploded views to enable easy identification of the items. When illustrations omit the part numbers and description, both the illustrations and separate listing must show the index, reference, or key number that will cross-reference the illustrated part to the listed part. Group the parts shown in the listings by components, assemblies, and subassemblies in accordance with the manufacturer's standard practice. Parts data may cover more than one model or series of equipment, components, assemblies, subassemblies, attachments, or accessories, such as typically shown in a master parts catalog.

1.6.5.5 Warranty Information

List and explain the various warranties and clearly identify the servicing and technical precautions prescribed by the manufacturers or contract documents in order to keep warranties in force. Include warranty information for primary components of the system. Provide copies of warranties required by Section 01 78 00 CLOSEOUT SUBMITTALS.

1.6.5.6 Extended Warranty Information

List all warranties for products, equipment, components, and sub-components whose duration exceeds one year. For each warranty listed, indicate the applicable specification section, duration, start date, end date, and the point of contact for warranty fulfillment. Also, list or reference the specific operation and maintenance procedures that must be performed to keep the warranty valid. Provide copies of warranties required by Section 01 78 00 CLOSEOUT SUBMITTALS.

1.6.5.7 Personnel Training Requirements

Provide information available from the manufacturers that is needed for use in training designated personnel to properly operate and maintain the equipment and systems.

1.6.5.8 Testing Equipment and Special Tool Information

Include information on test equipment required to perform specified tests and on special tools needed for the operation, maintenance, and repair of components. Provide final set points.

1.6.5.9 Testing and Performance Data

Include completed prefunctional checklists, functional performance test forms, and monitoring reports. Include recommended schedule for retesting and blank test forms. Provide final set points.

1.6.5.10 Field Test Reports

Provide a copy of Field Test Reports (SD-06) submittals documented with the required approval.

1.6.5.11 Contractor Information

Provide a list that includes the name, address, and telephone number of the General Contractor and each Subcontractor who installed the product or equipment, or system. For each item, also provide the name address and telephone number of the manufacturer's representative and service organization that can provide replacements most convenient to the project site. Provide the name, address, and telephone number of the product,

equipment, and system manufacturers.

1.7 SCHEDULE OF OPERATION AND MAINTENANCE DATA PACKAGES

Provide the O&M data packages specified in individual technical sections. The information required in each type of data package follows:

1.7.1 Data Package 1

- a. Safety precautions and hazards
- b. Cleaning recommendations
- c. Maintenance and repair procedures
- d. Warranty information
- e. Extended warranty information
- f. Contractor information
- g. Spare parts and supply list

1.7.2 Data Package 2

- a. Safety precautions and hazards
- b. Normal operations
- c. Environmental conditions
- d. Lubrication data
- e. Preventive maintenance plan, schedule, and procedures
- f. Cleaning recommendations
- g. Maintenance and repair procedures
- h. Removal and replacement instructions
- i. Spare parts and supply list
- j. Parts identification
- k. Warranty information
- l. Extended warranty information
- m. Contractor information

1.7.3 Data Package 3

- a. Safety precautions and hazards
- b. Operator prestart
- c. Startup, shutdown, and post-shutdown procedures

- d. Normal operations
 - e. Emergency operations
 - f. Environmental conditions
 - g. Operating log
 - h. Lubrication data
 - i. Preventive maintenance plan, schedule, and procedures
 - j. Cleaning recommendations
 - k. Troubleshooting guides and diagnostic techniques
 - l. Wiring diagrams and control diagrams
 - m. Maintenance and repair procedures
 - n. Removal and replacement instructions
 - o. Spare parts and supply list
 - p. Product submittal data
 - q. O&M submittal data
 - r. Parts identification
 - s. Warranty information
 - t. Extended warranty information
 - u. Testing equipment and special tool information
 - v. Testing and performance data
 - w. Contractor information
 - x. Field test reports
- 1.7.4 Data Package 4
- a. Safety precautions and hazards
 - b. Operator prestart
 - c. Startup, shutdown, and post-shutdown procedures
 - d. Normal operations
 - e. Emergency operations
 - f. Operator service requirements
 - g. Environmental conditions
 - h. Operating log

- i. Lubrication data
 - j. Preventive maintenance plan, schedule, and procedures
 - k. Cleaning recommendations
 - l. Troubleshooting guides and diagnostic techniques
 - m. Wiring diagrams and control diagrams
 - n. Repair procedures
 - o. Removal and replacement instructions
 - p. Spare parts and supply list
 - q. Repair work-hours
 - r. Product submittal data
 - s. O&M submittal data
 - t. Parts identification
 - u. Warranty information
 - v. Extended warranty information
 - w. Personnel training requirements
 - x. Testing equipment and special tool information
 - y. Testing and performance data
 - z. Contractor information
 - aa. Field test reports
- 1.7.5 Data Package 5
- a. Safety precautions and hazards
 - b. Operator prestart
 - c. Start-up, shutdown, and post-shutdown procedures
 - d. Normal operations
 - e. Environmental conditions
 - f. Preventive maintenance plan, schedule, and procedures
 - g. Troubleshooting guides and diagnostic techniques
 - h. Wiring and control diagrams
 - i. Maintenance and repair procedures

- j. Removal and replacement instructions
- k. Spare parts and supply list
- l. Product submittal data
- m. Manufacturer's instructions
- n. O&M submittal data
- o. Parts identification
- p. Testing equipment and special tool information
- q. Warranty information
- r. Extended warranty information
- s. Testing and performance data
- t. Contractor information
- u. Field test reports
- v. Additional requirements for HVAC control systems

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

3.1 TRAINING

Prior to acceptance of the facility by the Contracting Officer for Beneficial Occupancy, provide comprehensive training for the systems and equipment specified in the technical specifications. The training must be targeted for the Facilities Management Specialist, building maintenance personnel, and applicable building occupants. Instructors must be well-versed in the particular systems that they are presenting. Address aspects of the Operation and Maintenance Manual submitted in accordance with Section 01 78 00 CLOSEOUT SUBMITTALS.. Training must include classroom or field lectures based on the system operating requirements. The location of classroom training requires approval by the Contracting Officer.

3.1.1 Training Plan

Submit a written training plan to the Contracting Officer for approval at least 60 calendar days prior to the scheduled training. Training plan must be approved by the Quality Control Manager (QC) prior to forwarding to the Contracting Officer. Also, coordinate the training schedule with the Contracting Officer and QC. Include within the plan the following elements:

- a. Equipment included in training
- b. Intended audience

- c. Location of training
- d. Dates of training
- e. Objectives
- f. Outline of the information to be presented and subjects covered including description
- g. Start and finish times and duration of training on each subject
- h. Methods (e.g. classroom lecture, video, site walk-through, actual operational demonstrations, written handouts)
- i. Instructor names and instructor qualifications for each subject
- j. List of texts and other materials to be furnished by the Contractor that are required to support training
- k. Description of proposed software to be used for video recording of training sessions.

3.1.2 Training Content

The core of this training must be based on manufacturer's recommendations and the operation and maintenance information. The QC is responsible for overseeing and approving the content and adequacy of the training. Spend 95 percent of the instruction time during the presentation on the OPERATION AND MAINTENANCE DATA. Include the following for each system training presentation:

- a. Start-up, normal operation, shutdown, unoccupied operation, seasonal changeover, manual operation, controls set-up and programming, troubleshooting, and alarms.
- b. Relevant health and safety issues.
- c. Discussion of how the feature or system is environmentally responsive. Advise adjustments and optimizing methods for energy conservation.
- d. Design intent.
- e. Use of O&M Manual Files.
- f. Review of control drawings and schematics.
- g. Interactions with other systems.
- h. Special maintenance and replacement sources.
- i. Tenant interaction issues.

3.1.3 Training Outline

Provide the Operation and Maintenance Manual Files (Bookmarked PDF) and a written course outline listing the major and minor topics to be discussed by the instructor on each day of the course to each trainee in the course. Provide the course outline 14 calendar days prior to the training.

3.1.4 Training Video Recording

Record classroom training session(s) on video. Provide to the Contracting Officer two copies of the training session(s) in DVD video recording format. Capture within the recording, in video and audio, the instructors' training presentations including question and answer periods with the attendees. The recording camera(s) must be attended by a person during the recording sessions to assure proper size of exhibits and projections during the recording are visible and readable when viewed as training.

3.1.5 Unresolved Questions from Attendees

If, at the end of the training course, there are questions from attendees that remain unresolved, the instructor must send the answers, in writing, to the Contracting Officer for transmittal to the attendees, and the training video must be modified to include the appropriate clarifications.

3.1.6 Validation of Training Completion

Ensure that each attendee at each training session signs a class roster daily to confirm Government participation in the training. At the completion of training, submit a signed validation letter that includes a sample record of training for reporting what systems were included in the training, who provided the training, when and where the training was performed, and copies of the signed class rosters. Provide two copies of the validation to the Contracting Officer, and one copy to the Operation and Maintenance Manual Preparer for inclusion into the Manual's documentation.

3.1.7 Quality Control Coordination

Coordinate this training with the QCCxA in accordance with Section 01 45 00.00 10 QUALITY CONTROL.

-- End of Section --

SECTION 01 91 00.15
BUILDING COMMISSIONING
05/23

PART 1 GENERAL

Building Commissioning is a systematic, quality-focused process for enhancing the delivery of a project that focuses on verifying and documenting that all of the commissioned systems and assemblies are planned, designed, installed, tested, operated, and maintained to meet the project requirements. The purpose is to reduce the cost and performance risks associated with delivering facilities projects, and to increase value to owners, occupants, and users.

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 90.1 - IP (2019; Errata 1 2019; Errata 2-5 2020; Addenda BY-CP 2020; Addenda AF-DB 2020; Addenda A-G 2020; Addenda F-Y 2021; Errata 6-8 2021; Interpretation 1-4 2020; Interpretation 5-8 2021 Addenda AS-AQ 2022) Energy Standard for Buildings Except Low-Rise Residential Buildings

ASHRAE 180 (2012) Standard Practice for Inspection and Maintenance of Commercial Building HVAC Systems

ASHRAE 202 (2018) Commissioning Process for Buildings and Systems

ASSOCIATED AIR BALANCE COUNCIL (AABC)

ACG Commissioning Guideline (2005) Commissioning Guideline

NATIONAL ENVIRONMENTAL BALANCING BUREAU (NEBB)

NEBB S1110 (2019) Whole Building Technical Commissioning of New Construction; 2nd Edition

SHEET METAL AND AIR CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION (SMACNA)

ANSI/SMACNA 014 (2013) HVAC Systems Commissioning Manual, 2nd Edition

U.S. ARMY CORPS OF ENGINEERS (USACE)

ER 25-345-1 (2019) Commissioning -- Systems Manual

1.2 DEFINITIONS

Commissioning Process (Cx) - a quality-focused process for enhancing the delivery of a project. Refer to ASHRAE 202 for a comprehensive description of the commissioning process.

Lead Commissioning Specialist (CxC) - The entity who leads, plans, and coordinates the Commissioning Team. The terms Commissioning Provider, Commissioning Firm, Lead Commissioning Specialist, Commissioning Specialist, and Commissioning Authority (CA or CxA) when used by sustainable Third Party Certification (TPC) programs, are interchangeable.

Commissioning Authority - The Government retains the authority for oversight and assurance of the entire commissioning process, and final approval of all commissioning deliverables.

1.3 COMMUNICATION WITH THE GOVERNMENT

The Lead Commissioning Specialist (CxC) must submit all plans, schedules, reports, and documentation directly to the Contracting Officer's Representative concurrent with submission to the CQC System Manager.

The Lead Commissioning Specialist must have direct communication with the Contracting Officer's Representative regarding all elements of the commissioning process; however, the Government has no direct contract authority with the Lead Commissioning Specialist.

1.4 SYSTEMS TO BE COMMISSIONED

Coordinate commissioning and quality control activities for the following systems, equipment, and associated controls. System-specific requirements are located in the associated specification sections. Commission the following systems, equipment, and associated controls in accordance with this section and the inspection, testing, and quality control requirements of their respective sections:

Heating, ventilating, air-conditioning, and refrigeration systems (mechanical and passive) and associated controls (HVAC)

Service hot-water systems and controls

Building Control Systems

1.5 COMMISSIONING TEAM

The Commissioning team will include, but is not limited to the following team members.

Ensure all Construction Activities for systems to be commissioned are coordinated with the appropriate commissioning team members.

- a. Lead Commissioning Specialist (CxC)
- b. CQC System Manager
- c. Sub-Contractor Representatives for each trade responsible for construction/installation of systems to be commissioned

- d. Contractor's Project Manager
- e. Technical Commissioning Specialists for each system to be commissioned
- f. TAB Representative
- g. Equipment manufacturer representatives
- h. Government Contracting Officer
- i. Government Representatives
- j. Installation Maintenance Representative
- k. Facility End User

1.6 PROJECT SCHEDULE

Include the following tasks in the project schedule. Ensure sufficient time is scheduled to complete each item. The order of items listed below is not intended to imply a specified sequence:

- a. Submission and approval of the Commissioning Firm Qualifications
- d. Submission and approval of the Final Construction Phase Commissioning Plans
- e. Commissioning Kickoff Meeting
- f. Regular Commissioning Coordination Meetings (via Teleconference)
- j. Manufacturer's Equipment Start-Up for each of the systems to be commissioned
- k. Submission and approval of the Completed Commissioning Observation Checklists
- l. Submission and approval of Certificate of Readiness for each system to be commissioned
- m. Commissioning Testing, including Functional Performance Testing, for each system to be commissioned
- o. Post-test deficiency correction for each system to be commissioned
- p. Re-Testing
- q. Submission and approval of the Maintenance and Service Life Plans
- r. Submission and approval of the Systems Manual
- s. Training for each of the systems to be commissioned
- t. Submission and approval of the Final Commissioning Reports

1.7 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-06 Test Reports

Completed Construction Observation Checklists; G

Design Review Report; G

Final Construction Phase Commissioning Plan; G;

Issues Log; G

SD-07 Certificates

Commissioning Firm; G

SD-10 Operation and Maintenance Data

Maintenance and Service Life Plan; G

Systems Manual; G

SD-11 Closeout Submittals

Final Commissioning Report; G

1.8 COMMISSIONING FIRM

Employ the services of a Commissioning Firm and all Commissioning Specialists required to perform work for this project. The Commissioning Firm must be a first-tier subcontractor that is financially and corporately independent from contractor and all other subcontractors and the Designer of Record.

- a. Submit the Commissioning Firm's and Commissioning Specialists' qualifications, including the name of the firm and each CxC and each certification, no later than 60 calendar days after notice to proceed.
- b. If, for any reason, a specialist loses a certification during this period, immediately notify the Contracting Officer and submit another Commissioning Specialist for approval. An approved successor must validate all work performed for this project by the CxC who lost a certification.

1.8.1 Commissioning Specialists (CxC)

Assign Lead Commissioning Specialist and other appropriate Commissioning Specialists for the systems to be commissioned.

1.8.1.1 Lead Commissioning Specialist (CxC)

Lead Commissioning Specialist (CxC) coordinates all aspects of the

commissioning process. Duties include leading and overseeing the commissioning work and acting as the primary point of contact for the commissioning work. CxC may serve as a systems Specialist if all requirements for both designations are met. CxC must have a minimum of five years of commissioning experience, including two projects of similar size and complexity to this project.

CxC must be certified in one of the following:

NEBB Building System Commissioning Professional (CxCP)

ACG Certified Commissioning Authority (CxA)

ICB/TABB Certified Commissioning Supervisor

BCA Certified Commissioning Professional (CCP)

AEE Certified Building Commissioning Professional (CBCP)

University of Wisconsin-Madison Qualified Commissioning Process Provider (QCxP)

ASHRAE Building Commissioning Professional (BCxP).

1.8.1.2 Commissioning Specialists

Refer to the related technical commissioning specification section for additional qualifications for each Commissioning Specialist associated with each system. Include all Commissioning Specialist qualifications with the Commissioning Firm submittal:

- a. Mechanical Commissioning Specialist: The technical work associated with mechanical systems to be commissioned must be performed by a Commissioning Specialist certified by NEBB, ACG, ICB/TABB, AEE, University of Wisconsin-Madison, ASHRAE, or BCA in the commissioning of HVAC systems with five years of experience in the commissioning of HVAC systems.

1.9 COMMISSIONING STANDARD

Comply with ASHRAE 202 and the commissioning standards under which the Commissioning Firm and Specialists qualifications are approved, which may include ACG Commissioning Guideline, NEBB S1110, or ANSI/SMACNA 014. In a conflict, the most stringent requirements apply. In addition, comply with ASHRAE 90.1 - IP commissioning requirements for all systems. Refer to related technical commissioning specification sections for additional standards requirements. The following requirements apply to all project commissioning and test standards:

- a. Implement all recommendations and suggested practices contained in the Commissioning Standard and test standards.
- b. Use the Commissioning Standard for all aspects of Commissioning, including calibration of instruments.
- c. Where the instrument manufacturer calibration recommendations are more stringent than those listed in the Commissioning Standard, adhere to the manufacturer calibration recommendations.

- d. All quality assurance provisions of the Commissioning Standard such as performance guarantees are part of this contract.
- e. The Commissioning Specialists must develop commissioning procedures for any systems or system components not covered in the Commissioning Standard.
- f. Use any new requirements, recommendations, and procedures published or adopted by the body responsible for the applicable Commissioning Standards at the time of project award.
- g. If there is a conflict between the requirements of the contract documents and the commissioning standard used, the contract documents take precedent.

1.10 ISSUES LOG

The Commissioning Specialist develops and maintains an Issues Log for the systems to be commissioned. The issues log documents and tracks resolution of deficiencies identified during submittal reviews, inspection, and testing. At any point during construction, any commissioning team member finding deficiencies may communicate those deficiencies in writing to the Commissioning Specialist for inclusion into the Issues Log. For each issue, the Issues Log includes, but is not limited to, a unique reference number, description of the issue with contract requirement referenced, location of or equipment name/tags exhibiting the issue, the initials of the individual's name whom reported the issue, the date of first observation, the proposed resolution of the issue and date proposed, the date of any subsequent observations with applicable additional information, and the date of implementation of the final resolution of the issue as confirmed by the Commissioning Specialist and Contracting Officer. Issues must not be deleted from the issues log.

CxC must submit the Issues Log monthly and within three working days from changes to the Issue Log. The CxC is responsible for distributing the Issues Log to the Commissioning Team. CQC System Manager must track construction deficiencies identified in the Issues Log using a quality management system.

1.11 CERTIFICATE OF READINESS

Prior to scheduling Commissioning Tests for each system, the Quality Control Manager must issue a Certificate of Readiness for each system, certifying that inspections have been completed, open issues have been resolved, and the system is ready for Commissioning Tests. Refer to each related technical commissioning specification section for additional requirements.

Submit the Certificate of Readiness for each system 30 calendar days prior to Commissioning Tests of that system. Do not schedule Commissioning Tests for a system until the Certificate of Readiness is approved by the Government.

PART 2 PRODUCTS

Not used.

PART 3 EXECUTION

3.1 DESIGN REVIEW

The CxC and other Commissioning Specialists must review design documents.

Provide a Design Review Report identifying discrepancies or deficiencies that would prevent the systems to be commissioned from operating or performing effectively or being adequately maintained. Report must include individual list of each deficiency and corresponding corrective action necessary for proper system performance. Identify any discrepancies between the design and the Owner's Project Requirements Document. The Owner's Project Requirements Document is provided for commissioning review purposes only and does not form a part of the contract documents for this project. **Submit the Design Review Report no later than 14 calendar days after approval of the Commissioning Firm and Commissioning Specialists.** The Contracting Officer, the Contractor's Project Manager, the CxC, and the Designers of Record for the associated systems must meet, discuss, and resolve any outstanding items contained in the report no later than 14 calendar days after submission of the report.

3.2 CONSTRUCTION SUBMITTAL REVIEWS

Coordinate construction submittal document reviews for commissioned systems and assemblies with the CxC. The commissioning submittal review does not replace the Government submittal review, in accordance with Section 01 33 00 SUBMITTAL PROCEDURES.

The CxC must identify construction submittals to be provided by the contractor for the commissioned systems. The CxC must evaluate construction submittals for compliance with the contract documents prior to submission to the Government. Include a copy of CxC comments with the construction submittals. Include a copy of the submittal document review transmittal and response in the Commissioning Report.

3.3 COMMISSIONING KICKOFF MEETING

Conduct a Commissioning Kickoff Meeting, led by the CxC, after approval of the Commissioning Firm and Commissioning Specialists, and no later than 60 days following construction notice to proceed. Discuss the commissioning process including contract requirements, lines of communication, roles and responsibilities, schedules, documentation requirements, inspection and test procedures, and logistics as specified in this section.

The Contractor's Project Manager, Quality Control team, Designer of Record, and the Government must attend this meeting. Invite the User and Base Civil Engineering Representative to attend this meeting.

3.4 REGULAR COMMISSIONING COORDINATION MEETINGS

The Quality Control team, Designer of Record, and the Government must attend this meeting. Sub-Contractor Representatives for each trade responsible for construction/installation of systems to be commissioned must attend this meeting as requested by the CxC. Invite the User and a Base Civil Engineering Representative to attend this meeting.

CxC shall conduct commissioning coordination meetings as needed when installation of commissioned systems begins. Provide status of commissioned systems, open issues log items, outstanding submittals, and

upcoming commissioning activities. Conduct bi-weekly commissioning coordination meetings as needed within 30 days of the scheduled date for commissioning testing.

3.5 CONSTRUCTION PHASE COMMISSIONING PLANS

The Final Construction Phase Commissioning Plan includes the information provided in the Interim Construction Phase Commissioning Plan as well as commissioning construction observation checklists and test procedures such as Pre-Functional Checklists and Functional Performance Test Checklists and other Commissioning Test Checklists for each building, for each system required to be commissioned, and for each component for inclusion in the Final Construction Phase Commissioning Plan. Refer to the related technical commissioning specification section for additional requirements for checklists. Submit the Final Construction Phase Commissioning Plan, prepared by the CxC, no later than 90 calendar days prior to the start of Commissioning Inspections.

3.5.1 Construction Observation Checklists

Construction Observation Checklists must include items for physical inspection or testing that demonstrate that installation and start-up of equipment and systems is complete. Refer to paragraph COMMISSIONING INSPECTIONS. Construction observation checklists must be tailored to verify the specific installation requirements and details of the construction documents and manufacturer's instructions.

3.5.2 Test Procedures and Checklists

Test procedures and checklists must include procedures that explain, step-by-step, the actions and expected results that will demonstrate that the systems perform in accordance with the contract. Refer to paragraph COMMISSIONING TESTS. Include the following sections and details appropriate to the systems being tested in the test procedures and checklists:

- a. Notable system features including information about controls to facilitate understanding of system operation
- b. Conclusions and recommendations. Conclusions must clearly indicate if system does or does not perform in accordance with contract requirements. Recommendation must clearly indicate that the system should or should not be approved by the Government.
- c. Test conditions including date, beginning and ending time, and beginning and ending outdoor air conditions
- d. Attendees
- e. Identification of the equipment involved in the test
- f. Control system feature identification
- g. As-found condition of the system operation
- h. List of test items with step numbers along with the corresponding feature or operation, intended test procedure, expected system response, and pass/fail indication.

- i. Space for comments for each test item.

3.6 COMMISSIONING INSPECTIONS

Complete inspections using Construction Observation Checklists for each individual item of equipment or system for each system required to be commissioned in accordance with the commissioning plan. Indicate commissioning team member inspection and validation of each checklist item by initials. Validation of each checklist item by each team member indicates that item conforms to the contract documents and design in their area of responsibility. Commissioning Specialist validation of each checklist item indicates that each item has been installed correctly and in accordance with contract documents. Submit the initialed and Completed Construction Observation Checklists no later than 7 calendar days after completion of inspection of all checklist items for each system.

3.7 COMMISSIONING TESTS

Demonstrate that all systems, equipment, and components have been installed correctly and that the systems operate and perform, including interactive operation between systems, in accordance with contract documents. Perform tests as specified in related technical commissioning specifications. Provide all materials, services, and labor required to perform all commissioning tests.

Commissioning Specialist's duties include leading and documenting all tests for the systems to be commissioned with appropriate sub-contractors performing the Tests. The representatives listed in the paragraph COMMISSIONING TEAM must attend the tests with the exception of the Contractor's Project Manager.

3.7.1 Test Scheduling and Coordination

Schedule Commissioning Tests for each system only after the Certificate of Readiness has been approved by the Government for the system. Correct all deficiencies identified through any prior review, inspection, or test activity before the start of Commissioning tests.

Commissioning Tests must be performed with the CxC present. Government reserves the right to witness all tests. Coordinate test schedule with Government representatives.

3.7.2 Testing Procedures

Commissioning tests include tests such as functional performance and integrated systems tests. Perform test procedures in accordance with the commissioning standards specified. In addition, comply with the testing procedures specified in the sections listed in paragraph RELATED SECTIONS.

3.7.3 Sample Strategy

Refer to the sections identified in paragraph RELATED SECTIONS for sample strategy.

3.7.4 Aborted Tests and Re-Testing

Abort any test if any deficiency prevents successful completion of the test or if any required commissioning team member is not present for the test. Re-test after all deficiencies identified during the original test

have been corrected. Contracting Officer may withhold payment equivalent to lost time, re-testing, and aborted tests. These costs may include salary, travel costs, and per diem for Government team members.

3.8 TRAINING PLAN

CxC must review the training plan for training associated with the equipment and systems to be commissioned, checking that each plan has the trainer name, trainer contract information, training schedule and location. Submit review at least 30 days prior to the first training event. Incorporate CxC review comments prior to submitting training plan in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA. Update and resubmit the training plan based on any corrective action taken.

3.9 SYSTEMS MANUAL

Prepare and submit a Systems Manual, including a signed certification or letter from the Commissioning Specialists and the CxC stating that the Systems Manual is complete, clear, and accurate. The Systems Manual, for all commissioned systems, must conform to Appendix A SYSTEMS MANUAL ORGANIZATION AND CONTENT per ER 25-345-1, available at the USACE Publications website at the following location: <https://www.publications.usace.army.mil/USACE-Publications/Engineer-Regulations/>. Submit Systems Manual no later than 30 calendar days following completion of Functional Performance Tests. Update and resubmit the Systems Manual based on any corrective action taken during the warranty period.

Ensure Systems Manual is coordinated with the requirements of Section 01 78 23 OPERATION AND MAINTENANCE DATA and Quality Control requirements.

3.10 MAINTENANCE AND SERVICE LIFE PLAN

3.10.1 Maintenance Plan

Prepare and submit a Maintenance Plan for the project mechanical, electrical, plumbing, and fire protection systems. Prepare the HVAC and refrigeration sections of the Maintenance Plan in accordance with ASHRAE 180. Develop required inspection and maintenance tasks similar to Section 5 of ASHRAE 180 for the other commissioned systems and fire protection systems. Ensure Maintenance Plan is coordinated with the requirements of Section 01 78 23 OPERATION AND MAINTENANCE DATA.

Submit the Maintenance Plan no later than 30 calendar days following the completion of Functional Performance Tests.

3.10.2 Service Life Plan

Prepare and submit a Service Life Plan for the building enclosure, structural systems, and site hardscape that includes the following for each assembly or component:

- a. A description of each including the materials or products.
- b. The estimated service life, in years.
- c. The estimated maintenance frequency and description of maintenance tasks.

- d. The point of maintenance access for the components with estimated service life less than service life of the building.

Ensure Service Life Plan is coordinated with the requirements of Section 01 78 23 OPERATION AND MAINTENANCE DATA. Submit the Service Life Plan no later than 30 calendar days following the completion of Functional Performance Tests.

3.11 COMMISSIONING REPORT

Submit an Final Commissioning Report no later than 14 calendar days following commissioning team validation of all Commissioning Tests, including Functional Performance Tests,, with the exception of Seasonal Tests. Include the following information in the Final Commissioning Report:

- a. An summary describing the overall commissioning process, the results of the commissioning process, outstanding deficiencies and recommended resolutions. Indicate whether the systems meet the requirements of the contract documents.
- b. A list of deficiencies discovered during the commissioning process and the corrective actions taken in the report.
- c. Completed Pre-Functional Checklists and other Commissioning Observation Checklists, Commissioning Test Checklists such as Functional Performance Test Checklists the Final Construction Phase Commissioning Plan, the Issues Log, Training Attendance Rosters, the Design Review Reports, Submittal Review Report, and any other documents as specified by related technical commissioning specification sections.

-- End of Section --

This page left blank.

SECTION 01 91 19

BUILDING ENCLOSURE COMMISSIONING
05/2023

PART 1 GENERAL

1.1 SUMMARY

Use this Section in conjunction with UFGS 01 91 00.15 BUILDING COMMISSIONING. Building Enclosure Commissioning (BECx) is an essential part of overall Building Commissioning. The final BECx report is part of the Final Commissioning Report as defined in 01 91 00.15 BUILDING COMMISSIONING. This Section covers Building Enclosure Commissioning for all six surfaces (4 walls, roof, and floor, for a rectangular shaped zone) of a building. Additional Quality Control and testing requirements for specific components of the building enclosure are described in the Division 03 thru 08 UFGS Sections of the project specifications.

1.2 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referenced within the text by the basic designation only.

AMERICAN ARCHITECTURAL MANUFACTURERS ASSOCIATION (AAMA)

AAMA 501.2 (2015) Quality Assurance and Diagnostic Water Leakage Field Check of Installed Storefronts, Curtain Walls and Sloped Glazing Systems

AMERICAN SOCIETY FOR NONDESTRUCTIVE TESTING (ASNT)

ANSI/ASNT CP-105 (2020) ASNT Standard Topical Outlines for Qualification of Nondestructive Testing Personnel

ANSI/ASNT CP-189 (2020) ASNT Standard for Qualification and Certification of Nondestructive Testing Personnel

ASNT SNT-TC-1A (2020) Recommended Practice for Personnel Qualification and Certification in Nondestructive Testing

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 90.1 - IP (2019) Energy Standard for Buildings Except Low-Rise Residential Buildings

ASHRAE 202 (2018) Commissioning Process for Buildings and Systems

ASTM INTERNATIONAL (ASTM)

ASTM C1193 (2016) Standard Guide for Use of Joint

Sealants

ASTM D4541	(2022) Standard Test Method for Pull-Off Strength of Coatings Using Portable Adhesion Testers
ASTM E779	(2019) Standard Test Method for Determining Air Leakage Rate by Fan Pressurization
ASTM E1186	(2022) Standard Practices for Air Leakage Site Detection in Building Envelopes and Air Barrier Systems
ASTM E1258	(1988; R 2018) Standard Test Method for Airflow Calibration of Fan Pressurization Devices
ASTM E1827	(2022) Standard Test Methods for Determining Airtightness of Buildings Using an Orifice Blower Door
ASTM E2813	(2018) Standard Practice for Building Enclosure Commissioning
ASTM E2947	(2021) Standard Guide for Building Enclosure Commissioning

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION (ISO)

ISO 6781	(1983) Thermal Insulation - Qualitative Detection of Thermal Irregularities in Building Envelopes - Infrared Method
ISO 6781-2	(2010) Performance of Buildings - Detection of Heat, Air, and Moisture Irregularities in Buildings by Infrared Methods - Part 2: Equipment Requirements
ISO 6781-3	(2015) Performance of Buildings - Detection of Heat, Air, and Moisture Irregularities in Buildings by Infrared Methods - Part 3: Qualifications of Equipment Operators, Data Analysts, and Report Writers

1.3 DEFINITIONS

The definitions included here are specific to this Section. Refer to UFGS 01 91 00.15 for definitions that apply to both Sections. The following terms as they apply to this section:

1.3.1 Air Barrier Envelope

The surface that separates the inside air from the outside air. The combination of air barrier assemblies and air barrier components, connected by air barrier accessories are designed to provide a continuous barrier to the movement of air through an environmental separator. A single building may have more than one air barrier envelope. The air

barrier surface includes the top, bottom, and sides of the envelope. The term "air barrier envelope" is also known as "air barrier system" or simply "air barrier".

1.3.2 Air Leakage Rate

A measurement of air infiltration or exfiltration through the building envelope over time. The air leakage rate is the rate of air flow across the air barrier per unit surface area of the envelope at a defined differential pressure.

1.3.3 Basis of Design (BoD)

A document developed by the design team which includes technical concepts, assumptions, calculations, decisions, and product selections to support the Owner's Project Requirements (OPR).

1.3.4 Bias Pressure

Also known as zero flow pressure, baseline pressure, offset pressure or background pressure. With the envelope not artificially pressurized, bias is the differential pressure that always exists between the envelope that has been prepared (sealed) for the pressure test and the outdoors. Bias pressure is made up of two components, fixed static offset (usually due to stack effect or the HVAC system) and fluctuating pressure (usually due to wind or a moving elevator). Because of pressure fluctuations many bias pressure readings are recorded and averaged for use in the calculations.

1.3.5 Blower Door

Commonly used term for an apparatus used to pressurize and depressurize the space within the building envelope and quantify air leakage through the envelope. The blower door typically includes a door fan and an air resistant fabric or a series of hard panels that extends to cover and seal the door opening between the fan shroud and door frame. The door fan is a calibrated fan capable of measuring air flow and is usually placed in the opening of an exterior door. With the air barrier otherwise sealed, air produced by the door fan pressurizes or de-pressurizes the envelope, depending on the fan's orientation.

1.3.6 Building Enclosure (or envelope)

The materials, components, systems, and assemblies intended to provide an environmental separator between the interior and exterior or between interior spaces with different environment requirements. "Enclosure" is used interchangeably with "envelope".

1.3.7 Building Enclosure Commissioning (BECx)

Technical service provided on behalf of the Government to provide a quality-focused process for enhancing the performance of the building enclosure by validating the design phase and verifying during the construction phase that the performance of the building enclosure materials components, assemblies, and systems are designed and installed to meet the Owner's Project Requirements (OPR).

1.3.8 Building Enclosure Commissioning Provider (BECxP)

An entity that functions as part of the overall Commissioning Team and is

responsible for validating the design phase and verifying during the construction phase that the performance of the building enclosure materials, components, assemblies, and systems are designed and installed to meet the Owner's Project Requirements (OPR).

1.3.9 Construction Phase

The period of a project following the award of construction Contract to project completion.

1.3.10 Design Phase

The period of the project delivery process when a design supporting the Owner's Project Requirements is developed and translated into Contract Documents.

1.3.11 Environmental Separator

The parts of a building that separate the controlled interior environment from the uncontrolled exterior environment, or that separate spaces within a building that have dissimilar environments. The term "environmental separator" is also known as the "control layer".

1.3.12 Functional Performance Test (FPT)

A systematic process to verify that controls and other elements of the building project are capable of and configured to operate or perform as required.

1.3.13 Owner's Project Requirements (OPR)

A document that details the stakeholders' requirements for the project and the expectations for how it will be used and operated. The OPR is provided for commissioning review purposes only and is not a Contract requirement.

1.3.14 Pressure Test

A generic term for a test in which the envelope is either pressurized or de-pressurized with respect to the outdoors.

1.3.15 Negative Pressure Test (Depressurization Test)

A test wherein air inside the envelope is drawn to the outdoors. This places the envelope at a lower (negative) pressure with respect to the outdoors.

1.3.16 Positive Pressure Test (Pressurization Test)

A test wherein outdoor air is pushed into the envelope. This air movement places the envelope at a higher (positive) pressure with respect to the outdoors.

1.3.17 Verification & Testing (V&T) Provider

An entity who completes the activities needed to implement the building functional performance testing (FPT) activities or verify that elements of the building project meet stated requirements.

1.4 COMMUNICATION WITH THE GOVERNMENT COMMISSIONING PROVIDER

For communication responsibilities, see Section 01 91 00.15 BUILDING COMMISSIONING.

1.5 COMMUNICATION WITH GOVERNMENT ACCEPTANCE TESTING REPRESENTATIVES

The QC Manager must communicate directly with the Government Acceptance Testing Representatives and Contracting Officer's Representative regarding Government acceptance testing activities. Inform the Contracting Officer's Representative when systems are ready for testing to be witnessed by Government Acceptance Testing Representatives, and allow access to the construction site and system(s) to be tested

1.6 ENCLOSURE COMPONENTS TO BE COMMISSIONED

1.6.1 Verification of the Design and Installation of the Continuous Air Barrier

- a. Conduct periodic field inspection of the continuous air barrier materials and assemblies, including all penetrations through the six sides of the air barrier, during construction while the continuous air barrier is still accessible for inspection and repair (after installation of all penetrations and wall cladding anchoring devices and before the installation of interior finishes) to verify and document compliance with the requirements. Conduct inspections at initial installation of each building envelope component and at in-progress construction intervals as stated in Part 3 section titled BUILDING ENVELOPE INSPECTION AND TESTING.
- b. Conduct Performance Verification Testing of the entire building envelope (systems, components, and assemblies) for air tightness in accordance with Part 3 section titled BUILDING ENVELOPE AIR TIGHTNESS REQUIREMENT.

1.6.2 Inspection of Fenestration and Doors

- a. Fenestration and Doors must be labeled and inspected to verify compliance with Building Envelope energy requirements, including applicable U-factors, Solar Heat Gain Coefficient (SHGC), Visible Transmittance (VT), and air leakage rates.
- b. Inspect doors and windows for coordination with the insulating plane of the wall, continuity with the air/weather barrier, and flashing.
- c. Inspect operation of doors, closers, and operating mechanisms for conformance with manufacturer's instructions.
- d. Inspect seals and gaskets for fenestration and doors (including loading dock, sectional, and coiling doors) for proper installation and to verify that seals are in good condition.

1.6.3 Inspection of Opaque Roof, Walls, and Floors

Opaque roof, above-grade and below-grade walls, and floors, must be subject to the following inspections during construction:

- a. Use of ASHRAE 90.1 - IP-compliant materials and assemblies.

- b. Insulation material meets design specifications and is continuous.

1.6.4 Fenestration Inspections

Conduct inspections of the following fenestration-related items during construction:

- a. Skylights size and location in relation to the designed primary sidelighted area and secondary sidelighted area below.
- b. Roof monitor size and location in relation to the designed primary sidelighted area and secondary sidelighted area below.
- c. Dynamic glazing compliance with SHGC and U-factors, and testing of the operation for conformance with the manufacturer's instructions.
- d. Permanent fenestration projections installation and performance in accordance with ASHRAE 90.1 - IP requirements and the Contract documents.

1.7 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Building Enclosure Commissioning Specialist Qualifications; G

Building Enclosure Testing Work Plan; G

SD-03 Product Data

Thermal Imaging Camera; G

Test Equipment; G

SD-05 Design Data

Envelope Surface Area Calculations; G

SD-06 Test Reports

Completed Building Envelope Inspection Checklists; G

Pressure Test Procedures; G

Air Leakage Test Report; G

Diagnostic Test Report; G

SD-07 Certificates

Pressure Test Agency

Thermographer Qualifications

Certificate of Readiness

SD-10 Operation and Maintenance Data

Training; G

1.8 BUILDING ENCLOSURE TESTING WORK PLAN

For each building enclosure test to be performed, submit the following not later than 120 calendar days after Contract award, but before start of testing work, steps to be taken by the lead test technician to accomplish the required testing.

- a. Memorandum of test procedure.
 - (1) Proposed dates for conducting the tests.
 - (2) Submit detailed test procedures prior to the test. Provide a plan view showing proposed locations (personnel doors or other similar openings) to install equipment (such as blower doors or flexible ducts for trailer-mounted fans, if used).
- b. Test equipment to be used.
- c. Scaffolding, scissor lifts, power, electrical extension cords, duct tape, plastic sheeting and other Contractor's support equipment required to perform all tests.
- d. Other Contractor's support personnel who will be on site for testing.

1.9 ACCESSIBILITY REQUIREMENTS

Air barrier components, insulation, fenestration, and doors for commissioned systems must be made accessible for inspections. Contractor must make necessary modifications at Contractor's own expense if systems and enclosures are not accessible for inspections and testing. Assist commissioning team in testing and inspections by removing equipment covers, opening access panels, and other required activities that assist with visual oversight. Furnish ladders, flashlights, meters, gauges, or other inspection equipment as necessary.

1.10 SCHEDULING

Notify the Contracting Officer a minimum 14 calendar days in advance of site visits and inspections by the roof system manufacturer technical representative for coordination with the Government Acceptance Testing Representative.

1.11 COORDINATION

Refer to Section 01 91 00.15 BUILDING COMMISSIONING for requirements pertaining to coordination during the commissioning process. Coordinate with the Commissioning Provider in accordance with Section 01 91 00.15 and in accordance with the Commissioning Plan to schedule inspections as required to support the commissioning process. Furnish additional information requested by the Commissioning Provider.

Coordinate scheduling of air barrier inspections and air barrier pressure testing with the commissioning team. Upload plans, reports, notes, and other documentation to the Commissioning Provider's web-based commissioning software, or as specified in the commissioning plan, as it is completed.

1.12 QUALITY CONTROL

1.12.1 Modification of References

Perform all pressure and diagnostic tests according to the referenced publications listed in paragraph REFERENCES and as modified by this section. Consider the advisory or recommended provisions, of the referred references, as mandatory.

1.12.2 Qualifications

1.12.2.1 Building Enclosure Commissioning Specialist Qualifications

See UFGS 01 91 00.15 BUILDING COMMISSIONING for the qualification requirements of the Building Enclosure Commissioning Specialist.

1.12.2.2 Pressure Test Agency

Submit, no later than 15 calendar days after Contract award, information certifying that the pressure test agency is not affiliated with any other company participating in work on this Contract. The work of the test agency is limited to pressure testing the building envelope, performing a thermography test and fog test, and investigating, through various methods, the location of air leaks through the air barrier. See Part 3 paragraph PRESSURE TEST AGENCY for additional requirements. For thermographer qualifications, see paragraph THERMOGRAPHER QUALIFICATIONS.

Use the sample TEST AGENCY QUALIFICATIONS SHEET form (Appendix C), to submit the following information.

- a. Verification of 2 years of experience as an agency in pressure testing commercial or industrial buildings.
- b. List of at least ten commercial/industrial facilities with building envelopes that the agency has tested within the past 2 years. Include building name, address, and name of prime construction Contractor and Contractor's point-of-contact information.
- c. Confirmation of 2 years of commercial and or industrial building pressure test experience for the lead pressure test technician and the thermographer in using the specified ASTM E779 or ASTM E1827 testing standard. References from five Contracting Officers for facilities where the lead test technician has supervised commercial and or industrial building pressure tests in the last 2 years.
- d. Verification that the lead pressure test technician has been employed by a building pressure testing agency in the capacity of a lead pressure test technician for not less than 1 year.

1.12.2.3 Thermographer Qualifications

To perform an infrared diagnostic evaluation, use a lead thermographer who

has at least an active Level II Certification that is based on the requirements in ANSI/ASNT CP-105 or ANSI/ASNT CP-189 and is in accordance with ASNT SNT-TC-1A. The course of study is to be specifically focused on infrared thermography for building science. The thermographer must have at least two years of building science thermography experience in IR testing commercial or industrial buildings. The thermographer must also have experience in building envelopes and building science in order to make effective recommendations to the Contractor should the envelope require additional sealing. Thermographic equipment operators, data analysts and report writers must comply with the requirements of ISO 6781-3. Submit the thermographer's certificate for approval. Submit a list of at least ten commercial/industrial buildings on which the thermographer has performed IR thermography in the past two years. The thermographer is to have a current active certification. Submit certification at least 60 days prior to thermography testing.

1.12.3 Test Reports

No later than 14 days after completion of the pressure test, submit electronic copies of an organized report and 4 bound paper copies in a durable 3-ring binder. The report is to contain a table of contents, an executive summary, an introduction, a results section and a discussion of the results. Submit the air leakage test report as described in paragraph AIR LEAKAGE TEST REPORT. Submit a diagnostic test report as described in paragraph LOCATING LEAKS BY DIAGNOSTIC TESTING. The diagnostic test report is to include the Thermographic Investigation Report and the Fog Test Report (if performed).

Submit field data and completed report forms found in the appendices. Use the sample forms, Test Agency Qualification Sheet, Air Leakage Test Form and Air Leakage Test Results Form to summarize the tests for the appropriate building envelope. Submit both electronically populated and field hand filled-in forms.

Report Data. Include in the report the following information for all tests:

- a. Date of issue
- b. Project title and number
- c. Name, address, and telephone number of testing agency
- d. Dates and locations of samples and tests or inspections
- e. Names of individuals making the inspection or test
- f. Designation of the work and test method
- g. Identification of product and specification section
- h. Complete inspection or test data
- i. Test results and an interpretation of test results
- j. Comments or professional opinion on whether inspected or tested work complies with Contract document requirements
- k. Recommendations on retesting

1.13 CLIMATE CONDITIONS SUITABLE FOR A PRESSURE TEST

As the test date approaches, monitor the weather forecast for the test site. Avoid testing on days forecast to experience high winds, rain, or snow. Monitor weather forecasts prior to shipping pressure test equipment to the site. Based on current and forecast weather conditions, the Contracting Officer's representative is to grant final approval for testing to occur.

1.13.1 Rain

For safety reasons, avoid testing during rain or if rain is anticipated during testing. If pneumatic hoses are installed and exposed to rain inspect the hose to ensure rainwater has not migrated into the hose ends. Orient all exposed hose ends to keep them out of water puddles. Success in temporarily sealing outdoor ventilation components such as louvers and exhaust fans may also be compromised by rain. Don't seal roof-mounted ventilation components during times of potential lightning.

1.13.2 Wind

Because wind can skew pressure test results, test only on days and at times when winds are anticipated to be the calmest. Avoid pressure testing during gusty or high wind conditions. Avoid installing test fans on the windward side of the building if wind gusts during the test are anticipated to be greater than 10 miles per hour.

1.14 CERTIFICATE OF READINESS

Prior to scheduling the Commissioning Tests as required by this Section, submit Certificate of Readiness documentation in accordance with Section 01 91 00.15 BUILDING COMMISSIONING for each enclosure-related system, certifying that inspections have been completed, open issues have been resolved, and the system is ready for the Commissioning Tests. Documentation would include Building Envelope Inspection Checklists as required within this Section, as well as any inspections or test reports required within each enclosure-related technical specification section. Additional Quality Control and testing requirements for specific components of the building enclosure are described in the Division 03 thru 08 UFGS Sections of the project specifications.

Submit the Certificate of Readiness for each system 30 calendar days prior to Commissioning Tests of that system. Do not schedule Commissioning Tests for a system until the Certificate of Readiness is approved by the Government. Do not schedule air tightness testing of the building envelope system until Certificates of Readiness and supporting documentation for enclosure-related systems have been submitted, reviewed and approved by the Government.

PART 2 PRODUCTS

2.1 TEST EQUIPMENT

Provide all equipment required to perform testing for the systems and components to be commissioned. Provide all testing equipment of sufficient quality and accuracy to test and measure system performance with the tolerances specified. Provide a sufficient quantity of two-way radios for each subcontractor.

Submit a signed and dated list of instruments to be used for testing, their application, manufacture, model, serial number, range of operation accuracy, and date of most recent calibration. Calibration data applicable to fan systems must be in accordance with ASTM E1258. Also list special equipment and proprietary tools specific to a piece of equipment required for testing.

2.2 PRESSURE TEST EQUIPMENT

Depending on site conditions and size of the envelope, the test may be conducted using blower door equipment and trailer-mounted fans . The testing agency is to supply sufficient quantity of blower equipment that will produce a minimum of 75 Pa differential pressure between the envelope and outdoors using the test methods described herein. Supplying additional blower test equipment to provide additional airflow capacity or to act as a backup is highly recommended.

2.2.1 Blower Door Fans and Trailer Mounted Fans

Each air flow measuring system including blower door fans and trailer mounted fans are to be calibrated within the last 5 years. Calibrated blower door fans and trailer mounted fans must measure accurately to within plus or minus 5 percent of the flow reading. Blower door equipment and trailer mounted fans are to be specifically designed to pressurize building envelopes. Each set of blower door equipment is to include fan(s), digital gage(s), door frame, door fabric or hard panels.

2.2.2 Digital Gages as Test Instruments

Use only digital gages as measuring instruments in the pressure test; analog gages are not acceptable. The gauges must be accurate to within 1.0 percent of the pressure reading or 0.15 Pa, whichever is greater. Each gage is to have been calibrated within two years of the test. The calibration is to be checked against a National Institute of Standards and Technology (NIST, formerly National Bureau of Standards) traceable standard.

2.3 THERMAL IMAGING CAMERA REQUIREMENTS

The thermal imaging camera used in the thermography test must have a thermal sensitivity (Noise Equivalent Temperature Difference.) of +/- 0.18 degrees F at 86 degrees F or less. Ensure the camera's operating spectral range falls between 2 and 15 micrometers. Ensure the camera's IR image viewing screen resolution measures at least 320x240 pixels. Ensure the camera has a means of recording thermal images seen on the camera viewing screen. The camera is to display output as individual still frame images that also can be downloaded and inserted into an electronic Thermographic Investigation Report. All thermographic equipment must comply with the requirements of ISO 6781-2. Submit camera make and model, and catalog information that defines the camera thermal sensitivity for approval.

PART 3 EXECUTION

Conduct building enclosure commissioning in accordance with ASHRAE 202 and ASTM E2947 in addition to the requirements herein. Follow ASTM E2947 except where it references ASTM E2813. Commissioning must document in sufficient detail compliance of the building envelope with the design

intent as defined in the Contract documents.

3.1 MEETINGS

Attend all meetings in accordance with Section 01 91 00.15 BUILDING COMMISSIONING.

Provide timely updates on construction schedule changes so Commissioning Provider has scheduling information needed to execute commissioning process efficiently. Notify Contracting Officer of anticipated construction delays to commissioning activities not yet performed or not yet scheduled.

3.2 PRELIMINARY BECx PLAN

Submit the Preliminary BECx Plan no later than 14 calendar days after the Commissioning Kickoff Meeting. Submit the Preliminary BECx Plan for inclusion in the Construction Phase Commissioning Plan as identified in Section 01 91 00.15 BUILDING COMMISSIONING. Coordinate the development of this plan with the commissioning plans required in Section 01 91 00.15 BUILDING COMMISSIONING. Outline the commissioning process, commissioning team members and responsibilities, lines of communication, inspections, and documentation requirements for BECx. Identify the Commissioning Standards chosen for the project. Establish appropriate and quantifiable enclosure related performance metrics, test standards, and test methodology in accordance with referenced standards for inclusion in the Contract documents. Provide a list of team members for systems to be commissioned with contact information, a list of tests as required to complete the scope of all commissioning and a copy of the project schedule as required by Section 01 32 01.00 10 PROJECT SCHEDULE for inclusion in the Preliminary BECx Plan.

The Preliminary BECx Plan must include, at a minimum, the following:

1. Required performance of commissioned equipment, systems, and assemblies, and results of FPT and verification.
2. Summary of compliance of the building and its components, assemblies, controls, and systems with requirements.
3. Issues and resolution logs, including itemization of deficiencies found during verification, testing, and commissioning that have not been corrected at the time of report preparation.
4. Deferred tests that cannot be performed at the time of report preparation.
5. Documentation of the training of operation personnel and building occupants on commissioned systems, and a plan for the completion of any deferred trainings not completed at the time of report preparation.
6. A plan for the completion of commissioning and training, including climatic and other conditions required for performance of the deferred tests.

3.3 DESIGN REVIEW

Provide a Design Review Report identifying discrepancies or deficiencies

that would prevent the systems to be commissioned from operating or performing in accordance with the design requirements or being safely maintained. Submit the building enclosure-related Design Review Report for inclusion in the overall project Design Review Report as identified in Section 01 91 00.15 BUILDING COMMISSIONING. Report must include individual list of each deficiency and corresponding corrective action necessary for proper system performance. Identify any discrepancies between the design and the Owner's Project Requirements Document. The Owner's Project Requirements Document is provided for commissioning review purposes only and does not form a part of the contract documents for this project. Submit the Design Review Report no later than 14 calendar days after approval of the Commissioning Firm and Commissioning Specialists after completing the review of the design. The Contracting Officer, Construction Manager, the Contractor's Project Manager, the BECxP, and the Designers of Record for the associated systems must meet, discuss, and resolve any outstanding items contained in the report no later than 14 calendar days after submission of the report. The BECxP must verify that their review comments have been adequately addressed in subsequent design submittals.

The BECxP is responsible for reviewing the design and preparing a Design Review Report identifying discrepancies or deficiencies that would prevent the systems to be commissioned from operating or performing in accordance with the design requirements or being safely maintained. The Contracting Officer, the CxC, the BECxP, and the Designers of Record for the associated systems must meet, discuss, and resolve any outstanding items contained in the report no later than 14 calendar days after submission of the report. The BECxP must verify that the review comments have been adequately addressed in subsequent design submittals.

Give particular attention to the continuity of the air barrier, vapor and moisture control within enclosure assembly, acoustic control of the enclosure assemblies to meet required Outdoor Indoor Transmission Class (OITC) values, flashing, thermal bridges, and resistance to water penetration or ponding.

3.4 FINAL BECx PLAN

Submit the Final BECx Plan for inclusion in the Interim Construction Phase Commissioning Plan as identified in Section 01 91 00.15 BUILDING COMMISSIONING. Outline the commissioning process, commissioning team members and responsibilities, lines of communication, and documentation requirements for BECx. Identify the Commissioning Standards chosen for the project. Identify enclosure related inspections, performance metrics, test standards, and test methodologies in accordance with referenced standards for inclusion in the commissioning process.

Provide a list of team members for systems to be commissioned with contact information, a list of tests as required by this Section as well as 07 27 10 BUILDING AIR BARRIER SYSTEM, and a copy of the project schedule as required by Section 01 32 17.00 20 COST-LOADED NETWORK ANALYSIS SCHEDULE 01 32 01.00 10 PROJECT SCHEDULE for inclusion in the Final BECx Plan. Final BECx plan must be submitted with the Interim Construction Phase Commissioning Plan, and must be updated and included with the Final Construction Phase Commissioning Plan as identified in Section 01 91 00.15 BUILDING COMMISSIONING.

3.5 CONSTRUCTION SUBMITTAL REVIEWS

Coordinate construction submittal document reviews for commissioned systems and assemblies with the CxC and BECxP. The commissioning submittal review does not replace the designer of record (DoR) or Government submittal review, in accordance with Section 01 33 00 SUBMITTAL PROCEDURES.

The BECxP must identify construction submittals to be provided by the Contractor for the commissioned systems, and coordinate with the CxC. The BECxP must evaluate construction submittals related to BECx for compliance with the Contract documents. Include a copy of the submittal document review transmittal and response in the Commissioning Report.

3.6 TEMPLATE BUILDING ENVELOPE INSPECTION CHECKLISTS

The Building Enclosure Commissioning Specialist must develop the Template Building Envelope Inspection Checklists to verify the building materials and construction maintain the required air tightness of the building envelope system.

The Building Envelope Compliance Documentation Form from ASHRAE 90.1 - IP User's Manual may be used as an example. The submitted checklist is not required to match the format of the form; however, the checklist must contain the same level of detail as shown on the mandatory provisions of the sample form.

3.7 BUILDING ENVELOPE INSPECTION AND TESTING

Demonstrate that all system components have been installed, that each building enclosure component operates, and that the systems operate and perform in accordance with Contract documents and the Owner's Project Requirements. Provide all materials, services, and labor required to perform the Building Envelope Inspections.

Document building envelope inspections by the commissioning team using the approved Template Building Envelope Inspection Checklists. Indicate commissioning team member inspection and validation of each Building Envelope Inspection Checklist item by initials at the time they are inspected and found to be in conformance with Contract requirements. Inspect checklist items before they become hidden as construction progresses. Submit the initialed and completed Building Envelope Inspection Checklists no later than 14 calendar days after completion of inspection of all checklist items. The BECxP must conduct inspections at initial installation of each building envelope component and a minimum of monthly site visits to the site to observe construction of the building envelope in-progress, each time reviewing the in-progress checklists to ensure that the commissioning team is inspecting the building envelope as required. Coordinate inspection requirements with Section 07 27 10 BUILDING AIR BARRIER SYSTEM and other Division 7 Specifications. The BECxP must witness the building envelope pressure tests and diagnostic tests specified in this Section; review the resulting reports; and provide recommendations for correction of any deficiencies or further testing.

3.7.1 Additional Building Enclosure Testing

- a. Conduct adhesion tests on liquid-applied and adhered waterproofing and air/weather barrier in accordance with ASTM D4541.

- c. Conduct small scale bubble tests of waterproofing and air/weather barriers in accordance with ASTM E1186.
- e. Conduct water penetration tests of installed storefronts, curtainwall, and sloped glazing systems in accordance with AAMA 501.2.
- f. Conduct adhesion and cohesion tests of sealants in accordance with ASTM C1193.

3.8 BUILDING ENCLOSURE AIR BARRIER PRESSURE TESTING

3.8.1 Pressure Test Agency

Employ an independent agency to conduct the pressure test on the building envelope in accordance with ASTM E779 and this specification section. The test agency is to be an independent third-party subcontractor, not an affiliated or subsidiary of the prime Contractor, subcontractors, or A/E firm. The agency is to be regularly engaged in pressure testing of commercial/industrial building envelopes. If using blower door or trailer-mounted fans, the lead test technician must have at least two years of experience in using such equipment in building envelope pressurization tests. Formal training using pressure test equipment is highly recommended. Technicians using the building's air handling system for pressure testing are to have tested at least five commercial/industrial buildings within the past two years with each building having over 50,000 square feet of floor area. Submit the name, address, and floor areas of each of these five buildings for approval.

3.8.1.1 Field Work

The lead pressure test technician and thermographer are to be present at the project site while testing is performed and is to be responsible for conducting, supervising, and managing of their respective test work. Management includes health and safety of test agency employees.

3.8.1.2 Reporting Work

The lead pressure test technician is to prepare, sign, and date the test agenda, equipment list, and submit a certified Air Leakage Test Report. The thermographer is to prepare, sign, and date the test agenda, equipment list, and submit a certified Thermographic Investigation Report. The Contractor is to prepare a final report that identifies improvements that were made to the envelope to reduce air leaks, mitigate thermal bridging, eliminate moisture migration, repair insulation voids discovered during diagnostic tests. The Verification & Testing (V&T) providers must certify completion of required verification and FPT and include a plan for the completion of any deferred FPT, including climatic and other conditions required for performance of the deferred tests; include the results of the FPT and verification activities in the completed verification and FPT (functional performance testing) documentation. Jointly submit all reports.

3.8.2 Envelope Surface Area Calculation

The architectural air barrier boundary includes the floor, walls, and ceiling. After construction of the air barrier envelope is complete, field measure the envelope to ensure the physical measurements match the design drawings and the air barrier envelope surface area calculations are

generated. If the calculation result is not within 10 percent of the defined air barrier boundary calculation result as indicated, submit the envelope surface area calculation and results for review.

3.8.3 Preparing The Building Envelope For The Pressure Test

3.8.3.1 Testing During Construction

The pressure test cannot be conducted until all components of the air barrier system have been installed. After all sealing as described herein has been completed, inspect the envelope to ensure it has been adequately prepared. During the pressure test, stop all ongoing construction within and neighboring the envelope which may impact the test or the air barrier integrity. The pressure test may be conducted before finishes that are not part of the air barrier envelope have been installed. For example, if suspended ceiling tile, interior gypsum board or cladding systems are not part of the air barrier the test can be conducted before they are installed. Recommend testing prior to installing the finished ceilings and interior wall finishes within the envelope and immediately surrounding it. The absence of finishes allows for inspection and diagnostic testing of the roof/wall interface and for implementation of repairs to the air barrier, if necessary to comply with the maximum allowed leakage.

3.8.3.2 Sealing the Air Barrier Envelope

The Contractor is to seal all penetrations through the air barrier. Unavoidable penetrations due to electrical boxes or conduit, plumbing, and other assemblies that are not air-tight are to be made so by sealing the assembly and the interface between the assembly and the air barrier or by extending the air barrier over the assembly. Support the air barrier to withstand the maximum positive and negative air pressure to be placed on the building without displacement or damage, and transfer the load to the structure. Durably construct the air barrier to last the anticipated service life of the assembly and to withstand the maximum positive and negative pressures placed on it during pressure testing. Do not install lighting fixtures that are equipped with ventilation holes through the air barrier.

3.8.3.3 Sealing Plumbing

Prime all plumbing traps located within the envelope full of water.

3.8.3.4 Close and Lock Doors

Close and lock all doors and windows in the envelope perimeter. For doors not equipped with latching hardware, temporarily secure them in the closed position. Secure the doors in such a way that they remain fully closed even when the maximum anticipated differential air pressure produced during the test acts on them. Provide signage stating not to open the door and the time and duration of the test.

3.8.3.5 Hold Excluded Building Areas at the Outdoor Pressure Level

Keep building areas immediately surrounding but excluded from the test envelope at the outdoor pressure level during the pressure test. Maintain these areas at the outdoor pressure level by propping exterior doors open, opening windows and de-energizing all air moving devices in or serving these areas.

3.8.3.6 Maintain an Even Pressure within the Envelope

Ensure the pressure differences within the envelope are minimized by opening all internal air pathways including propping open all interior doors. Distribute test fans throughout the envelope as necessary to ensure the internal pressures are uniform (within 10 percent of the average differential pressure). Ideally, do not install suspended ceilings until after all pressure tests have been completed. If, however the envelope includes finished suspended ceiling spaces, temporarily remove approximately 5 percent of all ceiling tiles or a minimum of 1 tile from each isolated suspended ceiling space, whichever comprises the greatest surface area. Temporarily remove additional ceiling tiles during testing to allow for inspection and diagnostic testing of the ceiling/wall interface. An alternative to removing ceiling tiles is to measure the differential pressure between each isolated suspended ceiling space and the outdoors when the area below the suspended ceiling is maintained at a differential pressure of 75 Pa with respect to the outdoors. If the suspended ceiling differential pressure measurement is within ten percent of the 75 Pa pressure below the suspended ceiling no ceiling tiles need to be removed.

3.8.3.7 Maintain Access to Mechanical and Electrical Rooms

Maintain access to mechanical rooms and electrical rooms associated with the envelope to allow for de-energizing ventilation equipment and resetting circuit breakers tripped by blower door equipment, if used.

3.8.3.8 Minimize Potential for Blowing Dust and Debris

Because high velocity air will be blown into and out of the envelope during the test, debris, including dust and litter, may become airborne. Airborne debris may become trapped or entangled in test equipment, thereby skewing test results. Ensure areas within and surrounding the envelope are free of dust, litter and construction materials that are easily airborne. If pressurizing existing, occupied areas, provide adequate notice to building occupants of blowing dust and debris, and general disruption of normal activities during the test.

3.8.3.9 De-energize Air Moving Devices

De-energize all air moving devices serving the envelope to keep air within the envelope as still as reasonably achievable. De-energize all fans that deliver air to, exhaust air from, or recirculate air within the envelope. Also, de-energize all fans serving areas adjacent to but excluded from the envelope.

3.8.3.10 Installing Blower Door Equipment in a Door Opening

Where blower door fans are used, before installing blower door equipment, select a door opening that does not restrict air flow into and out of the envelope and has at least 5 feet clear distance in front of and behind the door opening. Disconnect the door actuator and secure the door open to prevent it from being drawn into the fan-by-fan pressure. Avoid installing blower door equipment on the windward side of the building.

3.8.4 Building Envelope Air Tightness Requirement

For each building envelope, perform the Architectural Only test and if noted below, the Architectural Plus HVAC System test. The purpose of the

pressure (air leakage) test is to determine final compliance with the airtightness requirement by demonstrating the performance of the continuous air barrier. An effective air barrier envelope minimizes infiltration and exfiltration through unintended air paths (leaks). The tests may be performed in any desired order.

3.8.4.1 Architectural Only Test

The test envelope is the architectural air barrier boundary as defined on the Contract drawings. This boundary includes connecting walls, roof and floor which comprise a complete, whole, and continuous three-dimensional envelope. Perform both a positive pressure test and a negative pressure test on this envelope, unless otherwise directed.

3.8.4.1.1 Test Goal

Input data from the test into the Air Leakage Rate by Fan Pressurization spreadsheet as described in paragraph CALCULATION PROGRAM via the Air Leakage Test Form. Compare output from the spreadsheet against the maximum allowable leakage defined in Section 07 27 10 BUILDING AIR BARRIER SYSTEM. The envelope passes the test if the leakage rate, as calculated using the spreadsheet, is equal to or lower than the Architectural Only leakage rate goal.

3.8.4.1.2 Preparing the Envelope for the Pressure Test - Seal All Openings through the Air Barrier

Temporarily close all perimeter windows, roof hatches and doors in the envelope perimeter except for those doors that are to remain open to accommodate blower door or trailer mounted fan test equipment installation. Seal, or isolate all other intentional openings, pathways, and fenestrations through the architectural envelope prior to pressure testing. Follow the Recommended Test Envelope Conditions identified in ASTM E1827, Table 1, for the Closed Envelope condition. These openings may include boiler flues, fuel-burning water heater flues, fuel-burning kitchen equipment, clothes dryer vents, fireplaces, wall or ceiling grilles, diffusers, and other similar openings. Before sealing flues, close their associated fuel valves and verify the associated pilot lights are extinguished. Prime all plumbing traps located within the envelope full of water. In lieu of applying tape or plastic, typical temporary sealing materials include tape and sheet plastic or a self-adhesive grille wrap. Use and apply tape and plastic in a manner that does not deface or remove paint or mar the finish of permanent surfaces. Be especially aware of residue that remains from tape applied to stainless steel surfaces such as kitchen hoods or rollup doors. For painted surfaces, use tape types that do not remove finish paint when the tape is removed. If paint is removed from the finished surface, repaint to match existing surfaces. Secure dampers closed either manually or by using the building's HVAC system controls. Use the table below for further guidance in building preparation.

Building Component	Envelope Condition
Air handling units, duct fans	As found (open) or temporarily sealed as necessary
Clothes dryer	Off

Building Component	Envelope Condition
Clothes dryer vents	Temporarily sealed
Dampers - intake, exhaust	Physically closed or closed using control power or temporarily sealed
Diffusers, registers, grilles within the envelope	Temporarily sealed
Doors, personnel type, at the envelope perimeter	Secured closed
Doors, personnel type, within the envelope	Secured (propped) open
Doors, roll-up type, at the envelope perimeter	Closed (no additional sealing)
Exhaust hoods	Closed* and temporarily sealed
Fireplace hearth	Temporarily sealed *
Kitchen hoods	Temporarily sealed *
Pilot light and associated fuel valve	Extinguished and closed, respectively
Vented combustion appliance	Temporarily sealed *
Vented combustion appliance exhaust flue	Off
Windows	Secured closed
* If the building component has an associated manual or automatic damper, consider securing the damper closed in lieu of temporarily sealing.	

3.8.4.2 Architectural Plus HVAC System Test

This test envelope includes the architectural air barrier boundary as defined on the Contract drawings plus all HVAC supply, return and exhaust systems that penetrate and terminate within said architectural air barrier boundary and that extends outward from said boundary. All associated ductwork, intake and exhaust dampers, and air moving devices, including air handling units and fans, are included in this test envelope even if they are physically located outside of the architectural air barrier boundary. The boundary extends to and includes the low leakage intake and exhaust dampers. Perform both a positive pressure test and a negative pressure test on this envelope, unless otherwise indicated.

3.8.4.2.1 Test Goal

Data from the test is to be input into the Air Leakage Rate by Fan Pressurization spreadsheet as described in paragraph CALCULATION PROGRAM via the Air Leakage Test Form. If both positive and negative pressure tests were performed, both data sets are to be input in the spreadsheet. Compare output from the spreadsheet against the leakage rate goal. The envelope passes the test if the leakage rate, as calculated using the spreadsheet, is equal to or lower than the Architectural Plus HVAC System leakage rate goal.

3.8.4.2.2 Preparing the Building for the Pressure Test

In preparation for this test, de-energize all air moving devices within this envelope by putting their controls in the Unoccupied mode. This allows the building's HVAC controls to close all associated motorized intake, exhaust, and relief dampers. Make no other changes to the HVAC systems. Temporarily sealing diffusers, grilles, registers, kitchen hoods, exhaust hoods, fans, air handling units and all other HVAC system elements with tape or plastic sheeting or any other means is not allowed. If the envelope includes a fireplace hearth do not seal it with tape and plastic. Use the table below for further guidance in building preparation.

Building Component	Envelope Condition
Air handling units, duct fans	As found (open)
Clothes dryer	Off
Clothes dryer vents	As found (no preparation)
Dampers - intake, exhaust	As found (no preparation)
Diffusers, registers, grilles within the envelope	As found (open)
Doors, personnel type, at the envelope perimeter	Secured closed
Doors, personnel type, within the envelope	Secured (propped) open
Doors, roll-up type, at the envelope perimeter	Closed (no preparation)
Exhaust hoods	Closed
Fireplace hearth	As found (open)
Kitchen hoods	As found (open)
Pilot light and associated fuel valve	Extinguished and closed, respectively
Vented combustion appliance	Off
Vented combustion appliance exhaust flue	As found (open)
Windows	Secured closed

3.8.5 Conducting The Pressure Test

Notify the Contracting Officer at least ten(10) working days before conducting the pressure tests to provide the Government the opportunity to witness the tests and to monitor weather forecasts for conditions favorable for testing. Do not pressure test until verifying that the continuous air barrier is in place and installed without failures in accordance with installation instructions. During the pressure test periodically inspect temporarily sealed items to ensure they are still

sealed. Seals on temporarily sealed items tend to release more readily at higher pressures. Test data obtained after temporarily sealed items become unsealed cannot be used as input into the calculation program. Follow the Envelope Pressure Test Procedures in the paragraphs below. Submit detailed pressure test procedures indicating the test apparatus, the test methods and procedures, and the analysis methods to be employed for the building envelope pressure (air tightness) test. Submit these procedures not later than 60 days after Notice to Proceed.

3.8.5.1 Extend Pneumatic Tubes and Establish a Reference Differential Pressure

Confirm the various zones within the envelope have a relatively uniform interior pressure distribution by establishing a representative differential pressure between the envelope and the outdoors with blower door or trailer-mounted fans operating. The number of indoor pressure difference measurements (pneumatic hoses) required depends on the number of interior zones separated by bottle necks that could create significant pressure drops (e.g., doorways and stairwells). Extend at least four pneumatic hoses (differential pressure monitoring ports) to locations within the envelope that are physically opposite of each other. In multiple story buildings, especially those over three stories, extend hoses to multiple floors. Locate the hose ends away from the effects of air discharge from blower test equipment. Select one of the four (or more) interior hoses, one judged by the test agency to be the most unaffected by air velocity produced by blower test equipment, to serve as the interior reference pressure port. Extend at least one additional pneumatic hose to the outdoors (outdoor pressure port). To the end of this hose manifold at least four hoses together and terminate each hose on a different side of the building. With the envelope sealed and the blowers energized, measure the differential pressure using the interior reference pressure port and the four outdoor pressure ports. Then measure and record the differential pressure by individually using each of the remaining three interior hoses. Ensure each reading is within plus or minus 10 percent of the reference reading. Thus, at an average 75 Pa maximum pressure difference across the envelope, the difference between the highest and lowest interior pressure difference measurements should be 15 Pa or less. If this condition cannot be met, attempt to create additional air pathways within the envelope to minimize pressure differences within the envelope. If necessary, move the interior hose ends. See step 2.13 of the Air Leakage Test Form in Appendix A.

3.8.5.2 Bias Pressure Readings

With the fan pressurization equipment de-energized and the envelope sealed, obtain the differential pressure between the outdoors and the envelope. Record 12 bias pressure readings before the pressure test and 12 bias pressure readings after the pressure test. Each reading is the average of ten or more 1-second measurements. Include positive and negative signs for each reading. To help dampen bias pressures that significantly contribute to test pressure, reduce temperature differences between indoor and outdoor air. Temperature differences can be reduced by operating test fan equipment for a few minutes to replace most of the indoor air with outdoor air.

3.8.5.3 Testing in Both Positive and Negative Directions

The preferred method for testing a building envelope is to test in both the pressurized and depressurized directions. Testing in one direction is

only allowed if opposite direction testing cannot logistically be performed due to test equipment limitations or restrictions. After obtaining the pre-test bias differential pressure readings, conduct the pressure test. Record the envelope pressures (in units of Pascals) from one interior pneumatic hose (monitoring port) and the outdoor pneumatic hose(s), averaged or manifolded, with corresponding flows (in units of cfm) for each fan. Record the flow rates at least 10 to 12 positive and 10 to 12 negative building pressure readings. If conducting both positive and negative pressure tests the lowest allowable test pressure is 40 Pa and the highest test pressure is 85 Pa. Keep at least 25 Pa difference between the lowest and highest test pressure readings. Include the 75 Pa pressure value between the lowest and highest readings. The 10 to 12 readings in each direction are to be roughly evenly spaced along the range of pressures and flows. After testing is complete de-energize the equipment used to provide pressurization and obtain an additional 10 to 12 post-test bias pressure readings. None of the bias pressure readings are allowed to exceed 30 percent of the minimum test pressure. If these limits are exceeded the test fails and must be repeated.

3.8.5.4 Pressure Testing - Special Cases

3.8.5.4.1 Pressure Testing a Multiple Isolated Zoned Building

Pressure test each exterior corner zone plus at least an additional 20 percent (as measured by floor area) of remaining zones. The Contracting Officer is responsible for selecting which of these additional zones to test. If all zones pass the pressure test it is assumed that all untested zones also pass and no further testing is required. If, however, any zone fails to pass the test's leakage requirements, re-seal, and re-test until it passes in accordance with paragraph FAILED PRESSURE TEST. Test an additional 20 percent of previously untested zones. If all tested zones pass, no further testing is needed. If any zone in this group fails the test re-seal and re-test the zone until it passes. Continue this process until all the tested zones pass. When testing a zone, the doors to all adjacent zones that share a common surface with the tested zone are to have their doors opened to the outdoors. The resulting leakage from the test zoned is that through all six surfaces (4 walls, roof, and floor, for a rectangular shaped zone).

3.8.5.5 Failed Pressure Test

If the pressure test fails to meet the established criteria, use diagnostic test methods described in paragraph LOCATING LEAKS BY DIAGNOSTIC TESTING to discover the leak locations. Provide additional permanent sealing measures to reduce or eliminate leak sources discovered during diagnostic testing. Retest (perform another pressure test) after sealing has been completed. Repeat this sequence of documenting test results in the test report, performing diagnostic tests, documenting recommendations for additional sealing measures in the test report, sealing leak locations per recommendations, and re-testing as necessary until the building envelope passes the pressure test and is in compliance with the performance requirements.

3.8.5.6 Air Leakage Test Report

Report volumetric flow rates and corresponding differential pressures in cubic feet per minute (cfm) and Pascals (Pa), respectively, on the Air Leakage Test Form sample form found in Appendix A. Populate the accompanying spreadsheet file titled Pressure Test Data Analysis with

information obtained during the test. The spreadsheet uses equations found in ASTM E779 as a basis for calculating the envelope leakage rate. Other similar leakage rate calculation programs cannot be used or submitted for review. Submit a printout of the data input and output in the report. Should any air tightness (pressure) test fail, the pressure test report is to include data and results from all previous failed tests along with the final successful test data and results. Indicate if the resulting leakage rate did or did not meet the goal leakage requirement. Identify and document deficiencies in the building construction upon failure of a test to meet the specified maximum leakage rate.

Test reports on leakage tests performed using fan pressurization must meet ASTM E779 requirements; reports on tests performed utilizing blower door testing must meet ASTM E1827 requirements. Include the Test Agency Qualification Sheet, Air Leakage Test Form and Air Leakage Test Results Form in the written report. Document every test set-up condition with diagrams and photos to ensure the tests can be made repeatable. Document all pneumatic hose termination locations. Record in detail how the building envelope was prepared for the tests. Also describe in detail which building items were temporarily sealed. Include photos of test equipment and sealing measures in the report. Include an electronic (pdf) version of all test reports on a CD. If the building envelope fails to meet the leakage rate goal, provide recommendations to further seal the envelope and document these recommendations in the test report.

3.8.6 Locating Leaks By Diagnostic Testing

Use diagnostic test methods described herein to discover obvious leaks through the envelope. Perform diagnostic tests on the building envelope regardless of the envelope meeting or failing to meet the designated leakage rate goal. Use diagnostic test methods in accordance with ASTM E1186 and in conjunction with pressurization equipment, as necessary. Use the thermography diagnostic test to establish a baseline for envelope leakage. Apply additional diagnostic tests (find, feel, fog or other tests) as necessary to further define leak locations and pathways discovered using thermography or to find additional leaks not readily detected by thermography. Using a variety of diagnostic tests may help locate leaks that would otherwise go undetected if only a single diagnostic test were used. Pay special attention to locating leaks at interfaces where there is a change in materials or a change in direction of like materials. These interfaces, at a minimum, include roof/wall, wall/wall, floor/wall, wall/window, wall/door, wall/louver, roof mounted equipment/roof curb interfaces and all utility penetrations (such as ducts, pipes, and conduit) through the envelope's architecture. Also use diagnostic tests to check for leakage between the air duct and duct damper, when the damper, under normal control power, is placed in the closed position.

3.8.6.1 Sealing and Re-Testing

Should leaks be discovered during diagnostic tests, thoroughly document the exact leak locations on a floor plan so that sealing can be later applied, if required or as directed. If the envelope passes the leakage test, use the diagnostic test procedure described above to identify obvious leakage locations. Seal the leaks at the discretion of the COR based on the magnitude, location, potential for liquid moisture penetration or retention, potential for condensation, presence of daylight through an architectural surface or if the leakage location could potentially cause rapid deterioration or mold growth of, or in the

building envelope materials and assemblies. Apply sealing measures after diagnostic testing is complete and all pressurization blowers are off. To verify that the applied sealing measures are effective, re-test for leaks using the same diagnostic methods that discovered the leak. Reseal and retest until the envelope meets the leakage rate goal and all obvious leaks through the envelope are sealed.

3.8.6.2 Find Test

Use visual observation to locate daylight or artificial light streaming from the opposite side of the envelope. Observe all interfaces identified above.

3.8.6.3 Feel Test

Use the building's air handling system or blower door equipment to negatively pressurize the building envelope, to at least 25 Pa but no greater than 85 Pa, with respect to the outdoors. The larger the pressure difference, the easier discovering leaks by feeling them becomes. While inside the envelope, hand feel roof/wall, wall/wall, and floor/wall interfaces and utility penetrations (such as ducts, pipes and conduit) for leaks and note the leak locations on a floor plan. The "Feel" test may also be used to check for leaks between the ductwork and ductwork damper. To do this, positively pressurize the envelope and check for air movement from the envelope exterior.

3.8.6.4 Infrared Thermography Test

Coordinate thermography examination with the pressure test agency and the test agency's pressurization equipment. The pressure test agency is to allow adequate time for the thermographer to perform a complete thermographic examination, as described hereinafter, of the envelope interior and exterior, including readings of the roof.

3.8.6.4.1 Thermography Test Methods

Before thermographic testing, remove furniture, construction equipment, and all other obstructions both inside and outside the building as necessary to gain a clear field of view. In the Thermographic Investigation Report, document all areas where obstructions remain. For exterior thermal examination of the envelope, including readings of the roof, verify that no direct solar radiation has heated the envelope surfaces to be examined for a period of approximately 3 hours for frame construction and for approximately 8 hours for masonry veneer construction. Conduct exterior investigations after sunset, before sunrise, or on an overcast day when the influence of solar radiation can be determined to be minimal. Limit exterior examinations to times when the influence of solar radiation is minimal, such as after sunset or before sunrise or during an overcast day. Conduct thermal imaging tests only when wind speeds are less than 8 mph at the time of analysis and at the end of analysis. Document any variations in wind during the test. Document all variations of test conditions in the Thermographic Investigation Report. Test only when exterior surfaces are dry. Monitor and document ongoing test parameters, such as the temperatures inside and outside the air barrier envelope, wind speed, and differential pressure.

3.8.6.4.1.1 Thermography Testing of the Air Barrier

Test the building envelope in accordance with ISO 6781, and ASTM E1186.

Perform a complete thermographic inspection consisting of the full inspection of the interior and exterior of the complete air barrier envelope, to include readings of the roof. Document envelope areas that are inaccessible for testing. Use infrared thermography technology in concert with standard pressurization methods (blower doors, trailer mounted fans or the building's own air handling systems) to locate leaks through the air barrier. Adjust the HVAC system, if possible, to create or enhance the temperature difference between the envelope interior and exterior. The minimum allowable temperature difference is 9 degrees F. Maintain this temperature difference for at least 3 hours prior to the test. Use pressurization methods to establish a minimum of +20 Pa pressure difference with respect to the outdoors while using an infrared camera to view the envelope from outdoors. When viewing with the camera from inside the envelope, keep the envelope at a pressure differential of -20 Pa with respect to the outdoors using pressure testing equipment or the building's own air handling system.

3.8.6.4.2 Thermography Test Results

Document the location of all leaks, anomalies, and unusual thermal features on a floor plan or elevation view and catalog them with a visible light picture for locating the defect for correction. The thermographer is to recommend corrective actions to eliminate the leaks, anomalies, and unusual thermal features. Where leaks are found perform corrective sealing as necessary to achieve the whole envelope air leakage rate specified. After sealing, again use thermography in concert with standard pressurization methods to verify that the air leakage has been reduced. After these leaks have been permanently sealed, note all actions taken on the drawings or in the Thermographic Investigation Report. Submit the drawings for approval as part of the Thermographic Investigation Report. Also include thermographic photos that show where leaks were discovered. Include thermograms using an imaging palette that clearly shows the observed thermal patterns indicating air leakage. The Contracting Officer's Representative is to witness all testing.

3.8.6.5 Fog Test

Before using a theatrical fog generator, disable all building smoke detectors as they may alarm when fog is issued. Coordinate fog tests and the disabling of all smoke detectors with the Contracting Officer's representative and the local fire department as necessary. Use pressure test equipment or the buildings own air handling system to positively pressurize the building envelope to at least 25 Pa but not greater than 85 Pa over the outdoors. Using a theatrical fog generator within the envelope, direct fog at suspected leakage points such as at building interfaces. Test the following interfaces: roof/wall, wall/wall, floor/wall, wall/window, roof/mounted mechanical equipment. From the vantage point immediately outside the envelope and opposite that of the interface being tested, observe the effect as the fog is issued. Detection may also be further enhanced by using a scented fog liquid or a fog liquid that produces a colored fog. Look for fog and smell for associated odor percolating through the interface. Also use smoke puffers and smoke sticks as necessary to locate leaks at these and other interface locations. If the Architectural Plus HVAC System pressure test will be/was performed introduce fog into ductwork to check for leakage between ductwork and associated dampers. After fog testing has ended, reactivate the building smoke detectors, and notify the Contracting Officer and local fire department that the test has ended. After sealing has been completed retest these areas using fog. Seal additional leaks that are found.

(Note that theatrical fog may release quantities of the water vapor, glycol, mineral oil, or other media that could damage electronics and interior finishes or cause allergic reactions. Small scale smoke trace could be used as an alternative. See "Effects of Theatrical Smokes and Fogs on Respiratory Health in the Entertainment Industry" at www.nih.gov.)

3.8.6.6 Diagnostic Test Report

Once the diagnostic tests have been completed and the leakage locations identified and sealed, document these procedures, locations, and recommendations in the diagnostic test report. Submit plan and profile drawings that thoroughly identify leak locations. Describe in detail all leak locations so that the seal-up crew knows where to apply sealing measures. After sealing measures have been applied, describe the methods used along with applicable photos of the final sealed condition.

3.8.6.6.1 Thermographic Investigation Report

Submit a report of each thermographic investigation identifying the thermal discontinuities in the thermal control layer. Indicate in the final report locations to which improvements for both the air control layer and the thermal control layer were made to reduce air leaks and correct discontinuities in the thermal control layer. Include in the report some selected radiometric images of suspected failure points in the air barrier envelope that indicate before and after conditions. Devote a chapter(s) of the Thermographic Investigation Report to identifying suspected points of thermal bridging, moisture migration through roofs and walls, and insulation voids. Indicate in the final report improvements that were made to the envelope to reduce air leaks. Include the following items in the report:

- a. Brief description of the building construction
- b. Types of interior and exterior surface materials used in the building.
- c. Geographical orientation of the building with a description of the exterior surroundings including other buildings, vegetation, landscaping, and surface water drainage.
- d. Camera brand, model and serial number, and most recent calibration date; optional lenses with serial numbers (if applicable)
- e. Thermographer's and Government Inspector's names
- f. Date and time of tests
- g. Air temperature and humidity inside the air barrier envelope
- h. Outdoor air temperature and humidity
- i. General information for the last 12 hours on the solar radiation conditions in the geographic area where the test is being performed.
- j. Ambient conditions such as precipitation and wind direction and speed occurring with the last 24 hours, as applicable. Refer to specific requirements in each section of each thermographic inspection type for requirements in each specific area.
- k. Documentation of those portions of the building envelope which were

not within test conditions when the scan was performed, and which portions were obstructed by adjacent structures, interior furnishings, intervening cavities, or reflective surfaces.

- l. Other relevant information, which may have influenced test results.
- m. Drawings, sketches, floor plans and photographs detailing the locations in the buildings where thermograms were taken detailing possible irregularities in the components being tested.
- n. Thermal images taken during the inspection with their relative locations and written or voiced recorded explanations of the anomaly listed along with visual and reference images.
- o. An identification of the aspects or components of the building being examined.
- p. Explanations for the type and the extent of each construction defect observed during the inspection.
- q. Any results from additional measurements and investigations. Identify additional equipment used and support with type, model number, serial number, and date of most recent calibrated.

3.8.6.6.2 Fog Test Report

Document all turbulent air flow and dead air spaces within the envelope. Report fog behavior as it exits from or is entrained within the building. Include a floor plan in the report that documents the locations where fog passed through the envelope.

3.8.7 Calculation Program

To calculate the envelope leakage rate and other required outputs, input the data obtained during the pressure tests as documented in the Air Leakage Test Form (Appendix A) into the Air Leakage Rate by Fan Pressurization Excel spreadsheet. This spreadsheet can be found at the following web site:

<http://www.wbdg.org/ffc/dod/unified-facilities-guide-specifications-ufgs/forms-graphic>

3.8.8 After Completion Of The Pressure And Diagnostic Test

After all pressure and diagnostic testing has been completed unseal all temporarily sealed items. Unless otherwise directed by the Contracting Officer, return all dampers, doors, and windows to their pre-test condition. Remove tape and plastic from all temporarily sealed openings, being careful not to deface painted surfaces. If paint is removed from finished surfaces, repaint to match existing surfaces. Unless otherwise directed by the Contracting Officer's representative, return fuel (gas) valves to their pre-test position and relight pilot lights. Return all fans and air handling units to pre-test conditions. Restore smoke/fire detectors to operating condition.

3.8.9 Repair And Protection

Repair and protection are the Contractor's responsibility, regardless of the assignment of responsibility for testing, inspection, and similar services. Upon completion of inspection, testing, or sample taking and similar services, repair damaged construction and restore substrates and

finishes, protect construction exposed by or for quality control service activities, and protect repaired construction.

3.9 TRAINING

The Building Enclosure Commissioning Specialist must review the training plan required by Section 01 78 00 OPERATION AND MAINTENANCE DATA and identify any deficiencies to the Contracting Officer's Representative and the Contractor's Quality Control Personnel.

Coordinate, schedule, and document training of all commissioned systems as required by Section 01 91 00.15 BUILDING COMMISSIONING paragraph titled "Training Plan".

3.10 FINAL BECx REPORT

The BECx must provide a final BECx report that includes information generated by the BECx process including: BECx meeting minutes, design reports, test reports, the final OPR, BoD, final BECx Plan, issue and resolution log, site observations, as-built drawings (provided by the Contractor), submittals, record of training, and recommended preventive maintenance actions and intervals.

The BECxP must ensure the Final BECx Report is submitted as a portion of the Final Commissioning Report for the project, as defined in Section 01 91 00.15 BUILDING COMMISSIONING. Submit report within 14 calendar days of completion of all commissioning efforts.

3.11 APPENDICES

The following forms are available for download as a MS Word file at <http://www.wbdg.org/ffc/dod/unified-facilities-guide-specifications-ufgs/forms-graphic>

Appendix A - Air Leakage Test Form
Appendix B - Air Leakage Test Results Form
Appendix C - Test Agency Qualifications Sheet

-- End of Section --

SECTION 02 41 00

DEMOLITION

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS
(AASHTO)

AASHTO M 145 (1991; R 2012) Standard Specification for
Classification of Soils and Soil-Aggregate
Mixtures for Highway Construction Purposes

U.S. ARMY CORPS OF ENGINEERS (USACE)

EM 385-1-1 (2014) Safety and Health Requirements
Manual

U.S. FEDERAL AVIATION ADMINISTRATION (FAA)

FAA AC 70/7460-1 (2016; Rev L; Change 2) Obstruction
Marking and Lighting

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

40 CFR 61 National Emission Standards for Hazardous
Air Pollutants

1.2 PROJECT DESCRIPTION

1.2.1 Demolition/Deconstruction Plan

Prepare a Demolition Plan and submit proposed salvage, demolition, and removal procedures for approval before work is started. Include in the plan procedures for careful removal and disposition of materials specified to be salvaged, coordination with other work in progress, a disconnection schedule of utility services, and a detailed description of methods and equipment to be used for each operation and of the sequence of operations. Identify components and materials to be salvaged for reuse or recycling with reference to paragraph Existing Facilities to be Removed. Append tracking forms for all removed materials indicating type, quantities, condition, destination, and end use. Coordinate with Waste Management Plan. Provide procedures for safe conduct of the work in accordance with EM 385-1-1. Plan shall be approved by Contracting Officer prior to work beginning.

1.2.2 General Requirements

Do not begin demolition or deconstruction until authorization is received from the Contracting Officer. The work of this section is to be performed

in a manner that maximizes the value derived from the salvage and recycling of materials. Remove rubbish and debris from the project site; do not allow accumulations inside or outside the buildings. The work includes demolition, salvage of identified items and materials, and removal of resulting rubbish and debris. Remove rubbish and debris from Government property daily, unless otherwise directed. Store materials that cannot be removed daily in areas specified by the Contracting Officer.

In the interest of occupational safety and health, perform the work in accordance with EM 385-1-1, Section 23, Demolition, and other applicable Sections.

1.3 ITEMS TO REMAIN IN PLACE

Take necessary precautions to avoid damage to existing items to remain in place, to be reused, or to remain the property of the Government. Repair or replace damaged items as approved by the Contracting Officer. Coordinate the work of this section with all other work indicated. Construct and maintain shoring, bracing, and supports as required. Ensure that structural elements are not overloaded. Increase structural supports or add new supports as may be required as a result of any cutting, removal, deconstruction, or demolition work performed under this contract. Repairs, reinforcement, or structural replacement require approval by the Contracting Officer prior to performing such work.

1.3.1 Existing Construction Limits and Protection

Do not disturb existing construction beyond the extent indicated or necessary for installation of new construction. Provide protective measures to control accumulation and migration of dust and dirt in all work areas. Remove dust, dirt, and debris from work areas daily.

1.3.2 Trees

Protect trees within the project site which might be damaged during demolition or deconstruction, and which are indicated to be left in place.

1.3.3 Utility Service

Maintain existing utilities indicated to stay in service and protect against damage during demolition and deconstruction operations.

1.3.4 Facilities

Protect electrical and mechanical services and utilities. Where removal of existing utilities and pavement is specified or indicated, provide approved barricades, temporary covering of exposed areas, and temporary services. Ensure that no elements determined to be unstable are left unsupported and place and secure bracing, shoring, or lateral supports as may be required as a result of any cutting, removal, deconstruction, or demolition work performed under this contract.

1.4 BURNING

The use of burning at the project site for the disposal of refuse and debris will not be permitted.

1.5 SUBMITTALS

Government approval is required for submittals with a "G" designation;

submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Demolition Plan

SD-11 Closeout Submittals

1.6 QUALITY ASSURANCE

Submit timely notification of demolition projects to Federal, State, regional, and local authorities in accordance with 40 CFR 61, Subpart M. Notify the Contracting Officer in writing 10 working days prior to the commencement of work in accordance with 40 CFR 61, Subpart M. Comply with federal, state, and local hauling and disposal regulations. In addition to the requirements of the "Contract Clauses," conform to the safety requirements contained in ASSE/SAFE A10.6. Comply with the Environmental Protection Agency requirements specified. Use of explosives will not be permitted.

1.6.1 Dust and Debris Control

Prevent the spread of dust and debris and avoid the creation of a nuisance or hazard in the surrounding area. Do not use water if it results in hazardous or objectionable conditions such as, but not limited to, ice, flooding, or pollution.

1.7 PROTECTION

1.7.1 Traffic Control Signs

a. Where pedestrian and driver safety is endangered in the area of removal work, use traffic barricades with flashing lights. Notify the Contracting Officer prior to beginning such work.

Provide a minimum of 2 aviation red or high intensity white obstruction lights on temporary structures (including cranes) over 100 feet above ground level. Light construction and installation shall comply with FAA AC 70/7460-1. Lights shall be operational during periods of reduced visibility, darkness, and as directed by the Contracting Officer. Maintain the temporary services during the period of construction and remove only after permanent services have been installed and tested and are in operation.

1.7.2 Protection of Personnel

Before, during and after the demolition work continuously evaluate the condition of the structure being demolished and take immediate action to protect all personnel working in and around the project site. No area, section, or component of floors, roofs, walls, columns, pilasters, or other structural element will be allowed to be left standing without sufficient bracing, shoring, or lateral support to prevent collapse or failure while workmen remove debris or perform other work in the immediate area.

1.8 RELOCATIONS

Perform the removal and reinstallation of relocated items as indicated with workmen skilled in the trades involved. Repair or replace items to be relocated which are damaged by the Contractor with new undamaged items as approved by the Contracting Officer.

1.9 EXISTING CONDITIONS

Before beginning any demolition or deconstruction work, survey the site and examine the drawings and specifications to determine the extent of the work. Record existing conditions in the presence of the Contracting Officer showing the condition of structures and other facilities adjacent to areas of alteration or removal. Photographs sized 4 inch will be acceptable as a record of existing conditions. Include in the record the elevation of the top of foundation walls, finish floor elevations, possible conflicting electrical conduits, plumbing lines, alarms systems, the location and extent of existing cracks and other damage and description of surface conditions that exist prior to before starting work. It is the Contractor's responsibility to verify and document all required outages which will be required during the course of work, and to note these outages on the record document.

PART 2 PRODUCTS

2.1 FILL MATERIAL

- a. Comply with excavating, backfilling, and compacting procedures for soils used as backfill material to fill voids, depressions or excavations resulting from demolition of structures.
- b. Fill material shall conform to the definition of satisfactory soil material as defined in AASHTO M 145, Soil Classification Groups A-1, A-2-4, A-2-5 and A-3. In addition, fill material shall be free from roots and other organic matter, trash, debris, frozen materials, and stones larger than 2 inches in any dimension.

PART 3 EXECUTION

3.1 EXISTING FACILITIES TO BE REMOVED

Inspect and evaluate existing structures onsite for reuse. Existing construction scheduled to be removed for reuse shall be disassembled. Dismantled and removed materials are to be separated, set aside, and prepared as specified, and stored or delivered to a collection point for reuse, remanufacture, recycling, or other disposal, as specified.

3.1.1 Structures

- a. Remove existing structures indicated to be removed to 4 feet below grade.
- b. Demolish structures in a systematic manner from the top of the structure to the ground. Complete demolition work above each tier or floor before the supporting members on the lower level are disturbed. Demolish concrete and masonry in small sections.

3.1.2 Utilities and Related Equipment

3.1.2.1 General Requirements

Do not interrupt existing utilities serving occupied or used facilities, except when authorized in writing by the Contracting Officer. Do not interrupt existing utilities serving facilities occupied and used by the Government except when approved in writing and then only after temporary utility services have been approved and provided. Do not begin demolition or deconstruction work until all utility disconnections have been made. Shut off and cap utilities for future use, as indicated.

3.1.2.2 Disconnecting Existing Utilities

Remove existing utilities, as indicated and terminate in a manner conforming to the nationally recognized code covering the specific utility and approved by the Contracting Officer. When utility lines are encountered but are not indicated on the drawings, notify the Contracting Officer prior to further work in that area.

3.1.3 Chain Link Fencing

Remove chain link fencing, gates and other related salvaged items scheduled for removal and transport off site.

3.1.4 Paving and Slabs

Remove sawcut concrete and asphaltic concrete paving and slabs including aggregate base to a depth of 6 inches below new finish grade. Provide neat sawcuts at limits of pavement removal as indicated. Pavement and slabs not to be used in this project shall be removed from the Installation at Contractor's expense.

3.1.5 Concrete

Saw concrete along straight lines to a depth of a minimum 2 inch. Make each cut in walls perpendicular to the face and in alignment with the cut in the opposite face. Break out the remainder of the concrete provided that the broken area is concealed in the finished work, and the remaining concrete is sound. At locations where the broken face cannot be concealed, grind smooth or saw cut entirely through the concrete.

3.1.6 Electrical Equipment and Fixtures

3.1.6.1 Electrical Devices

Remove and salvage switches, switchgear, transformers, conductors including wire and nonmetallic sheathed and flexible armored cable, regulators, meters, instruments, plates, circuit breakers, panelboards, outlet boxes, and similar items. Box and tag these items for identification according to type and size.

3.1.6.2 Wiring Ducts or Troughs

Remove and salvage wiring ducts or troughs. Dismantle plug-in ducts and wiring troughs into unit lengths. Remove plug-in or disconnecting devices from the busway and store separately.

3.1.6.3 Conduit and Miscellaneous Items

Salvage conduit except where embedded in concrete or masonry. Consider corroded, bent, or damaged conduit as scrap metal. Sort straight and undamaged lengths of conduit according to size and type. Classify supports, knobs, tubes, cleats, and straps as debris to be removed and disposed.

3.1.7 Items With Unique/Regulated Disposal Requirements

Remove and dispose of items with unique or regulated disposal requirements in the manner dictated by law or in the most environmentally responsible manner.

3.2 DISPOSITION OF MATERIAL

3.2.1 Title to Materials

Except for salvaged items specified in related Sections, and for materials or equipment scheduled for salvage, all materials and equipment removed and not reused or salvaged, shall become the property of the Contractor and shall be removed from Government property. Title to materials resulting from demolition and deconstruction, and materials and equipment to be removed, is vested in the Contractor upon approval by the Contracting Officer of the Contractor's demolition, deconstruction, and removal procedures, and authorization by the Contracting Officer to begin demolition and deconstruction. The Government will not be responsible for the condition or loss of, or damage to, such property after contract award. Showing for sale or selling materials and equipment on site is prohibited.

3.2.2 Reuse of Materials and Equipment

Remove and store materials and equipment listed in the Demolition Plan to be reused or relocated to prevent damage, and reinstall as the work progresses.

3.2.3 Salvaged Materials and Equipment

Remove materials and equipment that are listed in the Demolition Plan to be removed by the Contractor and that are to remain the property of the Government, and deliver to a storage site, as directed by the Contracting Officer.

- a. Salvage items and material to the maximum extent possible.
- b. Store all materials salvaged for the Contractor as approved by the Contracting Officer and remove from Government property before completion of the contract. On site sales of salvaged material is prohibited.
- c. Remove salvaged items to remain the property of the Government in a manner to prevent damage, and packed or crated to protect the items from damage while in storage or during shipment. Items damaged during removal or storage must be repaired or replaced to match existing items. Properly identify the contents of containers.
- d. Remove historical items in a manner to prevent damage. Deliver the following historical items to the Government for disposition: Corner

stones, contents of corner stones, and document boxes wherever located on the site.

3.2.4 Unsalvageable and Non-Recyclable Material

Dispose of unsalvageable and non-recyclable noncombustible material off Government property.

3.3 CLEANUP

Remove debris and rubbish from basement and similar excavations. Remove and transport the debris in a manner that prevents spillage on streets or adjacent areas. Apply local regulations regarding hauling and disposal.

3.4 DISPOSAL OF REMOVED MATERIALS

3.4.1 Regulation of Removed Materials

Dispose of debris, rubbish, scrap, and other nonsalvageable materials resulting from removal operations with all applicable federal, state and local regulations as contractually specified.

3.4.2 Burning on Government Property

Burning of materials removed from demolished and deconstructed structures will not be permitted on Government property.

3.4.3 Removal from Government Property

Transport waste materials removed from demolished and deconstructed structures, except waste soil, from Government property for legal disposal. Dispose of waste soil as directed.

3.5 REUSE OF SALVAGED ITEMS

Replace items damaged during removal and salvage operations or restore them as necessary to usable condition.

-- End of Section --

This page left blank.

SECTION 03 30 00

CAST-IN-PLACE CONCRETE

02/19, CHG 7: 02/24

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN CONCRETE INSTITUTE (ACI)

ACI 117	(2010; Errata 2011) Specifications for Tolerances for Concrete Construction and Materials and Commentary
ACI 121R	(2008) Guide for Concrete Construction Quality Systems in Conformance with ISO 9001
ACI 301	(2016) Specifications for Structural Concrete
ACI 302.1R	(2015) Guide for Concrete Floor and Slab Construction
ACI 304.2R	(2017) Guide to Placing Concrete by Pumping Methods
ACI 304R	(2000; R 2009) Guide for Measuring, Mixing, Transporting, and Placing Concrete
ACI 305R	(2020) Guide to Hot Weather Concreting
ACI 306R	(2016) Guide to Cold Weather Concreting
ACI 308.1	(2011) Specification for Curing Concrete
ACI SP-2	(2007; Abstract: 10th Edition) ACI Manual of Concrete Inspection
ACI SP-15	(2011) Field Reference Manual: Standard Specifications for Structural Concrete ACI 301-05 with Selected ACI References

AMERICAN HARDBOARD ASSOCIATION (AHA)

AHA A135.4	(1995; R 2004) Basic Hardboard
------------	--------------------------------

ASTM INTERNATIONAL (ASTM)

ASTM A53/A53M	(2022) Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
---------------	---

ASTM A184/A184M	(2019) Standard Specification for Welded Deformed Steel Bar Mats for Concrete Reinforcement
ASTM A615/A615M	(2022) Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement
ASTM A780/A780M	(2020) Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings
ASTM A884/A884M	(2019) Standard Specification for Epoxy-Coated Steel Wire and Welded Wire Reinforcement
ASTM A934/A934M	(2022) Standard Specification for Epoxy-Coated Prefabricated Steel Reinforcing Bars
ASTM A996/A996M	(2016) Standard Specification for Rail-Steel and Axle-Steel Deformed Bars for Concrete Reinforcement
ASTM A1022/A1022M	(2016b) Standard Specification for Deformed and Plain Stainless Steel Wire and Welded Wire for Concrete Reinforcement
ASTM A1060/A1060M	(2016b) Standard Specification for Zinc-Coated (Galvanized) Steel Welded Wire Reinforcement, Plain and Deformed, for Concrete
ASTM A1064/A1064M	(2022) Standard Specification for Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete
ASTM C31/C31M	(2023) Standard Practice for Making and Curing Concrete Test Specimens in the Field
ASTM C33/C33M	(2023) Standard Specification for Concrete Aggregates
ASTM C39/C39M	(2023) Standard Test Method for Compressive Strength of Cylindrical Concrete Specimens
ASTM C42/C42M	(2020) Standard Test Method for Obtaining and Testing Drilled Cores and Sawed Beams of Concrete
ASTM C78/C78M	(2022) Standard Test Method for Flexural Strength of Concrete (Using Simple Beam with Third-Point Loading)
ASTM C94/C94M	(2023) Standard Specification for Ready-Mixed Concrete

ASTM C136/C136M	(2019) Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates
ASTM C143/C143M	(2020) Standard Test Method for Slump of Hydraulic-Cement Concrete
ASTM C150/C150M	(2022) Standard Specification for Portland Cement
ASTM C172/C172M	(2017) Standard Practice for Sampling Freshly Mixed Concrete
ASTM C173/C173M	(2023) Standard Test Method for Air Content of Freshly Mixed Concrete by the Volumetric Method
ASTM C231/C231M	(2022) Standard Test Method for Air Content of Freshly Mixed Concrete by the Pressure Method
ASTM C260/C260M	(2010a; R 2016) Standard Specification for Air-Entraining Admixtures for Concrete
ASTM C311/C311M	(2022) Standard Test Methods for Sampling and Testing Fly Ash or Natural Pozzolans for Use in Portland-Cement Concrete
ASTM C330/C330M	(2017a) Standard Specification for Lightweight Aggregates for Structural Concrete
ASTM C494/C494M	(2019; E 2022) Standard Specification for Chemical Admixtures for Concrete
ASTM C618	(2023; E 2023) Standard Specification for Coal Fly Ash and Raw or Calcined Natural Pozzolan for Use in Concrete
ASTM C803/C803M	(2023) Standard Test Method for Penetration Resistance of Hardened Concrete
ASTM C873/C873M	(2015) Standard Test Method for Compressive Strength of Concrete Cylinders Cast in Place in Cylindrical Molds
ASTM C900	(2015) Standard Test Method for Pullout Strength of Hardened Concrete
ASTM C1017/C1017M	(2013; E 2015) Standard Specification for Chemical Admixtures for Use in Producing Flowing Concrete
ASTM C1074	(2019) Standard Practice for Estimating Concrete Strength by the Maturity Method
ASTM C1077	(2017) Standard Practice for Agencies Testing Concrete and Concrete Aggregates for Use in Construction and Criteria for Testing Agency Evaluation

ASTM C1107/C1107M	(2020) Standard Specification for Packaged Dry, Hydraulic-Cement Grout (Nonshrink)
ASTM C1218/C1218M	(2020c) Standard Test Method for Water-Soluble Chloride in Mortar and Concrete
ASTM C1240	(2020) Standard Specification for Silica Fume Used in Cementitious Mixtures
ASTM C1260	(2023) Standard Test Method for Potential Alkali Reactivity of Aggregates (Mortar-Bar Method)
ASTM C1293	(2008; R 2015) Standard Test Method for Determination of Length Change of Concrete Due to Alkali-Silica Reaction
ASTM C1567	(2023) Standard Test Method for Potential Alkali-Silica Reactivity of Combinations of Cementitious Materials and Aggregate (Accelerated Mortar-Bar Method)
ASTM C1602/C1602M	(2022) Standard Specification for Mixing Water Used in Production of Hydraulic Cement Concrete
ASTM C1778	(2016) Standard Guide for Reducing the Risk of Deleterious Alkali-Aggregate Reaction in Concrete
ASTM D5759	(2012; R 2020) Characterization of Coal Fly Ash and Clean Coal Combustion Fly Ash for Potential Uses
ASTM E96/E96M	(2022a; E 2023) Standard Test Methods for Gravimetric Determination of Water Vapor Transmission Rate of Materials
ASTM E329	(2023) Standard Specification for Agencies Engaged in Construction Inspection, Testing, or Special Inspection
ASTM E1155	(2020) Standard Test Method for Determining Floor Flatness and Floor Levelness Numbers
ASTM E1643	(2018a) Standard Practice for Selection, Design, Installation, and Inspection of Water Vapor Retarders Used in Contact with Earth or Granular Fill Under Concrete Slabs
ASTM E1745	(2017; R 2023) Standard Specification for Water Vapor Retarders Used in Contact with Soil or Granular Fill under Concrete Slabs

CONCRETE REINFORCING STEEL INSTITUTE (CRSI)

- CRSI 10MSP (2018) Manual of Standard Practice
- CRSI RB4.1 (2016) Supports for Reinforcement Used in Concrete

NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY (NIST)

- NIST PS 1 (2009) DOC Voluntary Product Standard PS 1-07, Structural Plywood

U.S. ARMY CORPS OF ENGINEERS (USACE)

- COE CRD-C 104 (1980) Method of Calculation of the Fineness Modulus of Aggregate

1.2 DEFINITIONS

- a. "Cementitious material" as used herein must include all portland cement, pozzolan, fly ash, slag cement.
- b. "Exposed to public view" means situated so that it can be seen from eye level from a public location after completion of the building. A public location is accessible to persons not responsible for operation or maintenance of the building.
- c. "Chemical admixtures" are materials in the form of powder or fluids that are added to the concrete to give it certain characteristics not obtainable with plain concrete mixes.
- d. "Supplementary cementing materials" (SCM) include coal fly ash, slag cement, natural or calcined pozzolans, and ultra-fine coal ash when used in such proportions to replace the portland cement that result in improvement to sustainability and durability and reduced cost.
- e. "Design strength" ($f'c$) is the specified compressive strength of concrete at time(s) specified in this section to meet structural design criteria.
- f. "Mass Concrete" is any concrete system that approaches a maximum temperature of 158 degrees F within the first 72 hours of placement. In addition, it includes all concrete elements with a section thickness of 3 feet or more regardless of temperature.
- g. "Mixture proportioning" is the process of designing concrete mixture proportions to enable it to meet the strength, service life and constructability requirements of the project while minimizing the initial and life-cycle cost.
- h. "Mixture proportions" are the masses or volumes of individual ingredients used to make a unit measure (cubic meter or cubic yard) of concrete.
- i. "Pozzolan" is a siliceous or siliceous and aluminous material, which in itself possesses little or no cementitious value but will, in finely divided form and in the presence of moisture, chemically react with calcium hydroxide at ordinary temperatures to form compounds possessing cementitious properties.

- j. "Workability (or consistence)" is the ability of a fresh (plastic) concrete mix to fill the form/mould properly with the desired work (vibration) and without reducing the concrete's quality. Workability depends on water content, chemical admixtures, aggregate (shape and size distribution), cementitious content and age (level of hydration).

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Concrete Curing Plan
Quality Control Program; G
Quality Control Personnel Certifications; G
Quality Control Organizational Chart
Laboratory Accreditation; G
Maturity Method Data

SD-02 Shop Drawings

Reinforcing Steel; G

SD-03 Product Data

Joint Sealants; S
Joint Filler; S
Formwork Materials
Recycled Aggregate Materials; S
Cementitious Materials; S
Vapor Retarder and Vapor Barrier
Concrete Curing Materials
Reinforcement; S
Liquid Chemical Floor Hardeners and Sealers
Admixtures
Reinforcing Fibers
Mechanical Reinforcing Bar Connectors
Waterstops

Local/Regional Materials; S

Biodegradable Form Release Agent

Pumping Concrete

Nonshrink Grout

SD-04 Samples

SD-05 Design Data

Concrete Mix Design; G

SD-06 Test Reports

Concrete Mix Design; G

Fly Ash

Pozzolan

Slag Cement

Aggregates

Compressive Strength Tests; G

Unit Weight of Structural Concrete

Chloride Ion Concentration

Air Content

Slump Tests

Water

SD-07 Certificates

Reinforcing Bars

Welder Qualifications

Forest Stewardship Council (FSC) Certification

Field Testing Technician and Testing Agency

SD-08 Manufacturer's Instructions

Liquid Chemical Floor Hardeners and Sealers

Joint Sealants; S

Curing Compound

1.4 MODIFICATION OF REFERENCES

Accomplish work in accordance with ACI publications except as modified herein. Consider the advisory or recommended provisions to be mandatory. Interpret reference to the "Building Official," the "Structural Engineer," and the "Architect/Engineer" to mean the Contracting Officer.

1.5 DELIVERY, STORAGE, AND HANDLING

Follow ACI 301, ACI 304R and ASTM A934/A934M requirements and recommendations. Do not deliver concrete until vapor retarder, vapor barrier, forms, reinforcement, embedded items, and chamfer strips are in place and ready for concrete placement. Do not store concrete curing compounds or sealers with materials that have a high capacity to adsorb volatile organic compound (VOC) emissions. Do not store concrete curing compounds or sealers in occupied spaces.

1.5.1 Reinforcement

Store reinforcement of different sizes and shapes in separate piles or racks raised above the ground to avoid excessive rusting. Protect from contaminants such as grease, oil, and dirt. Ensure bar sizes can be accurately identified after bundles are broken and tags removed.

1.6 QUALITY ASSURANCE

1.6.1 Design Data

1.6.1.1 Concrete Mix Design

Sixty days minimum prior to concrete placement, submit a mix design for each strength and type of concrete. Submit all documentation required in ACI 301 Section 4 and as specified in this section. Submit a complete list of materials including type; brand; source and amount of cement, supplementary cementitious materials, and admixtures; and applicable reference specifications. Submit mill test and all other test for cement, supplementary cementitious materials, aggregates, and admixtures. Provide documentation of maximum nominal aggregate size, gradation analysis, percentage retained and passing sieve, and a graph of percentage retained versus sieve size. Provide mix proportion data using at least three different water-cementitious material ratios for each type of mixture, which produce a range of strength encompassing those required for each type of concrete required. If source material changes, resubmit mix proportion data using revised source material. Provide only materials that have been proven by trial mix studies to meet the requirements of this specification, unless otherwise approved in writing by the Contracting Officer. Indicate clearly in the submittal where each mix design is used when more than one mix design is submitted. Resubmit data on concrete components if the qualities or source of components changes. Required average strength can be documented by field experience if field strength test data are available and represent a single group of at least 10 consecutive strength tests for one mixture, using materials and conditions similar to those expected for work, and encompassing a period of not less than 45 days. The average of field strength tests shall equal or exceed f_{cr} . Changes in materials, conditions, and proportions within the test record shall not have been more closely restricted than those for the proposed work. Test records shall not be more than 24 months old. Obtain mix design approval from the contracting officer prior to concrete placement.

1.6.2 Shop Drawings

1.6.2.1 Reinforcing Steel

Indicate bending diagrams, assembly diagrams, splicing and laps of bars, shapes, dimensions, and details of bar reinforcing, accessories, and concrete cover. Do not scale dimensions from structural drawings to determine lengths of reinforcing bars. Reproductions of contract drawings are unacceptable.

1.6.3 Control Submittals

1.6.3.1 Concrete Curing Plan

Submit proposed materials, methods and duration for curing concrete elements in accordance with ACI 308.1.

1.6.3.2 Pumping Concrete

Submit proposed materials and methods for pumping concrete. Submittal must include mix designs, pumping equipment including type of pump and size and material for pipe, and maximum length and height concrete is to be pumped.

1.6.3.3 Safety Data Sheets

Submit Safety Data Sheets (SDS) for all materials that are regulated for hazardous health effects. SDS must be readily accessible during each work shift to employees when they are at the construction site.

1.6.4 Test Reports

1.6.4.1 Fly Ash and Pozzolan

Submit test results in accordance with ASTM C618 for fly ash and pozzolan. Submit test results performed within 6 months of submittal date.

1.6.4.2 Aggregates

Submit test results in accordance with ASTM C33/C33M, or ASTM C330/C330M for lightweight aggregate, and ASTM C1293 or ASTM C1567 as required in the paragraph titled ALKALI-AGGREGATE REACTION.

1.6.5 Quality Control Program

Develop and submit for approval a concrete quality control program in accordance with the guidelines of ACI 121R and as specified herein. The plan must include approved laboratories. Provide direct oversight for the concrete qualification program inclusive of associated sampling and testing. All quality control reports must be provided to the Contracting Officer, Quality Manager and Concrete Supplier. Maintain a copy of ACI SP-15 and CRSI 10MSP at project site.

1.6.6 Quality Control Personnel Certifications

The Contractor must submit for approval the responsibilities of the various quality control personnel, including the names and qualifications of the individuals in those positions and a quality control organizational

chart defining the quality control hierarchy and the responsibility of the various positions. Quality control personnel must be employed by the Contractor.

Submit American Concrete Institute certification for the following:

- a. CQC personnel responsible for inspection of concrete operations.
- b. Lead Foreman or Journeyman of the Concrete Placing, Finishing, and Curing Crews.
- c. Field Testing Technicians: ACI Concrete Field Testing Technician, Grade I.

1.6.6.1 Quality Manager Qualifications

The quality manager must hold a current license as a professional engineer in a U.S. state or territory with experience on at least five similar projects. Evidence of extraordinary proven experience may be considered by the Contracting Officer as sufficient to act as the Quality Manager.

1.6.6.2 Field Testing Technician and Testing Agency

Submit data on qualifications of proposed testing agency and technicians for approval by the Contracting Officer prior to performing testing on concrete.

- a. Work on concrete under this contract must be performed by an ACI Concrete Field Testing Technician Grade 1 qualified in accordance with ACI SP-2 or equivalent. Equivalent certification programs must include requirements for written and performance examinations as stipulated in ACI SP-2.
- b. Testing agencies that perform testing services on reinforcing steel must meet the requirements of ASTM E329.
- c. Testing agencies that perform testing services on concrete materials must meet the requirements of ASTM C1077.

1.6.7 Laboratory Qualifications for Concrete Qualification Testing

The concrete testing laboratory must have the necessary equipment and experience to accomplish required testing. The laboratory must meet the requirements of ASTM C1077 and be Cement and Concrete Reference Laboratory (CCRL) inspected.

1.6.8 Laboratory Accreditation

Laboratory and testing facilities must be provided by and at the expense of the Contractor. The laboratories performing the tests must be accredited in accordance with ASTM C1077, including ASTM C78/C78M and ASTM C1260. The accreditation must be current and must include the required test methods, as specified. Furthermore, the testing must comply with the following requirements:

- a. Aggregate Testing and Mix Proportioning: Aggregate testing and mixture proportioning studies must be performed by an accredited laboratory and under the direction of a registered professional engineer in a U.S. state or territory competent in concrete materials who is

competent in concrete materials and must sign all reports and designs.

- b. Acceptance Testing: Furnish all materials, labor, and facilities required for molding, curing, testing, and protecting test specimens at the site and in the laboratory. Furnish and maintain boxes or other facilities suitable for storing and curing the specimens at the site while in the mold within the temperature range stipulated by ASTM C31/C31M.
- c. Contractor Quality Control: All sampling and testing must be performed by an approved, onsite, independent, accredited laboratory.

PART 2 PRODUCTS

2.1 FORMWORK MATERIALS

- a. Form-facing material in contact with concrete must be lumber, plywood, tempered concrete-form-grade hardboard, metal, plastic,. Submit product information on proposed form-facing materials if different from that specified herein.
- b. Design formwork, shores, reshores, and backshores to support loads transmitted to them and to comply with applicable building code requirements.
- c. Design formwork and shoring for load redistribution resulting from stressing of post-tensioned reinforcement. Ensure that formwork allows movement resulting from application of prestressing force.
- d. Design formwork to withstand pressure resulting from placement and vibration of concrete and to maintain specified tolerances.
- e. Design formwork to accommodate waterstop materials in joints at locations indicated in Contract Documents.
- f. Provide temporary openings in formwork if needed to facilitate cleaning and inspection.
- g. Design formwork joints to inhibit leakage of mortar.
- h. Limit deflection of facing materials for concrete surfaces exposed to view to 1/240 of center-to-center spacing of facing supports.
- j. Submit product information on proposed form-facing materials if different from that specified herein.
- m. Submit procedure for reshoring and backshoring, including drawings signed and sealed by a licensed design engineer. Include on shop drawings the formwork removal procedure and magnitude of construction loads used for design of reshoring or backshoring system. Indicate in procedure the magnitude of live and dead loads assumed for required capacity of the structure at time of reshoring or backshoring.
- n. Submit manufacturer's product data on form liner proposed for use with each formed surface.

2.1.1 Wood Forms

Use lumber as specified in Section 06 10 00 ROUGH CARPENTRY and as

follows. Provide lumber that is square edged or tongue-and-groove boards, free of raised grain, knotholes, or other surface defects. Provide plywood that complies with NIST PS 1, B-B concrete form panels or better or AHA A135.4, hardboard for smooth form lining.

2.1.1.1 Concrete Form Plywood (Standard Rough)

Provide plywood that conforms to NIST PS 1, B-B, concrete form, not less than 5/8-inch thick.

2.2 FORMWORK ACCESSORIES

- a. Use commercially manufactured formwork accessories, including ties and hangers.
- b. Form ties and accessories must not reduce the effective cover of the reinforcement.

2.2.1 Chamfer Materials

Use lumber materials with dimensions of 3/4 x 3/4 in.

2.2.2 Construction and movement joints

- a. Submit details and locations of construction joints in accordance with the requirements herein.
- b. Locate construction joints within middle one-third of spans of slabs, beams, and girders. If a beam intersects a girder within the middle one-third of girder span, the distance between the construction joint in the girder and the edge of the beam must be at least twice the width of the larger member.
- c. For members with post-tensioning tendons, locate construction joints where tendons pass through centroid of concrete section.
- d. Locate construction joints in walls and columns at underside of slabs, beams, or girders and at tops of footings or slabs.
- e. Make construction joints perpendicular to main reinforcement.
- f. Provide movement joints where indicated in Contract Documents or in accepted alternate locations.
- g. Submit location and detail of movement joints if different from those indicated in Contract Documents.
- h. Submit manufacturer's data sheet on expansion joint materials.
- i. Provide keyways where indicated in Contract Documents. Longitudinal keyways indicated in Contract Documents must be at least 1-1/2 in. deep, measured perpendicular to the plane of the joint.

2.2.3 Other Embedded items

Use sleeves, inserts, anchors, and other embedded items of material and design indicated in Contract Documents.

2.3 CONCRETE MATERIALS

2.3.1 Cementitious Materials

2.3.1.1 Portland Cement

- a. Unless otherwise specified, provide cement that conforms to ASTM C150/C150M Type I II.
- b. Use one brand and type of cement for formed concrete having exposed-to-view finished surfaces.
- c. For portland cement manufactured in a kiln fueled by hazardous waste, maintain a record of source for each batch. Supplier must certify that no hazardous waste is used in the fuel mix or raw materials. Supplier must certify that the hazardous waste is neutralized by the manufacturing process and that no additional pollutants are discharged.
- d. Submit information along with evidence demonstrating compliance with referenced standards. Submittals must include types of cementitious materials, manufacturing locations, shipping locations, and certificates showing compliance.
- e. Cementitious materials must be stored and kept dry and free from contaminants.

2.3.1.2 Fly Ash

- a. ASTM C618, Class F, except that the maximum allowable loss on ignition must not exceed 3 percent.
- b. If fly ash is used it shall range from 15 to 30 percent by weight of cementitious material, provided the fly ash does not reduce the amount of cement in the concrete mix below the minimum requirements of local building codes. Where the use of fly ash cannot meet the minimum level, it shall not be used. Report the chemical analysis of the fly ash in accordance with ASTM C311/C311M. Evaluate and classify fly ash in accordance with ASTM D5759.

2.3.1.3 Silica Fume

Silica fume must conform to ASTM C1240, including the optional limits on reactivity with cement alkalis. Silica fume may be furnished as a dry, densified material or as slurry. Proper mixing is essential to accomplish proper distribution of the silica fume and avoid agglomerated silica fume which can react with the alkali in the cement resulting in premature and extensive concrete damage. Supervision at the batch plant, finishing, and curing is essential.

2.3.1.4 Other Supplementary Cementitious Materials

Natural pozzolan must be raw or calcined and conform to ASTM C618, Class N, including the optional requirement for uniformity.

Ultra Fine Fly Ash (UFFA) and Ultra Fine Pozzolan (UFP) must conform to ASTM C618, Class F or N, and the following additional requirements:

- a. The strength activity index at 28 days of age must be at least 95

percent of the control specimens.

- b. The average particle size must not exceed 6 microns.
- c. The sum of SiO₂ plus Al₂O₃ plus Fe₂O₃ must be greater than 77 percent.

2.3.2 Water

- a. Water or ice must comply with the requirements of ASTM C1602/C1602M.
- b. Minimize the amount of water in the mix. Improve workability by adjusting the grading of the aggregate and using admixture rather than by adding water.
- c. Water must be potable; free from injurious amounts of oils, acids, alkalis, salts, organic materials, or other substances deleterious to concrete.
- d. Protect mixing water and ice from contamination during storage and delivery.
- e. Submit test report showing water complies with ASTM C1602/C1602M.

2.3.3 Aggregate

2.3.3.1 Normal-Weight Aggregate

- a. Aggregates must conform to ASTM C33/C33M .
- b. Aggregates used in concrete must be obtained from the same sources and have the same size range as aggregates used in concrete represented by submitted field test records or used in trial mixtures.
- c.
- d. Store and handle aggregate in a manner that will avoid segregation and prevents contamination by other materials or other sizes of aggregates. Store aggregates in locations that will permit them to drain freely. Do not use aggregates that contain frozen lumps.
- e. Submit types, pit or quarry locations, producers' names, aggregate supplier statement of compliance with ASTM C33/C33M, and ASTM C1293 expansion data not more than 18 months old.

2.3.4 Admixtures

- a. Chemical admixtures must conform to ASTM C494/C494M.
- b. Air-entraining admixtures must conform to ASTM C260/C260M.
- c. Chemical admixtures for use in producing flowing concrete must conform to ASTM C1017/C1017M.
- d. Do not use calcium chloride admixtures
- e.
- f. Admixtures used in concrete must be the same as those used in the concrete represented by submitted field test records or used in trial

mixtures.

- g. Protect stored admixtures against contamination, evaporation, or damage.
- h. To ensure uniform distribution of constituents, provide agitating equipment for admixtures used in the form of suspensions or unstable solutions. Protect liquid admixtures from freezing and from temperature changes that would adversely affect their characteristics.
- i. Submit types, brand names, producers' names, manufacturer's technical data sheets, and certificates showing compliance with standards required herein.

2.4 MISCELLANEOUS MATERIALS

2.4.1 Concrete Curing Materials

Provide concrete curing material in accordance with ACI 301 Section 5 and ACI 308.1 Section 2. Submit product data for concrete curing compounds. Submit manufactures instructions for placement of curing compound.

2.4.2 Nonshrink Grout

Nonshrink grout in accordance with ASTM C1107/C1107M.

2.4.3 Expansion/Contraction Joint Filler

- . Material must be 1/2 inch thick.

2.4.4 Vapor Retarder and Vapor Barrier

ASTM E1745 Class C A B polyethylene sheeting, minimum 10 mil 15 mil thickness or other equivalent material with a maximum permeance rating of 0.04 perms per ASTM E96/E96M.

Consider plastic vapor retarders and adhesives with a high recycled content, low toxicity low VOC (Volatile Organic Compounds) levels.

2.5 CONCRETE MIX DESIGN

2.5.1 Properties and Requirements

- a. Use materials and material combinations listed in this section and the contract documents.
- b. Cementitious material content must be adequate for concrete to satisfy the specified requirements for strength, w/cm, durability, and finishability described in this section and the contract documents.

The minimum cementitious material content for concrete used in floors must meet the following requirements:

Nominal maximum size of aggregate, in.	Minimum cementitious material content, pounds per cubic yard
1-1/2	470
1	520
3/4	540
3/8	610

- c. Selected target slump must meet the requirements this section, the contract documents, and must not exceed 9 in. Concrete must not show visible signs of segregation.
- d. The target slump must be enforced for the duration of the project. Determine the slump by ASTM C143/C143M. Slump tolerances must meet the requirements of ACI 117.
- e. The nominal maximum size of coarse aggregate for a mixture must not exceed three-fourths of the minimum clear spacing between reinforcement, one-fifth of the narrowest dimension between sides of forms, or one-third of the thickness of slabs or toppings.
- f. Concrete must be air entrained for members assigned to Exposure Class F1, F2, or F3. The total air content must be in accordance with the requirements of the paragraph titled DURABILITY.
- g. Measure air content at the point of delivery in accordance with ASTM C173/C173M or ASTM C231/C231M.
- h. Concrete for slabs to receive a hard-troweled finish must not contain an air-entraining admixture or have a total air content greater than 3 percent.
- i. Concrete properties and requirements for each portion of the structure are specified in the construction drawings. .

2.5.2 Durability

2.5.2.1 Alkali-Aggregate Reaction

Do not use any aggregate susceptible to alkali-carbonate reaction (ACR). Use one of the three options below for qualifying concrete mixtures to reduce the potential of alkali-silica reaction (ASR):

- a. For each aggregate used in concrete, the expansion result determined in accordance with ASTM C1293 must not exceed 0.04 percent at one year.
- b. For each aggregate used in concrete, the expansion result of the aggregate and cementitious materials combination determined in accordance with ASTM C1567 must not exceed 0.10 percent at an age of 16 days.
- c. Alkali content in concrete (LBA) must not exceed 4 pounds per cubic yard for moderately reactive aggregate or for highly reactive aggregate. Reactivity must be determined by testing in accordance

with ASTM C1293 and categorized in accordance with ASTM C1778. Alkali content is calculated as follows:

$$\text{LBA} = (\text{cement content, pounds per cubic yard}) \times (\text{equivalent alkali content of portland cement in percent}/100 \text{ percent})$$

2.5.2.2 Corrosion and Chloride Content

- a. Provide concrete meeting the requirements of the following table based on the exposure class assigned to members requiring protection against reinforcement corrosion in Contract Documents.
- b. Submit documentation verifying compliance with specified requirements.
- c. Water-soluble chloride ion content contributed from constituents including water, aggregates, cementitious materials, and admixtures must be determined for the concrete mixture by ASTM C1218/C1218M at age between 28 and 42 days.
- d. The maximum water-soluble chloride ion (Cl-) content in concrete, percent by mass of cement is as follows:

Exposure class	Maximum w/cm*	Minimum f'c, psi	Maximum water-soluble chloride ion (CL-) content in concrete, percent by mass of cement
Reinforced concrete			
C0	N/A	2500	1.00
C1	N/A	2500	0.30
C2	0.4	5000	0.15
Prestressed concrete			
C0	N/A	2500	0.06
C1	N/A	2500	0.06
C2	0.4	5000	0.06

*The maximum w/cm limits do not apply to lightweight concrete.

2.5.2.3 Concrete Temperature

The temperature of concrete as delivered must not exceed 95°F .

2.5.3 Ready-Mix Concrete

Provide concrete that meets the requirements of ASTM C94/C94M.

Ready-mixed concrete manufacturer must provide duplicate delivery tickets with each load of concrete delivered. Provide delivery tickets with the following information in addition to that required by ASTM C94/C94M:

- a. Type and brand cement
- b. Cement and supplementary cementitious materials content in 94-pound bags per cubic yard of concrete
- c. Maximum size of aggregate

- d. Amount and brand name of admixtures
- e. Total water content expressed by water cementitious material ratio

2.6 REINFORCEMENT

- a. Bend reinforcement cold. Fabricate reinforcement in accordance with fabricating tolerances of ACI 117.
- b. Submit manufacturer's certified test report for reinforcement.
- c. Submit placing drawings showing fabrication dimensions and placement locations of reinforcement and reinforcement supports. Placing drawings must indicate locations of splices, lengths of lap splices, and details of mechanical and welded splices.
- d. Submit request with locations and details of splices not indicated in Contract Documents.
- e. Submit request to place column dowels without using templates.
- f. Submit request and procedure to field-bend or straighten reinforcing bars partially embedded in concrete at locations not indicated in Contract Documents. Field bending or straightening of reinforcing bars is permitted where indicated in the Contract Documents
- g. Submit request for field cutting, including location and type of bar to be cut and reason field cutting is required.

2.6.1 Reinforcing Bars

- a. Reinforcing bars must be deformed, except spirals, load-transfer dowels, and welded wire reinforcement, which may be plain.
- b. ASTM A615/A615M with the bars marked S, Grade 60; or ASTM A996/A996M with the bars marked R, Grade 60, or marked A, Grade 60.
- c. Reinforcing bars may contain post-consumer or post-industrial recycled content.
- d. Submit mill certificates for reinforcing bars.

2.6.1.1 Bar Mats

- a. Bar mats must conform to ASTM A184/A184M.
- b. If coated bar mats are required, repair damaged coating as required in the paragraph titled GALVANIZED REINFORCING BARS EPOXY-COATED REINFORCING BARS and DUAL-COATED REINFORCING BARS.

2.6.2 Wire

- a. Provide flat sheets of welded wire reinforcement for slabs and toppings.
- b. Plain or deformed steel wire must conform to ASTM A1064/A1064M.
- c. Stainless steel wire must conform to ASTM A1022/A1022M.

- d. Epoxy-coated wire must conform to ASTM A884/A884M. Coating damage incurred during shipment, storage, handling, and placing of epoxy-coated wires must be repaired. Repair damaged coating areas with patching material in accordance with material manufacturer's written recommendations. If damaged area exceeds 2 percent of surface area in each linear foot of each wire, wire must not be used. The 2 percent limit on damaged coating area must include repaired areas damaged before shipment as required by ASTM A884/A884M. Fading of coating color shall not be cause for rejection of epoxy-coated wire reinforcement.

2.6.3 Welded wire reinforcement

- a. Use welded wire reinforcement specified in Contract Documents and conforming to one or more of the specifications given herein.
- b. Plain welded wire reinforcement must conform to ASTM A1064/A1064M, with welded intersections spaced no greater than 12 in. apart in direction of principal reinforcement.
- c. Deformed welded wire reinforcement must conform to ASTM A1064/A1064M, with welded intersections spaced no greater than 16 in. apart in direction of principal reinforcement.
- d. Epoxy-coated welded wire reinforcement must conform to ASTM A884/A884M. Coating damage incurred during shipment, storage, handling, and placing of epoxy-coated welded wire reinforcement must be repaired in accordance with ASTM A884/A884M. Repair damaged coating areas with patching material in accordance with material manufacturer's written recommendations. If damaged area exceeds 2 percent of surface area in each linear foot of each wire or welded wire reinforcement, the sheet containing the damaged area must not be used. The 2 percent limit on damaged coating area must include repaired areas damaged before shipment as required by ASTM A884/A884M. Fading of coating color shall not be cause for rejection of epoxy-coated welded wire reinforcement.
- e. Stainless steel welded wire reinforcement must conform to ASTM A1022/A1022M.
- f. Zinc-coated (galvanized) welded wire reinforcement must conform to ASTM A1060/A1060M. Coating damage incurred during shipment, storage, handling, and placing of zinc-coated (galvanized) welded wire reinforcement must be repaired in accordance with ASTM A780/A780M. If damaged area exceeds 2 percent of surface area in each linear foot of each wire or welded wire reinforcement, the sheet containing the damaged area must not be used. The 2 percent limit on damaged coating area shall include repaired areas damaged before shipment as required by ASTM A1060/A1060M.

2.6.4 Reinforcing Bar Supports

- a. Provide reinforcement support types within structure as required by Contract Documents. Reinforcement supports must conform to CRSI RB4.1. Submit description of reinforcement supports and materials for fastening coated reinforcement if not in conformance with CRSI RB4.1.
- b.

- c. Legs of supports in contact with formwork must be hot-dip galvanized, or plastic coated after fabrication, or stainless-steel bar supports.
- d.

2.6.5 Dowels for Load Transfer in Floors

Provide greased dowels for load transfer in floors of the type, design, weight, and dimensions indicated. Provide dowel bars that are plain-billet steel conforming to ASTM A615/A615M, Grade 40. Provide dowel pipe that is steel conforming to ASTM A53/A53M.

PART 3 EXECUTION

3.1 EXAMINATION

- a. Do not begin installation until substrates have been properly constructed; verify that substrates are level.
- b. If substrate preparation is the responsibility of another installer, notify Contracting Officer of unsatisfactory preparation before processing.
- c. Check field dimensions before beginning installation. If dimensions vary too much from design dimensions for proper installation, notify Contracting Officer and wait for instructions before beginning installation.

3.2 PREPARATION

Determine quantity of concrete needed and minimize the production of excess concrete. Designate locations or uses for potential excess concrete before the concrete is poured.

3.2.1 General

- a. Surfaces against which concrete is to be placed must be free of debris, loose material, standing water, snow, ice, and other deleterious substances before start of concrete placing.
- b. Remove standing water without washing over freshly deposited concrete. Divert flow of water through side drains provided for such purpose.

3.2.2 Subgrade Under Foundations and Footings

- a. When subgrade material is semi-porous and dry, sprinkle subgrade surface with water as required to eliminate suction at the time concrete is deposited, or seal subgrade surface by covering surface with specified vapor retarder.
- b. When subgrade material is porous, seal subgrade surface by covering surface with specified vapor retarder.

3.2.3 Subgrade Under Slabs on Ground

- a. Before construction of slabs on ground, have underground work on pipes and conduits completed and approved.

- b. Previously constructed subgrade or fill must be cleaned of foreign materials
- c. Finish surface of capillary water barrier under interior slabs on ground must not show deviation in excess of 1/4 inch when tested with a 10-foot straightedge parallel with and at right angles to building lines.
- d. Finished surface of subgrade or fill under exterior slabs on ground must not be more than 0.02-foot above or 0.10-foot below elevation indicated.

3.2.4 Edge Forms and Screed Strips for Slabs

- a. Set edge forms or bulkheads and intermediate screed strips for slabs to obtain indicated elevations and contours in finished slab surface and must be strong enough to support vibrating bridge screeds or roller pipe screeds if nature of specified slab finish requires use of such equipment.
- b. Align concrete surface to elevation of screed strips by use of strike-off templates or approved compacting-type screeds.

3.2.5 Reinforcement and Other Embedded Items

- a. Secure reinforcement, joint materials, and other embedded materials in position, inspected, and approved before start of concrete placing.
- b. When concrete is placed, reinforcement must be free of materials deleterious to bond. Reinforcement with rust, mill scale, or a combination of both will be considered satisfactory, provided minimum nominal dimensions, nominal weight, and minimum average height of deformations of a hand-wire-brushed test specimen are not less than applicable ASTM specification requirements.

3.3 FORMS

- a. Provide forms, shoring, and scaffolding for concrete placement. Set forms mortar-tight and true to line and grade.
- b. Chamfer above grade exposed joints, edges, and external corners of concrete 0.75 inch. Place chamfer strips in corners of formwork to produce beveled edges on permanently exposed surfaces. Do not bevel reentrant corners or edges of formed joints of concrete.
- c. Provide formwork with clean-out openings to permit inspection and removal of debris.
- d. Inspect formwork and remove foreign material before concrete is placed.
- e. At construction joints, lap form-facing materials over the concrete of previous placement. Ensure formwork is placed against hardened concrete so offsets at construction joints conform to specified tolerances.
- f. Provide positive means of adjustment (such as wedges or jacks) of shores and struts. Do not make adjustments in formwork after concrete has reached initial setting. Brace formwork to resist lateral deflection and lateral instability.

- g. Fasten form wedges in place after final adjustment of forms and before concrete placement.
- h. Provide anchoring and bracing to control upward and lateral movement of formwork system.
- i. Construct formwork for openings to facilitate removal and to produce opening dimensions as specified and within tolerances.
- j. Provide runways for moving equipment. Support runways directly on formwork or structural members. Do not support runways on reinforcement. Loading applied by runways must not exceed capacity of formwork or structural members.
- k. Position and support expansion joint materials, waterstops, and other embedded items to prevent displacement. Fill voids in sleeves, inserts, and anchor slots temporarily with removable material to prevent concrete entry into voids.
- l. Clean surfaces of formwork and embedded materials of mortar, grout, and foreign materials before concrete placement.

3.3.1 Coating

- a. Cover formwork surfaces with an acceptable material that inhibits bond with concrete.
- b. If formwork release agent is used, apply to formwork surfaces in accordance with manufacturer's recommendations before placing reinforcement. Remove excess release agent on formwork prior to concrete placement.
- c. Do not allow formwork release agent to contact reinforcement or hardened concrete against which fresh concrete is to be placed.

3.3.2 Reshoring

- a. Do not allow structural members to be loaded with combined dead and construction loads in excess of loads indicated in the accepted procedure.
- b. Install and remove reshores or backshores in accordance with accepted procedure.
- c. For floors supporting shores under newly placed concrete, either leave original supporting shores in place, or install reshores or backshores. Shoring system and supporting slabs must resist anticipated loads. Locate reshores and backshores directly under a shore position or as indicated on formwork shop drawings.
- d. In multistory buildings, place reshoring or backshoring over a sufficient number of stories to distribute weight of newly placed concrete, forms, and construction live loads.

3.3.3 Reuse

- a. Reuse forms providing the structural integrity of concrete and the aesthetics of exposed concrete are not compromised.

- b. Wood forms must not be clogged with paste and must be capable of absorbing high water-cementitious material ratio paste.
- c. Remove leaked mortar from formwork joints before reuse.

3.3.4 Forms for Standard Rough Form Finish

Provide formwork in accordance with ACI 301 Section 5 with a surface finish, SF-1.0, for formed surfaces that are to be concealed by other construction.

3.3.5 Tolerances for Form Construction

- a. Construct formwork so concrete surfaces conform to tolerances in ACI 117.
- b. Position and secure sleeves, inserts, anchors, and other embedded items such that embedded items are positioned within ACI 117 tolerances.
- c. To maintain specified elevation and thickness within tolerances, install formwork to compensate for deflection and anticipated settlement in formwork during concrete placement. Set formwork and intermediate screed strips for slabs to produce designated elevation, camber, and contour of finished surface before formwork removal. If specified finish requires use of vibrating screeds or roller pipe screeds, ensure that edge forms and screed strips are strong enough to support such equipment.

3.3.6 Removal of Forms and Supports

- a. If vertical formed surfaces require finishing, remove forms as soon as removal operations will not damage concrete.
- b. Remove top forms on sloping surfaces of concrete as soon as removal will not allow concrete to sag. Perform repairs and finishing operations required. If forms are removed before end of specified curing period, provide curing and protection.
- c. Do not damage concrete during removal of vertical formwork for columns, walls, and sides of beams. Perform needed repair and finishing operations required on vertical surfaces. If forms are removed before end of specified curing period, provide curing and protection.
- e. Form-facing material and horizontal facing support members may be removed before in-place concrete reaches specified compressive strength if shores and other supports are designed to allow facing removal without deflection of supported slab or member.

3.3.7 Strength of Concrete Required for Removal of Formwork

If removal of formwork, reshoring, or backshoring is based on concrete reaching a specified in-place strength, mold and field-cure cylinders in accordance with ASTM C31/C31M. Test cylinders in accordance with ASTM C39/C39M. Alternatively, use one or more of the methods listed herein to evaluate in-place concrete strength for formwork removal.

- a. Tests of cast-in-place cylinders in accordance with ASTM C873/C873M. This option is limited to slabs with concrete depths from 5 to 12 in.
- b. Penetration resistance in accordance with ASTM C803/C803M.
- c. Pullout strength in accordance with ASTM C900.
- d. Maturity method in accordance with ASTM C1074. Submit maturity method data using project materials and concrete mix proportions used on the project to demonstrate the correlation between maturity and compressive strength of laboratory cured test specimens to the Contracting Officer.

3.4 PLACING REINFORCEMENT AND MISCELLANEOUS MATERIALS

- a. Unless otherwise specified, placing reinforcement and miscellaneous materials must be in accordance to ACI 301. Provide bars, welded wire reinforcement, wire ties, supports, and other devices necessary to install and secure reinforcement.
- b. Reinforcement must not have rust, scale, oil, grease, clay, or foreign substances that would reduce the bond. Rusting of reinforcement is a basis of rejection if the effective cross-sectional area or the nominal weight per unit length has been reduced. Remove loose rust prior to placing steel. Tack welding is prohibited.
- c. Nonprestressed cast-in-place concrete members must have concrete cover for reinforcement given in the following table:

Concrete Exposure	Member	Reinforcement	Specified cover, in.
Cast against and permanently in contact with ground	All	All	3
Exposed to weather or in contact with ground	All	No. 6 through No. 18 bars	2
		No. 5 bar, W31 or D31 wire, and smaller	1-1/2

Concrete Exposure	Member	Reinforcement	Specified cover, in.
Not exposed to weather or in contact with ground	Slabs, joists, and walls	No. 14 and No. 18 bars	1-1/2
		No. 11 bar and smaller	3/4
	Beams, columns, pedestals, and tension ties	Primary reinforcement, stirrups, ties, spirals, and hoops	1-1/2

- d. Cast-in-place prestressed concrete members must have concrete cover for reinforcement, ducts, and end fittings given in the following table:

Concrete	Member	Reinforcement	Specified
Cast against and permanently in contact with ground	All	All	3
Exposed to weather or in contact with ground	Slabs, joists, and walls	All	1
	All other	All	1-1/2
Not exposed to weather or in contact with ground	Slabs, joists, and walls	All	3/4
		Primary reinforcement	1-1/2
	Beams, columns, and tension ties	Stirrups, ties, spirals, and hoops	1

- e. Precast nonprestressed or prestressed concrete members manufactured under plant conditions must have concrete cover for reinforcement, ducts, and end fittings given in the following table:

Concrete Exposure	Member	Reinforcement	Specified cover, in.
Exposed to weather or in contact with ground	Walls	No. 14 and No. 18 bars; tendons larger than 1-1/2 in. diameter	1-1/2
		No. 11 bars and smaller; W31 and D31 wire, and smaller; tendons and strands 1-1/2 in.	3/4
	All other	No. 14 and No. 18 bars; tendons larger than 1-1/2 in.	2
	No. 6 through No. 11 bars; tendons and strands larger than 5/8 in. diameter through 1-1/2 in.	1-1/2	
	No. 5 bar, W31 or D31 wire, and smaller; tendons and strands 5/8 in. diameter and smaller	1-1/4	

Concrete Exposure	Member	Reinforcement	Specified cover, in.
Not exposed to weather or in contact with ground	Slabs, joists, and walls	No. 14 and No. 18 bars; tendons larger than 1-1/2 in. diameter	1-1/4
		Tendons and strands 1-1/2 in. diameter and smaller	3/4
		No. 11 bar, W31 or D31	5/8
	Beams, columns, pedestals, and tension ties	Primary reinforcement	Greater of bar diameter and 5/8 and need not exceed 1-1/2
		Stirrups, ties, spirals, and hoops	3/8

3.4.1 General

Provide details of reinforcement that are in accordance with the Contract Documents.

3.4.2 Vapor Retarder and Vapor Barrier

- a. Install in accordance with ASTM E1643. Provide beneath the on-grade concrete floor slab. Use the greatest widths and lengths practicable to eliminate joints wherever possible. Lap joints a minimum of 12 inches and tape.
- b. Remove torn, punctured, or damaged vapor retarder and vapor barrier material and provide with new vapor retarder and vapor barrier prior to placing concrete. Concrete placement must not damage vapor retarder and vapor barrier material.

3.4.3 Reinforcement Supports

Provide reinforcement support in accordance with CRSI RB4.1 and ACI 301 Section 3 requirements. Supports for coated or galvanized bars must also be coated with electrically compatible material for a distance of at least 2 inches beyond the point of contact with the bars.

3.4.4 Splicing

As indicated in the Contract Documents. For splices not indicated follow ACI 301. Do not splice at points of maximum stress. Overlap welded wire reinforcement the spacing of the cross wires, plus 2 inches.

3.4.5 Future Bonding

Plug exposed, threaded, mechanical reinforcement bar connectors with a greased bolt. Provide bolt threads that match the connector. Countersink the connector in the concrete. Caulk the depression after the bolt is installed.

3.4.6 Setting Miscellaneous Material

Place and secure anchors and bolts, pipe sleeves, conduits, and other such items in position before concrete placement and support against displacement. Plumb anchor bolts and check location and elevation. Temporarily fill voids in sleeves with readily removable material to prevent the entry of concrete.

3.4.7 Fabrication

Shop fabricate reinforcing bars to conform to shapes and dimensions indicated for reinforcement, and as follows:

- a. Provide fabrication tolerances that are in accordance with ACI 117.
- b. Provide hooks and bends that are in accordance with the Contract Documents.

Reinforcement must be bent cold to shapes as indicated. Bending must be done in the shop. Rebending of a reinforcing bar that has been bent incorrectly is not permitted. Bending must be in accordance with standard approved practice and by approved machine methods.

Deliver reinforcing bars bundled, tagged, and marked. Tags must be metal with bar size, length, mark, and other information pressed in by machine. Marks must correspond with those used on the placing drawings.

Do not use reinforcement that has any of the following defects:

- a. Bar lengths, depths, and bends beyond specified fabrication tolerances
- b. Bends or kinks not indicated on drawings or approved shop drawings
- c. Bars with reduced cross-section due to rusting or other cause

Replace defective reinforcement with new reinforcement having required shape, form, and cross-section area.

3.4.8 Placing Reinforcement

Place reinforcement in accordance with ACI 301.

For slabs on grade (over earth or over capillary water barrier) and for footing reinforcement, support bars or welded wire reinforcement on precast concrete blocks, spaced at intervals required by size of reinforcement, to keep reinforcement the minimum height specified above

the underside of slab or footing.

For slabs other than on grade, supports for which any portion is less than 1 inch from concrete surfaces that are exposed to view or to be painted must be of precast concrete units, plastic-coated steel, or stainless steel protected bar supports. Precast concrete units must be wedge shaped, not larger than 3-1/2 by 3-1/2 inches, and of thickness equal to that indicated for concrete protection of reinforcement. Provide precast units that have cast-in galvanized tie wire hooked for anchorage and blend with concrete surfaces after finishing is completed.

Provide reinforcement that is supported and secured together to prevent displacement by construction loads or by placing of wet concrete, and as follows:

- a. Provide supports for reinforcing bars that are sufficient in number and have sufficient strength to carry the reinforcement they support, and in accordance with ACI 301 and CRSI 10MSP. Do not use supports to support runways for concrete conveying equipment and similar construction loads.
- b. Equip supports on ground and similar surfaces with sand-plates.
- c. Support welded wire reinforcement as required for reinforcing bars.
- d. Secure reinforcements to supports by means of tie wire. Wire must be black, soft iron wire, not less than 16 gage.
- e. Reinforcement must be accurately placed, securely tied at intersections, and held in position during placing of concrete by spacers, chairs, or other approved supports. Point wire-tie ends away from the form. Unless otherwise indicated, numbers, type, and spacing of supports must conform to the Contract Documents.
- f. Bending of reinforcing bars partially embedded in concrete is permitted only as specified in the Contract Documents.

3.4.9 Spacing of Reinforcing Bars

- a. Spacing must be as indicated in the Contract Documents.
- b. Reinforcing bars may be relocated to avoid interference with other reinforcement, or with conduit, pipe, or other embedded items. If any reinforcing bar is moved a distance exceeding one bar diameter or specified placing tolerance, resulting rearrangement of reinforcement is subject to preapproval by the Contracting Officer.

3.4.10 Concrete Protection for Reinforcement

Additional concrete protection must be in accordance with the Contract Documents.

3.5 BATCHING, MEASURING, MIXING, AND TRANSPORTING CONCRETE

In accordance with ASTM C94/C94M, ACI 301, ACI 302.1R and ACI 304R, except as modified herein. Batching equipment must be such that the concrete ingredients are consistently measured within the following tolerances: 1 percent for cement and water, 2 percent for aggregate, and 3 percent for admixtures. Furnish mandatory batch ticket information for each load of

ready mix concrete.

3.5.1 Measuring

Make measurements at intervals as specified in paragraphs SAMPLING and TESTING.

3.5.2 Mixing

- a. Mix concrete in accordance with ASTM C94/C94M, ACI 301 and ACI 304R.
- b. Machine mix concrete. Begin mixing within 30 minutes after the cement has been added to the aggregates. Place concrete within 90 minutes of either addition of mixing water to cement and aggregates or addition of cement to aggregates. A retarder shall be used to facilitate placing and finishing when concrete temperature is 85 degrees F or greater.
- c. Dissolve admixtures in the mixing water and mix in the drum to uniformly distribute the admixture throughout the batch. Do not reconstitute concrete that has begun to solidify.
- d. When fibers are used, add fibers together with the aggregates and never as the first component in the mixer. Fibers must be dispensed into the mixing system using appropriate dispensing equipment and procedure as recommended by the manufacturer.

3.5.3 Transporting

Transport concrete from the mixer to the forms as rapidly as practicable. Prevent segregation or loss of ingredients. Clean transporting equipment thoroughly before each batch. Do not use aluminum pipe or chutes. Remove concrete which has segregated in transporting and dispose of as directed.

3.6 PLACING CONCRETE

Place concrete in accordance with ACI 301 Section 5. Concrete shall be placed within 15 minutes of discharge into non-agitating equipment.

3.6.1 Footing Placement

Concrete for footings may be placed in excavations without forms upon inspection and approval by the Contracting Officer. Excavation width must be a minimum of 4 inches greater than indicated.

3.6.2 Pumping

ACI 304R and ACI 304.2R. Pumping must not result in separation or loss of materials nor cause interruptions sufficient to permit loss of plasticity between successive increments. Loss of slump in pumping equipment must not exceed 2 inches at discharge/placement. Do not convey concrete through pipe made of aluminum or aluminum alloy. Avoid rapid changes in pipe sizes. Limit maximum size of coarse aggregate to 33 percent of the diameter of the pipe. Limit maximum size of well-rounded aggregate to 40 percent of the pipe diameter. Take samples for testing at both the point of delivery to the pump and at the discharge end.

3.6.3 Cold Weather

Cold weather concrete must meet the requirements of ACI 301 unless otherwise specified. Do not allow concrete temperature to decrease below 50 degrees F. Obtain approval prior to placing concrete when the ambient temperature is below 40 degrees F or when concrete is likely to be subjected to freezing temperatures within 24 hours. Cover concrete and provide sufficient heat to maintain 50 degrees F minimum adjacent to both the formwork and the structure while curing. Limit the rate of cooling to 37 degrees F in any one hour and 50 degrees F per 24 hours after heat application.

3.6.4 Hot Weather

Hot weather concrete must meet the requirements of ACI 301 unless otherwise specified. Maintain required concrete temperature using Figure 4.2 in ACI 305R to prevent the evaporation rate from exceeding 0.2 pound of water per square foot of exposed concrete per hour. Cool ingredients before mixing or use other suitable means to control concrete temperature and prevent rapid drying of newly placed concrete. Shade the fresh concrete as soon as possible after placing. Start curing when the surface of the fresh concrete is sufficiently hard to permit curing without damage. Provide water hoses, pipes, spraying equipment, and water hauling equipment, where job site is remote to water source, to maintain a moist concrete surface throughout the curing period. Provide burlap cover or other suitable, permeable material with fog spray or continuous wetting of the concrete when weather conditions prevent the use of either liquid membrane curing compound or impervious sheets. For vertical surfaces, protect forms from direct sunlight and add water to top of structure once concrete is set.

3.6.5 Bonding

Surfaces of set concrete at joints, must be roughened and cleaned of laitance, coatings, loose particles, and foreign matter. Roughen surfaces in a manner that exposes the aggregate uniformly and does not leave laitance, loosened particles of aggregate, nor damaged concrete at the surface.

Obtain bonding of fresh concrete that has set as follows:

- a. At joints between footings and walls or columns, between walls or columns and the beams or slabs they support, and elsewhere unless otherwise specified; roughened and cleaned surface of set concrete must be dampened, but not saturated, immediately prior to placing of fresh concrete.
- b. At joints in exposed-to-view work; at vertical joints in walls; at joints near midpoint of span in girders, beams, supported slabs, other structural members; in work designed to contain liquids; the roughened and cleaned surface of set concrete must be dampened but not saturated and covered with a cement grout coating.
- c. Provide cement grout that consists of equal parts of portland cement and fine aggregate by weight with not more than 6 gallons of water per sack of cement. Apply cement grout with a stiff broom or brush to a minimum thickness of 1/16 inch. Deposit fresh concrete before cement grout has attained its initial set.

3.7 WASTE MANAGEMENT

Provide as specified in the Waste Management Plan and as follows.

3.7.1 Mixing Equipment

Before concrete pours, designate Contractor-owned site meeting environmental standards for cleaning out concrete mixing trucks. Minimize water used to wash equipment.

3.7.2 Reinforcing Steel

Collect reinforcing steel and place in designated area for recycling.

3.7.3 Other Waste

Identify concrete manufacturer's or supplier's policy for collection or return of construction waste, unused material, deconstruction waste, and/or packaging material.

3.8 SURFACE FINISHES EXCEPT FLOOR, SLAB, AND PAVEMENT FINISHES

3.8.1 Defects

Repair surface defects in accordance with ACI 301 Section 5.

3.8.2 Formed Surfaces

3.8.2.1 Tolerances

Tolerances in accordance with ACI 117 and as indicated.

3.8.2.2 As-Cast Rough Form

Provide for surfaces not exposed to public view a surface finish SF-1.0. Patch holes and defects in accordance with ACI 301.

3.9 FLOOR, SLAB, AND PAVEMENT FINISHES AND MISCELLANEOUS CONSTRUCTION

In accordance with ACI 301 and ACI 302.1R, unless otherwise specified. Slope floors uniformly to drains where drains are provided. Depress the concrete base slab where quarry tile, ceramic tile, are indicated. Steel trowel and fine-broom finish concrete slabs that are to receive quarry tile, ceramic tile, or paver tile. Where straightedge measurements are specified, Contractor must provide straightedge.

3.9.1 Finish

Place, consolidate, and immediately strike off concrete to obtain proper contour, grade, and elevation before bleedwater appears. Permit concrete to attain a set sufficient for floating and supporting the weight of the finisher and equipment. If bleedwater is present prior to floating the surface, drag the excess water off or remove by absorption with porous materials. Do not use dry cement to absorb bleedwater. Grate tampers ("jitterbugs") shall not be used.

3.9.1.1 Scratched

Use for surfaces intended to receive bonded applied cementitious

applications. Finish concrete in accordance with ACI 301 Section 5 for a scratched finish.

3.9.1.2 Steel Troweled

Use for floors intended as walking surfaces for reception of floor coverings. Finish concrete in accordance with ACI 301 Section 5 for a steel troweled finish.

3.9.1.3 Nonslip Finish

Use on surfaces of exterior platforms, steps, and landings; and on exterior and interior pedestrian ramps. Finish concrete in accordance with ACI 301 Section 5 for a dry-shake finish. After the selected material has been embedded by the two floatings, complete the operation with a broomed finish.

3.9.1.4 Broomed

Use on surfaces of exterior walks, platforms, patios, and ramps, unless otherwise indicated. Finish concrete in accordance with ACI 301 Section 5 for a broomed finish.

3.9.2 Flat Floor Finishes

ACI 302.1R. Construct in accordance with one of the methods recommended in Table 10.15.3a, "Slab-on-ground flatness/levelness construction guide" or Table 10.15.3b, "Suspended slab flatness/levelness construction guide" appropriate for the type of construction. ACI 117 for tolerance tested by ASTM E1155.

a. Specified Conventional Value:

Floor Flatness (Ff) 20 minimum

Floor Levelness (FL) 15 minimum

b. Specified Industrial:

Floor Flatness (Ff) 30 minimum

Floor Levelness (FL) 20 minimum

3.9.2.1 Measurement of Floor Tolerances

Test slab within 24 hours of the final troweling. Provide tests to Contracting Officer within 12 hours after collecting the data. Floor flatness inspector is required to provide a tolerance report which must include:

a. Key plan showing location of data collected.

b. Results required by ASTM E1155.

3.9.2.2 Remedies for Out of Tolerance Work

Contractor is required to repair and retest any floors not meeting specified tolerances. Prior to repair, Contractor must submit and receive approval for the proposed repair, including product data from any

materials proposed. Repairs must not result in damage to structural integrity of the floor. For floors exposed to public view, repairs must prevent any uneven or unusual coloring of the surface.

3.9.3 Concrete Walks

Provide 4 inches thick minimum. Provide contraction joints spaced every 5 linear feet unless otherwise indicated. Cut contraction joints 1 inch deep, or one fourth the slab thickness whichever is deeper, with a jointing tool after the surface has been finished. Provide 0.5 inch thick transverse expansion joints at changes in direction where sidewalk abuts curb, steps, rigid pavement, or other similar structures; space expansion joints every 50 feet maximum. Give walks a broomed finish. Unless indicated otherwise, provide a transverse slope of 1/48. Limit variation in cross section to 1/4 inch in 5 feet.

3.10 JOINTS

3.10.1 Construction Joints

Make and locate joints not indicated so as not to impair strength and appearance of the structure, as approved. Joints must be perpendicular to main reinforcement. Reinforcement must be continued and developed across construction joints. Locate construction joints as follows:

3.10.1.1 Construction Joints for Constructability Purposes

- a. In walls, at top of footing; at top of slabs on ground; at top and bottom of door and window openings or where required to conform to architectural details; and at underside of deepest beam or girder framing into wall.
- b. In columns or piers, at top of footing; at top of slabs on ground; and at underside of deepest beam or girder framing into column or pier.
- c. Near midpoint of spans for supported slabs, beams, and girders unless a beam intersects a girder at the center, in which case construction joints in girder must offset a distance equal to twice the width of the beam. Make transfer of shear through construction joint by use of inclined reinforcement.

Provide keyways at least 1-1/2-inches deep in construction joints in walls and slabs and between walls and footings; approved bulkheads may be used for slabs.

3.10.2 Isolation Joints in Slabs on Ground

- a. Provide joints at points of contact between slabs on ground and vertical surfaces, such as column pedestals, foundation walls, grade beams, and elsewhere as indicated.
- b. Fill joints with premolded joint filler strips 1/2 inch thick, extending full slab depth. Install filler strips at proper level below finish floor elevation with a slightly tapered, dress-and-oiled wood strip temporarily secured to top of filler strip to form a groove not less than 3/4 inch in depth where joint is sealed with sealing compound and not less than 1/4 inch in depth where joint sealing is not required. Remove wood strip after concrete has set. Contractor must clean groove of foreign matter and loose particles after surface

has dried.

3.10.3 Contraction Joints in Slabs on Ground

- a. Provide joints to form panels as indicated.
- b. Under and on exact line of each control joint, cut 50 percent of welded wire reinforcement before placing concrete.
- c. Sawcut contraction joints into slab on ground in accordance with ACI 301 Section 5.
- d. Joints must be 1/8-inch wide by 1/5 to 1/4 of slab depth and formed by inserting hand-pressed fiberboard strip into fresh concrete until top surface of strip is flush with slab surface. After concrete has cured for at least 7 days, the Contractor must remove inserts and clean groove of foreign matter and loose particles.
- e. Sawcutting will be limited to within 12 hours after set and at 1/4 slab depth.

3.10.4 Sealing Joints in Slabs on Ground

- a. Contraction and control joints which are to receive finish flooring material must be sealed with joint sealing compound after concrete curing period. Slightly underfill groove with joint sealing compound to prevent extrusion of compound. Remove excess material as soon after sealing as possible.
- b. Sealed groove must be left ready to receive filling material that is provided as part of finish floor covering work.

3.11 CURING AND PROTECTION

Curing and protection in accordance with ACI 301 Section 5, unless otherwise specified. Begin curing immediately following form removal. Avoid damage to concrete from vibration created by blasting, pile driving, movement of equipment in the vicinity, disturbance of formwork or protruding reinforcement, and any other activity resulting in ground vibrations. Protect concrete from injurious action by sun, rain, flowing water, frost, mechanical injury, tire marks, and oil stains. Do not allow concrete to dry out from time of placement until the expiration of the specified curing period. Do not use membrane-forming compound on surfaces where appearance would be objectionable, on any surface to be painted, where coverings are to be bonded to the concrete, or on concrete to which other concrete is to be bonded. If forms are removed prior to the expiration of the curing period, provide another curing procedure specified herein for the remaining portion of the curing period. Provide moist curing for those areas receiving liquid chemical sealer, hardener, or epoxy coating. Allow curing compound/sealer installations to cure prior to the installation of materials that adsorb VOCs, including .

3.11.1 Requirements for Type III, High-Early-Strength Portland Cement

The curing periods are required to be not less than one-fourth of those specified for portland cement, but in no case less than 72 hours.

3.11.2 Curing Periods

ACI 301 Section 5, except 10 days for retaining walls, pavement or chimneys. Begin curing immediately after placement. Protect concrete from premature drying, excessively hot temperatures, and mechanical injury; and maintain minimal moisture loss at a relatively constant temperature for the period necessary for hydration of the cement and hardening of the concrete. The materials and methods of curing are subject to approval by the Contracting Officer.

3.11.3 Curing Formed Surfaces

Accomplish curing of formed surfaces, including undersurfaces of girders, beams, supported slabs, and other similar surfaces by moist curing with forms in place for full curing period or until forms are removed. If forms are removed before end of curing period, accomplish final curing of formed surfaces by any of the curing methods specified above, as applicable.

3.11.4 Curing Unformed Surfaces

- a. Accomplish initial curing of unformed surfaces, such as monolithic slabs, floor topping, and other flat surfaces, by membrane curing.
- b. Accomplish final curing of unformed surfaces by any of curing methods specified, as applicable.
- c. Accomplish final curing of concrete surfaces to receive liquid floor hardener of finish flooring by moisture-retaining cover curing.

3.11.5 Temperature of Concrete During Curing

When temperature of atmosphere is 41 degrees F and below, maintain temperature of concrete at not less than 55 degrees F throughout concrete curing period or 45 degrees F when the curing period is measured by maturity. When necessary, make arrangements before start of concrete placing for heating, covering, insulation, or housing as required to maintain specified temperature and moisture conditions for concrete during curing period.

When the temperature of atmosphere is 80 degrees F and above or during other climatic conditions which cause too rapid drying of concrete, make arrangements before start of concrete placing for installation of wind breaks, of shading, and for fog spraying, wet sprinkling, or moisture-retaining covering of light color as required to protect concrete during curing period.

Changes in temperature of concrete must be uniform and not exceed 37 degrees F in any one hour nor 80 degrees F in any 24-hour period.

3.11.6 Protection from Mechanical Injury

During curing period, protect concrete from damaging mechanical disturbances, particularly load stresses, heavy shock, and excessive vibration and from damage caused by rain or running water.

3.11.7 Protection After Curing

Protect finished concrete surfaces from damage by construction operations.

3.12 FIELD QUALITY CONTROL

3.12.1 Aggregate Testing

3.12.1.1 Fine Aggregate

At least once during each shift when the concrete plant is operating, there shall be one sieve analysis and fineness modulus determination in accordance with ASTM C136/C136M and COE CRD-C 104 for the fine aggregate or for each fine aggregate if it is batched in more than one size or classification. The location at which samples are taken may be selected by the Contractor as the most advantageous for control. However, the Contractor is responsible for delivering fine aggregate to the mixer within specification limits. When the amount passing on any sieve is outside the specification limits, the fine aggregate shall be immediately resampled and retested. If there is another failure on any sieve, the fact shall be immediately reported to the Contracting Officer, concreting shall be stopped, and immediate steps taken to correct the grading.

3.12.1.2 Coarse Aggregate

At least once during each shift in which the concrete plant is operating, there shall be a sieve analysis in accordance with ASTM C136/C136M for each size of coarse aggregate. The location at which samples are taken may be selected by the Contractor as the most advantageous for production control. However, the Contractor shall be responsible for delivering the aggregate to the mixer within specification limits. A test record of samples of aggregate taken at the same locations shall show the results of the current test as well as the average results of the five most recent tests including the current test. The Contractor may adopt limits for control coarser than the specification limits for samples taken other than as delivered to the mixer to allow for degradation during handling. When the amount passing any sieve is outside the specification limits, the coarse aggregate shall be immediately resampled and retested. If the second sample fails on any sieve, that fact shall be reported to the Contracting Officer. Where two consecutive averages of 5 tests are outside specification limits, the operation shall be considered out of control and reported to the Contracting Officer. Concreting shall be stopped and immediate steps shall be taken to correct the grading.

3.12.2 Concrete Sampling

ASTM C172/C172M. Collect samples of fresh concrete to perform tests specified. ASTM C31/C31M for making test specimens.

3.12.3 Concrete Testing

3.12.3.1 Slump Tests

ASTM C143/C143M. Take concrete samples during concrete placement/discharge. The maximum slump may be increased as specified with the addition of an approved admixture provided that the water-cementitious material ratio is not exceeded. Perform tests at commencement of concrete placement, when test cylinders are made, and for each 20 cubic yards (maximum) of concrete.

3.12.3.2 Temperature Tests

Test the concrete delivered and the concrete in the forms. Perform tests in hot or cold weather conditions (below 50 degrees F and above 80 degrees F) for each batch (minimum) or every 20 cubic yards (maximum) of concrete, until the specified temperature is obtained, and whenever test cylinders and slump tests are made.

3.12.3.3 Compressive Strength Tests

ASTM C39/C39M. Make six 6 inch by 12 inch or nine 4 inch by 8 inch test cylinders for each set of tests in accordance with ASTM C31/C31M, ASTM C172/C172M and applicable requirements of ACI 305R and ACI 306R. Take precautions to prevent evaporation and loss of water from the specimen. Test two 6 inch by 12 inch or three 4 inch by 8 inch cylinders at 7 days, two 6 inch by 12 inch or three 4 inch by 8 inch cylinders at 28 days, two 6 inch by 12 inch or three 4 inch by 8 inch cylinders at 56 days. Take samples for strength tests for each concrete mixture placed each day not less than once a day, nor less than once for each 150 cubic yards of concrete, nor less than once for each 5000 square feet of surface area for slabs or walls. For the entire project, take no less than five sets of samples and perform strength tests for each mix design of concrete placed. Each strength test result must be the average of two 6 inch by 12 inch or three 4 inch by 8 inch cylinders from the same concrete sample tested at 28 days. Concrete compressive tests must meet the requirements of this section, the Contract Document, and ACI 301.

3.12.3.4 Air Content

ASTM C173/C173M or ASTM C231/C231M for normal weight concrete. Test air-entrained concrete for air content at the same frequency as specified for slump tests.

3.12.3.5 Strength of Concrete Structure

The strength of the concrete structure will be considered to be deficient if any of the following conditions are identified:

- a. Failure to meet compressive strength tests as evaluated.
- b. Reinforcement not conforming to requirements specified.
- c. Concrete which differs from required dimensions or location in such a manner as to reduce strength.
- d. Concrete curing and protection of concrete against extremes of temperature during curing, not conforming to requirements specified.
- e. Concrete subjected to damaging mechanical disturbances, particularly load stresses, heavy shock, and excessive vibration.
- f. Poor workmanship likely to result in deficient strength.

Where the strength of the concrete structure is considered deficient submit a mitigation or remediation plan for review and approval by the contracting officer.

3.12.3.6 Non-Conforming Materials

Factors that indicate that there are non-conforming materials include (but not limited to) excessive compressive strength, inadequate compressive strength, excessive slump, excessive voids and honeycombing, concrete delivery records that indicate excessive time between mixing and placement, or excessive water was added to the mixture during delivery and placement. Any of these indicators alone are sufficient reason for the Contracting Officer to request additional sampling and testing.

Investigations into non-conforming materials must be conducted at the Contractor's expense. The Contractor must be responsible for the investigation and must make written recommendations to adequately mitigate or remediate the non-conforming material. The Contracting Officer may accept, accept with reduced payment, require mitigation, or require removal and replacement of non-conforming material at no additional cost to the Government.

3.12.3.7 Testing Concrete Structure for Strength

When there is evidence that strength of concrete structure in place does not meet specification requirements or there are non-conforming materials, make cores drilled from hardened concrete for compressive strength determination in accordance with ASTM C42/C42M, and as follows:

- a. Take at least three representative cores from each member or area of concrete-in-place that is considered potentially deficient. Location of cores will be determined by the Contracting Officer.
- b. Test cores after moisture conditioning in accordance with ASTM C42/C42M if concrete they represent is more than superficially wet under service.
- c. Air dry cores, (60 to 80 degrees F with relative humidity less than 60 percent) for 7 days before test and test dry if concrete they represent is dry under service conditions.
- d. Strength of cores from each member or area are considered satisfactory if their average compressive strength is equal to or greater than 85 percent of the design compressive strength, and if no single core strength is less than 75 percent of the design compressive strength. Additional testing of cores extracted from locations represented by erratic core strength results will be permitted only when approved by the Contracting Officer.

Fill core holes solid with patching mortar and finished to match adjacent concrete surfaces.

Correct concrete work that is found inadequate by core tests in a manner approved by the Contracting Officer.

3.13 REPAIR, REHABILITATION AND REMOVAL

Before the Contracting Officer accepts the structure the Contractor must inspect the structure for cracks, damage and substandard concrete placements that may adversely affect the service life of the structure. A report documenting these defects must be prepared which includes recommendations for repair, removal or remediation must be submitted to the Contracting Officer for approval before any corrective work is

accomplished.

3.13.1 Crack Repair

Prior to final acceptance, all cracks in excess of 0.02 inches wide must be documented and repaired. The proposed method and materials to repair the cracks must be submitted to the Contracting Officer for approval. The proposal must address the amount of movement expected in the crack due to temperature changes and loading.

3.13.2 Repair of Weak Surfaces

Weak surfaces are defined as mortar-rich, rain-damaged, uncured, or containing exposed voids or deleterious materials. Concrete surfaces with weak surfaces less than 1/4 inch thick must be diamond ground to remove the weak surface. Surfaces containing weak surfaces greater than 1/4 inch thick must be removed and replaced or mitigated in a manner acceptable to the Contracting Officer.

3.13.3 Failure of Quality Assurance Test Results

Proposed mitigation efforts by the Contractor must be approved by the Contracting Officer prior to proceeding.

-- End of Section --

SECTION 04 20 00

UNIT MASONRY

11/15, CHG 2: 05/19

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN CONCRETE INSTITUTE (ACI)

ACI SP-66 (2004) ACI Detailing Manual

ASTM INTERNATIONAL (ASTM)

ASTM A153/A153M (2023) Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware

ASTM A185/A185M (2007) Standard Specification for Steel Welded Wire Reinforcement, Plain, for Concrete

ASTM A615/A615M (2022) Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement

ASTM A641/A641M (2019) Standard Specification for Zinc-Coated (Galvanized) Carbon Steel Wire

ASTM A653/A653M (2023) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process

ASTM A951/A951M (2011) Standard Specification for Steel Wire for Masonry Joint Reinforcement

ASTM A996/A996M (2016) Standard Specification for Rail-Steel and Axle-Steel Deformed Bars for Concrete Reinforcement

ASTM A1008/A1008M (2023) Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable

ASTM A1064/A1064M (2022) Standard Specification for Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete

ASTM C90 (2023) Standard Specification for

Loadbearing Concrete Masonry Units

ASTM C129	(2023) Standard Specification for Nonloadbearing Concrete Masonry Units
ASTM C207	(2018) Standard Specification for Hydrated Lime for Masonry Purposes
ASTM C270	(2019a; E 2019) Standard Specification for Mortar for Unit Masonry
ASTM C476	(2023) Standard Specification for Grout for Masonry
ASTM C494/C494M	(2019; E 2022) Standard Specification for Chemical Admixtures for Concrete
ASTM C641	(2023) Standard Test Method for Iron Staining Materials in Lightweight Concrete Aggregates
ASTM C780	(2023) Standard Test Method for Preconstruction and Construction Evaluation of Mortars for Plain and Reinforced Unit Masonry
ASTM C1019	(2019) Standard Test Method for Sampling and Testing Grout
ASTM C1384	(2012a) Standard Specification for Admixtures for Masonry Mortars
ASTM C1611/C1611M	(2021) Standard Test Method for Slump Flow of Self-Consolidating Concrete
ASTM D2000	(2018) Standard Classification System for Rubber Products in Automotive Applications
ASTM D2287	(2019) Nonrigid Vinyl Chloride Polymer and Copolymer Molding and Extrusion Compounds
ASTM E514/E514M	(2020) Standard Test Method for Water Penetration and Leakage Through Masonry

THE MASONRY SOCIETY (TMS)

TMS MSJC	(2016) Masonry Standard Joint Committee's (MSJC) Book - Building Code Requirements and Specification for Masonry Structures, Containing TMS 402/ACI 530/ASCE 5, TMS 602/ACI 530.1/ASCE 6, and Companion Commentaries
----------	--

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

C

Reinforcement Detail Drawings; G

SD-03 Product Data

Hot Weather Procedures; G

Cold Weather Procedures; G

Cement; G

Cementitious Materials; G

SD-04 Samples

Admixtures for Masonry Mortar; G

Anchors, Ties, and Bar Positioners; G

Joint Reinforcement; G

SD-05 Design Data

Masonry Compressive Strength; G

Bracing Calculations; G

SD-06 Test Reports

Field Testing of Mortar

Field Testing of Grout

Prism Tests

SD-07 Certificates

Special Masonry Inspector Qualifications

Concrete Masonry Units (CMU)

Concrete Brick

Precast Concrete Units

Cementitious Materials

Admixtures for Masonry Mortar

Admixtures for Grout

Anchors, Ties, and Bar Positioners

Joint Reinforcement

SD-08 Manufacturer's Instructions

Admixtures for Masonry Mortar

Admixtures for Grout

SD-10 Operation and Maintenance Data

Take-Back Program

SD-11 Closeout Submittals

Recycled Content of Cement; S

1.3 QUALITY ASSURANCE

1.3.1 Special Masonry Inspector Qualifications

Refer to Section 01 45 35 SPECIAL INSPECTIONS for qualifications and responsibilities of the masonry special inspector.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver, store, handle, and protect material to avoid chipping, breakage, and contact with soil or contaminating material. Store and prepare materials in already disturbed areas to minimize project site disturbance and size of project site.

1.4.1 Masonry Units

Cover and protect masonry units from precipitation. Conform to handling and storage requirements of TMS MSJC.

- a. Mark prefabricated lintels on top sides to show either the lintel schedule number or the number and size of top and bottom bars.

1.4.2 Reinforcement, Anchors, and Ties

Store steel reinforcing bars, coated anchors, ties, and joint reinforcement above the ground. Maintain steel reinforcing bars and uncoated ties free of loose mill scale and loose rust.

1.4.3 Cementitious Materials, Sand and Aggregates

Deliver cementitious and other packaged materials in unopened containers, plainly marked and labeled with manufacturers' names and brands. Store cementitious material in dry, weathertight enclosures or completely cover. Handle cementitious materials in a manner that will prevent the inclusion of foreign materials and damage by water or dampness. Store sand and aggregates in a manner to prevent contamination and segregation.

1.5 PROJECT/SITE CONDITIONS

Conform to TMS MSJC for hot and cold weather masonry erection.

1.5.1 Hot Weather Procedures

When ambient air temperature exceeds 100 degrees F, or exceeds 90 degrees F

and the wind velocity is greater than 8 mph, comply with TMS MSJC Article 1.8 D for: preparation prior to conducting masonry work; construction while masonry work is in progress; and protection for newly completed masonry.

1.5.2 Cold Weather Procedures

When ambient temperature is below 40 degrees F, comply with TMS MSJC Article 1.8 C for: preparation prior to conducting masonry work; construction while masonry work is in progress; and protection for newly completed masonry.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

2.1.1 Design - Specified Compressive Strength of Masonry

The specified compressive strength of masonry, f'_m , is as indicated on the drawings.

2.1.2 Performance - Verify Masonry Compressive Strength

Verify specified compressive strength of masonry using the "Unit Strength Method" of TMS MSJC. Submit calculations and certifications of unit and mortar strength.

Verify specified compressive strength of masonry using the "Prism Test Method" of TMS MSJC when the "Unit Strength Method" cannot be used. Submit test results.

2.2 MANUFACTURED UNITS

2.2.1 General Requirements

Do not change the source of materials, which will affect the appearance of the finished work, after the work has started except with Contracting Officer's approval. Submit test reports from an approved independent laboratory. Certify test reports on a previously tested material as the same materials as that proposed for use in this project. Submit certificates of compliance stating that the materials meet the specified requirements.

2.2.2 Concrete Units

2.2.2.1 Aggregates

Test lightweight aggregates, and blends of lightweight and heavier aggregates in proportions used in producing the units, for stain-producing iron compounds in accordance with ASTM C641, visual classification method. Do not incorporate aggregates for which the iron stain deposited on the filter paper exceeds the "light stain" classification.

2.2.2.2 Concrete Masonry Units (CMU)

2.2.2.2.1 Cement

Use only cement that has a low alkali content and is of one brand.

2.2.2.2.2 Size

Provide units with specified dimension of as indicated inches wide, 8 inches high, and 16 inches long.

2.2.2.2.3 Surfaces

2.2.2.2.4 Weather Exposure

Provide concrete masonry units with water-repellant admixture added during manufacture where units will be exposed to weather.

2.2.2.2.5 Unit Types

- a. Hollow Load-Bearing Units: ASTM C90, lightweight . Provide load-bearing units for exterior walls, foundation walls, load-bearing walls, and shear walls.
- b. Hollow Non-Load-Bearing Units: ASTM C129, lightweight . Load-bearing units may be provided in lieu of non-load-bearing units.
- c. Solid Load-Bearing Units: ASTM C90, lightweight units. Provide solid units as indicated.

2.2.2.2.6 Jamb Units

Provide jamb units of the shapes and sizes to conform with wall units. Solid units may be incorporated in the masonry work where necessary to fill out at corners, gable slopes, and elsewhere as approved.

Provide sash jamb units with a 3/4 by 3/4 inch groove near the center at end of each unit.

2.3 EQUIPMENT

2.3.1 Vibrators

Maintain at least one spare vibrator on site at all times.

2.3.2 Grout Pumps

Pumping through aluminum tubes is not permitted.

2.4 MATERIALS

2.4.1 Mortar Materials

2.4.1.1 Cementitious Materials

Provide cementitious materials that conform to those permitted by ASTM C270.

2.4.1.2 Hydrated Lime and Alternates

Provide lime that conforms to one of the materials permitted by ASTM C207 for use in combination with portland cement, hydraulic cement, and blended hydraulic cement. Do not use lime in combination with masonry cement or mortar cement.

2.4.1.3 Admixtures for Masonry Mortar

In cold weather, use a non-chloride based accelerating admixture that conforms to ASTM C1384, unless Type III portland cement is used in the mortar.

In showers and kitchens, use mortar that contains a water-repellent admixture that conforms to ASTM C1384. Provide a water-repellent admixture, conforming to ASTM C1384 and of the same brand and manufacturer as the block's integral water-repellent, in the mortar used to place concrete masonry units that have an integral water-repellent admixture.

2.4.1.4 Aggregate and Water

Provide aggregate (sand) and water that conform to materials permitted by ASTM C270.

2.4.2 Grout and Ready-Mix Grout Materials

2.4.2.1 Cementitious Materials for Grout

Provide cementitious materials that conform to those permitted by ASTM C476.

2.4.2.2 Admixtures for Grout

Water-reducing admixtures that conform to ASTM C494/C494M Type F or G and viscosity-modifying admixtures that conform to ASTM C494/C494M Type S are permitted for use in grout. Other admixtures require approval by the Contracting Officer.

In cold weather, a non-chloride based accelerating admixture may be used subject to approval by the Contracting Officer; use accelerating admixture that is non-corrosive and conforms to ASTM C494/C494M, Type C.

2.4.2.3 Aggregate and Water

Provide fine and coarse aggregates and water that conform to materials permitted by ASTM C476.

2.5 MORTAR AND GROUT MIXES

2.5.1 Mortar Mix

- a. Provide mortar Type S or M unless specified otherwise herein. Do not use masonry cement in the mortar. Do not use air-entrainment in the mortar.
- b.
- . For field-batched mortar, measure component materials by volume. Use measuring boxes for materials that do not come in packages, such as sand, for consistent batching. Mix cementitious materials and aggregates between 3 and 5 minutes in a mechanical batch mixer with a sufficient amount of water to produce a workable consistency. Do not hand mix mortar unless approved by the Contracting Officer. Maintain workability of mortar by remixing or retempering. Discard mortar that has begun to stiffen or is not used within 2-1/2 hours after initial mixing.

- . For preblended mortar, follow manufacturer's mixing instructions.

2.5.2 Grout and Ready Mix Grout Mix

Use grout that conforms to ASTM C476, coarse. Use conventional grout with a slump between 8 and 11 inches. Use self-consolidating grout with slump flow of 24 to 30 inches and a visual stability index (VSI) not greater than 1. Provide minimum grout strength of 2000 psi in 28 days, as tested in accordance with ASTM C1019. Do not change proportions and do not use materials with different physical or chemical characteristics in grout for the work unless additional evidence is furnished that grout meets the specified requirements. Use ready-mixed grout that conforms to ASTM C476.

2.6 ACCESSORIES

2.6.1 Grout Barriers

Grout barriers for vertical cores that consist of fine mesh wire, fiberglass, or expanded metal.

2.6.2 Anchors, Ties, and Bar Positioners

2.6.2.1 General

- a. Fabricate anchors and ties without drips or crimps. Size anchors and ties to provide a minimum of 5/8 inch mortar cover from each face of masonry.
- b. Fabricate steel wire anchors and ties from wire conforming to ASTM A1064/A1064M and hot-dip galvanize in accordance with ASTM A153/A153M.
- c. Fabricate joint reinforcement in conformance with ASTM A951/A951M. Hot dip galvanize joint reinforcement in exterior walls and in interior walls exposed to moist environment in conformance with ASTM A153/A153M. Galvanize joint reinforcement in other interior walls in conformance with ASTM A641/A641M; coordinate with paragraph JOINT REINFORCEMENT below.
- d. Fabricate sheet metal anchors and ties in conformance with ASTM A1008/A1008M. Hotdip galvanize sheet metal anchors and ties in exterior walls and in interior walls exposed to moist environment in compliance with ASTM A153/A153M Class B. Galvanize sheet metal anchors and ties in other interior walls in compliance with ASTM A653/A653M, Coating Designation G60.
- e. Submit two anchors, ties and bar positioners of each type used, as samples.

2.6.2.2 Wire Mesh Anchors

Provide wire mesh anchors of 1/4 inch mesh galvanized hardware cloth, conforming to ASTM A185/A185M, with length not less than 12 inches, at intersections of interior non-bearing masonry walls.

2.6.2.3 Bar Positioners

Factory-fabricate bar positioners, used to prevent displacement of reinforcing bars during the course of construction, from 9 gauge steel wire or equivalent, and hot-dip galvanized. Bar positioners must be suitable for intended use and be corrosion resistant steel. Bar positioners not fully contained within the wythe must be hot-dip galvanized.

2.6.3 Joint Reinforcement

Factory fabricate joint reinforcement in conformance with ASTM A951/A951M, welded construction. Provide ladder type joint reinforcement, having one longitudinal wire in the mortar bed of each face shell for hollow units and one wire for solid units and with all wires a minimum of 9 gauge. Size joint reinforcement to provide a minimum of 5/8 inch cover from each face. Space crosswires not more than 16 inches. Provide joint reinforcement for straight runs in flat sections not less than 10 feet long. Provide joint reinforcement with factory formed corners and intersections. If approved for use, joint reinforcement may be furnished with adjustable wall tie features. Submit one piece of each type used, including corner and wall intersection pieces, showing at least two cross wires.

2.6.4 Reinforcing Steel Bars

Provide reinforcing steel bars and rods conforming to ASTM A615/A615M or ASTM A996/A996M, Grade 60.

2.6.5 Concrete Masonry Control Joint Keys

Provide control joint keys of a factory fabricated solid section of natural or synthetic rubber (or combination thereof) conforming to ASTM D2000 M2AA-805 with a minimum durometer hardness of 80 or polyvinyl chloride conforming to ASTM D2287 Type PVC 654-4 with a minimum durometer hardness of 85. Form the control joint key with a solid shear section not less than 5/8 inch thick and 3/8 inch thick flanges, with a tolerance of plus or minus 1/16 inch, to fit neatly, but without forcing, in masonry unit jamb sash grooves.

PART 3 EXECUTION

3.1 EXAMINATION

Prior to start of work, verify the applicable conditions as set forth in TMS MSJC, inspection.

3.2 PREPARATION

3.2.1 Stains

Protect exposed surfaces from mortar and other stains. When mortar joints are tooled, remove mortar from exposed surfaces with fiber brushes and wooden paddles. Protect base of walls from splash stains by covering adjacent ground with sand, sawdust, or polyethylene.

3.2.2 Loads

Do not apply uniform loads for at least 12 hours or concentrated loads for at least 72 hours after masonry is constructed. Provide temporary bracing as required.

3.2.3 Concrete Surfaces

Where masonry is to be placed, clean concrete of laitance, dust, dirt, oil, organic matter, or other foreign materials and slightly roughen to provide a surface texture with a depth of at least 1/8 inch. Sandblast, if necessary, to remove laitance from pores and to expose the aggregate.

3.2.4 Bracing

Provide bracing and scaffolding necessary for masonry work. Design bracing to resist wind pressure as required by OSHA and local codes and submit bracing calculations, sealed by a registered professional engineer. Do not remove bracing in less than 10 days.

3.3 ERECTION

3.3.1 General

- a. Coordinate masonry work with the work of other trades to accommodate built-in items and to avoid cutting and patching. Lay masonry units in running bond pattern. Lay facing courses level with back-up courses, unless the use of adjustable ties has been approved in which case the tolerances is plus or minus 1/2 inch. Adjust each unit to its final position while mortar is still soft and has plastic consistency.
- b. Remove and clean units that have been disturbed after the mortar has stiffened, and relay with fresh mortar. Keep air spaces, cavities, chases, expansion joints, and spaces to be grouted free from mortar and other debris. Select units to be used in exposed masonry surfaces from those having the least amount of chipped edges or other imperfections detracting from the appearance of the finished work.
- c. When necessary to temporarily discontinue the work, step (rack) back the masonry for joining when work resumes. Tothing may be used only when specifically approved by the Contracting Officer. Before resuming work, remove loose mortar and thoroughly clean the exposed joint. Cover the top of walls subjected to rain or snow with nonstaining waterproof covering or membrane when work is not in process. Extend the covering a minimum of 610 mm 2 feet down on each side of the wall and hold securely in place.
- d. Ensure that units being laid and surfaces to receive units are free of water film and frost. Lay solid units in a nonfurrowed full bed of mortar. Shove units into place so that the vertical joints are tight. Completely fill vertical joints between solid units with mortar, except where indicated at control, expansion, and isolation joints. Place hollow units so that mortar extends to the depth of the face shell at heads and beds, unless otherwise indicated. Mortar will be permitted to protrude up to 1/2 inch into the space or cells to be grouted. Provide means to prevent mortar from dropping into the space below or clean grout spaces prior to grouting.

3.3.1.1 Jointing

Tool mortar joints when the mortar is thumbprint hard. Tool horizontal joints after tooling vertical joints. Brush mortar joints to remove loose and excess mortar.

3.3.1.1.1 Tooled Joints

Tool mortar joints in exposed exterior and interior masonry surfaces concave , using a jointer that is slightly larger than the joint width so that complete contact is made along the edges of the unit. Perform tooling so that the mortar is compressed and the joint surface is sealed. Use a jointer of sufficient length to obtain a straight and true mortar joint. No exterior joints are to be left un-tooled.

3.3.1.1.2 Flush Joints

Flush cut mortar joints in concealed masonry surfaces and joints at electrical outlet boxes in wet areas. Finish flush cut joints by cutting off the mortar flush with the face of the wall. Point joints in unparged masonry walls below grade tight. For architectural units, such as fluted units, completely fill both the head and bed joints and flush cut.

3.3.1.1.3 Door and Window Frame Joints

On the exposed interior side of exterior frames, rake joints between frames and abutting masonry walls to a depth of 3/8 inch. On the exterior side of exterior frames, rake joints between frames and abutting masonry walls to a depth of 3/8 inch.

3.3.1.1.4 Joint Widths

- a. Provide 3/8 inch wide mortar joints in concrete masonry, except for prefaced concrete masonry units.
- b. Provide 3/8 inch wide mortar joints on unfaced side of prefaced concrete masonry units and not less than 3/16 inch nor more than 1/4 inch wide on prefaced side.
- c. Maintain mortar joint widths within tolerances permitted by TMS MSJC

3.3.1.2 Cutting and Fitting

Use full units of the proper size wherever possible, in lieu of cut units. Locate cut units where they would have the least impact on the architectural aesthetic goals of the facility. Perform cutting and fitting, including that required to accommodate the work of others, by masonry mechanics using power masonry saws. Concrete masonry units may be wet or dry cut. Before being placed in the work, dry wet-cut units to the same surface-dry appearance as uncut units being laid in the wall. Provide cut edges that are clean, true and sharp.

- a. Carefully make openings in the masonry so that wall plates, cover plates or escutcheons required by the installation will completely conceal the openings and will have bottoms parallel with the masonry

bed joints. Provide reinforced masonry lintels above openings over 12 inches wide for pipes, ducts, cable trays, and other wall penetrations, unless steel sleeves are used.

- b. Do not reduce masonry units in size by more than one-third in height and one-half in length. Do not locate cut products at ends of walls, corners, and other openings.

3.3.1.3 Unfinished Work

Rack back unfinished work for joining with new work. Tothing may be resorted to only when specifically approved by the Contracting Officer. Remove loose mortar and thoroughly clean the exposed joints before laying new work.

3.3.1.4 Control Joints

Provide control joints in concrete masonry as indicated. Construct by using sash jamb units with control joint key in accordance with the details shown on the Drawings. Form a continuous vertical joint at control joint locations, including through bond beams, by utilizing half blocks in alternating courses on each side of the joint. Interrupt the control joint key in courses containing continuous bond beam reinforcement. Do not interrupt the horizontal reinforcement and grout at the control joint.

Where mortar was placed in the joint, rake both faces of the control joints to a depth of 3/4 inch. Install backer rod and sealant on both faces in accordance with Section 07 92 00 JOINT SEALANTS.

3.3.2 Reinforced, Single Wythe Concrete Masonry Units Walls

3.3.2.1 Concrete Masonry Unit Placement

- a. Fully bed units used to form piers, pilasters, columns, starting courses on footings, solid foundation walls, lintels, and beams, and where cells are to be filled with grout in mortar under both face shells and webs. Provide mortar beds under both face shells for other units. Mortar head joints for a distance in from the face of the unit not less than the thickness of the face shell.
- b. Solidly grout foundation walls below grade.
- c. Stiffen double walls at wall-mounted plumbing fixtures by use of strap anchors, two above each fixture and two below each fixture, located to avoid pipe runs, and extending from center to center of each wall within the double wall. Adequately reinforce walls and partitions for support of wall-hung plumbing fixtures when chair carriers are not specified.
- d. Submit drawings showing elevations of walls exposed to view and indicating the location of all cut CMU products.

3.3.2.2 Preparation for Reinforcement

Lay units in such a manner as to preserve the unobstructed vertical continuity of cores to be grouted. Remove mortar protrusions extending 1/2 inch or more into cells before placing grout. Position reinforcing bars accurately as indicated before placing grout. Where vertical

reinforcement occurs, fill cores solid with grout in accordance with paragraph PLACING GROUT in this Section.

3.3.3 ANCHORAGE

3.3.3.1 Anchorage to Concrete

Anchor masonry to the face of concrete columns, beams, or walls with dovetail anchors spaced not over 16 inches on centers vertically and 24 inches on center horizontally.

3.3.3.2 Anchorage to Structural Steel

Anchor masonry to vertical structural steel framing with adjustable steel wire anchors spaced not over 16 inches on centers vertically, and if applicable, not over 24 inches on centers horizontally.

3.3.3.3 Anchorage at Intersecting Walls

Provide wire mesh anchors at maximum 16 inches spacing at intersections of interior non-bearing masonry walls.

Anchor structural masonry walls with , unless the drawings indicate a movement joint at the intersection.

3.3.4 Lintels

3.3.4.1 Masonry Lintels

Construct masonry lintels with lintel units filled solid with grout in all courses and reinforced with a minimum of two No. 4 bars in the bottom course unless otherwise indicated. Extend lintel reinforcement beyond each side of masonry opening 40 bar diameters or 24 inches, whichever is greater. Support reinforcing bars in place prior to grouting and locate 1/2 inch above the bottom inside surface of the lintel unit.

3.3.4.2 Precast Concrete and Steel Lintels

Provide precast concrete and steel lintels as shown on the Drawings. Set lintels in a full bed of mortar with faces plumb and true. Provide steel and precast lintels with a minimum bearing length of 8 inches unless otherwise indicated. In partially grouted masonry, provide fully grouted units under the full lintel bearing length, unless otherwise indicated.

3.3.5 Sills and Copings

Set sills and copings in a full bed of mortar with faces plumb and true. Slope sills and copings to drain water. Mechanically anchor copings and sills longer than 4 feet as indicated.

3.4 INSTALLATION

3.4.1 Bar Reinforcement Installation

3.4.1.1 Preparation

Submit detail drawings showing bar splice locations. Identify bent bars on a bending diagram and reference and locate such bars on the drawings. Show wall dimensions, bar clearances, and wall openings. Utilize bending

details that conform to the requirements of ACI SP-66. No approval will be given to the shop drawings until the Contractor certifies that all openings, including those for mechanical and electrical service, are shown. If, during construction, additional masonry openings are required, resubmit the approved shop drawings with the additional openings shown along with the proposed changes. Clearly highlight location of these additional openings. Provide wall elevation drawings with minimum scale of 1/4 inch per foot. Submit drawings including plans, elevations, and details of wall reinforcement; details of reinforcing bars at corners and wall intersections; offsets; tops, bottoms, and ends of walls; control and expansion joints; lintels; and wall openings.

Clean reinforcement of loose, flaky rust, scale, grease, mortar, grout, and other coatings that might destroy or reduce its bond prior to placing grout. Do not use bars with kinks or bends not shown on the approved shop drawings. Place reinforcement prior to grouting. Unless otherwise indicated, extend vertical wall reinforcement to within 2 inches of tops of walls.

3.4.1.2 Positioning Bars

- a. Accurately place vertical bars within the cells at the positions indicated on the drawings. Maintain a minimum clearance of 1/2 inch between the bars and masonry units. Provide minimum clearance between parallel bars of 1/2 inch between the bars and masonry units for coarse grout and a minimum clearance of 1/4 inch between the bars and masonry units for fine grout. Provide minimum clearance between parallel bars of 1 inch or one diameter of the reinforcement, whichever is greater. Vertical reinforcement may be held in place using bar positioners located near the ends of each bar and at intermediate intervals of not more than 192 diameters of the reinforcement or by other means to prevent displacement beyond permitted tolerances. As masonry work progresses, secure vertical reinforcement to prevent displacement beyond allowable tolerances.
- b. Wire column and pilaster lateral ties in position around the vertical reinforcing bars. Place lateral ties in contact with the vertical reinforcement and do not place in horizontal mortar bed joints.
- c. Position horizontal reinforcing bars as indicated. Stagger splices in adjacent horizontal bars, unless otherwise indicated.
- d. Form splices by lapping bars as indicated. Do not cut, bend or eliminate reinforcing bars. Foundation dowel bars may be field-bent when permitted by TMS MSJC.

3.4.1.3 Splices of Bar Reinforcement

Lap splice reinforcing bars as indicated. When used, provide welded or mechanical connections that develop at least 125 percent of the specified yield strength of the reinforcement.

3.4.2 Placing Grout

3.4.2.1 General

Fill cells containing reinforcing bars with grout. Solidly grout hollow masonry units in walls or partitions supporting plumbing, heating, or other mechanical fixtures, voids at door and window jambs, and other

indicated spaces. Solidly grout cells under lintel bearings on each side of openings for full height of openings. Solidly grout walls below grade, lintels, and bond beams. Units other than open end units may require grouting each course to preclude voids in the units.

Discard site-mixed grout that is not placed within 1-1/2 hours after water is first added to the batch or when the specified slump is not met without adding water after initial mixing. Discard ready-mixed grout that does not meet the specified slump without adding water other than water that was added at the time of initial discharge. Allow sufficient time between grout lifts to preclude displacement or cracking of face shells of masonry units. Provide a grout shear key between lifts when grouting is delayed and the lower lift loses plasticity. If blowouts, flowouts, misalignment, or cracking of face shells should occur during construction, tear down the wall and rebuild.

3.4.2.2 Vertical Grout Barriers for Multi-Wythe Composite Walls

In multi-wythe composite walls, provide grout barriers in the collar joint not more than 30 feet apart, or as required, to limit the horizontal flow of grout for each pour.

3.4.2.3 Horizontal Grout Barriers

Embed horizontal grout barriers in mortar below cells of hollow units receiving grout.

3.4.2.4 Grout Holes and Cleanouts

3.4.2.4.1 Grout Holes

Provide grouting holes in slabs, spandrel beams, and other in-place overhead construction. Locate holes over vertical reinforcing bars or as required to facilitate grout fill in bond beams. Provide additional openings spaced not more than 16 inches on centers where grouting of hollow unit masonry is indicated. Form such openings not less than 4 inches in diameter or 3 by 4 inches in horizontal dimensions. Upon completion of grouting operations, plug and finish grouting holes to match surrounding surfaces.

3.4.2.4.2 Cleanouts for Hollow Unit Masonry Construction

For hollow masonry units, provide cleanout holes at the bottom of every grout pour in cores containing vertical reinforcement when the height of the grout pour exceeds 5 feet 4 inches. Where all cells are to be grouted, construct cleanout courses using bond beam units in an inverted position to permit cleaning of all cells. Provide cleanout holes at a maximum spacing of 32 inches where all cells are to be filled with grout.

Establish a new series of cleanouts if grouting operations are stopped for more than 4 hours. Provide cleanouts not less than 3 by 3 inch by cutting openings in one face shell. Manufacturer's standard cutout units may be used at the Contractor's option. Do not cleanout holes until masonry work, reinforcement, and final cleaning of the grout spaces have been completed and inspected. For walls which will be exposed to view, close cleanout holes in an approved manner to match surrounding masonry.

3.4.2.5 Grout Placement

A grout pour is the total height of masonry to be grouted prior to erection of additional masonry. A grout lift is an increment of grout placement within a grout pour. A grout pour is filled by one or more lifts of grout.

- a. Lay masonry to the top of a pour permitted by TMS MSJC Table 7, based on the size of the grout space and the type of grout. Prior to grouting, remove masonry protrusions that extend 1/2 inch or more into cells or spaces to be grouted. Provide grout holes and cleanouts in accordance with paragraph GROUT HOLES AND CLEANOUTS above when the grout pour height exceeds 5 feet 4 inches. Hold reinforcement, bolts, and embedded connections rigidly in position before grouting is started. Do not prewet concrete masonry units.
- b. Place grout using a hand bucket, concrete hopper, or grout pump to fill the grout space without segregation of aggregate. Operate grout pumps to produce a continuous stream of grout without air pockets, segregation, or contamination.
- c. If the masonry has cured at least 4 hours, grout slump is maintained between 10 to 11 inches, and no intermediate reinforced bond beams are placed between the top and bottom of the pour height, place conventional grout in lifts not exceeding 12 feet 8 inches. For the same curing and slump conditions but with intermediate bond beams, limit conventional grout lift to the bottom of the lowest bond beam that is more than 5 feet 4 inches above the bottom of the lift, but do not exceed 12 feet 8 inches. If masonry has not cured at least 4 hours or grout slump is not maintained between 10 to 11 inches, place conventional grout in lifts not exceeding 5 feet 4 inches.
- d. Consolidate conventional grout lift and reconsolidate after initial settlement before placing next lift. For grout pours that are 12 inches or less in height, consolidate and reconsolidate grout by mechanical vibration or puddling. For grout pours that are greater than 12 inches in height, consolidate and reconsolidate grout by mechanical vibration. Apply vibrators at uniformly spaced points not further apart than the visible effectiveness of the machine. Limit duration of vibration to time necessary to produce satisfactory consolidation without causing segregation. If previous lift is not permitted to set, dip vibrator into previous lift. Do not insert vibrators into lower lifts that are in a semi-solidified state. If lower lift sets prior to placement of subsequent lift, form a grout key by terminating grout a minimum of 1-1/2 inch below a mortar joint. Vibrate each vertical cell containing reinforcement in partially grouted masonry. Do not form grout keys within beams.
- e. If the masonry has cured 4 hours, place self-consolidating grout (SCG) in lifts not exceeding the pour height. If masonry has not cured for at least 4 hours, place SCG in lifts not exceeding 5 feet 4 inches. Do not mechanically consolidate self-consolidating grout. Place self-consolidating grout in accordance with manufacturer's recommendations.
- f. Upon completion of each day's grouting, remove waste materials and debris from the equipment, and dispose of outside the masonry.

3.4.3 Joint Reinforcement Installation

Install joint reinforcement at 16 inches on center unless otherwise indicated. Lap joint reinforcement not less than 6 inches. Install prefabricated sections at corners and wall intersections. Place the longitudinal wires of joint reinforcement in mortar beds to provide not less than 5/8 inch cover to either face of the unit.

3.4.4 Bond Beams

Reinforce and grout bond beams as indicated and as described in paragraphs above. Install grout barriers under bond beam units to retain the grout as required, unless wall is fully grouted or solid bottom units are used. For high lift grouting in partially grouted masonry, provide grout retaining material on the top of bond beams to prevent upward flow of grout. Ensure that reinforcement is continuous, including around corners, except through control joints or expansion joints, unless otherwise indicated.

3.5 APPLICATION

3.5.1 Interface with Other Products

3.5.1.1 Built-In Items

Fill spaces around built-in items with mortar. Point openings around flush-mount electrical outlet boxes in wet locations with mortar. Embed anchors, ties, wall plugs, accessories, flashing, pipe sleeves and other items required to be built-in as the masonry work progresses. Fully embed anchors, ties and joint reinforcement in the mortar. Fill cells receiving anchor bolts and cells of the first course below bearing plates with grout, unless otherwise indicated.

3.5.1.2 Door and Window Frame Joints

On the exposed interior and exterior sides of exterior frames, rake joints between frames and abutting masonry walls to a depth of 3/8 inch.

3.5.1.3 Bearing Plates

Set bearing plates for beams, joists, joist girders and similar structural members to the proper line and elevation with damp-pack bedding mortar, except where non-shrink grout is indicated. Provide bedding mortar and non-shrink grout as specified in Section 03 30 00 CAST-IN-PLACE CONCRETE.

3.5.2 Tolerances

Lay masonry plumb, true to line, with courses level within the tolerances of TMS MSJC, Article 3.3 F.

3.6 FIELD QUALITY CONTROL

3.6.1 Tests

3.6.1.1 Field Testing of Mortar

Prepare and test mortar samples for mortar aggregate ratio in accordance

with ASTM C780 Appendix A4.

3.6.1.2 Field Testing of Grout

- a. Perform grout testing at the following frequency: four times per day. For each required grout property to be evaluated, provide a minimum of three specimens.
- b. Sample and test conventional and self-consolidating grout for compressive strength and temperature in accordance with ASTM C1019.
- c. Evaluate slump in conventional grout in accordance with ASTM C1019.
- d. Evaluate slump flow and visual stability index of self-consolidating grout in accordance with ASTM C1611/C1611M.

3.6.1.3 Single-Wythe Masonry Wall Water Penetration Test

Prior to start of field construction of the single-wythe concrete masonry wall, perform masonry wall water penetration test on mock-up wall assemblies consisting of the identical design, materials, mix, and construction methods as the actual wall construction and in accordance with ASTM E514/E514M. Prepare a minimum of three specimens and cure for minimum 28 days prior to testing. Construct panels by the same methods, processes, and applications to be used on the project's construction site. Spray test for 6 hours on each specimen. If water is visible on back of test panels during the test and areas of dampness on the backside of the test panels do not exceed 25 percent of the wall area, the panels will be considered to have passed. Dampness is defined as any area of surface darkening or discoloration due to moisture penetration or accumulation below the observed surface.

Construct additional test panels for each failed test performed until three test panels pass the test. Factors that can affect test performance include materials, mixing, and quality of application and workmanship. Materials, mixing, and methods adjustments may be necessary in order to provide construction that passes the water penetration test. Document and record the test specimen construction materials and application and provide written test report in accordance with ASTM E514/E514M, supplemented by a detailed discussion of the specifics of test panel construction, application methods and processes used, quality of construction, and any variances or deviations that may have occurred between test panels during test panel construction. For failed test panels, identify in the supplemental report the variances, deficiencies or flaws that contributed to test panel failure and itemize the precautions to be taken in field construction of the masonry wall to prevent similar deficiencies and assure the wall construction replicates test panel conditions that pass the water penetration test. Submit the complete, certified test report, including supplemental report, to the Contracting Officer prior to start of single-wythe concrete masonry wall construction. Significant changes to materials, proportions, or construction techniques from those used in the passing water penetration test are grounds for performing new tests, at the discretion of the Contracting Officer.

3.6.2 Special Inspection

Perform special inspections and testing in accordance with Section 01 45 35 SPECIAL INSPECTIONS.

3.7 POINTING AND CLEANING

After mortar joints have attained their initial set, but prior to hardening, completely remove mortar and grout daubs and splashings from masonry-unit surfaces that will be exposed or painted. Before completion of the work, rake out defects in joints of masonry to be exposed or painted, fill with mortar, and tool to match existing joints. Immediately after grout work is completed, remove scum and stains that have percolated through the masonry work using a low pressure stream of water and a stiff bristled brush. Do not clean masonry surfaces, other than removing excess surface mortar, until mortar in joints has hardened. Leave masonry surfaces clean, free of mortar daubs, dirt, stain, and discoloration, including scum from cleaning operations, and with tight mortar joints throughout. Do not use metal tools and metal brushes for cleaning.

3.7.1 Dry-Brushing Concrete Masonry

Dry brush exposed concrete masonry surfaces at the end of each day's work and after any required pointing, using stiff-fiber bristled brushes.

3.8 CLOSE-OUT TAKE-BACK PROGRAM

Collect information from manufacturer for take-back program options. Set aside to be returned to manufacturer for recycling into new product. When such a service is not available, seek local recyclers to reclaim the materials. Submit documentation that includes contact information, summary of procedures, and the limitations and conditions applicable to the project. Indicate manufacturer's commitment to reclaim materials for recycling and/or reuse.

3.9 PROTECTION

Protect facing materials against staining. Cover top of walls with nonstaining waterproof covering or membrane to protect from moisture intrusion when work is not in progress. Continue covering the top of the unfinished walls until the wall is waterproofed with a complete roof or parapet system. Extend covering a minimum of 2 feet down on each side of the wall and hold securely in place. Before starting or resuming work, clean top surface of masonry in place of loose mortar and foreign material.

-- End of Section --

This page left blank.

SECTION 05 12 00

STRUCTURAL STEEL
08/18, CHG 2: 05/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC)

AISC 207	(2016; R 2017) Certification Standard for Steel Fabrication and Erection, and Manufacturing of Metal Components
AISC 303	(2016) Code of Standard Practice for Steel Buildings and Bridges
AISC 325	(2017) Steel Construction Manual
AISC 326	(2009) Detailing for Steel Construction
AISC 360	(2016) Specification for Structural Steel Buildings
AISC DESIGN GUIDE 10	(1997) Erection Bracing of Low-Rise Structural Steel Buildings

AMERICAN SOCIETY FOR NONDESTRUCTIVE TESTING (ASNT)

ANSI/ASNT CP-189	(2020) ASNT Standard for Qualification and Certification of Nondestructive Testing Personnel
------------------	--

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B46.1	(2020) Surface Texture, Surface Roughness, Waviness and Lay
------------	---

AMERICAN WELDING SOCIETY (AWS)

AWS A2.4	(2012) Standard Symbols for Welding, Brazing and Nondestructive Examination
AWS D1.1/D1.1M	(2020; Errata 1 2021) Structural Welding Code - Steel
AWS D1.8/D1.8M	(2016) Structural Welding Code—Seismic Supplement
AWS QC1	(2016) Specification for AWS Certification of Welding Inspectors

ASTM INTERNATIONAL (ASTM)

ASTM A6/A6M	(2023) Standard Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
ASTM A29/A29M	(2023) Standard Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought
ASTM A36/A36M	(2019) Standard Specification for Carbon Structural Steel
ASTM A500/A500M	(2023) Standard Specification for Cold-Formed Welded and Seamless Carbon Steel Structural Tubing in Rounds and Shapes
ASTM A563	(2021; E 2022a) Standard Specification for Carbon and Alloy Steel Nuts
ASTM A563M	(2007; R 2013) Standard Specification for Carbon and Alloy Steel Nuts (Metric)
ASTM A992/A992M	(2022) Standard Specification for Structural Steel Shapes
ASTM A1085/A1085M	(2015) Standard Specification for Cold-Formed Welded Carbon Steel Hollow Structural Sections (HSS)
ASTM C827/C827M	(2023) Standard Test Method for Change in Height at Early Ages of Cylindrical Specimens of Cementitious Mixtures
ASTM C1107/C1107M	(2020) Standard Specification for Packaged Dry, Hydraulic-Cement Grout (Nonshrink)
ASTM F436/F436M	(2019) Standard Specification for Hardened Steel Washers Inch and Metric Dimensions
ASTM F844	(2019) Standard Specification for Washers, Steel, Plain (Flat), Unhardened for General Use
ASTM F1554	(2020) Standard Specification for Anchor Bolts, Steel, 36, 55, and 105-ksi Yield Strength
ASTM F3125/F3125M	(2019) Standard Specification for High Strength Structural Bolts and Assemblies, Steel and Alloy Steel, Heat Treated, Inch Dimensions 120 ksi and 150 ksi Minimum Tensile Strength, and Metric Dimensions 830 MPa and 1040 MPa Minimum Tensile Strength

SOCIETY FOR PROTECTIVE COATINGS (SSPC)

SSPC PA 1	(2016) Shop, Field, and Maintenance Coating of Metals
SSPC Paint 20	(2019) Zinc-Rich Primers (Type I, Inorganic, and Type II, Organic)
SSPC Paint 29	(2002; E 2004) Zinc Dust Sacrificial Primer, Performance-Based
SSPC SP 3	(2018) Power Tool Cleaning
SSPC SP 6/NACE No.3	(2007) Commercial Blast Cleaning

U.S. DEPARTMENT OF DEFENSE (DOD)

UFC 3-301-01	(2023) Structural Engineering
--------------	-------------------------------

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR Part 1926, Subpart R	Steel Erection
-----------------------------	----------------

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Erection and Erection Bracing Drawings; G

SD-02 Shop Drawings

Fabrication Drawings Including Details of Connections; G

SD-03 Product Data

Shop Primer

Welding Electrodes and Rods

Direct Tension Indicator Washers

Non-Shrink Grout

Tension Control Bolts

Recycled Content for Structural Steel; S

Recycled Content for Structural Steel Tubing; S

Recycled Content for Steel Pipe; S

SD-05 Design Data

SD-06 Test Reports

Class B Coating

Bolts, Nuts, and Washers

Weld Inspection Reports

Direct Tension Indicator Washer Inspection Reports

Bolt Testing Reports

SD-07 Certificates

Steel

Bolts, Nuts, and Washers

AISC Structural Steel Fabricator Quality Certification

AISC Structural Steel Erector Quality Certification

Welding Procedures and Qualifications

Welding Electrodes and Rods

Certified Welding Inspector

NDT Technician

Welding Procedure Specifications (WPS)

1.3 AISC QUALITY CERTIFICATION

Work must be fabricated by an AISC Certified Structural Steel Fabricator, in accordance with AISC 207, Category BU. Submit AISC Structural Steel Fabricator quality certification.

Work must be erected by an AISC Structural Steel Certified Erector, in accordance with AISC 207, Category CSE. Submit AISC Structural Steel erector quality certification.

1.4 QUALITY ASSURANCE

1.4.1 Preconstruction Submittals

1.4.1.1 Erection and Erection Bracing Drawings

Submit for record purposes. Indicate the sequence of erection, temporary shoring and bracing. The erection drawings must conform to AISC 303.

1.4.2 Fabrication Drawing Requirements

Submit fabrication drawings for approval prior to fabrication. Prepare in accordance with AISC 303, AISC 326 and AISC 325. Fabrication drawings must not be reproductions of contract drawings. Include complete information for the fabrication and erection of the structure's components, including the location, type, and size of bolts, welds, member sizes and lengths, connection details, blocks, copes, and cuts. Use AWS A2.4 standard welding symbols. Clearly highlight any deviations from

the details shown on the contract drawings highlighted on the fabrication drawings. Explain the reasons for any deviations from the contract drawings.

1.4.3 Certifications

1.4.3.1 Welding Procedures and Qualifications

Prior to welding, submit certification for each welder stating the type of welding and positions qualified for, the code and procedure qualified under, date qualified, and the firm and individual certifying the qualification tests. If the qualification date of the welder or welding operator is more than 6 months old, the welding operator's qualification certificate must be accompanied by a current certificate by the welder attesting to the fact that he has been engaged in welding since the date of certification, with no break in welding service greater than 6 months.

Conform to all requirements specified in AWS D1.1/D1.1M and AWS D1.8/D1.8M.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Provide the structural steel system, including shop primer, complete and ready for use. Provide structural steel systems including design, materials, installation, workmanship, fabrication, assembly, erection, inspection, quality control, and testing in accordance with AISC 303, AISC 360, and UFC 3-301-01 except as modified in this contract.

2.2 STEEL

2.2.1 Structural Steel

Wide flange and WT shapes, ASTM A992/A992M. Angles, Channels and Plates, ASTM A36/A36M. Provide structural steel containing a minimum of 80 percent recycled content. Submit data identifying percentage of recycled content for structural steel.

2.2.2 Structural Steel Tubing

ASTM A500/A500M, Grade C. ASTM A1085/A1085M. Provide structural steel tubing containing a minimum of 25 percent recycled content. Submit data identifying percentage of recycled content for structural steel tubing.

2.3 BOLTS, NUTS, AND WASHERS

Submit the certified manufacturer's mill reports which clearly show the applicable ASTM mechanical and chemical requirements together with the actual test results for the supplied fasteners.

2.3.1 High-Strength Bolts

High strength bolts and nuts must be shipped together in the same shipping container. Fasteners indicated to be galvanized shall be tested by the supplier to show that the galvanized nut with the supplied lubricant provided may be rotated from the snug tight condition well in excess of the rotation required for pretensioned installation without stripping. The supplier shall supply nuts that have been lubricated and tested with the supplied bolts.

2.3.1.1 Bolts

ASTM F3125/F3125M, Grade A325M A325 , Type 1 Heavy Hex Head Style, plain finish .

2.3.1.2 Nuts

ASTM A563, Grade and Style as specified in the applicable ASTM bolt standard.

2.3.1.3 Washers

ASTM F436/F436M, plain carbon steel.

2.3.2 Tension Control Bolts

ASTM F3125/F3125M, Grade , Type 1, twistoff style assemblies consisting of steel structural bolts with splined ends, heavy-hex carbon steel nuts, and hardened carbon steel washers. Assembly finish must be . Submit product data for tension control bolts.

2.3.3 Foundation Anchorage

2.3.3.1 Anchor Rods

ASTM F1554 Gr 36 , Class 1A.

2.3.3.2 Anchor Nuts

ASTM A563, Grade A, hex style.

2.3.3.3 Anchor Washers

ASTM F844.

2.3.3.4 Anchor Plate Washers

ASTM A36/A36M.

2.4 STRUCTURAL STEEL ACCESSORIES

2.4.1 Welding Electrodes and Rods

AWS D1.1/D1.1M and AWS D1.8/D1.8M. Submit product data for welding electrodes and rods.

2.4.2 Non-Shrink Grout

ASTM C1107/C1107M, with no ASTM C827/C827M shrinkage. Submit product data for non-shrink grout.

2.4.3 Welded Shear Stud Connectors

ASTM A29/A29M, Grades 1010 through 1020. AWS D1.1/D1.1M, Table 7.1, Type B.

2.5 FABRICATION

Fabrication must be in accordance with the applicable provisions of AISC 325. Fabrication and assembly must be done in the shop to the greatest extent possible. Punch, subpunch and ream, or drill bolt holes perpendicular to the surface of the member.

Compression joints depending on contact bearing must have a surface roughness not in excess of 500 micro inch as determined by ASME B46.1, and ends must be square within the tolerances for milled ends specified in ASTM A6/A6M.

Shop splices of members between field splices will be permitted only where indicated on the Contract Drawings. Splices not indicated require the approval of the Contracting Officer.

2.5.1 Markings

Prior to erection, identify members by a painted erection mark. Connecting parts assembled in the shop for reaming holes in field connections must be match marked with scratch and notch marks. Do not locate erection markings on areas to be welded. Do not locate match markings in areas that will decrease member strength or cause stress concentrations.

2.5.2 Shop Primer

SSPC Paint 20 or SSPC Paint 29, (zinc rich primer). Shop prime structural steel, except as modified herein, in accordance with SSPC PA 1. Do not prime steel surfaces embedded in concrete, galvanized surfaces, or surfaces within 0.5 inch of the toe of the welds prior to welding (except surfaces on which metal decking and shear studs are to be welded). If flash rusting occurs, re-clean the surface prior to application of primer. Apply primer to a minimum dry film thickness of 2.0 mil. Submit shop primer product data.

Prime slip critical surfaces with a Class B coating in accordance with AISC 325. Submit test report for Class B coating.

Prior to assembly, prime surfaces which will be concealed or inaccessible after assembly. Do not apply primer in foggy or rainy weather; when the ambient temperature is below 45 degrees F or over 95 degrees F; or when the primer may be exposed to temperatures below 40 degrees F within 48 hours after application, unless approved otherwise by the Contracting Officer. Repair damaged primed surfaces with an additional coat of primer.

2.5.2.1 Cleaning

SSPC SP 6/NACE No.3, except steel exposed in spaces above ceilings, attic spaces, furred spaces, and chases that will be hidden to view in finished construction may be cleaned to SSPC SP 3 when recommended by the shop primer manufacturer. Maintain steel surfaces free from rust, dirt, oil, grease, and other contaminants through final assembly.

2.6 DRAINAGE HOLES

Drill adequate drainage holes to eliminate water traps. Hole diameter must be 1/2 inch and location indicated on the detail drawings. Hole size and locations must not affect the structural integrity.

PART 3 EXECUTION

3.1 ERECTION

- a. Erection of structural steel, except as indicated in item b. below, must be in accordance with the applicable provisions of AISC 325, AISC 303 and 29 CFR Part 1926, Subpart R.
- b. For low-rise structural steel buildings (60 feet tall or less and a maximum of 2 stories), erect the structure in accordance with AISC DESIGN GUIDE 10.

After final positioning of steel members, provide full bearing under base plates and bearing plates using nonshrink grout. Place nonshrink grout in accordance with the manufacturer's instructions.

3.1.1 STORAGE

Store the material out of contact with the ground in such manner and location as to minimize deterioration.

3.2 CONNECTIONS

Except as modified in this section, design connections indicated in accordance with AISC 360. Build connections into existing work. Do not tighten anchor bolts set in concrete with impact torque wrenches. Holes must not be cut or enlarged by burning. Bolts, nuts, and washers must be clean of dirt and rust, and lubricated immediately prior to installation.

3.2.1 High-Strength Bolts

Provide direct tension indicator washers in all ASTM F3125/F3125M, Grade A325 and Grade A490 bolted connections. Bolts must be installed in connection holes and initially brought to a snug tight fit. After the initial tightening procedure, fully tension bolts, progressing from the most rigid part of a connection to the free edges.

Fastener components shall be protected from dirt and moisture in closed containers at the site of the installation. Fastener components that are not incorporated into the work shall be returned to protected storage at the end of the work shift.

3.2.1.1 Installation of Direct Tension Indicator Washers (DTIW)

Where possible, install the DTIW under the bolt head and tighten the nut. If the DTIW is installed adjacent to the turned element, provide a flat washer between the DTIW and nut when the nut is turned for tightening, and between the DTIW and bolt head when the bolt head is turned for tightening. In addition to the DTIW, provide flat washers under both the bolt head and nut when ASTM F3125/F3125M, Grade A490 bolts are used.

3.2.2 Tension Control Bolts

Bolts must be installed in connection holes and initially brought to a snug tight fit. After the initial tightening procedure, fully tension bolts, progressing from the most rigid part of a connection to the free edges.

3.3 GAS CUTTING

Use of gas-cutting torch in the field for correcting fabrication errors is not permitted on any major member in the structural framing. Use of a gas cutting torch will be permitted on minor members not under stress only after approval has been obtained from the Contracting Officer.

3.4 WELDING

Welding must be in accordance with AWS D1.1/D1.1M and AWS D1.8/D1.8M. Provide AWS D1.1/D1.1M qualified welders, welding operators, and tackers.

Develop and submit the Welding Procedure Specifications (WPS) for all welding, including welding done using prequalified procedures. Submit for approval all WPS, whether prequalified or qualified by testing.

3.4.1 Removal of Temporary Welds, Run-Off Plates, and Backing Strips

Removal is not required.

3.5 SHOP PRIMER REPAIR

Repair shop primer in accordance with the paint manufacturer's recommendation for surfaces damaged by handling, transporting, cutting, welding, or bolting.

3.5.1 Field Priming

Field prime steel exposed to the weather, or located in building areas without HVAC for control of relative humidity. After erection, the field bolt heads and nuts, field welds, and any abrasions in the shop coat must be cleaned and primed with paint of the same quality as that used for the shop coat.

3.6 FIELD QUALITY CONTROL

Perform field tests, and provide labor, equipment, and incidentals required for testing. Notify the Contracting Officer in writing of defective welds, bolts, nuts, and washers within 7 working days of the date of the inspection.

3.6.1 Welds

3.6.1.1 Visual Inspection

AWS D1.1/D1.1M. Furnish the services of AWS-certified welding inspectors for fabrication and erection inspection and testing and verification inspections. A Certified Welding Inspector must perform visual inspection on 100 percent of all welds. Document this inspection in the Visual Weld Inspection Log. Submit certificates indicating that certified welding inspectors meet the requirements of AWS QC1.

3.6.1.2 Nondestructive Testing

Nondestructive testing must be in accordance with AWS D1.1/D1.1M. Ultrasonic testing must be performed in accordance with Table of AWS D1.1/D1.1M. Test locations must be selected by the Contracting Officer. All personnel performing NDT must be certified in accordance with ANSI/ASNT CP-189 in the method of testing being performed. Submit

certificates showing compliance with ANSI/ASNT CP-189 for all NDT technicians. If more than 20 percent of welds made by a welder contain defects identified by testing, then all groove welds made by that welder must be tested by ultrasonic testing, and all fillet welds made by that welder must be inspected by magnetic particle testing (MT) or dye penetrant testing (PT) as approved by the Contracting Officer. When groove welds made by an individual welder are required to be tested, magnetic particle or dye penetrant testing may be used only in areas inaccessible to ultrasonic testing. Retest all repaired areas. Submit weld inspection reports.

Testing frequency: Provide the following types and number of tests:

<u>Test Type</u>	<u>Number of Tests</u>
Ultrasonic	50 percent of CJP Welds
Magnetic Particle	50 percent of PJP and Fillet Welds
Dye Penetrant	50 percent of PJP and Fillet Welds

3.6.2 High-Strength Bolts

3.6.2.1 Inspection

Inspection procedures must be in accordance with AISC 360. Confirm and report to the Contracting Officer that the materials meet the project specification and that they are properly stored. Confirm that the faying surfaces have been properly prepared before the connections are assembled. Observe the specified job site testing and calibration, and confirm that the procedure to be used provides the required tension. Monitor the work to ensure the testing procedures are routinely followed on joints that are specified to be fully tensioned.

3.6.2.2 Testing

The Government has the option to perform nondestructive tests on 5 percent of the installed bolts to verify compliance with pre-load bolt tension requirements. Provide the required access for the Government to perform the tests. The nondestructive testing will be done in-place using an ultrasonic measuring device or any other device capable of determining in-place pre-load bolt tension. The test locations must be selected by the Contracting Officer. If more than 10 percent of the bolts tested contain defects identified by testing, then all bolts used from the batch from which the tested bolts were taken, must be tested at the Contractor's expense. Retest new bolts after installation at the Contractor's expense.

3.6.3 Inspection and Testing of Steel Stud Welding

Perform verification inspection and testing of steel stud welding conforming to the requirements of AWS D1.1/D1.1M, Stud Welding Clause. The Contracting Officer will serve as the verification inspector. Bend test studs that do not show a full 360 degree weld flash or have been

repaired by welding as required by AWS D1.1/D1.1M, Stud Welding Clause. Studs that crack under testing in the weld, base metal or shank will be rejected and replaced by the Contractor at no additional cost.

-- End of Section --

This page left blank.

SECTION 05 21 00

STEEL JOIST FRAMING
05/15, CHG 1: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN WELDING SOCIETY (AWS)

AWS D1.1/D1.1M (2020; Errata 1 2021) Structural Welding Code - Steel

ASTM INTERNATIONAL (ASTM)

ASTM A36/A36M (2019) Standard Specification for Carbon Structural Steel

INTERNATIONAL CODE COUNCIL (ICC)

ICC IBC (2021) International Building Code

SOCIETY FOR PROTECTIVE COATINGS (SSPC)

SSPC PA 1 (2016) Shop, Field, and Maintenance Coating of Metals

SSPC Paint 15 (1999; E 2004) Steel Joist Shop Primer/Metal Building Primer

SSPC SP 2 (2018) Hand Tool Cleaning

STEEL JOIST INSTITUTE (SJI)

SJI LOAD TABLES (2020) Standard Specifications Load Tables and Weight Tables for Steel Joists and Joist Girders - 45th Edition

SJI MANUAL (2009) 80 Years of Open Web Steel Joist Construction

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1926 Safety and Health Regulations for Construction

29 CFR 1926.756 Steel Erection; Beams and Columns

29 CFR 1926.757 Steel Erection; Open Web Steel Joists

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S"

classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Welder Qualification

SD-02 Shop Drawings

Steel Joist Framing; G

SD-03 Product Data

Recycled Content Of Steel Products; S

SD-05 Design Data

Design Calculations; G

SD-06 Test Reports

Erection Inspection

Welding Inspections

SD-07 Certificates

Certification of Compliance

1.3 QUALITY ASSURANCE

Perform all work in compliance with the requirements set forth in 29 CFR 1926.

1.3.1 Drawing Requirements

Submit drawings of steel joist framing including fabrication, specifications for shop painting, and identification markings of joists . Show joist type and size, layout in plan, all applicable loads, deflection criteria, and erection details including methods of anchoring, framing at openings, type, size, and location and connections for and spacing of bridging, requirements for field welding, and details of accessories as applicable. Show profiles for nonstandard joist configurations. Show steel joist field splice locations and details.

1.3.2 Certification of Compliance

Prior to construction commencement, submit certification for welder qualification, in compliance with AWS D1.1/D1.1M, welding operation, and tacker, stating the type of welding and positions qualified for, the code and procedure qualified under, date qualified, and the firm and individual certifying the qualification tests. Submit certification of compliance for the following:

a. SJI MANUAL

. Steel Joist Institute Member Fabricator

- b. 29 CFR 1926
- c. 29 CFR 1926.757
- d. Statement from steel joist manufacturer, that work was performed in accordance with approved construction documents and with SJI standard specifications, in accordance with ICC IBC Section 1704.2.5.2.

1.4 DELIVERY, STORAGE, AND HANDLING

Handle, transport, and store joists in a manner to prevent damage affecting their structural integrity. Verify piece count of all joist products upon delivery and inspect all joists products for damage. Report any damage to the joist supplier. Store all items off the ground in a well drained location protected from the weather and easily accessible for inspection and handling. Store joists with top chord down and with joists in a vertical position. Store deep joists horizontally if they were shipped on their sides.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Designate steel joists on the drawings in accordance with the standard designations of the Steel Joist Institute. Joists of other standard designations or joists with properties other than those shown may be substituted for the joists designated provided the structural properties are equal to or greater than those of the joists shown and provided all other specified requirements are met.

2.2 STEEL JOISTS

Provide steel joists conforming to SJI LOAD TABLES. Design joists designated K, KCS, LH and DLH to support the loads given in the applicable standard load tables of SJI LOAD TABLES. Submit design calculations for special steel joists, net uplift loads, non-SJI standard details, and field splices. Include cover letter signed and sealed by the joist manufacturer's registered design professional.

2.2.1 Steel Joist Camber

Camber joists according to SJI LOAD TABLES.

2.2.2 Special Steel Joists

Provide special joists and connections capable of withstanding the design loads indicated with a live-load deflection less than L/240 for roof joists and L/360 for floor joists.

2.3 ACCESSORIES AND FITTINGS

2.3.1 Bridging

Provide bridging of material, size, and type required by SJI LOAD TABLES for type of joist, chord size, spacing and span. Furnish additional erection bridging if required for stability.

2.3.2 Bearing Plates

Fabricate steel bearing plates from ASTM A36/A36M steel of size and thickness indicated.

2.4 SHOP PAINTING

SSPC Paint 15. Shop prime joists, except as modified herein, in accordance with SSPC PA 1. Clean joists in accordance with SSPC SP 2 before priming. If flash rusting occurs, re-clean the surface prior to application of primer. For joists which require finish painting under Section 09 90 00 PAINTS AND COATINGS, the primer paint must be compatible with the finish paint.

PART 3 EXECUTION

3.1 ERECTION

Install joists in conformance with SJI LOAD TABLES for the joist series indicated, and the requirements of 29 CFR 1926 and 29 CFR 1926.757 and 29 CFR 1926.756. Handle and set joists avoiding damage to the members. Place the "tag end" of joists as shown on the joists placement plans. Ensure that square-end joists are erected right side up. Distribute temporary loads so that joist capacity is not exceeded. Remove damaged joists from the site, except when field repair is approved and such repairs are satisfactorily made in accordance with the manufacturer's recommendations. Do not repair, field modify, or alter any joists without specific written instructions from the Designer of Record and/or joist manufacturer.

Install and connect bridging concurrently with joist erection, before construction loads are applied. Do not apply loads to bridging. Anchor ends of bridging lines at top and bottom chords if terminating at walls or beams. Do not cut away vertical leg of bridging where bridging makes an elevation transition; weld a separate piece of bridging at the transition. Perform all welding in accordance with AWS D1.1/D1.1M.

3.2 BEARING PLATES

Provide bearing plates to accept full bearing after the supporting members have been plumbed and properly positioned, but prior to placing superimposed loads. The area under the plate must be damp-packed solidly with bedding mortar, except where nonshrink grout is indicated on the drawings. Provide bedding mortar and grout as specified in Section 03 30 00 CAST-IN-PLACE CONCRETE.

3.3 PAINTING

3.3.1 Touch-Up Painting

After erection of joists, touch-up connections and areas of abraded shop coat with paint of the same type used for the shop coat.

3.4 VISUAL INSPECTIONS

Perform the following visual inspections:

- a. Verify that all joists are spaced properly.

- b. Verify that there is sufficient joist bearing on steel beams, concrete, and masonry.
- c. Verify all bridging lines are properly spaced and anchored.
- d. Verify that damage has not occurred to the joists during erection.
- e. Verify the joists are aligned vertically and there is no lateral sweep in the joists.
- f. Where concentrated loads are present on the joists verify that they are located in accordance with the joists placement plan.
- g. Verify welding of bridging and joist seats in accordance with AWS D1.1/D1.1M, Section 6. Perform erection inspection and field welding inspections with AWS certified welding inspectors.
- h. Verify proper bolting of diagonal bridging and joist seats where the bolts are snug-tight.

-- End of Section --

This page left blank.

SECTION 05 30 00

STEEL DECKS
05/15, CHG 2: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN IRON AND STEEL INSTITUTE (AISI)

AISI D100 (2017) Cold-Formed Steel Design Manual

AMERICAN WELDING SOCIETY (AWS)

AWS D1.1/D1.1M (2020; Errata 1 2021) Structural Welding Code - Steel

AWS D1.3/D1.3M (2018) Structural Welding Code - Sheet Steel

ASTM INTERNATIONAL (ASTM)

ASTM A36/A36M (2019) Standard Specification for Carbon Structural Steel

ASTM A123/A123M (2017) Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products

ASTM A780/A780M (2020) Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings

ASTM A792/A792M (2022) Standard Specification for Steel Sheet, 55% Aluminum-Zinc Alloy-Coated by the Hot-Dip Process

ASTM A1008/A1008M (2023) Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable

ASTM D746 (2014) Standard Test Method for Brittleness Temperature of Plastics and Elastomers by Impact

ASTM D1056 (2020) Standard Specification for Flexible Cellular Materials - Sponge or Expanded Rubber

ASTM D1149 (2007; R 2012) Standard Test Method for Rubber Deterioration - Surface Ozone

Cracking in a Chamber

ASTM E84	(2023) Standard Test Method for Surface Burning Characteristics of Building Materials
FM GLOBAL (FM)	
FM APP GUIDE	(updated on-line) Approval Guide http://www.approvalguide.com/
FM DS 1-28R	(1998) Data Sheet: Roof Systems
SOCIETY FOR PROTECTIVE COATINGS (SSPC)	
SSPC Paint 20	(2019) Zinc-Rich Primers (Type I, Inorganic, and Type II, Organic)
STEEL DECK INSTITUTE (SDI)	
ANSI/SDI C	(2017) Standard for Composite Steel Floor Deck - Slabs
ANSI/SDI NC	(2017) Standard for Non-Composite Steel Floor Deck
ANSI/SDI QA/QC	(2017) Standard for Quality Control and Quality Assurance for Installation of Steel Deck
ANSI/SDI RD	(2017) Standard for Steel Roof Deck
SDI DDM04	(2015; Errata 1-3 2016; Add 1 2015; Add 2 20162006) Diaphragm Design Manual; 4th Edition
SDI DDP	(1987; R 2000) Deck Damage and Penetrations
SDI MOC3	(2016) Manual of Construction with Steel Deck (3rd Edition)
U.S. DEPARTMENT OF DEFENSE (DOD)	
UFC 3-301-01	(2023) Structural Engineering
U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)	
29 CFR 1926	Safety and Health Regulations for Construction
UNDERWRITERS LABORATORIES (UL)	
UL 580	(2006; Reprint Mar 2019) UL Standard for Safety Tests for Uplift Resistance of Roof Assemblies
UL Fire Resistance	(2014) Fire Resistance Directory

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Fabrication Drawings; G

SD-03 Product Data

Accessories

Deck Units

Galvanizing Repair Paint

Mechanical Fasteners

Touch-Up Paint

Sound Absorbing Materials

Welding Equipment

Welding Rods and Accessories

Recycled Content of Steel Products; S

SD-04 Samples

Metal Roof Deck Units

Cellular Metal Floor Deck Units

Flexible Closure Strips

Acoustical Material

SD-05 Design Data

Deck Units; G

SD-07 Certificates

Powder-Actuated Tool Operator

Welder Qualifications

Welding Procedures

Fire Safety

Wind Storm Resistance

Manufacturer's Certificate

Stud Manufacture's Certification

Stud Manufacture's Test Reports

1.3 QUALITY ASSURANCE

1.3.1 Deck Units

Furnish deck units and accessory products from a manufacturer regularly engaged in manufacture of steel decking. Provide manufacturer's certificates attesting that the decking material meets the specified requirements.

1.3.2 Certification of Powder-Actuated Tool Operator

Provide manufacturer's certificate attesting that the operators are authorized to use the low velocity powder-actuated tool.

1.3.3 Qualifications for Welding Work

Follow Welding Procedures of AWS D1.3/D1.3M for sheet steel and AWS D1.1/D1.1M for stud welding. Submit qualified Welder Qualifications in accordance with AWS D1.3/D1.3M for sheet steel and AWS D1.1/D1.1M for stud welding, or under an equivalent approved qualification test. Perform tests on test pieces in positions and with clearances equivalent to those actually encountered. If a test weld fails to meet requirements, perform an immediate retest of two test welds until each test weld passes. Failure in the immediate retest will require the welder be retested after further practice or training, performing a complete set of test welds.

Submit manufacturer's catalog data for Welding Equipment and Welding Rods and Accessories.

1.3.4 Regulatory Requirements

1.3.4.1 Fire Safety

Test roof deck as a part of a roof deck construction assembly of the type used for this project, listing as fire classified in the UL Fire Resistance, or listing as Class I construction in the FM APP GUIDE, and so labeled.

1.3.4.2 Wind Storm Resistance

Provide roof construction assembly capable of withstanding a nominal uplift pressure of 90 pounds per square foot when tested in accordance with the uplift pressure test described in the FM DS 1-28R or as described in UL 580 and in general compliance with UFC 3-301-01.

1.3.5 Fabrication Drawings

Show type and location of units, location and sequence of connections, bearing on supports, methods of anchoring, attachment of accessories, adjusting plate details, cant strips, ridge and valley plates, metal closure strips, size and location of holes to be cut and reinforcement to be provided, the manufacturer's erection instructions and other pertinent details.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver deck units to the site in a dry and undamaged condition. Store and handle steel deck in a manner to protect it from corrosion, deformation, and other types of damage. Do not use decking for storage or as working platform until units have been fastened into position. Exercise care not to damage material or overload decking during construction. The maximum uniform distributed storage load must not exceed the design live load. Stack decking on platforms or pallets and cover with weathertight ventilated covering. Elevate one end during storage to provide drainage. Maintain deck finish at all times to prevent formation of rust. Repair deck finish using touch-up paint. Replace damaged material.

1.5 DESIGN REQUIREMENTS FOR ROOF DECKS

1.5.1 Properties of Sections

Properties of metal roof deck sections must comply with engineering design width as limited by the provisions of AISI D100.

1.5.2 Allowable Loads

Indicate total uniform dead and live load for detailing purposes.

PART 2 PRODUCTS

2.1 DECK UNITS

Submit manufacturer's design calculations, or applicable published literature for the structural properties of the proposed deck units.

Provide products with an average recycled content of steel products so postconsumer recycled content plus one half of preconsumer recycled content not less than percent.

2.1.1 Roof Deck

Conform to ASTM A792/A792M or ASTM A1008/A1008M for deck used in conjunction with insulation and built-up roofing. Fabricate roof deck units of the steel design thickness required by the design drawings and galvanized. Furnish sample of Metal Roof Deck Units used to illustrate actual cross section dimensions and configurations.

2.1.2 Length of Deck Units

Provide deck units of sufficient length to span three or more spacings where possible.

2.1.3 Touch-Up Paint

Provide a high zinc-dust content paint for regalvanizing welds in galvanized steel conforming to ASTM A780/A780M.

Provide touch-up paint for shop-painted units, and touch-up paint for zinc-coated units of an approved galvanizing repair paint with a high-zinc dust content. Touch-up welds with paint conforming to SSPC Paint 20 in accordance with ASTM A780/A780M. Maintain finish of deck units and accessories by using touch-up paint whenever necessary to prevent the

formation of rust.

2.2 ACCESSORIES

Provide accessories of same material as deck, unless specified otherwise. Provide manufacturer's standard type accessories, as specified.

2.2.1 Adjusting Plates

Provide adjusting plates, or segments of deck units, of same thickness and configuration as deck units in locations too narrow to accommodate full size units. Provide factory cut plates of predetermined size where possible.

2.2.2 Partition Closures

Provide closures for closing voids above interior walls and partitions that are perpendicular to the direction of the configurations. Provide rubber, plastic, or sheet steel closures above typical partitions.

2.2.3 Flexible Closure Strips for Roof Decks

Provide strips made of vulcanized, closed-cell, synthetic rubber material specified and premolded to the configuration required to provide tight-fitting closures at open ends and sides of steel roof decking. Furnish one sample of each type Flexible Closure Strips, 12 inch long.

Conforming to ASTM D1056, Grade 2A1, with the following additional properties:

Brittleness temperature of minus 40 degrees F when tested in accordance with ASTM D746.

Flammability resistance with a flame spread rating of less than 25 when tested in accordance with ASTM E84.

Resistance to ozone must be "no cracks" after exposure of a sample kept under a surface tensile strain of 25 percent to an ozone concentration of 100 parts per million of air by volume in air for 100 hours at 104 degrees F and tested in accordance with ASTM D1149.

Provide a elastomeric type adhesive as recommended by the manufacturer of the flexible closurestrips.

2.2.4 Sheet Metal Collar

Where deck is cut for passage of pipes, ducts, columns, etc., and deck is to remain exposed, provide a neatly cut sheet metal collar to cover edges of deck. Do not cut deck until after installation of supplemental supports.

2.2.5 Cover Plates

Sheet metal to close panel edge and end conditions, and where panels change direction or butt. Polyethylene-coated, self-adhesive, 2 inch wide joint tape may be provided in lieu of cover plates on flat-surfaced decking butt joints.

Fabricate cover plates for abutting floor deck units from the specified

structural-quality steel sheets not less than nominal 18 gage thick before galvanizing. Provide 6 inch wide cover plates and form to match the contour of the floor deck units.

2.2.6 Access Hole Covers

Sheet metal, minimum 0.0474 inch thick.

2.2.7 Hanger

Provide clips or loops for utility systems and suspended ceilings of one or more of the following types:

- a. Lip tabs or integral tabs where noncellular decking or flat plate of cellular section is 0.0474 inch thick or more, and a structural concrete fill is used over deck.
- b. Slots or holes punched in decking for installation of pigtails.
- c. Tabs driven from top side of decking and arranged so as not to pierce electrical cells.
- d. Decking manufacturer's standard as approved by the Contracting Officer.

2.2.8 Cant Strips for Roof Decks

Fabricate cant strips from the specified commercial-quality steel sheets not less than nominal 0.0358 inch thick before galvanizing. Bend strips to form a 45-degree cant not less than 5 inch wide, with top and bottom flanges a minimum 3 inch wide. Length of strips 10 feet.

2.2.9 Ridge and Valley Plates for Roof Decks

Fabricate plates from the specified structural-quality steel sheets, not less than nominal 0.0358 inch thick before galvanizing. Provide plates of minimum 4-1/2 inch wide and bent to provide tight fitting closures at ridges and valleys. Provide a minimum length of ridge and valley plates of 10 feet.

2.2.10 Metal Closure Strips for Roof Decks

Fabricate strips from the specified commercial-quality steel sheets not less than nominal 0.0358 inch thick before galvanizing. Provide strips from the configuration required to provide tight-fitting closures at open ends and sides of steel roof decking.

2.2.11 Galvanized Steel Angles for Roof Decks

Provide hot-rolled carbon steel angles conforming to ASTM A36/A36M, and hot-dip galvanized in accordance with ASTM A123/A123M.

2.2.12 Mechanical Fasteners

Provide mechanical fasteners, such as powder actuated fasteners, pneumatically driven fasteners or self-drilling screws, for anchoring the deck to structural supports and adjoining units as indicated.

2.2.13 Miscellaneous Accessories

Furnish the manufacturer's standard accessories to complete the deck

installation. Furnish metal accessories of the same material as the deck and with the minimum design thickness as follows: saddles, 0.0474 inch welding washers, 0.0598 inch other metal accessories, 0.0358 inch unless otherwise indicated.

PART 3 EXECUTION

3.1 EXAMINATION

Prior to installation of decking units and accessories, examine worksite to verify that as-built structure will permit installation of decking system without modification.

3.2 INSTALLATION

Install steel deck units in accordance with 29 CFR 1926, Subpart R - Steel Erection, ANSI/SDI QA/QC, ANSI/SDI CAN/SDI NCANSI/SDI RD and approved shop drawings. Place units on structural supports, properly adjusted, leveled, and aligned at right angles to supports before permanently securing in place. Damaged deck and accessories including material which is permanently stained or contaminated, deformed, or with burned holes shall not be installed. Extend deck units over three or more supports unless absolutely impractical. Report inaccuracies in alignment or leveling to the Contracting Officer and make necessary corrections before permanently anchoring deck units. Locate deck ends over supports only. Lap 2 inch deck ends. Do not use unanchored deck units as a work or storage platform. Permanently anchor units placed by the end of each working day. Do not support suspended ceilings, light fixtures, ducts, utilities, or other loads by steel deck unless indicated. Distribute loads by appropriate means to prevent damage.

3.2.1 Attachment

Immediately after placement and alignment, and after correcting inaccuracies, permanently fasten steel deck units to structural supports and to adjacent deck units by welding with normal 5/8 inch diameter puddle welds, fastened with screws, powder-actuated fasteners, or pneumatically driven fasteners as indicated on the design drawings and in accordance with manufacturer's recommended procedure and ANSI/SDI C, ANSI/SDI NC or ANSI/SDI RD. Clamp or weight deck units to provide firm contact between deck units and structural supports while performing welding or fastening. Attachment of adjacent deck units by button-punching is prohibited.

3.2.1.1 Welding

Perform welding in accordance with AWS D1.3/D1.3M using methods and electrodes recommended by the manufacturers of the base metal alloys being used. Ensure only operators previously qualified by tests prescribed in AWS D1.3/D1.3M make welds. Immediately recertify, or replace qualified welders, that are producing unsatisfactory welding. Conform to the recommendations of the Steel Deck Institute and the steel deck manufacturer for location, size, and spacing of fastening. Do use welding washers at the connections of the deck to supports. Do not use welding washers at sidelaps. Holes and similar defects will not be acceptable. Attach all partial or segments of deck units to structural supports in accordance with Section 2.5 of SDI DDM04. . Immediately clean welds by chipping and wire brushing. Heavily coat welds, cut edges and damaged portions of coated finish with zinc-dust paint conforming to ASTM A780/A780M .

3.2.1.2 Mechanical Fastening

Anchor deck to structural supports and adjoining units with mechanical fasteners. Drive pneumatically driven fasteners with a low-velocity fastening tool and comply with the manufacturer's recommendations.

3.2.1.3 Sidelap Fastening

Lock sidelaps between adjacent floor deck units together by welding or screws as indicated.

3.2.2 Openings

Cut or drill all holes and openings required and be coordinated with the drawings, specifications, and other trades. Frame and reinforce openings through the deck in conformance with SDI DDP. Reinforce holes and openings 6 to 12 inch across by 0.0474 inch thick steel sheet at least 12 inch wider and longer than the opening and be fastened to the steel deck at each corner of the sheet and at a maximum of 6 inch on center. Reinforce holes and openings larger than 12 inch by steel channels or angles installed perpendicular to the steel joists and supported by the adjacent steel joists. Install steel channels or angles perpendicular to the deck ribs and fasten to the channels or angles perpendicular to the steel joists. Deck manufacturer shall approve holes or openings larger than 6 inch in diameter prior to drilling or cutting.

3.2.3 Deck Damage

SDI MOC3, for repair of deck damage.

3.2.4 Touch-Up Paint

3.2.4.1 Roof Deck

After roof decking installation, wire brush, clean, and touchup paint the scarred areas on top and bottom surfaces of metal roof decking. The scarred areas include welds, weld scars, bruises, and rust spots. Touchup galvanized surfaces with galvanizing repair paint. Touchup painted surfaces with repair paint of painted surfaces.

3.2.5 Accessory Installation

3.2.5.1 Adjusting Plates

Provide in locations too narrow to accommodate full-size deck units and install as shown on shop drawings.

3.2.5.2 End Closures

Provide end closure to close open ends of cells at columns, walls, and openings in deck.

3.2.5.3 Closures Above Partitions

Provide for closing voids between cells over partitions that are perpendicular to direction of cells. Provide a one-piece closure strip for partitions 4 inch nominal or less in thickness and two-piece closure strips for wider partitions. Provide sheet metal closures above fire-rated partitions at both sides of partition with space between filled

with fiberglass insulation. Provide flexible rubber closures above acoustic-rated partitions at both sides of partition with space between filled with blanket insulation.

3.2.5.4 Cover Plates

Provide metal cover plates, or joint tape, at joints between cellular decking sheets to be used as electrical raceways.

3.2.5.5 Access Hole Covers

Provide access hole covers to seal holes cut in decking to facilitate welding of the deck to structural supports.

3.3 CANT STRIPS FOR ROOF DECKS

Provide strips to be fusion welded to surface of roof decking, secured to wood nailers by galvanized screws or to steel framing by galvanized self-tapping screws or welds. Do not exceed spacing of welds and fasteners of 12 inch. Lap end joints a minimum 3 inch and secure with galvanized sheet metal screws spaced a maximum 4 inch on center.

3.4 RIDGE AND VALLEY PLATES FOR ROOF DECKS

Provide plates to be fusion welded to top surface of roof decking. Lap end joints a minimum 3 inch. For valley plates, provide endlaps to be in the direction of water flow.

3.5 CLOSURE STRIPS FOR ROOF DECKS

Provide closure strips at open, uncovered ends and edges of the roof decking and in voids between roof decking and top of walls and partitions where indicated. Install closure strips in position in a manner to provide a weathertight installation.

3.6 ROOF INSULATION SUPPORT FOR ROOF DECKS

Provide metal closure strips for support of roof insulation where rib openings in top surface of metal roof decking occur adjacent to edges and openings. Weld metal closure strips in position.

3.7 CLEANING AND PROTECTION FOR ROOF DECKS

Upon completion of the deck, sweep surfaces clean and prepare for installation of the roofing.

3.8 FIELD QUALITY CONTROL

3.8.1 Headed Stud Inspection

In addition to visual inspection, test and inspect shop-welded shear connectors according to requirements in AWS D1.1/D1.1M for stud welding and as follows:

- a. Perform bend tests if visual inspections reveal either a less-than-continuous 360-degree flash or welding repairs to any shear connector.
- b. Conduct tests according to requirements in AWS D1.1/D1.1M on

additional shear connectors if weld fracture occurs on shear connectors already tested.

3.8.2 Deck Weld Inspection

Visual inspect welds in accordance with AWS D1.3/D1.3M.

3.8.3 Decks Not Receiving Concrete

Inspect the decking top surface for distortion after installation. For roof decks not receiving concrete, verify distortion by placing a straight edge across three adjacent top flanges. The maximum allowable gap between the straight edge and the top flanges should not exceed manufacturing and construction tolerances of supporting members. When gap is more than the allowable, provide corrective measures or replacement. Reinspect decking after performing corrective measures or replacement.

-- End of Section --

This page left blank.

SECTION 05 50 13

MISCELLANEOUS METAL FABRICATIONS

05/17, CHG 1: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ALUMINUM ASSOCIATION (AA)

AA DAF45 (2003; Reaffirmed 2009) Designation System
for Aluminum Finishes

AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC)

AISC 303 (2016) Code of Standard Practice for Steel
Buildings and Bridges

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B18.2.1 (2012; Errata 2013) Square and Hex Bolts
and Screws (Inch Series)

ASME B18.2.2 (2022) Nuts for General Applications:
Machine Screw Nuts, and Hex, Square, Hex
Flange, and Coupling Nuts (Inch Series)

ASME B18.6.2 (2020) Square Head Set Screws and Slotted
Headless Set Screws (Inch Series)

ASME B18.6.3 (2013; R 2017) Machine Screws, Tapping
Screws, and Machine Drive Screws (Inch
Series)

ASME B18.21.1 (2009; R 2016) Washers: Helical
Spring-Lock, Tooth Lock, and Plain Washers
(Inch Series)

ASME B18.21.2M (1999; R 2014) Lock Washers (Metric Series)

ASME B18.22M (1981; R 2017) Metric Plain Washers

AMERICAN SOCIETY OF SAFETY PROFESSIONALS (ASSP)

ASSP A10.3 (2020) Safety Requirements for
Powder-Actuated Fastening Systems American
National Standard for Construction and
Demolition Operations

AMERICAN WELDING SOCIETY (AWS)

AWS D1.1/D1.1M (2020; Errata 1 2021) Structural Welding
Code - Steel

ASTM INTERNATIONAL (ASTM)

ASTM A36/A36M	(2019) Standard Specification for Carbon Structural Steel
ASTM A47/A47M	(1999; R 2022; E 2022) Standard Specification for Ferritic Malleable Iron Castings
ASTM A53/A53M	(2022) Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
ASTM A123/A123M	(2017) Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
ASTM A153/A153M	(2023) Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
ASTM A307	(2021) Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 PSI Tensile Strength
ASTM A500/A500M	(2021a) Standard Specification for Cold-Formed Welded and Seamless Carbon Steel Structural Tubing in Rounds and Shapes
ASTM A653/A653M	(2023) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM A780/A780M	(2020) Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings
ASTM A786/A786M	(2015; R 2021) Standard Specification for Hot-Rolled Carbon, Low-Alloy, High-Strength Low-Alloy, and Alloy Steel Floor Plates
ASTM A924/A924M	(2022a) Standard Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process
ASTM B26/B26M	(2018; E 2018) Standard Specification for Aluminum-Alloy Sand Castings
ASTM B108/B108M	(2019) Standard Specification for Aluminum-Alloy Permanent Mold Castings
ASTM B209	(2014) Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate
ASTM B209M	(2014) Standard Specification for Aluminum

	and Aluminum-Alloy Sheet and Plate (Metric)
ASTM B221	(2021) Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes
ASTM B221M	(2021) Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric)
ASTM C1513	(2018) Standard Specification for Steel Tapping Screws for Cold-Formed Steel Framing Connections
ASTM D1187/D1187M	(1997; R 2018) Standard Specification for Asphalt-Base Emulsions for Use as Protective Coatings for Metal
ASTM F1554	(2020) Standard Specification for Anchor Bolts, Steel, 36, 55, and 105-ksi Yield Strength
MASTER PAINTERS INSTITUTE (MPI)	
MPI 79	(2016) Primer, Alkyd, Anti-Corrosive for Metal
SOCIETY FOR PROTECTIVE COATINGS (SSPC)	
SSPC SP 3	(2018) Power Tool Cleaning
SSPC SP 6/NACE No.3	(2007) Commercial Blast Cleaning
U.S. ARMY CORPS OF ENGINEERS (USACE)	
EM 385-1-1	(2014) Safety -- Safety and Health Requirements Manual

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Structural Steel Door Frames, Fabrication Drawings; G

Expansion Joint Covers, Installation Drawings; G

Bollards/Pipe Guards; G

Embedded Angles and Plates, Installation Drawings; G

SD-03 Product Data

Expansion Joint Covers; G

Structural Steel Door Frames; G

Recycled Content; S

SD-04 Samples

Expansion Joint Covers

SD-07 Certificates

Certificates of Compliance; G

1.3 QUALIFICATION OF WELDERS

Qualify welders in accordance with AWS D1.1/D1.1M. Use procedures, materials, and equipment of the type required for the work.

1.4 DELIVERY, STORAGE, AND PROTECTION

Protect from corrosion, deformation, and other types of damage. Store items in an enclosed area free from contact with soil and weather. Remove and replace damaged items with new items.

1.5 MISCELLANEOUS REQUIREMENTS

1.5.1 Fabrication Drawings

Submit fabrication drawings showing layout(s), connections to structural system, and anchoring details as specified in AISC 303.

1.5.2 Installation Drawings

Submit templates, erection, and installation drawings indicating thickness, type, grade, class of metal, and dimensions. Show construction details, reinforcement, anchorage, and installation in relation to the building construction.

PART 2 PRODUCTS

2.1 RECYCLED CONTENT

Provide products with recycled content. Provide certificates of compliance for recycled content.

2.2 MATERIALS

Provide exposed fastenings of compatible materials (avoid contact of dissimilar metals). Coordinate color and finish with the material to which fastenings are applied.

2.2.1 Structural Carbon Steel

Provide in accordance with ASTM A36/A36M.

2.2.2 Structural Tubing

Provide in accordance with ASTM A500/A500M.

2.2.3 Steel Pipe

Provide in accordance with ASTM A53/A53M, Type E or S, Grade B.

2.2.4 Fittings for Steel Pipe

Provide standard malleable iron fittings in accordance with ASTM A47/A47M.

2.2.5 Gratings

a. Provide metal plank grating, non-slip requirement, steel in accordance with ASTM A653/A653M, Z275 G90.

2.2.6 Floor Plates, Patterned

Provide floor plate in accordance with ASTM A786/A786M. Provide steel plate not less than 14 gage.

2.2.7 Anchor Bolts

Provide in accordance with ASTM F1554. Where exposed, provide anchor bolts of the same material, color, and finish as the metal to which they are applied.

2.2.7.1 Lag Screws and Bolts

Provide in accordance with ASME B18.2.1, type and grade best suited for the purpose.

2.2.7.2 Toggle Bolts

Provide in accordance with ASME B18.2.1.

2.2.7.3 Bolts, Nuts, Studs and Rivets

Provide in accordance with ASME B18.2.2 or ASTM A307.

2.2.7.4 Powder Actuated Fasteners

Follow safety provisions in accordance with ASSP A10.3.

2.2.7.5 Screws

Provide in accordance with ASME B18.2.1, ASME B18.6.2, ASME B18.6.3 and ASTM C1513.

2.2.7.6 Washers

Provide plain washers in accordance with ASME B18.22M, ASME B18.21.1. Provide beveled washers for American Standard beams and channels, square or rectangular, tapered in thickness, and smooth. Provide lock washers in accordance with ASME B18.21.2M, ASME B18.21.1.

2.2.8 Aluminum Alloy Products

Provide in accordance with ASTM B209M, ASTM B209 for sheet plate, ASTM B221M, ASTM B221M, ASTM B221 for extrusions and ASTM B26/B26M or ASTM B108/B108M for castings. Provide aluminum extrusions at least 1/8 inch thick and aluminum plate or sheet at least 0.050 inch thick.

2.3 FABRICATION FINISHES

2.3.1 Galvanizing (All exterior applications)

Hot-dip galvanize items specified to be zinc-coated, after fabrication where practicable. Provide galvanizing in accordance with ASTM A123/A123M, ASTM A153/A153M, ASTM A653/A653M or ASTM A924/A924M, Z275 G90.

2.3.2 Galvanize

Anchor bolts, grating fasteners, washers, and parts or devices necessary for proper installation, unless indicated otherwise.

2.3.3 Repair of Zinc-Coated Surfaces

Repair damaged surfaces with galvanizing repair method and paint in accordance with ASTM A780/A780M or by application of stick or thick paste material specifically designed for repair of galvanizing, as approved by Contracting Officer. Clean areas to be repaired and remove slag from welds. Heat, with a torch, surfaces to which stick or paste material will be applied. Heat to a temperature sufficient to melt the metals in the stick or paste. Spread molten material uniformly over surfaces to be coated and wipe off excess material.

2.3.4 Shop Cleaning and Painting

2.3.4.1 Surface Preparation

Blast clean surfaces in accordance with SSPC SP 6/NACE No.3. Surfaces that will be exposed in spaces above ceiling or in attic spaces, crawl spaces, furred spaces, and chases may be cleaned in accordance with SSPC SP 3 in lieu of being blast cleaned. Wash cleaned surfaces which become contaminated with rust, dirt, oil, grease, or other contaminants with solvents until thoroughly clean. Steel to be embedded in concrete must be free of dirt and grease prior to embed. Do not paint or galvanize bearing surfaces, including contact surfaces within slip critical joints. Shop coat these surfaces with rust prevention.

2.3.4.2 Pretreatment, Priming and Painting

Apply pre-treatment, primer, and paint in accordance with manufacturer's printed instructions. On surfaces concealed in the finished construction or not accessible for finish painting, apply an additional prime coat to a minimum dry film thickness of 1.0 mil. Tint additional prime coat with a small amount of tinting pigment.

2.3.5 Nonferrous Metal Surfaces

Protect by plating, anodic, or organic coatings.

2.3.6 Aluminum Surfaces

2.3.6.1 Surface Condition

Before finishes are applied, remove roll marks, scratches, rolled-in scratches, kinks, stains, pits, orange peel, die marks, structural streaks, and other defects which will affect uniform appearance of finished surfaces.

2.3.6.2 Aluminum Finishes

Unexposed sheet, plate and extrusions may have mill finish as fabricated. Sandblast castings' finish, medium, AA DAF45. Unless otherwise specified, provide all other aluminum items with a anodized finish. Provide a coating thickness not less than that specified for protective and decorative type finishes for items used in interior locations or architectural Class I type finish for items used in exterior locations. Provide in accordance with AA DAF45. Provide a polished satin finish on items to be anodized.

2.4 EXPANSION JOINT COVERS

Provide expansion joint covers constructed of extruded aluminum with anodized satin aluminum finish for walls and ceilings and standard mill finish for floor covers and exterior covers. Furnish plates, backup angles, expansion filler strips and anchors as indicated. Provide fire-rating for expansion joints in fire rated construction assemblies, rating equal to assembly rating.

2.5 BOLLARDS/PIPE GUARDS

Provide galvanized standard weight steel pipe in accordance with ASTM A53/A53M, size as indicated. Anchor posts in concrete as indicated and fill solidly with concrete with minimum compressive strength of 2500 psi.

2.6 MISCELLANEOUS PLATES AND SHAPES

Provide items that do not form a part of the structural steel framework, such as lintels, sill angles, support framing for ceiling-mounted toilet partitions, miscellaneous mountings and frames. Provide lintels fabricated from structural steel shapes over openings in masonry walls and partitions as indicated and as required to support wall loads over openings. Provide with connections and fasteners. Construct to have at least 8 in bearing on masonry at each end as indicated.

Provide angles and plates in accordance with ASTM A36/A36M, for embedment as indicated. Galvanize embedded items exposed to the elements in accordance with ASTM A123/A123M.

2.7 STRUCTURAL STEEL DOOR FRAMES

- a. Provide frames as indicated. Unless otherwise indicated, construct frames of structural shapes, or shape and plate composite, to form a full depth channel shape with at least 1-1/2 inch outstanding legs.
- b. Provide support where track, guides, hoods, hangers, operators, and other accessories are required.

- c. Provide jamb anchors near top, bottom, and at not more than 24 inch intervals. Provide the bottom of each jamb member with a clip angle welded in place with two 1/2 inch diameter floor bolts for adjustment.

Provide frames of rolled shapes as indicated. Miter and weld heads to jambs, or provide riveted clip angle connections concealed in the finished work. Stiffen head openings greater than 3 feet as necessary to limit deflection to not more than 1/16 inch. Secure frames to masonry with zinc-coated metal anchors spaced not more than 30 inches on centers. Where necessary to engage the threads of machine screws for fastening hardware, back frames on inside faces with steel plates of suitable thickness. Tap frames and reinforcing plates as necessary for the installation of hardware and other work. Countersink rivets and screw heads where they will be exposed in the finished work. Grind welds smooth.

PART 3 EXECUTION

3.1 GENERAL INSTALLATION REQUIREMENTS

Install items at locations indicated in accordance with manufacturer's instructions. Verify all field dimensions prior to fabrication. Include materials and parts necessary to complete each assembly, whether indicated or not. Miss-alignment and miss-sizing of holes for fasteners is cause for rejection. Conceal fastenings where practicable. Joints exposed to weather must be watertight.

3.2 WORKMANSHIP

Provide miscellaneous metalwork that is true and accurate in shape, size, and profile. Make angles and lines continuous and straight. Make curves consistent, smooth and unfaceted. Provide continuous welding along the entire area of contact except where tack welding is permitted. Do not tack weld exposed connections. Unless otherwise indicated and approved, provide a smooth finish on exposed surfaces. Provide countersunk rivets where exposed. Provide coped and mitered corner joints aligned flush and without gaps.

3.3 ANCHORAGE, FASTENINGS, AND CONNECTIONS

Provide anchorage as necessary, whether indicated or not, for fastening miscellaneous metal items securely in place. Include slotted inserts, expansion shields, powder-driven fasteners, toggle bolts (when approved for concrete), through bolts for masonry, headed shear studs, machine and carriage bolts for steel, through bolts, lag bolts, and screws for wood. Do not use wood plugs. Provide non-ferrous attachments for non-ferrous metal. Provide exposed fastenings of compatible materials (avoid contact of dissimilar metals), that generally match in color and finish the surfaces to which they are applied. Conceal fastenings where practicable. Provide all fasteners flush with the surfaces they fasten, unless indicated otherwise.

3.4 BUILT-IN WORK

Where necessary and not otherwise indicated, form built-in metal work for anchorage with concrete or masonry. Provide built-in metal work in ample time for securing in place as the work progresses.

3.5 WELDING

Perform welding, welding inspection, and corrective welding in accordance with AWS D1.1/D1.1M. Use continuous welds on all exposed connections. Grind visible welds smooth in the finished installation. Provide welded headed shear studs in accordance with AWS D1.1/D1.1M, Clause 7, except as otherwise specified. Provide in accordance with the safety requirements of EM 385-1-1.

3.6 DISSIMILAR METALS

Where dissimilar metals are in contact, protect surfaces with a coating in accordance with MPI 79 to prevent galvanic or corrosive action. Where aluminum is in contact with concrete, plaster, mortar, masonry, wood, or absorptive materials subject to wetting, protect in accordance with ASTM D1187/D1187M, asphalt-base emulsion. Clean surfaces with metal shavings from installation at the end of each work day.

3.7 PREPARATION

3.7.1 Material Coatings and Surfaces

Remove rust preventive coating just prior to field erection, using a remover approved by the metal manufacturer. Surfaces, when assembled, must be free of rust, grease, dirt and other foreign matter.

3.7.2 Environmental Conditions

Do not clean or paint surfaces when damp or exposed to foggy or rainy weather, when metallic surface temperature is less than minus 5 degrees F above the dew point of the surrounding air, or when surface temperature is below 45 degrees F or over 95 degrees F, unless approved by the Contracting Officer. Metal surfaces to be painted must be dry for a minimum of 48 hours prior to the application of primer or paint.

3.8 EXPANSION JOINT COVERS

Provide in accordance with manufacturer's written instructions. Verify installation allows specified movement prior to completion of work

3.9 INSTALLATION OF BOLLARDS/PIPE GUARDS

Set bollards/pipe guards vertically in concrete piers. Fill hollow cores with concrete having a compressive strength of 3000 psi.

3.10 STRUCTURAL STEEL DOOR FRAMES

Secure door frames to the floor slab by means of angle clips and expansion bolts. Provide any necessary reinforcements and drill and tap frames as required for hardware. Clean metal shavings from finished surfaces at the end of each work day.

3.11 INSTALLATION MISCELLANEOUS PLATES AND SHAPES

Provide lintels fabricated from structural steel shapes over openings in masonry walls and partitions as indicated and as required to support wall loads over openings. Provide with connections and fasteners. Construct to have at least 8 inches bearing on masonry at each end.

-- End of Section --

SECTION 06 10 00

ROUGH CARPENTRY
08/16, CHG 2: 11/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN FOREST FOUNDATION (AFF)

ATFS STANDARDS (2015) American Tree Farm System Standards of Sustainability 2015-2020

AMERICAN INSTITUTE OF TIMBER CONSTRUCTION (AITC)

AITC 111 (2005) Recommended Practice for Protection of Structural Glued Laminated Timber During Transit, Storage and Erection

AMERICAN LUMBER STANDARDS COMMITTEE (ALSC)

ALSC PS 20 (2015) American Softwood Lumber Standard

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B18.2.1 (2012; Errata 2013) Square and Hex Bolts and Screws (Inch Series)

ASME B18.2.2 (2022) Nuts for General Applications: Machine Screw Nuts, and Hex, Square, Hex Flange, and Coupling Nuts (Inch Series)

ASME B18.5.2.1M (2006; R 2011) Metric Round Head Short Square Neck Bolts

ASME B18.5.2.2M (1982; R 2010) Metric Round Head Square Neck Bolts

ASME B18.6.1 (2016) Wood Screws (Inch Series)

AMERICAN WOOD COUNCIL (AWC)

AWC NDS (2015) National Design Specification (NDS) for Wood Construction

AWC WFCM (2012) Wood Frame Construction Manual for One- and Two-Family Dwellings

AMERICAN WOOD PROTECTION ASSOCIATION (AWPA)

AWPA BOOK (2015) AWPA Book of Standards

AWPA M2 (2019) Standard for the Inspection of

Preservative Treated Wood Products for
Industrial Use

AWPA M6	(2013) Brands Used on Preservative Treated Materials
AWPA P5	(2015) Standard for Waterborne Preservatives
AWPA P18	(2014) Nonpressure Preservatives
AWPA P49	(2015; R 2021) Standard for Fire Retardant FR-1
AWPA T1	(2023) Use Category System: Processing and Treatment Standard
AWPA U1	(2023) Use Category System: User Specification for Treated Wood

APA - THE ENGINEERED WOOD ASSOCIATION (APA)

APA E445	(2002) Performance Standards and Qualification Policy for Structural-Use Panels (APA PRP-108)
APA EWS R540	(2013) Builder Tips: Proper Storage and Handling of Glulam Beams
APA F405	(19) Product Guide: Performance Rated Panels
APA L870	(2010) Voluntary Product Standard, PS 1-09, Structural Plywood
APA S350	(2014) PS 2-10, Performance Standard for Wood-Based Structural-Use Panels

ASTM INTERNATIONAL (ASTM)

ASTM A153/A153M	(2023) Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
ASTM A307	(2021) Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 PSI Tensile Strength
ASTM D2898	(2010; R 2017) Standard Practice for Accelerated Weathering of Fire-Retardant-Treated Wood for Fire Testing
ASTM F547	(202) Standard Terminology of Nails for Use with Wood and Wood-Base Materials
ASTM F1667/F1667M	(2021a) Standard Specification for Driven Fasteners: Nails, Spikes, and Staples

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350 (2017; Version 1.2) Standard Method for
the Testing and Evaluation of Volatile
Organic Chemical Emissions from Indoor
Sources using Environmental Chambers

CSA GROUP (CSA)

CSA Z809-08 (R2013) Sustainable Forest Management

FM GLOBAL (FM)

FM 4435 (2017) Roof Perimeter Flashing

FOREST STEWARDSHIP COUNCIL (FSC)

FSC STD 01 001 (2015) Principles and Criteria for Forest
Stewardship

GREEN SEAL (GS)

GS-36 (2013) Adhesives for Commercial Use

NATIONAL HARDWOOD LUMBER ASSOCIATION (NHLA)

NHLA Rules (2015) Rules for the Measurement &
Inspection of Hardwood & Cypress

NORTHEASTERN LUMBER MANUFACTURERS ASSOCIATION (NELMA)

NELMA Grading Rules (2013) Standard Grading Rules for
Northeastern Lumber

PROGRAMME FOR ENDORSEMENT OF FOREST CERTIFICATION (PEFC)

PEFC ST 2002:2013 (2015) PEFC International Standard Chain
of Custody of Forest Based Products
Requirements

REDWOOD INSPECTION SERVICE (RIS) OF THE CALIFORNIA REDWOOD
ASSOCIATION (CRA)

RIS Grade Use (1998) Redwood Lumber Grades and Uses

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168 (2017) Adhesive and Sealant Applications

SOUTHERN CYPRESS MANUFACTURERS ASSOCIATION (SCMA)

SCMA Spec (1986; Supple. No. 1, Aug 1993) Standard
Specifications for Grades of Southern
Cypress

SOUTHERN PINE INSPECTION BUREAU (SPIB)

SPIB 1003 (2014) Standard Grading Rules for Southern
Pine Lumber

SUSTAINABLE FOREST INITIATIVE (SFI)

SFI 2015-2019 (2015) Standards, Rules for Label Use,
Procedures and Guidance

U.S. DEPARTMENT OF COMMERCE (DOC)

DOC/NIST PS56 (1973) Structural Glued Laminated Timber

U.S. GENERAL SERVICES ADMINISTRATION (GSA)

CID A-A-1923 (Rev A; Notice 1; Notice 2; Notice 3;
Notice 4) Shield, Expansion (Lag, Machine
and Externally Threaded Wedge Bolt Anchors)

CID A-A-1924 (Rev A; Notice 3) Shield, Expansion (Self
Drilling Tubular Expansion Shell Bolt
Anchors)

CID A-A-1925 (Rev A; Notice 3) Shield Expansion (Nail
Anchors)

UNDERWRITERS LABORATORIES (UL)

UL 2818 (2022) GREENGUARD Certification Program
For Chemical Emissions For Building
Materials, Finishes And Furnishings

WEST COAST LUMBER INSPECTION BUREAU (WCLIB)

WCLIB 17 (2015) Standard Grading Rules

WESTERN WOOD PRODUCTS ASSOCIATION (WWPA)

WWPA G-5 (2017) Western Lumber Grading Rules

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Nailers and Nailing Strips; G

Drawings of field erection details, including materials and methods of fastening nailers in conformance with Factory Mutual wind uplift rated systems specified in other Sections of these specifications.

SD-03 Product Data

Fire-retardant Treatment

Adhesives

SD-06 Test Reports

Preservative-treated Lumber and Plywood

SD-07 Certificates

Certificates of Grade

Certified Sustainably Harvested Plywood for Other Uses; S

Preservative Treatment

1.3 DELIVERY AND STORAGE

Deliver materials to the site in an undamaged condition. Store, protect, handle, and install prefabricated structural elements in accordance with manufacturer's instructions and as specified. Store materials off the ground to provide proper ventilation, with drainage to avoid standing water, and protection against ground moisture and dampness. Store materials with a moisture barrier at both the ground level and as a cover forming a well ventilated enclosure. Store wood I-beams and glue-laminated beams and joists on edge. Adhere to requirements for stacking, lifting, bracing, cutting, notching, and special fastening requirements. Handle and store laminated timber in accordance with AITC 111 or APA EWS R540. Do not use materials that have visible moisture or biological growth. Remove defective and damaged materials and provide new materials. Store separated reusable wood waste convenient to cutting station and area of work.

1.4 GRADING AND MARKING

1.4.1 Lumber

Mark each piece of framing and board lumber or each bundle of small pieces of lumber with the grade mark of a recognized association or independent inspection agency. Such association or agency must be certified by the Board of Review, American Lumber Standards Committee, to grade the species used. Surfaces that are to be exposed to view must not bear grademarks, stamps, or any type of identifying mark. Hammer marking will be permitted on timbers when all surfaces will be exposed to view.

1.4.2 Plywood

Mark each sheet with the mark of a recognized association or independent inspection agency that maintains continuing control over the quality of the plywood. The mark must identify the plywood by species group or span rating, exposure durability classification, grade, and compliance with

APA L870. Surfaces that are to be exposed to view must not bear grademarks or other types of identifying marks.

1.4.3 Preservative-Treated Lumber and Plywood

The Contractor is responsible for the quality of treated wood products. Each treated piece must be inspected in accordance with AWPA M2 and permanently marked or branded, by the producer, in accordance with AWPA M6. The Contractor must provide Contracting Officer's Representative (COR) with the inspection report of an approved independent inspection agency that offered products comply with applicable AWPA Standards. The appropriate Quality Mark on each piece will be accepted, in lieu of inspection reports, as evidence of compliance with applicable AWPA treatment standards.

1.4.4 Fire-Retardant Treated Lumber

Mark each piece in accordance with AWPA M6, except pieces that are to be natural or transparent finished. In addition, exterior fire-retardant lumber must be distinguished by a permanent penetrating blue stain. Labels of a nationally recognized independent testing agency will be accepted as evidence of conformance to the fire-retardant requirements of AWPA M6.

1.5 SIZES AND SURFACING

ALSC PS 20 for dressed sizes of yard and structural lumber. Lumber must be surfaced four sides. Size references, unless otherwise specified, are nominal sizes, and actual sizes must be within manufacturing tolerances allowed by the standard under which the product is produced. Other measurements are IP or SI standard.

1.6 MOISTURE CONTENT

Air-dry or kiln-dry lumber. Kiln-dry treated lumber after treatment. Maximum moisture content of wood products must be as follows at the time of delivery to the job site:

- a. Framing lumber and board, 19 percent maximum
- b. Timbers 5 inches and thicker, 25 percent maximum
- d. Materials other than lumber; moisture content must be in accordance with standard under which the product is produced

1.7 PRESERVATIVE TREATMENT

Treat wood products with waterborne wood preservatives conforming to AWPA P5. Pressure treatment of wood products must conform to the requirements of AWPA BOOK Use Category System Standards U1 and T1. Pressure-treated wood products must not contain arsenic, chromium, or other agents classified as carcinogenic, probably carcinogenic, or possibly carcinogenic to humans (compounds in Groups 1, 2A, or 2B) by the International Agency for Research on Cancer (IARC), Lyon, France. Pressure-treated wood products must not exceed the limits of the U.S. EPA's Toxic Characteristic Leaching Procedure (TCLP), and must not be classified as hazardous waste. Submit certification from treating plant stating chemicals and process used and net amount of preservatives retained are in conformance with specified standards. In accordance with

AWPA U1 provide non-copper preservative treatment such as EL2, PTI or SBX, DOT for products in direct contact with sheet metal.

- a. 0.25 pcf intended for above ground use.
- b. 0.40 pcf intended for ground contact and fresh water use. 0.60 pcf intended for Ammoniacal Copper Quaternary Compound (ACQ)-treated foundations. 0.80 to 1.00 pcf intended for ACQ-treated pilings. All wood must be air or kiln dried after treatment. Specific treatments must be verified by the report of an approved independent inspection agency, or the AWPA Quality Mark on each piece. Minimize cutting and avoid breathing sawdust. Brush coat areas that are cut or drilled after treatment with either the same preservative used in the treatment or with a 2 percent copper naphthenate solution. The following items must be preservative treated:

- (1) Wood sills, soles, plates, furring, and sleepers that are less than 24 inches from the ground, furring and nailers that are set into or in contact with concrete or masonry.

- (2) Nailers, edge strips, crickets, curbs, and cants for roof decks.

1.7.1 New Construction

Use a boron-based preservative conforming to AWPA P18, sodium silicate wood mineralization process, or Ammoniacal Copper Quaternary Compound to treat wood. Use boron-based preservatives for above-ground applications only.

1.8 FIRE-RETARDANT TREATMENT

Fire-retardant treated wood must be pressure treated with fire retardants conforming to AWPA P49. Fire retardant treatment of wood products must conform to the requirements of AWPA U1, Commodity Specification H and AWPA T1, Section H. Treatment and performance inspection must be by an independent and qualified testing agency that establishes performance ratings. Each piece or bundle of treated material must bear identification of the testing agency to indicate performance in accordance with such rating. Treated materials to be exposed to rain wetting must be subjected to an accelerated weathering technique in accordance with ASTM D2898 prior to being tested. Such items which will not be inside a building, and such items which will be exposed to heat or high humidity, must receive exterior fire-retardant treatment. Fire-retardant-treated wood products must be free of halogens, sulfates, ammonium phosphate, and formaldehyde. Items to be treated include the following:

- a. Telecomm plywood backboards and other conditions identified. .

1.9 QUALITY ASSURANCE

1.9.1 Humidity Requirements

Sequence work to minimize use of temporary HVAC to dry out building and control humidity.

1.10 ENVIRONMENTAL REQUIREMENTS

During and immediately after installation of treated wood, engineered wood products, and laminated wood products at interior spaces, provide temporary ventilation.

1.11 CERTIFICATIONS

1.11.1 Certified Wood Grades

Provide certificates of grade from the grading agency on graded but unmarked lumber or plywood attesting that materials meet the grade requirements specified herein.

1.11.2 Certified Sustainably Harvested Wood

Provide wood certified as sustainably harvested by FSC STD 01 001, ATFS STANDARDS, CSA Z809-08, SFI 2015-2019, or other third party program certified by PEFC ST 2002:2013. Provide a letter of Certification of Sustainably Harvested Wood signed by the wood supplier. Identify certifying organization and their third party program name and indicate compliance with chain-of-custody program requirements. Submit sustainable wood certification data; identify each certified product on a line item basis. Submit copies of invoices bearing certification numbers.

1.11.3 Indoor Air Quality Certifications

Submit required indoor air quality certifications in one submittal package.

1.11.3.1 Adhesives and Sealants

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited herein.

PART 2 PRODUCTS

2.1 LUMBER

2.1.1 Framing Lumber

Framing lumber such as studs, plates, caps, collar beams, cant strips, bucks, sleepers, nailing strips, and nailers and board lumber such as subflooring and wall and roof sheathing must be one of the species listed in the table below. Minimum grade of species must be as listed. Finger-jointed lumber may be used in the same applications as solid lumber of an equivalent species and grade, provided the finger-jointed lumber meets all the requirements of the certification and the quality control programs of the rules writing agency having jurisdiction and all applicable requirements of DOC/NIST PS56. Provide certified sustainably harvested framing lumber.

<u>Table of Grades for Framing and Board Lumber</u>			
<u>Grading Rules</u>	<u>Species</u>	<u>Framing</u>	<u>Board Lumber</u>
WWPA G-5 standard grading rules	Aspen, Douglas Fir-Larch, Douglas Fir South, Engelmann Spruce-Lodgepole Pine, Engelmann Spruce, Hem-Fir, Idaho White Pine, Lodgepole Pine, Mountain Hemlock, Mountain Hemlock-Hem-Fir, Ponderosa Pine-Sugar Pine, Ponderosa Pine-Lodgepole Pine, Subalpine Fir, White Woods, Western Woods, Western Cedars, Western Hemlock	All Species: Standard Light Framing or No. 3 Structural Light Framing (Stud Grade for 2x4 nominal size, 10 feet and shorter)	All Species: No. 3 Common
WCLIB 17 standard grading rules	Douglas Fir-Larch, Hem-Fir, Mountain Hemlock, Sitka Spruce, Western Cedars, Western Hemlock	All Species: Standard Light Framing or No. 3 Structural Light Framing (Stud Grade for 2x4 nominal size, 10 feet and shorter)	All Species: Standard

<u>Table of Grades for Framing and Board Lumber</u>			
<u>Grading Rules</u>	<u>Species</u>	<u>Framing</u>	<u>Board Lumber</u>
SPIB 1003 standard grading rules	Southern Pine	All Species: Standard Light Framing or No. 3 Structural Light Framing (Stud Grade for 2x4 nominal size, 10 feet and shorter)	No. 2 Boards
SCMA Spec standard specifications	Cypress	No. 2 Common	No. 2 Common
NELMA Grading Rules standard grading rules	Balsam Fir, Eastern Hemlock-Tamarack, Eastern Spruce, Eastern White Pine, Northern Pine, Northern Pine-Cedar	All Species: Standard Light Framing or No. 3 Structural Light Framing (Stud Grade for 2x4 nominal size, 10 feet and shorter)	All Species: No. 3 Common except Standard for Eastern White and Northern Pine
RIS Grade Use standard specifications	Redwood	All Species: Standard Light Framing or No. 3 Structural Light Framing (Stud Grade for 2x4 nominal size, 10 feet and shorter)	Construction Heart

<u>Table of Grades for Framing and Board Lumber</u>			
<u>Grading Rules</u>	<u>Species</u>	<u>Framing</u>	<u>Board Lumber</u>
NHLA Rules rules for the measurement and inspection of hardwood and cypress lumber	Cypress	No. 2 Dimension	No. 2 Common

2.2 PLYWOOD, STRUCTURAL-USE, AND ORIENTED STRAND BOARD (OSB) PANELS

APA L870, APA S350, APA E445, and APA F405 respectively.

2.2.1 Other Uses

2.2.1.1 Plywood

Plywood for telecomm backboards. C-D Grade, Exposure 1. Provide certified sustainably harvested plywood for other uses.

2.3 OTHER MATERIALS

2.3.1 Miscellaneous Wood Members

2.3.1.1 Blocking

Blocking must be standard or number 2 grade.

2.3.1.2 Rough Bucks and Frames

Rough bucks and frames must be straight standard or number 2 grade.

2.3.2 Adhesives

Comply with applicable regulations regarding toxic and hazardous materials and as specified. Provide non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide aerosol adhesives used on the interior of the building meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of GS-36. Provide certification or validation of indoor air quality for non-aerosol adhesives applied on the interior of the building (inside of the weatherproofing system). Provide certification or validation of indoor air quality for aerosol adhesives used on the interior of the building (inside of the weatherproofing system).

2.4 ROUGH HARDWARE

Unless otherwise indicated or specified, rough hardware must be of the type and size necessary for the project requirements. Sizes, types, and

spacing of fastenings of manufactured building materials must be as recommended by the product manufacturer unless otherwise indicated or specified. Rough hardware exposed to the weather or embedded in or in contact with preservative treated wood, exterior masonry, or concrete walls or slabs must be hot-dip zinc-coated in accordance with ASTM A153/A153M. Nails and fastenings for fire-retardant treated lumber and woodwork exposed to the weather must be copper alloy or hot-dipped galvanized fasteners as recommended by the treated wood manufacturer.

2.4.1 Bolts, Nuts, Studs, and Rivets

ASME B18.2.1, ASME B18.5.2.1M, ASME B18.5.2.2M and ASME B18.2.2.

2.4.2 Anchor Bolts

ASTM A307, size as indicated, complete with nuts and washers.

2.4.3 Expansion Shields

CID A-A-1923, CID A-A-1924, and CID A-A-1925. Except as shown otherwise, maximum size of devices must be 3/8 inch.

2.4.4 Lag Screws and Lag Bolts

ASME B18.2.1.

2.4.5 Wood Screws

ASME B18.6.1.

2.4.6 Nails

ASTM F547, size and type best suited for purpose. For sheathing and subflooring, length of nails must be sufficient to extend 1 inch into supports. In general, 8-penny or larger nails must be used for nailing through 1 inch thick lumber and for toe nailing 2 inch thick lumber; 16-penny or larger nails must be used for nailing through 2 inch thick lumber. Nails used with treated lumber and sheathing must be hot-dipped galvanized in accordance with ASTM A153/A153M. Nailing must be in accordance with the recommended nailing schedule contained in AWC WFCM. Where detailed nailing requirements are not specified, nail size and spacing must be sufficient to develop an adequate strength for the connection. The connection's strength must be verified against the nail capacity tables in AWC NDS. Reasonable judgment backed by experience must ensure that the designed connection will not cause the wood to split. If a load situation exceeds a reasonable limit for nails, a specialized connector must be used.

2.4.7 Wire Nails

ASTM F1667/F1667M.

2.4.8 Clip Angles

Steel, 3/16 inch thick, size as indicated for intended use; or zinc-coated steel or iron commercial clips designed for connecting wood members.

2.4.9 Door Buck Anchors

Metal anchors, 1/8 by 1-1/4 inch steel, 12 inches long, with ends bent 2 inches , except as indicated otherwise. Anchors must be screwed to the backs of bucks and built into masonry or concrete. Locate 8 inches above sills and below heads and not more than 24 inches intermediately between.

PART 3 EXECUTION

3.1 INSTALLATION

Do not install building construction materials that show visual evidence of biological growth.

Conform to AWC WFCM and install in accordance with the National Association of Home Builders (NAHB) Advanced Framing Techniques: Optimum Value Engineering, unless otherwise indicated or specified. Select lumber sizes to minimize waste. Fit framing lumber and other rough carpentry, set accurately to the required lines and levels, and secure in place in a rigid manner.

3.2 MISCELLANEOUS

3.2.1 Wood Roof Nailers, Edge Strips, Crickets, Curbs, and Cants

Provide sizes and configurations indicated or specified and anchored securely to continuous construction.

3.2.1.1 Roof Edge Strips and Nailers

Provide at perimeter of roof, around openings through roof, and where roofs abut walls, curbs, and other vertical surfaces. Except where indicated otherwise, nailers must be 6 inches wide and the same thickness as the insulation. Anchor nailers securely to underlying construction. Anchor perimeter nailers in accordance with FM 4435.or as otherwise indicated.

3.2.1.2 Crickets, Cants, and Curbs

Provide wood saddles or crickets, cant strips, curbs for scuttles and ventilators, and wood nailers bolted to tops of concrete or masonry curbs as indicated, specified, or necessary and of lumber .

3.2.2 Rough Wood Bucks

2 inch nominal thickness. Set wood bucks true and plumb. Anchor bucks to concrete or masonry with steel straps extending into the wall 8 inches minimum. Place anchors near the top and bottom of the buck and space uniformly at 2 foot maximum intervals.

3.2.3 Wood Blocking

Provide proper sizes and shapes at proper locations for the installation and attachment of wood and other finish materials, fixtures, equipment, and items indicated or specified.

3.2.4 Wood Grounds

Provide for fastening wood trim, finish materials, and other items to

plastered walls and ceilings. Install grounds in proper alignment and true with an 8 foot straightedge.

3.2.5 Wood Furring

Provide where shown and as necessary for facing materials specified. Except as shown otherwise, furring strips must be nominal one by 3, continuous, and spaced 16 inches o.c. Erect furring vertically or horizontally as necessary. Nail furring strips to masonry. Do not use wood plugs. Provide furring strips around openings, behind bases, and at angles and corners. Furring must be plumb, rigid, and level and must be shimmed as necessary to provide a true, even plane with surfaces suitable to receive the finish required. Form furring for offsets and breaks in walls or ceilings on 1 by 4 wood strips spaced 16 inches o.c.

3.2.6 Wood Bumpers

Dress to the sizes indicated, and bevel edges. Bore, countersink, and bolt bumpers in place.

3.2.7 Temporary Closures

Provide with hinged doors and padlocks and install during construction at exterior doorways and other ground level openings that are not otherwise closed. Cover windows and other unprotected openings with polyethylene or other approved material, stretched on wood frames. Provide dustproof barrier partitions to isolate areas as directed.

3.3 WASTE MANAGEMENT OF WOOD PRODUCTS

In accordance with the Waste Management Plan and as specified. Clearly separate damaged wood and other scrap lumber for acceptable alternative uses on site, including bracing, blocking, cripples, ties, and shims.

Separate treated, stained, painted, and contaminated wood and place in designated area for hazardous materials. Dispose of according to local regulations. Do not leave any wood, shavings, sawdust, or other wood waste buried in fill or on the ground. Prevent sawdust and wood shavings from entering the storm drainage system. Do not burn scrap lumber that has been pressure treated, or lumber that is less than one year old.

-- End of Section --

SECTION 06 41 16.00 10

PLASTIC-LAMINATE-CLAD ARCHITECTURAL CABINETS

08/10, CHG 1: 11/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI A161.2 (1998) Decorative Laminate Countertops,
Performance Standards for Fabricated High
Pressure

ASTM INTERNATIONAL (ASTM)

ASTM D1037 (2012) Evaluating Properties of Wood-Base
Fiber and Particle Panel Materials

ASTM E84 (2023) Standard Test Method for Surface
Burning Characteristics of Building
Materials

ASTM F547 (202) Standard Terminology of Nails for
Use with Wood and Wood-Base Materials

BUILDERS HARDWARE MANUFACTURERS ASSOCIATION (BHMA)

ANSI/BHMA A156.9 (2020) Cabinet Hardware

COMPOSITE PANEL ASSOCIATION (CPA)

CPA A208.1 (2016) Particleboard

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

ANSI/NEMA LD 3 (2005) Standard for High-Pressure
Decorative Laminates

U.S. GREEN BUILDING COUNCIL (USGBC)

LEED BD+C (2009; R 2010) Leadership in Energy and
Environmental Design(tm) Building Design
and Construction (LEED-NC)

WINDOW AND DOOR MANUFACTURERS ASSOCIATION (WDMA)

ANSI/WDMA I.S.1A (2013) Interior Architectural Wood Flush
Doors

WOODWORK INSTITUTE (WI)

NAAWS 3.1 (2017; 2018 Errata Edition) North American

Architectural Woodwork Standards

1.2 SYSTEM DESCRIPTION

Work in this section includes laminate clad custom casework cabinets and vanities as shown on the drawings and as described in this specification. This Section includes high-pressure laminate surfacing and cabinet hardware. Comply with EPA requirements in accordance with Section 01 33 29 SUSTAINABILITY REQUIREMENTS AND REPORTING. Sand smooth and apply a clear finish of polyurethane to all exposed and semi-exposed surfaces, whose finish is not otherwise noted on the drawings or finish schedule. Wood finish may be shop finished or field applied in accordance with Section 09 90 00 PAINTS AND COATINGS.

1.3 SUSTAINABILITY REPORTING

Materials in this technical specification may contribute towards contract compliance with sustainability requirements. See Section 01 33 29 SUSTAINABILITY REQUIREMENTS AND REPORTING for project LEED BD+C local/regional materials, low-emitting materials, recycled content, certified wood and rapidly renewable materials LEED documentation requirements.

1.4 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Shop Drawings; G
Installation

SD-03 Product Data

Wood Materials; G
Laminate Finishes; G
Finish Schedule; G
Certification

SD-04 Samples

Plastic Laminates; G
Cabinet Hardware; G

SD-07 Certificates

Quality Assurance
Laminate Clad Casework

SD-11 Closeout Submittals

LEED Documentation

1.5 QUALITY ASSURANCE

1.5.1 General Requirements

Unless otherwise noted on the drawings, furnish all materials, construction methods, and fabrication conforming to and complying with the custom grade quality standards as outlined in NAAWS 3.1, Section for laminate clad cabinets. These standards apply in lieu of omissions or specific requirements in this specification. Contractors and their personnel engaged in the work must be able to demonstrate successful experience with work of comparable extent, complexity and quality to that shown and specified. Submit a quality control statement which illustrates compliance with and understanding of NAAWS 3.1 requirements, in general, and the specific NAAWS 3.1 requirements provided in this specification. The quality control statement must also certify a minimum of ten years Contractor's experience in laminate clad casework fabrication and construction. Provide a list of a minimum of five successfully completed projects of a similar scope, size, and complexity in the quality control statement.

1.6 DELIVERY, STORAGE, AND HANDLING

Casework may be delivered knockdown or fully assembled. Deliver all units to the site in undamaged condition, stored off the ground in fully enclosed areas, and protected from damage. Ventilate the storage area and do not subject to extreme changes in temperature or humidity.

1.7 SEQUENCING AND SCHEDULING

Coordinate work with other trades. Do not install units in any room or space until painting, and ceiling installation are complete within the room where the units are located. Install floor cabinets before finished flooring materials are installed.

PART 2 PRODUCTS

2.1 WOOD MATERIALS

2.1.1 Lumber

- a. Provide kiln-dried Grade III framing lumber to dimensions as shown on the drawings. Frame front, where indicated on the drawings, must be nominal 3/4 inch hardwood.

2.1.2 Panel Products

2.1.2.1 Plywood

Use veneer core hardwood plywood, NAAWS 3.1 Grade AA panels for framing purposes. Indicate nominal thickness of plywood panels in this specification and on the drawings.

2.1.2.2 Particleboard

Provide industrial grade, medium density (40 to 50 pounds per cubic foot), 3/4 inch thick particleboard. Use a moisture-resistant particleboard in grade Type 2-M-2 or 2-M-3 as the substrate for plastic laminate covered

countertops and other areas subjected to moisture. Provide particleboard meeting the minimum standards listed in ASTM D1037 and CPA A208.1.

2.2 SOLID POLYMER MATERIAL

Provide solid surfacing casework components in conformance to the requirements of Section 06 61 16 SOLID SURFACING FABRICATIONS.

2.3 HIGH PRESSURE DECORATIVE LAMINATE (HPDL)

Provide plastic laminates meeting the requirements of ANSI/NEMA LD 3 and ANSI A161.2 for high-pressure decorative laminates. Indicate design, colors, surface finish and texture, and locations on Section 09 06 00 SCHEDULES FOR FINISHES . Submit two samples of each plastic laminate pattern and color. Samples less than 5 by 7 inches in size are not acceptable. Provide plastic laminate types and nominal minimum thicknesses for casework components as indicated in the following paragraphs.

2.3.1 Horizontal General Purpose Standard (HGS) Grade

Provide horizontal general purpose standard grade plastic laminate that is 0.048 inches (plus or minus 0.005 inches) in thickness. This laminate grade is intended for horizontal surfaces where postforming is not required.

2.3.2 Vertical General Purpose Standard (VGS) Grade

Provide vertical general purpose standard grade plastic laminate that is 0.028 inches (plus or minus 0.004 inches) in thickness. This laminate grade is intended for exposed exterior vertical surfaces of casework components where postforming is not required.

2.3.3 Horizontal General Purpose Postformable (HGP) Grade

Provide horizontal general purpose postformable grade plastic laminate that is 0.042 inches (plus or minus 0.005 inches) in thickness. This laminate grade is intended for horizontal surfaces where post forming is required.

2.3.4 Vertical General Purpose Postformable (VGP) Grade

Provide vertical general purpose postformable grade plastic laminate that is 0.028 inches (plus or minus 0.004 inches) in thickness. This laminate grade is intended for exposed exterior vertical surfaces of components where postforming is required for curved surfaces.

2.3.5 Horizontal General Purpose Fire Rated (HGF) Grade

Provide horizontal general purpose fire rated grade plastic laminate that is 0.048 inches (plus or minus 0.005 inches) in thickness and a class 1, class A fire rating in accordance with ASTM E84.

2.3.6 Vertical General Purpose Fire Rated (VGF) Grade

Provide vertical general purpose fire rated grade plastic laminate that is 0.028 inches (plus or minus 0.004 inches) in thickness and a class 1, class A fire rating in accordance with ASTM E84.

2.3.7 Cabinet Liner Standard (CLS) Grade

Provide cabinet liner standard grade plastic laminate that is 0.020 inches in thickness. This laminate grade is intended for light duty semi-exposed interior surfaces of casework components.

2.3.8 Backing Sheet (BK) Grade

Undecorated backing sheet grade laminate is formulated specifically to be used on the backside of plastic laminated panel substrates to enhance dimensional stability of the substrate. Backing sheet thickness must be 0.020 inches. Provide backing sheets for all laminated casework components where plastic laminate finish is applied to only one surface of the component substrate.

2.4 EDGE BANDING

Provide PVC vinyl, 0.125 inch thick, edge banding for casework doors and drawer fronts. Material width must be 15/16 inches. Color and pattern must be as indicated in Section 09 06 00 Schedules and Finishes.

2.5 CABINET HARDWARE

Submit one sample of each cabinet hardware item specified to include hinges, pulls, and drawer glides. Provide hardware conforming to ANSI/BHMA A156.9, unless otherwise noted, and consisting of the following components:

2.5.1 Door Hinges

Concealer type, BHMA No. A156.9, B01602 (165 degree self closing feature at less than 90 degrees).

2.5.2 Cabinet Pulls

Back mounted wire type, BHMA No. A156.9, B32011 (matte black finish).

2.5.3 Drawer Slide

Side mounted ball bearing type, BHMA No. A156.9, B05091 with full extension and a minimum 100 pound load capacity. Include an positive stop to avoid accidental drawer removal.

2.5.4 Adjustable Shelf Support System

Recessed (mortised) metal standards, BHMA No. B04071, finish: satin stainless steel. Support clips for the standards must be open type, BHMA No. B04091, finish: satin stainless steel Multiple holes with metal pin supports.

2.6 FASTENERS

Provide nails, screws, and other suitable fasteners that are the size and type best suited for the purpose and conforming to ASTM F547 where applicable.

2.7 ADHESIVES, CAULKS, AND SEALANTS

2.7.1 Adhesives

Use formula and type of adhesives recommended by AWI. Select adhesives for their ability to provide a durable, permanent bond and take into consideration such factors as materials to be bonded, expansion and contraction, bond strength, fire rating, and moisture resistance. Meet local regulations regarding VOC emissions and off-gassing.

2.7.1.1 Wood Joinery

Use Type II for interior use polyvinyl acetate resin emulsion adhesives to bond wood members. Adhesives must withstand a bond test as described in ANSI/WDMA I.S.1A.

2.7.1.2 Laminate Adhesive

Adhesive used to join high-pressure decorative laminate to wood must be a water-based contact adhesive. Adhere PVC edgebanding using a polymer-based hot melt glue.

2.7.2 Caulk

Use clear, 100 percent silicone caulk to fill voids and joints between laminated components and between laminated components and adjacent surfaces.

2.7.3 Sealant

Use sealant recommended by the substrate manufacturer to provide a moisture barrier at sink cutouts and all other locations where unfinished substrate edges may be subjected to moisture.

2.8 ACCESSORIES

2.8.1 Grommets

Use plastic material for cutouts with a diameter of 2 inches. Indicate locations on the drawings.

2.9 FABRICATION

Verify field measurements as indicated in the shop drawings before fabrication. Accomplish fabrication and assembly of components at the shop site to the maximum extent possible. Meet or exceed the requirements for AWI custom grade unless otherwise indicated in this specification. Make cabinet style, in accordance with NAAWS 3.1, Section 400-G descriptions, flush overlay.

2.9.1 Base and Wall Cabinet Case Body

2.9.1.1 Cabinet Components

Use frame members that are glued-together, kiln-dried hardwood lumber. Brace top corners, bottom corners, and cabinet bottoms with either hardwood blocks or water-resistant glue and nailed in place metal or plastic corner braces. Construct cabinet components from the following materials and thicknesses:

2.9.1.1.1 Body Members (Ends, Divisions, Bottoms, and Tops)

3/4 inch particleboard or veneer core plywood panel product

2.9.1.1.2 Face Frames and Rails

3/4 inch panel product

2.9.1.1.3 Shelving

3/4 inch particleboard or veneer core plywood panel product

2.9.1.1.4 Cabinet Backs

1/4 inch particleboard or veneer core plywood panel product

2.9.1.1.5 Drawer Sides, Backs, and Subfronts

1/2 inch panel product

2.9.1.1.6 Drawer Bottoms

1/4 inch particleboard or veneer core plywood panel product

2.9.1.1.7 Door and Drawer Fronts

3/4-inch particleboard panel product

2.9.1.2 Joinery Method for Case Body Members

2.9.1.2.1 Tops, Exposed Ends, and Bottoms

- a. Steel "European" assembly screws (1-1/2 inch from end, 5 inch on center, fasteners will not be visible on exposed parts).
- b. Doweled, glued under pressure (approx. 4 dowels per 12 inches of joint).
- c. Stop dado, glued under pressure, and either nailed, stapled or screwed (fasteners will not be visible on exposed parts).
- d. Spline or biscuit, glued under pressure.

2.9.1.2.2 Exposed End Corner and Face Frame Attachment

2.9.1.2.2.1 Mitered Joint

lock miter or spline or biscuit, glued under pressure (no visible fasteners)

2.9.1.2.2.2 Non-Mitered Joint (90 degree)

butt joint glued under pressure (no visible fasteners)

2.9.1.2.2.3 Butt Joint

glued and nailed

2.9.1.2.3 Cabinet Backs (Wall Hung Cabinets)

Wall hung cabinet backs must not be relied upon to support the full weight of the cabinet and its anticipated load for hanging/mounting purposes. Method of back joinery and hanging/mounting mechanisms should transfer the load to case body members. Use the following fabrication method:

2.9.1.2.3.1 Full Bound

Full bound, captured in grooves on cabinet sides, top, and bottom. Cabinet backs for floor standing cabinets must be side bound, captured in grooves; glued and fastened to top and bottom.

2.9.1.2.3.2 Full Overlay

Full overlay, plant-on backs with minimum back thickness of 1/2 inch and minimum No. 12 plated (no case hardened) screws spaced a minimum 3 inches on center. Do not expose edge of back on finished sides. Anchor strips are not required when so attached.

2.9.1.2.3.3 Side Bound

Side bound, captured in groove or rabbets; glued and fastened.

2.9.1.2.4 Cabinet Backs (Floor Standing Cabinets)

2.9.1.2.4.1 Side Bound

Side bound, captured in grooves; glued and fastened to top and bottom.

2.9.1.2.4.2 Full Overlay

Full overlay, plant-on backs with minimum back thickness of 1/2 inch and minimum No. 12 plated (no case hardened) screws spaced a minimum 3 inches on center. Do not expose edge of back on finished sides. Anchor strips are not required when so attached.

2.9.1.2.4.3 Side Bound with Rabbets

Side bound, placed in rabbets; glued and fastened in rabbets.

2.9.1.2.5 Wall Anchor Strips

Wall Anchor Strips are required for all cabinets with backs less than 1/2 inch thick. Use strips consisting of minimum 1/2 inch thick lumber, minimum 2-1/2 inches width; securely attached to wall side of cabinet back - top and bottom for wall hung cabinets, top only for floor standing cabinets.

2.9.2 Cabinet Floor Base

Mount floor cabinets on a base constructed of nominal 2 inch thick lumber. Provide base assembly components that are treated lumber. Make finished height for each cabinet base no less than the full height of the installed, specified wall base. Make bottom edge of the cabinet door or drawer face flush with top of base.

2.9.3 Cabinet Door and Drawer Fronts

Fabricate door and drawer fronts from 3/4 inch medium density particleboard . Surface all door and drawer front edges with PVC edgebanding, color and pattern as indicated in Section 09 06 00 SCHEDULES FOR FINISHES.

2.9.4 Drawer Assembly

2.9.4.1 Drawer Components

Provide drawer components consisting of a removable drawer front, sides, backs, and bottom. Construct drawer components of the following materials and thicknesses:

2.9.4.1.1 Drawer Sides and Backs For Transparent Finish

1/2 inch thick 7-ply hardwood veneer core plywood (no voids), any species

2.9.4.1.2 Drawer Sides and Backs For Laminate Finish

1/2 inch thick 7-ply hardwood veneer core substrate

2.9.4.1.3 Drawer Bottom

1/4 inch thick veneer core panel product for transparent or plastic laminate finish

2.9.4.2 Drawer Assembly Joinery Method

- a. Multiple dovetail (all corners) or French dovetail front/dadoed back, glued under pressure.
- b. Doweled, glued under pressure.
- c. Lock shoulder, glued and pin nailed.
- d. Set bottoms into sides, front, and back, 1/4 inch deep groove with a minimum 3/8 inch standing shoulder.

2.9.5 Shelving

2.9.5.1 General Requirements

Fabricate shelving from 3/4 inch medium density particleboard or 3/4 inch veneer core plywood. Finish all shelving top and bottom surfaces with HPDL plastic laminate . Finish shelf edges in a PVC edgebanding.

2.9.5.2 Shelf Support System

The shelf support system is as follows:

2.9.5.2.1 Pin Hole Method

Drill holes on the interior surface of the cabinet side walls. Evenly space holes in two vertical columns. Space the holes in each column at 1 inch increments starting 6 inches from the cabinet interior bottom and extending to within 6 inches of the top interior surface of the cabinet. Drill holes to provide a level, stable surface when the shelf is resting

on the shelf pins. Coordinate hole diameter with pin insert size to provide a firm, tight fit.

2.9.6 Laminate Application

Apply laminate to substrates following the recommended procedures and instructions of the laminate manufacturer and ANSI/NEMA LD 3, using tools and devices specifically designed for laminate fabrication and application. Provide a balanced backer sheet (Grade BK) wherever only one surface of the component substrate requires a plastic laminate finish. Apply required grade of laminate in full uninterrupted sheets consistent with manufactured sizes using one piece for full length only, using adhesives specified herein or as recommended by the manufacturer. Fit corners and joints hairline. Machined flush, file, sand, or buff all laminate edges to remove machine marks and ease (sharp corners removed). Clean up at easing must be such that no overlap of the member eased is visible. Perform fabrication in conformance to ANSI A161.2. Provide laminate types and grades for component surfaces as follows unless otherwise indicated on the drawings:

2.9.6.1 Base/Wall Cabinet Case Body

- a. Exterior (exposed) surfaces to include exposed and semi-exposed face frame surfaces: HPDL Grade VGS.
- b. Interior (semi-exposed) surfaces to include interior back wall, bottom, and side walls: HPDL Grade CLS.

2.9.6.2 Adjustable Shelving

2.9.6.2.1 Top and Bottom Surfaces

HPDL Grade HGS

2.9.6.2.2 All Edges

PVC edgebanding

2.9.6.3 Fixed Shelving

2.9.6.3.1 Top and Bottom Surfaces

HPDL Grade HGS

2.9.6.3.2 Exposed Edges

PVC edgebanding

2.9.6.4 Door, Drawer Fronts, Access Panels

2.9.6.4.1 Exterior (Exposed) and Interior (Semi-Exposed) Faces

HPDL Grade VGS

2.9.6.4.2 Edges

PVC edgebanding

2.9.6.5 Drawer Assembly

All interior and exterior surfaces: HPDL Grade CLS.

2.9.6.6 Countertops and Splashes

All exposed and semi-exposed surfaces: HPDL Grade HGS

2.9.6.7 Tolerances

Meet the NAAWS 3.1 custom grade requirements for flushness, flatness, and joint tolerances of laminated surfaces.

2.9.7 Finishing

2.9.7.1 Filling

Do not expose fasteners on laminated surfaces. Make all nails, screws, and other fasteners in non-laminated cabinet components countersunk and fill the holes with wood filler consistent in color with the wood species.

2.9.7.2 Sanding

Prepare all surfaces requiring coatings by sanding with a grit and in a manner that scratches will not show in the final system.

2.9.7.3 Coatings

Types, method of application and location of casework finishes must be in accordance with the finish schedule, drawings and Section 09 90 00 PAINTS AND COATINGS. Paint all cabinet reveals. Submit descriptive data which provides narrative written verification of all types of construction materials and finishes, methods of construction, etc. not clearly illustrated on the submitted shop drawings. Provide written verification of conformance with NAAWS 3.1 for the quality indicated to include materials, tolerances, and types of construction. Both the manufacturer of materials and the fabricator must submit available literature which describes re-cycled product content, operations and processes in place that support efficient use of natural resources, energy efficiency, emissions of ozone depleting chemicals, management of water and operational waste, indoor environmental quality, and other production techniques supporting sustainable design and products.

PART 3 EXECUTION

3.1 INSTALLATION

Installation must comply with applicable requirements for NAAWS 3.1 custom quality standards. Install countertops and fabricated assemblies level, plumb, and true to line, in locations shown on the drawings. Attach and securely anchor cabinets and other laminate clad casework assemblies to the floor and walls with mechanical fasteners that are appropriate for the wall and floor construction.

3.1.1 Anchoring Systems

3.1.1.1 Floor

Utilize a floor anchoring system for base cabinets. Anchoring and

mechanical fasteners must not be visible from the finished side of the casework assembly. Attach cabinet assemblies to anchored bases without visible fasteners as indicated in the drawings. Where assembly abuts a wall surface, include a minimum 1/2 inch thick lumber or panel product hanging strip, minimum 2-1/2 inch width; securely attached to the top of the wall side of the cabinet back.

3.1.1.2 Wall

Utilize minimum 1/2 inch thick lumber or panel product hanging strips, minimum 2-1/2 inch width to wall mount cabinet ; securely attach to the wall side of the cabinet back, both top and bottom.

3.1.2 Countertops

Install solid surface countertops in locations as indicated on the drawings.

3.1.3 Hardware

Install casework hardware in types and locations as indicated on the drawings. Where fully concealed European-style hinges are specified to be used with particleboard or fiberboard doors, use plastic or synthetic insertion dowels to receive 3/16 inch "Euroscrews". The use of wood screws without insertion dowels is prohibited.

3.1.4 Doors, Drawers and Removable Panels

Accomplish the fitting of doors, drawers and removable panels within target fitting tolerances for gaps and flushness in accordance with NAAWS 3.1 custom grade requirements.

3.1.5 Plumbing Fixtures

Install sinks, sink hardware, and other plumbing fixtures in locations as indicated on the drawings and in accordance with Section 22 00 00 PLUMBING, GENERAL PURPOSE.

-- End of Section --

SECTION 06 61 16

SOLID SURFACING FABRICATIONS

08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM C920	(2018) Standard Specification for Elastomeric Joint Sealants
ASTM D570	(1998; E 2010; R 2010) Standard Test Method for Water Absorption of Plastics
ASTM D638	(2014) Standard Test Method for Tensile Properties of Plastics
ASTM D696	(2016) Standard Test Method for Coefficient of Linear Thermal Expansion of Plastics Between -30 degrees C and 30 degrees C With a Vitreous Silica Dilatometer
ASTM D790	(2017) Standard Test Methods for Flexural Properties of Unreinforced and Reinforced Plastics and Electrical Insulating Materials
ASTM D2583	(2013a) Indentation Hardness of Rigid Plastics by Means of a Barcol Impressor
ASTM E84	(2023) Standard Test Method for Surface Burning Characteristics of Building Materials
ASTM G21	(2015; R 2021; E 2021) Standard Practice for Determining Resistance of Synthetic Polymeric Materials to Fungi

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350	(2017; Version 1.2) Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers
--------------------	--

INTERNATIONAL CAST POLYMER ASSOCIATION (ICPA)

ICPA SS-1	(2001) Performance Standard for Solid Surface Materials
-----------	---

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

ANSI/NEMA LD 3 (2005) Standard for High-Pressure
Decorative Laminates

NSF INTERNATIONAL (NSF)

NSF/ANSI 51 (2023) Food Equipment Materials

1.2 SYSTEM DESCRIPTION

- a. Work under this section includes countertops, backsplashes, and shower wall finish and other items utilizing solid surfacing material fabrications as indicated on the drawings and as described in this specification. Do not change source of supply for materials after work has started, if the appearance of finished work would be affected.
- b. In most instances, installation of solid surfacing material fabricated components and assemblies requires strong correctly located structural support provided by other trades. To provide a stable, sound, secure installation, close coordination is required between the solid surfacing material fabricator/installer and other trades to ensure that necessary structural wall support, cabinet counter top structural support, proper clearances, and other supporting components are provided for the installation of wall panels, counter tops, shelving, and all other solid surfacing material fabrications to the degree and extent recommended by the solid surfacing material manufacturer.
- c. Provide appropriate staging areas for solid surfacing material fabrications. Allow variation in component size and location of openings of plus or minus 1/8 inch.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Detail Fabrication Drawings

Installation

SD-03 Product Data

Solid Polymer

Indoor air quality for solid surface seam and sealant products

Quartz Agglomerate Material

SD-04 Samples

Material

SD-06 Test Reports

Test Report Results

SD-07 Certificates

Qualifications

Indoor Air Quality for solid surface fabrication products

SD-10 Operation and Maintenance Data

Solid Polymer, Data Package 1

Quartz Agglomerate Material, Data Package 1

1.4 QUALITY ASSURANCE

1.4.1 Qualifications

To ensure warranty coverage, provide manufacturer certified solid surfacing fabricators to fabricate the solid surfacing material being utilized. Mark all fabrications with the fabricator's certification label affixed in an inconspicuous location. Minimum of 5 years of experience working with solid surfacing materials is required of fabricators. Submit solid surfacing material manufacturer's certification attesting to fabricator qualification approval.

1.5 DELIVERY, STORAGE, AND HANDLING

Do not deliver materials to project site until areas are ready for installation. Deliver components and materials to the site undamaged, in containers clearly marked and labeled with manufacturer's name. Store materials indoors and take adequate precautions to prevent damage to finished surfaces. Provide protective coverings to prevent physical damage or staining following installation, for duration of project.

1.6 WARRANTY

Provide manufacturer's warranty to repair or replace defective materials, excluding damages caused by physical or chemical abuse or excessive heat, and workmanship for a period of 10 years from date of final acceptance of the work.

PART 2 PRODUCTS

2.1 MATERIAL

Submit detail fabrication drawings and installation drawings of each solid surfacing fabrication indicated. Include elevations, dimensions, clearances, details of construction and anchorage, and details of joints and connections.

Submit manufacturers' descriptive product data for each type of solid polymer fabrication and quartz agglomerate fabrication indicated. Include manufacturers' literature, finishes, profiles and thicknesses of materials.

Submit manufacturers' operations and maintenance data for each type of solid polymer fabrication and quartz agglomerate material fabrication in

accordance with Section 01 78 23 OPERATIONS AND MAINTENANCE DATA.

2.1.1 Solid Surfacing Material

Provide solid polymer and quartz agglomerate material that is a homogeneous filled solid polymer; not coated, laminated or of a composite construction, complying with ICPA SS-1 and ICPA SS-1 for quartz agglomerate, except for composition. Provide material that meets or exceeds the minimum physical and performance properties specified. Superficial damage to a depth of 0.01 inch must be repairable by sanding or polishing. Material thickness is as indicated below; required minimum thickness is 1/4 inch. Submit a minimum 4 inch by 4 inch sample of each color and pattern for approval; include full range of color and pattern variation. Retain approved samples as a standard for this work. Submit test report results from an independent testing laboratory attesting that the submitted solid surfacing materials meet or exceed each of the specified performance requirements.

- a. Horizontal Surfaces: 1/2 inch thick material
- b. Vertical Surfaces: 1/4 inch thick material
- c. Provide materials that meet the emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type). Provide certification or validation of indoor air quality for solid surface fabrication products.

2.1.2 Cast, 100 Percent Acrylic Polymer Solid Surfacing Material

Cast, 100 percent acrylic solid polymer material composed of acrylic polymer, mineral fillers, and pigments. Provide acrylic polymer that meets or exceeds the following minimum performance requirements:

PROPERTY	REQUIREMENT (min. or max.)	TEST PROCEDURE
Tensile Strength	4000 psi (max.)	ASTM D638
Hardness	55-Barcol Impressor (min.)	ASTM D2583
Thermal Expansion	.000023 in/in/F (max.)	ASTM D696
Boiling Water Surface Resistance	No Change	ANSI/NEMA LD 3-3.05
High Temperature Resistance	No Change	ANSI/NEMA LD 3-3.06
Impact Resistance (Ball drop)		ANSI/NEMA LD 3-303
1/4 inch sheet	36-inches, 1/2 lb ball, no failure	
1/2 inch sheet	140-inches, 1/2 lb ball, no failure	

PROPERTY	REQUIREMENT (min. or max.)	TEST PROCEDURE
3/4 inch sheet	200-inches, 1/2 lb ball, no failure	
Mold & Mildew Growth	No growth	ASTM G21
Bacteria Growth	No growth	ASTM G21
Liquid Absorption (Weight in 24 hrs.)	0.1 percent max.	ASTM D570
Flammability		ASTM E84
Flame Spread	25 max.	
Smoke Developed	30 max.	
Sanitation	"Food Contact" approval	NSF/ANSI 51
Flexural Strength	[6,800][10,400] psi (min.)	ASTM D790

2.1.3 Quartz Agglomerate (or "Engineered Quartz") Solid Surfacing Material

Solid sheets consisting of quartz aggregates in an acrylic or polyester, or a combination of the two, resin binder (or matrix) that is solid and nonporous with integral color.

2.1.4 Material Patterns and Colors

Provide pattern and color for all solid surfacing material components and fabrications as specified in Section 09 06 00 SCHEDULES FOR FINISHES.as indicated; colors listed are not intended to limit the selection of equal colors from other manufacturers. Provide products with consistent patterned color throughout thickness of the product.

2.1.5 Surface Finish

Provide a uniform appearance on exposed finished surfaces and edges. Exposed surface finish is semigloss; gloss rating of 25-50 .

2.2 ACCESSORY PRODUCTS

Provide accessory products, as specified below, as manufactured by the solid surfacing material manufacturer or as approved by the solid surfacing material manufacturer for use with the solid surfacing materials being specified.

2.2.1 Adhesives

Provide a two-part seam adhesive kit to create permanent, inconspicuous, non-porous, hard seams and joints by chemical bond between solid surfacing materials and components to create a monolithic appearance of the fabrication. Provide adhesive approved by the solid surfacing material manufacturer. Color-match adhesive to the surfaces being bonded where solid-colored, solid surfacing materials are being bonded together. Provide clear or color matched seam adhesive where particulate patterned,

solid surfacing materials are being bonded together.

2.2.2 Seam and Sealant Emissions

Provide seam and other accessory materials that meet the emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type). Provide validation of indoor air quality for solid surface seam and sealant products.

2.2.3 Silicone Sealant

Provide silicone sealant, mildew-resistant, single-component, nonsag, plus 25 percent and minus 25 percent movement capability, acid-curing; ASTM C920, Type S, Grade NS, Class 25, Use NT; clear formulation; approved for use by the solid surfacing material manufacturer.

2.2.4 Mounting Hardware

Provide mounting hardware, including sink/bowl clips, inserts and fasteners for attachment of undermount sinks and lavatories.

2.3 FABRICATIONS

Provide factory or shop fabricate components to sizes and shapes indicated, to the greatest extent practical, in accordance with approved Shop Drawings and manufacturer's requirements. Provide factory cutouts for sinks, lavatories, and plumbing fixtures where indicated on the drawings. Contours and radii must be routed to template, with edges smooth. Defective and inaccurate work will be rejected. Submit product data indicating product description, fabrication information, and compliance with specified performance requirements for solid surfacing material, joint adhesive, sealants, and heat reflective tape.[Both the manufacturer of materials and the fabricator are required to submit a detailed description of operations and processes in place that support efficient use of natural resources, energy efficiency, emissions of ozone depleting chemicals, management of water and operational waste, indoor environmental quality, and other production techniques supporting sustainable design and products.]

2.3.1 Joints and Seams

Form joints and seams between solid surfacing material components using manufacturer's approved seam adhesive. Provide inconspicuous joints in appearance without voids to create a monolithic appearance.

2.3.2 Edge Finishing

Rout and finish component edges to a smooth, uniform appearance and finish. Provide edge shapes and treatments, including any inserts, as detailed on the drawings. Rout all cutouts, then sand all edges smooth. Repair or reject defective or inaccurate work.

2.3.3 Counter Top Splashes

Fabricate backsplashes and end splashes from 1/2 inch thick solid surfacing material to be 4 inches high. Provide backsplashes and end splashes for all counter tops. Shop fabricate backsplashes and provide loose, to be field attached.

2.3.3.1 End Splashes

Provide end splashes loose for installation at the jobsite after horizontal surfaces to which they are to be attached have been installed.

2.3.4 Counter Tops

Fabricate all solid surfacing material, counter top components from 1/2 inch thick material. Indicate details, dimensions, locations, and quantities on the drawings. Provide counter tops with 4 inch high loose back and side splashes at all locations. Attach 2 inch wide reinforcing strip of solid surfacing material under each horizontal counter top seam. Submit a minimum 1 foot wide by 6 inch deep, full size sample for each type of counter top shown on the project drawings; include the edge profile and backsplash as detailed on the drawings and at least one seam. Retain approved sample as standard for this work. Provide square edge profile with based edges.

2.3.4.1 Counter Tops with Sinks

- a. Provide stainless steel or vitreous china sink (see drawings); include cutouts to template for counter tops with sinks as furnished by the sink manufacturer. Provide manufacturer's standard sink mounting hardware for stainless steel or vitreous china undermount installation. Seal between sink and counter top with specified silicone sealant. Provide sink, faucet, and plumbing requirements in accordance with Section 22 00 00 PLUMBING, GENERAL PURPOSE.

2.3.5 Shower Wall Panel System

Provide shower wall enclosures with a system of solid surfacing material components to include: panels, corner trim, shampoo shelf, panel edge trim; dimensions of all components are as indicated. Form panels from manufacturer's standard 1/4 inch thick sheet product. Provide panels full width and height with seams occurring only at the inside corners of the enclosure. Provide soap dish and shampoo shelf of configuration, shape, and location as standard with the manufacturer's system.

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 Components

Install all components and fabricated units plumb, level, and rigid. Make field joints between solid surfacing material components using solid surfacing material manufacturer's approved seam adhesives, to provide a monolithic appearance with joints inconspicuous in the finished work. Attach metal or vitreous china sinks and lavatory bowls to counter tops using solid surfacing material manufacturer's recommended clear silicone sealant and undermounting hardware. Install solid polymer sinks and bowls using a color-matched seam adhesive.

3.1.1.1 Loose Counter Top Splashes

Mount loose splashes in the locations noted on the drawings. Adhere loose splashes to the counter top with a color matched silicone sealant when the solid surfacing material components are solid colors. Use a clear silicone sealant to provide adhesion of particulate patterned solid

surfacing material splashes to counter tops.

3.1.1.2 Wall Panels & Panel Systems

Installation of wall panels and system components to substrates must include the use of a specified panel adhesive. Use specified seam adhesive to adhere all solid surfacing material components to each other with the exception of expansion joints and inside corners. All inside corners and expansion joints between solid surfacing material components must be joined with specified silicone sealant. All joints between solid surfacing material components and non-solid polymer surfaces must be sealed with specified silicone sealant.

3.1.2 Silicone Sealant

Use specified silicone sealant to seal all expansion joints between solid surfacing material components and all joints between solid surfacing material components and other adjacent surfaces such as walls, floors, ceiling, and plumbing fixtures. Provide sealant bead smooth and uniform in appearance and minimum size necessary to bridge any gaps between the solid surfacing material and the adjacent surface. Provide continuous bead and run the entire length of the joint being sealed.

3.1.3 Plumbing

Make plumbing connections to sinks and lavatories in accordance with Section 22 00 00 PLUMBING, GENERAL PURPOSE .

3.2 CLEAN-UP

Components must be cleaned after installation and covered to protect against damage during completion of the remaining project items. Damaged components must be repaired or replaced at the Contractor's sole expense.

-- End of Section --

SECTION 07 21 16

MINERAL FIBER BLANKET INSULATION

08/23

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM C665	(2023) Standard Specification for Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing
ASTM C930	(2019) Standard Classification of Potential Health and Safety Concerns Associated with Thermal Insulation Materials and Accessories
ASTM D3833/D3833M	(1996; R 2019) Standard Test Method for Water Vapor Transmission of Pressure-Sensitive Tapes
ASTM D5359	(1998; R 2021) Standard Specification for Glass Cullet Recovered from Waste for Use in Manufacture of Glass Fiber
ASTM E84	(2023) Standard Test Method for Surface Burning Characteristics of Building Materials
ASTM E136	(2022) Standard Test Method for Assessing Combustibility of Materials Using a Vertical Tube Furnace at 750 Degrees C

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350	(2017; Version 1.2) Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers
--------------------	--

GREEN SEAL (GS)

GS-36	(2013) Adhesives for Commercial Use
-------	-------------------------------------

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS	SCS Global Services (SCS) Indoor Advantage
-----	--

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168 (2017) Adhesive and Sealant Applications

U.S. DEPARTMENT OF ENERGY (DOE)

Energy Star (1992; R 2006) Energy Star Energy
Efficiency Labeling System (FEMP)

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1910.134 Respiratory Protection

UNDERWRITERS LABORATORIES (UL)

UL 2818 (2022) GREENGUARD Certification Program
For Chemical Emissions For Building
Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Blanket Insulation; G

Recycled Content for Insulation Materials; S

Energy Star Label for Insulation Materials; S

Vapor Retarder

Pressure Sensitive Tape

Accessories

SD-07 Certificates

Indoor Air Quality for Insulation Materials; S

Indoor Air Quality for Adhesives; S

SD-08 Manufacturer's Instructions

Insulation

1.3 CERTIFICATIONS

Submit required indoor air quality certifications and validations in one submittal package.

1.3.1 Insulation Products

Provide product certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification by other third-party programs. Provide current product certification from certification body.

1.3.2 Adhesives and Sealants

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited herein.

1.4 DELIVERY, STORAGE, AND HANDLING

1.4.1 Delivery

Deliver materials to site in original sealed wrapping bearing manufacturer's name and brand designation, specification number, type, grade, R-value, and class. Store and handle to protect from damage. Do not allow insulation materials to become wet, soiled, crushed, or covered with ice or snow. Comply with manufacturer's recommendations for handling, storing, and protecting of materials before and during installation.

1.4.2 Storage

Inspect materials delivered to the site for damage; unload and store out of weather in manufacturer's original packaging. Store only in dry locations, not subject to open flames or sparks, and easily accessible for inspection and handling.

1.5 SAFETY PRECAUTIONS

1.5.1 Respirators

Provide installers with dust/mist respirators, training in their use, and protective clothing, all approved by National Institute for Occupational Safety and Health (NIOSH)/Mine Safety and Health Administration (MSHA) in accordance with 29 CFR 1910.134.

1.5.2 Other Safety Concerns

Consider other safety concerns and measures as outlined in ASTM C930.

PART 2 PRODUCTS

2.1 BLANKET INSULATION

ASTM C665, Type I, blankets without membrane coverings ; a flame spread rating of 25 or less and a smoke developed rating of 150 or less when tested in accordance with ASTM E84.

Provide insulation with R-Value and thickness or density for sound attenuation as indicated on drawings

2.1.1 Recycled Materials

Provide insulation materials containing the following minimum percentage of recycled material content by weight:

- a. Fiberglass: 20 percent glass cullet complying with ASTM D5359
- b. Mineral wool: 75 percent recovered materials content from slag

Provide data identifying percentage of recycled content for insulation materials.

2.1.2 Energy Star

Provide insulation materials that are Energy Star labeled. Provide data identifying Energy Star label for insulation materials.

2.1.3 Prohibited Materials

Do not provide asbestos-containing materials.

2.1.4 Reduced Volatile Organic Compounds (VOC) for Insulation Materials

Provide certification of indoor air quality for insulation materials.

2.2 BLOCKING

Metal, unfaced mineral fiber blankets in accordance with ASTM C665, Type I, or other approved materials. Use only non-combustible materials meeting the requirements of ASTM E136 for blocking around chimneys and heat producing devices.

2.3 PRESSURE SENSITIVE TAPE

As recommended by the vapor retarder manufacturer and having a water vapor permeance rating of one perm or less when tested in accordance with ASTM D3833/D3833M.

2.4 ACCESSORIES

2.4.1 Adhesive

As recommended by the insulation manufacturer. Provide non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) that meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide aerosol adhesives used on the interior of the building that meet either emissions requirements of CDPH SECTION 01350 (use the office or classroom requirements, regardless of space type) or VOC content requirements of GS-36. Provide certification or validation of indoor air quality for adhesives.

2.4.2 Mechanical Fasteners

Corrosion resistant fasteners as recommended by the insulation manufacturer.

2.4.3 Wire Mesh

Corrosion resistant and as recommended by the insulation manufacturer.

PART 3 EXECUTION

3.1 EXISTING CONDITIONS

Before installing insulation, ensure that surfaces that will be in contact with the insulation are dry and free of projections which could cause voids, compressed insulation, or punctured vapor retarders. If moisture or other conditions are found that do not allow the workmanlike installation of the insulation, do not proceed but notify Contracting Officer of such conditions.

3.2 INSTALLATION

3.2.1 Insulation

Install and handle insulation in accordance with manufacturer's instructions. Keep material dry and free of extraneous materials. Any materials that show visual evidence of biological growth due to presence of moisture must not be installed on the building project. Ensure personal protective clothing and respiratory equipment is used as required. Observe safe work practices.

3.2.1.1 Electrical wiring

Do not install insulation in a manner that would sandwich electrical conductors, that are not installed in conduit, between two layers of insulation.

3.2.1.2 Continuity of Insulation

Install blanket insulation to butt tightly against adjoining blankets and to studs, rafters, joists, sill plates, headers and any obstructions.

3.2.1.3 Installation at Bridging and Cross Bracing

Insulate at bridging and cross bracing by splitting blanket vertically at center and packing one half into each opening. Butt insulation at bridging and cross bracing; fill in bridged area with loose or scrap insulation.

3.2.1.4 Cold Climate Requirement

Place insulation to the outside of pipes.

3.2.1.5 Insulation without Affixed Vapor Retarder

Provide snug friction fit to hold insulation in place. Stuff pieces of insulation into cracks between trusses, joists, studs and other framing, such as at attic access doors, door and window heads, jambs, and sills, band joists, and headers.

3.2.1.6 Sizing of Blankets

Provide only full width blankets when insulating between trusses, joists, or studs. Size width of blankets for a snug fit where trusses, joists or

studs are irregularly spaced.

3.2.1.7 Access Panels and Doors

Affix blanket insulation to access panels greater than one square foot.
Use insulation with same R-Value as that for wall.

-- End of Section --

SECTION 07 27 10

BUILDING AIR BARRIER SYSTEM

08/23

PART 1 GENERAL

1.1 SUMMARY

This Section specifies the construction and quality control of the installation of an air barrier system. Construct the air barrier system indicated, taking responsibility for the means, methods, and workmanship of the installation of the air barrier system in the new addition. The air barrier must be contiguous and connected across all surfaces of the enclosed air barrier envelope indicated. The maximum leakage requirements of individual air barrier components and materials are specified in the other specification sections covering these items.

This section also defines the maximum allowable leakage of the final air barrier system in the new addition. The workmanship must be adequate to meet the maximum allowable leakage requirements of this specification. Test the assembled air barrier system to demonstrate that the building envelope is properly sealed and insulated. Passing the air barrier system leakage test and thermography test will result in system acceptance. Conform air barrier system leakage and thermography testing and reporting to the requirements of Section 01 91 19 BUILDING ENCLOSURE COMMISSIONING.

1.2 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referenced within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM D4541	(2022) Standard Test Method for Pull-Off Strength of Coatings Using Portable Adhesion Testers
ASTM E96/E96M	(2022a; E 2023) Standard Test Methods for Gravimetric Determination of Water Vapor Transmission Rate of Materials
ASTM E2178	(2021a) Standard Test Method for Determining Air Leakage Rate and Calculation of Air Permeance of Building Materials
ASTM E2357	(2018) Standard Test Method for Determining Air Leakage Rate of Air Barrier Assemblies

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 285	(2023) Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Wall Assemblies Containing Combustible
----------	--

Components

1.3 DEFINITIONS

The following terms as they apply to this section:

1.3.1 Air Barrier Accessory

Products designated to maintain air tightness between air barrier materials, air barrier assemblies and air barrier components, to fasten them to the structure of the building, or both (e.g., sealants, tapes, backer rods, transition membranes, fasteners, strapping, primers).

1.3.2 Air Barrier Assembly

The combination of air barrier materials and air barrier accessories that are designated and designed within the environmental separator to act as a continuous barrier to the movement of air through the environmental separator.

1.3.3 Air Barrier Component

Pre-manufactured elements such as windows, doors, dampers and service elements that are installed in the environmental separator.

1.3.4 Air Barrier Envelope

The combination of air barrier assemblies and air barrier components, connected by air barrier accessories that are designed to provide a continuous barrier to the movement of air through an environmental separator. There may be more than one air barrier envelope in a single building. Also known as Air Barrier System.

1.3.5 Air Barrier Material

A building material that is designed, tested or produced to provide the primary resistance to airflow through an air barrier assembly of a building enclosure.

1.3.6 Air Barrier System

Same as AIR BARRIER ENVELOPE.

1.3.7 Air Leakage Rate

The rate of airflow (CFM) driven through a unit surface area (sq.ft.) of an assembly or system by a unit static pressure difference (Pa) across the assembly. (example: 0.25 CFM/sq.ft. @ 75 Pa)

1.3.8 Air Leakage

The total airflow (CFM) driven through the air barrier system by a unit static pressure difference (Pa) across the air barrier envelope. (example: 6500 CFM @ 75 Pa)

1.3.9 Air Permeance

The tested rate of airflow (CFM) through a unit area (sq.ft.) of a material driven by unit static pressure difference (Pa) across the

material (example: 0.004 CFM/sq.ft. @ 75 Pa) as established by ASTM E2178.

1.3.10 Environmental Separator

The parts of a building that separate the controlled interior environment from the uncontrolled exterior environment, or that separate spaces within a building that have dissimilar environments. Also known as the Control Layer.

1.3.11 Vapor Permeance

Vapor permeance is separated into three classes based on the water vapor permeance of a material as tested via ASTM E96/E96M

Class I Vapor Barrier/Retarder 0.1 perm or less

Class II Vapor Barrier/Retarder 0.1 perm to 1.0 perm

Class III Vapor Barrier/Retarder 1.0 perm to 10 perm

1.4 PREPARATORY PHASE OR PRECONSTRUCTION CONFERENCE

Organize pre-construction conferences between the air barrier inspector and the sub-contractors involved in the construction of, or penetration of, the air barrier system to discuss where the work of each sub-contractor begins and ends, the sequence of installation, and each sub-contractor's responsibility to ensure airtight joints, junctures, penetrations and transitions between materials. Discuss the products, and assemblies of products specified in the different sections to be installed by the different sub-contractors.

1.5 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Air Barrier System Shop Drawings; G, Manufacturer produced warranted air barrier system

SD-03 Product Data

Air Barrier System Product Data; G

SD-04 Samples

Mock-Up; G

Material Samples For Air Barrier System; G

SD-05 Design Data

Design Data And Calculations For The Air Barrier System; G

SD-06 Test Reports

Design Review Report; G

Testing and Inspection; G

SD-07 Certificates

Air Barrier Inspector; G

1.6 AIR BARRIER ENVELOPE SURFACE AREA AND LEAKAGE REQUIREMENTS

The building air barrier systems must meet the following leakage requirements. The allowable leakage rate and the maximum leakage are at a differential test pressure of 75 Pa.

Air Barrier Envelope 1 Existing Building	
Surface Area	17,726 square feet
Architectural Only Test:	
Allowable leakage rate	0.25 CFM/sq.ft
Maximum leakage	4,432 total CFM

Air Barrier Envelope 2 New Addition	
Surface Area	11,044 square feet
Architectural Only Test:	
Allowable leakage rate	0.25 CFM/sq.ft
Maximum leakage	2,761 total CFM

1.7 AIR BARRIER INSPECTOR

Employ a designated Air Barrier Inspector on this project. The Air Barrier Inspector performs a Design Review, oversees quality control testing specified in these specifications, performs quality control air barrier inspection as specified, interfaces with the designer and product manufacturer's representatives to assure installation requirements are met, and verifies that the constructed work is in accordance with both the manufacturer's recommendations for products used, the content of this specification and other Contract drawings or documents. Qualifications for the Air Barrier Inspector are as follows:

- a. Training and certification as an Air Barrier Auditor from the Air Barrier Association of America (ABAA) or other third-party air barrier association.
- b. Or, provide documentation in resume format that demonstrates that the individual proposed has the experience, knowledge, skills and

abilities to fulfill the above stated duties as the air barrier inspector.

- c. It is acceptable that this individual be employed by the firm performing the building pressurization test or another independent third-party entity, provided they meet the above requirements but must not be a member of the installing Contractor or firm.

Provide copies of Air Barrier Inspector qualifications 30 days after Notice to Proceed.

1.8 DESIGN REVIEW

Review the Contract Plans and Specifications and advise the Contracting Officer of any deficiencies that would prevent the construction of an effective air barrier system. Provide a Design Review Report individually listing each deficiency and the corresponding proposed corrective action necessary for a proper air barrier system. Provide copies of the Design Review Report not later than 21 days after approval of the Air Barrier Inspector Qualifications. Submit design data and calculations for the Air Barrier System for a manufacturer produced and warranted air barrier system.

PART 2 PRODUCTS

2.1 AIR BARRIER

Provide air barrier system of compatible parts from one or several manufacturers coordinated by the Contractor or provide a single warranted system provided by a primary manufacturer. The air barrier system as part of a tested exterior wall assembly must meet the conditions of acceptance as tested in accordance with NFPA 285. Materials used for roof assembly air barrier must conform to the appropriate UL and FM wind and fire requirements for the specified roof assemblies.

If a complete air barrier system from a single manufacturer is utilized, whether warranted or not warranted, the air barrier system must conform to ASTM E2357.

Materials in the following categories, as used in the air barrier system or assembly of the exterior wall system, are tested and are required to conform to ASTM E2178: Self-adhered sheet membranes, fluid applied membranes, spray polyurethane foam, mechanically fastened commercial building wrap, factory bonded membranes to sheathing, and adhesive backed commercial building wrap and accessory products.

Other materials used as an air barrier such as concrete, glass, wood, metal or gypsum board may or may not conform to ASTM E2178 but are acceptable provided that when integrated into the air barrier system or assemblies they are not subject to material or environmental induced degradation in their final produced state once incorporated in the permanent construction.

All materials used must be identifiable through manufacturer testing data or literature to be compatible with all the attached or adjoining materials or substrates used in the system.

Provide Air Barrier System Shop Drawings, Material Samples for Air Barrier System and Air Barrier System Product Data.

PART 3 EXECUTION

3.1 QUALITY CONTROL

3.1.1 Documentation and Reporting

Document the entire installation process on daily job site reports. These reports include information on the Installer, substrates, substrate preparation, products used, ambient and substrate temperature, the location of the air barrier installation, the results of the quality control procedures, and testing results.

3.1.2 Construction Mock-Up

Build mock-up prior to building envelope construction.

- a. Prepare a construction mock-up to demonstrate proper installation of the air barrier assemblies and components. Include air barrier system connections between floor and wall, wall and window, and wall and roof. Also, include the sealing method between membrane joints at transitions from one material or component to another, at pipe or conduit penetrations of the wall and roof, and at duct penetration of the wall and roof. Work must not begin until the mock-up is satisfactory to the Contracting Officer.
- b. Size the mock-up to approximately 8 feet long by 8 feet high. The mock-up must be representative of primary exterior wall assemblies and glazing components including backup wall and typical penetrations as acceptable to the Contracting Officer. A corner of the actual building may be used as the mock-up.
- c. Mock-Up Tests for Adhesion: Test the mock-up of materials for adhesion in accordance with manufacturer's recommendations. Perform the test after the curing period recommended by the manufacturer. Record the mode of failure and the area which failed in accordance with ASTM D4541. When the air barrier material manufacturer has established a minimum adhesion level for the product on the particular substrate, the inspection report must indicate whether this requirement has been met. Where the manufacturer has not declared a minimum adhesion value for their product/substrate combination, simply record the value.

3.1.3 Quality Control Testing And Inspection

Conduct the following tests and inspections as applicable in the presence of the Contracting Officer during installation of the air barrier system, and submit quality control reports as indicated below.

- a. Provide a Daily Report of Observations with a copy to the Contracting Officer.
- b. Inspect to assure continuity of the air barrier system throughout the building enclosure and that all gaps are covered, the covering is structurally sound, and all penetrations are sealed allowing for no infiltration or exfiltration through the air barrier system.
- c. Inspect to assure structural support of the air barrier system to withstand design air pressures.

- d. Inspect to assure masonry surfaces receiving air barrier materials are smooth, clean, and free of cavities, protrusions and mortar droppings, with mortar joints struck flush or as required by the manufacturer of the air barrier material.
- e. Inspect and test to assure site conditions for application temperature, and dryness of substrates are within guidelines.
- f. Inspect to assure substrate surfaces are properly primed, if applicable, and in accordance with manufacturer's instructions. Priming must extend at least 2 inches beyond the air barrier material to make it obvious that the primer was applied to the substrate before the air barrier material.
- g. Inspect to assure laps in materials are at least a 2-inch minimum, shingled in the correct direction or mastic applied in accordance with manufacturer's recommendations, and with no fishmouths.
- h. Inspect to assure that a roller has been used to enhance adhesion. Identify any defects such as fishmouths, wrinkles, areas of lost adhesion, and improper curing. Note the intended remedy for the deficiencies.
- i. Measure application thickness of liquid applied materials to assure that manufacturer's specifications for the specific substrate are met.
- j. Inspect to assure that the correct materials are installed for compatibility.
- k. Inspect to assure proper transitions for change in direction and structural support at gaps.
- l. Inspect to assure proper connection between assemblies (membrane and sealants) for cleaning, preparation and priming of surfaces, structural support, integrity and continuity of seal.
- m. Perform adhesion tests for fluid-applied and self-adhered air barrier membranes to assure that the manufacturer's specified adhesion strength properties are met. Determine the bond strength of coatings to substrate in accordance with ASTM D4541.
- n. Provide cohesion tests for spray polyurethane foam (SPF). Perform the tests in accordance with the specification sections which specify these materials. Perform adhesion tests as follows: Using a coring tool remove a sample and determine the relative adhesion quality of the foam. If the foam is hard to remove and leaves small bits of foam on the substrate it is called cohesive foam failure and is considered the best adhesion. If the foam comes away from the substrate with some force but is clean, it is called a mechanical bond. If it comes away easily from the substrate, the adhesion is poor. Cohesive foam failure and a good mechanical bond are acceptable.
- o. Provide written test reports of all tests performed.

3.2 REPAIR AND PROTECTION

Upon completion of inspection, testing, sample removal and similar services, repair damaged construction and restore substrates, coatings and finishes. Protect construction exposed by or for quality control service

activities, and protect repaired construction.

-- End of Section --

SECTION 07 27 19.01

SELF-ADHERING AIR BARRIERS

08/23

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AIR BARRIER ASSOCIATION OF AMERICA (ABAA)

ABAA Accreditation	Accreditation
ABAA QAP	Quality Assurance Program

ASTM INTERNATIONAL (ASTM)

ASTM D146/D146M	(2004; E 2012; R 2012) Sampling and Testing Bitumen-Saturated Felts and Woven Fabrics for Roofing and Waterproofing
ASTM D412	(2016; R 2021) Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers - Tension
ASTM D570	(1998; E 2010; R 2010) Standard Test Method for Water Absorption of Plastics
ASTM D903	(1998; R 2017) Standard Test Method for Peel or Stripping Strength of Adhesive Bonds
ASTM D1876	(2008; R 2015; E 2015) Standard Test Method for Peel Resistance of Adhesives (T-Peel Test)
ASTM D4263	(1983; R 2018) Standard Test Method for Indicating Moisture in Concrete by the Plastic Sheet Method
ASTM D4541	(2022) Standard Test Method for Pull-Off Strength of Coatings Using Portable Adhesion Testers
ASTM E96/E96M	(2022a; E 2023) Standard Test Methods for Gravimetric Determination of Water Vapor Transmission Rate of Materials
ASTM E154/E154M	(2008a; R 2019) Standard Test Methods for Water Vapor Retarders Used in Contact with Earth Under Concrete Slabs, on Walls, or as Ground Cover
ASTM E283/E283M	(2019) Standard Test Method for

Determining Rate of Air Leakage Through
Exterior Windows, Skylights, Curtain
Walls, and Doors Under Specified Pressure
Differences Across the Specimen

ASTM E331 (2000; R 2023) Standard Test Method for
Water Penetration of Exterior Windows,
Skylights, Doors, and Curtain Walls by
Uniform Static Air Pressure Difference

ASTM E2178 (2021a) Standard Test Method for
Determining Air Leakage Rate and
Calculation of Air Permeance of Building
Materials

ASTM E2357 (2018) Standard Test Method for
Determining Air Leakage Rate of Air
Barrier Assemblies

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 285 (2023) Standard Fire Test Method for
Evaluation of Fire Propagation
Characteristics of Exterior Wall
Assemblies Containing Combustible
Components

1.2 RELATED REQUIREMENTS

Coordinate the requirements of Section 07 27 10 BUILDING AIR BARRIER SYSTEM, Section 01 91 19 BUILDING ENCLOSURE COMMISSIONING and other building enclosure sections to provide a complete building air barrier system. Submit all materials, components, and assemblies of the air barrier system together as one complete submittal package.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Qualifications of Manufacturer; G

Qualifications of Installer; G

SD-02 Shop Drawings

Self-adhering Air Barrier Shop Drawings; G

SD-03 Product Data

Self-adhering Air Barrier; G

Primers, Adhesives, and Mastics; G

Safety Data Sheets; G

SD-04 Samples

Self-adhering Air Barrier System Mockup; G

SD-06 Test Reports

Field Peel Adhesion Test; G

Flame Propagation of Wall Assemblies; G

Site Inspections and Testing; G

SD-08 Manufacturer's Instructions

Self-adhering Air Barrier Manufacturer's Printed Instructions; G

Primers, Adhesives, and Mastics; G

1.4 MISCELLANEOUS REQUIREMENTS

For self-adhering air barrier provide the following:

1.4.1 Shop Drawings

Submit self-adhering air barrier shop drawings showing locations and extent of air barrier assemblies and details of all typical conditions, intersections with other building enclosure assemblies and materials, and membrane counterflashings. Show details for bridging of gaps in construction, treatment of inside and outside corners, expansion joints, methods of attachment of materials covering the self-adhered barrier without compromising the barrier. Indicate how miscellaneous penetrations such as conduit, pipes, electric boxes, brick ties, and similar items will be sealed.

1.4.2 Product Data

Submit manufacturer's technical data indicating compliance with performance and environmental requirements in Part 2 of this specification. Also submit self-adhering air barrier manufacturer's printed instructions for evaluating, preparing, and treating substrates, temperature and other limitations of installation conditions, safety requirements for installation, and Safety Data Sheets. Indicate flame and smoke spread ratings for all products.

1.4.3 Mockup

Provide a self-adhering air barrier system mockup. Apply product in an area designated by the Contracting Officer. Apply an area of not less than 54 square feet. Include all components specified as representative of the complete system. Notify the Contracting Officer a minimum of 48 hours prior to the test application. Select a test area representative of conditions to be covered including window or door openings, wall to ceiling transitions, flashings, and penetrations, as applicable.

1.4.4 Test Reports

Submit test reports indicating that field peel-adhesion tests on all materials have been performed and the changes made, if required, in order to achieve successful and lasting adhesion. Submit test reports for flame propagation of wall assemblies tested in accordance with NFPA 285.

1.5 DELIVERY, STORAGE, AND HANDLING

1.5.1 Delivery

Deliver and store materials in sufficient quantity to allow for uninterrupted flow of work. Inspect materials delivered to the site for damage and store out of weather. Deliver materials to the jobsite in their original unopened packages, clearly marked with the manufacturer's name, brand designation, description of contents, and shelf life of containerized materials. Store and handle to protect from damage.

1.5.2 Storage

Inspect materials delivered to the site for damage; unload and store out of weather in manufacturer's original packaging. Store only in dry locations, not subject to open flames or sparks, and easily accessible for inspection and handling. Protect stored materials from direct sunlight. Keep materials sealed and separated from absorptive materials, such as wood and insulation.

1.6 AIR BARRIER TESTING

Perform air barrier testing in accordance with Section 07 27 10 BUILDING AIR BARRIER SYSTEM and Section 01 91 19 BUILDING ENCLOSURE COMMISSIONING.

1.7 QUALITY ASSURANCE

1.7.1 Qualifications of Manufacturer

Submit documentation verifying that the manufacturer of the self-adhering air barrier is currently accredited by Air Barrier Association of America (ABAA Accreditation <https://www.airbarrier.org/>).

1.7.2 Qualifications of Installer

Submit documentation verifying that installers of the self-adhering air barrier are currently certified in accordance with the ABAA QAP Quality Assurance Program (<https://www.airbarrier.org/qap/>).

1.7.3 Field Peel Adhesion Test

Perform a field peel-adhesion test on the construction mockup. Test the self-adhering air barrier for adhesion in accordance with ASTM D4541 using a Type II pull tester except use a disk that is 4 inches in diameter and cut through the membrane to separate the material attached to the dish from the surrounding material. Perform test after curing period in accordance with manufacturer's written recommendations. Record mode of failure and area which failed in accordance with ASTM D4541. Compare adhesion values with the manufacturer's established minimum values for the particular combination of material and substrate. Indicate on the inspection report whether the manufacturer's requirement has been met. Where the manufacturer has not declared a minimum adhesion value for their

product and substrate combination, the inspector must record actual values.

1.8 PRECONSTRUCTION MEETING

Conduct a preconstruction meeting a minimum of two weeks prior to commencing work specified in this specification Section. Agenda must include, at a minimum, construction and testing of mockup, sequence of construction, coordination with substrate preparation, materials approved for use, compatibility of materials, coordination with installation of adjacent and covering materials, and details of construction. Attendance is required by representatives of related trades including covering materials, substrate materials, adjacent materials, and materials and components of the air barrier system.

1.9 ENVIRONMENTAL CONDITIONS

1.9.1 Temperature

Install air barrier within the range of ambient and substrate temperatures as recommended in writing by the air barrier manufacturer. Verify that the surface to receive self-adhering air barrier is dry for a minimum of 48 hours prior to the installation of the barrier. Do not apply air barrier to damp or wet substrates. Do not apply during inclement weather or when ice, frost, surface moisture, or visible dampness is present on surfaces to be covered, or when precipitation is imminent.

1.9.2 Exposure to Weather and Ultraviolet Light

Protect air barrier products from direct exposure to rain, snow, sunlight, mist, and other extreme weather conditions. Replace, at no additional cost to the Government, barrier products that have been exposed to ultraviolet (sun)light longer than allowed by manufacturer's written requirements.

PART 2 PRODUCTS

2.1 SELF-ADHERING AIR BARRIER

Provide minimum 0.040 inch thick self-adhering, vapor permeable, air barrier membrane consisting of a cross-laminated high density polyethylene (HDPE) film, fully coated with rubberized butyl-based or acrylic-based adhesive. Provide membrane in rolls of various widths interleaved with disposable silicone release paper. Self-adhering air barrier must exhibit no visible water leakage when tested in accordance with ASTM E331 and must perform as a liquid water drainage plane flashed to discharge to the exterior incidental condensation or water penetration. Use regular or low temperature formulation depending on site conditions, within temperature ranges specified by manufacturer.

2.1.1 Physical Properties

- a. Air Permeance (ASTM E2178): In accordance with Section 07 27 10 BUILDING AIR BARRIER SYSTEM
- b. Air Leakage (ASTM E2357, ASTM E283/E283M): In accordance with Section 07 27 10 BUILDING AIR BARRIER SYSTEM and Section 01 91 19 BUILDING ENCLOSURE COMMISSIONING.
- c. Tensile Strength (ASTM D412 die C modified): Not less than 400 psi.

- d. Tensile Elongation (ASTM D412 die C modified): Not less than 200 percent.
- e. Puncture Resistance (ASTM E154/E154M): Not less than 40 lbs.
- f. Pliability (ASTM D146/D146M): Unaffected at minus 25 degrees F, 0.063 inch mandrel.
- g. Lap Adhesion (ASTM D1876 modified): Not less than 4.0 lbs per inch.
- h. Peel Adhesion (ASTM D903): Not less than 5.0 lbs per inch.
- i. Water Vapor Permeance (Vapor Permeable Air Barrier) (ASTM E96/E96M, desiccant method B): greater than 10.0 perms.
- i. Water Vapor Permeance (Vapor Impermeable Air Barrier) (ASTM E96/E96M, desiccant method A): 0.1 perms or less.
- j. Water Absorption (ASTM D570): Not to exceed 0.12 percent by weight.
- k. Flame propagation of wall assemblies (NFPA 285): Pass

2.2 PRIMERS, ADHESIVES, AND MASTICS

Provide primers, adhesives, mastics and other accessory materials as recommended in writing by the manufacturer of the self-adhering air barrier for adequate bonding to each type of substrate. Adhesive must be butyl- or acrylic-based.

2.3 SHEET METAL FLASHING

Provide as specified in Section 07 60 00 FLASHING AND SHEET METAL.

2.4 JOINT SEALANTS

Provide as specified in Section 07 92 00 JOINT SEALANTS. Verify compatibility with adjacent products that are or will be in contact with one another.

PART 3 EXECUTION

3.1 EXAMINATION

Before installing air barrier, examine substrates, areas, and conditions under which air barrier assemblies will be applied, with Installer present, for compliance with requirements. Ensure the following conditions are met:

- a. Surfaces are sound, dry, even, and free of oil, grease, dirt, excess mortar or other contaminants.
- b. Concrete surfaces are cured and dry, smooth without large voids, spalled areas or sharp protrusions.
- c. Verify substrate is visibly dry and free of moisture. Test for capillary moisture by plastic sheet method in accordance with ASTM D4263 and take suitable measures until substrate passes moisture test.

- d. Verify sealants used in sheathing are compatible with membrane proposed for use. Perform field peel adhesion test on materials to which sealants are adhered.

3.2 PREPARATION

Clean, prepare, and treat substrate in accordance with manufacturer's written instructions. Ensure clean, dust-free, and dry substrate for air barrier application.

- a. Prime masonry and concrete substrates with conditioning primer.
- b. Prime gypsum sheathing an adequate number of coats to achieve required bond, with adequate drying time between coats.
- c. Prime wood, metal, and painted substrates with primer.
- d. Prepare, treat, and seal vertical and horizontal surfaces at terminations and penetrations through air barrier and at protrusions.

3.3 INSTALLATION

3.3.1 Installation of Self-adhering Air Barrier

Install materials in accordance with manufacturer's recommendations and the following:

- a. Apply primer at rate recommended by manufacturer prior to membrane installation. Allow primer to dry completely before membrane application. Apply as many coats as necessary for proper adhesion.
- b. When membrane is properly positioned, press into place and roll membrane with roller immediately after placement.
- c. Apply membrane sheets to shed water naturally without interception by a sheet edge, unless that edge is sealed with permanently flexible termination mastic.
- d. Position subsequent sheets of membrane applied above so that membrane overlaps the membrane sheet below by a minimum of 2-1/2 inches, unless greater overlap is recommended by manufacturer. Roll into place with roller.
- e. Make side laps a minimum of 2-1/2 inches and end laps a minimum of 5 inches, unless greater overlap is recommended by manufacturer. Roll seams with roller.
- f. Roll membrane to adhere to substrate. Cover corners and joints with two layers of reinforcement by first applying a 12 inch width of membrane centered along the axis. Flash drains and projections with a second ply of membrane for a distance of 6 inches from the drain or projection.
- g. Seal around all penetrations through the air barrier resulting from pipes, vents, conduit, electrical fixtures, structural members, or other construction passing through it. Seal with termination mastic, extruded silicone sealant, membrane counterflashing or other sealing methods in accordance with manufacturer's written recommendations.

- h. Continuously connect the air barrier between walls, roof, floor and below grade assemblies to form a continuous integrated air barrier system around the entire building enclosure. Extend the air barrier membrane into rough openings such as doors, windows, louvers, and other exterior penetrations. Seal edges of barrier at junctures with rough openings.
- i. At changes in substrate plane, provide transition material (e.g., bead of sealant, mastic, extruded silicone sealant, membrane counterflashing or other material recommended by manufacturer) under membrane to eliminate all sharp 90-degree inside corners and to make a smooth transition from one plane to another.
- j. Provide mechanically fastened non-corrosive metal sheet to span gaps in substrate plane and to make a smooth transition from one plane to the other. Continuously support membrane with substrate.
- k. At deflection and control joints, provide backup for the membrane to accommodate anticipated movement.
- l. At expansion and seismic joints provide transition to the joint assemblies.
- m. Apply a bead or trowel coat of mastic along membrane seams at reverse lapped seams, rough cuts, and as recommended by the manufacturer.
- n. At end of each working day, seal top edge of membrane to substrate with termination mastic.
- o. Do not allow materials to come in contact with chemically incompatible materials.
- p. Counterflash upper edge of thru-wall flashing and air barrier. Counter flashing is specified in Section 07 60 00 FLASHING AND SHEET METAL. See applicable wall-type Sections for thru-wall flashing requirements.

3.4 FIELD QUALITY CONTROL

3.4.1 Site Inspections and Testing

Provide site inspections and testing in accordance with the manufacturer's instructions, Section 07 27 10 BUILDING AIR BARRIER SYSTEM, Section 01 91 19 BUILDING ENCLOSURE COMMISSIONING, and this section.

- a. Conduct inspections and testing at 5, 50, and 95 percent completion of this scope of work. Forward written site inspections and testing reports to the Contracting Officer within five working days of the inspection and test being performed.
- b. If inspections reveal defects, promptly remove and replace defective work at no additional expense to the Government.

3.5 FIELD PEEL ADHESION TEST

Conduct in accordance with test protocol indicated in Part 1, paragraph FIELD PEEL ADHESION TEST.

3.6 PROTECTION AND CLEANING

3.6.1 Protection

3.6.1.1 Adjacent Surfaces

Protect exposed adjacent surfaces that could be damaged by primers and adhesives associated with air barrier membrane. Provide protection during application and the remainder of construction in accordance with manufacturer's written instructions.

3.6.1.2 The Air Barrier Assembly

Protect finished portions of the air barrier assembly from damage during ongoing application and throughout the remainder of the construction period in accordance with manufacturer's written instructions. Coordinate timing of installation of materials that will cover the air barrier membrane to ensure the exposure period does not exceed that recommended by the air barrier manufacturer's written installation instructions. Remove and replace, at no additional cost to the Government, membrane products that exceed the manufacturer's allowed exposure limits.

3.6.2 Cleaning

Clean spillage and soiling from adjacent construction using cleaning agents and procedures recommended by manufacturer of affected construction and as acceptable to the primary material manufacturer.

-- End of Section --

This page left blank.

SECTION 07 27 26

FLUID-APPLIED MEMBRANE AIR BARRIERS

08/23

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AIR BARRIER ASSOCIATION OF AMERICA (ABAA)

ABAA Accreditation	Accreditation
ABAA QAP	Quality Assurance Program

ASTM INTERNATIONAL (ASTM)

ASTM C1305/C1305M	(2016) Standard Test Method for Crack Bridging Ability of Liquid-Applied Waterproofing Membrane
ASTM D412	(2016; R 2021) Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers - Tension
ASTM D4263	(1983; R 2018) Standard Test Method for Indicating Moisture in Concrete by the Plastic Sheet Method
ASTM D4541	(2022) Standard Test Method for Pull-Off Strength of Coatings Using Portable Adhesion Testers
ASTM D5590	(2017; R 2021) Standard Test Method for Determining the Resistance of Paint Films and Related Coatings to Fungal Defacement by Accelerated Four-Week Agar Plate Assay
ASTM E96/E96M	(2022a; E 2023) Standard Test Methods for Gravimetric Determination of Water Vapor Transmission Rate of Materials
ASTM E283/E283M	(2019) Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Skylights, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen
ASTM E331	(2000; R 2023) Standard Test Method for Water Penetration of Exterior Windows, Skylights, Doors, and Curtain Walls by Uniform Static Air Pressure Difference
ASTM E2178	(2021a) Standard Test Method for

Determining Air Leakage Rate and
Calculation of Air Permeance of Building
Materials

ASTM E2357

(2018) Standard Test Method for
Determining Air Leakage Rate of Air
Barrier Assemblies

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 285

(2023) Standard Fire Test Method for
Evaluation of Fire Propagation
Characteristics of Exterior Wall
Assemblies Containing Combustible
Components

1.2 RELATED REQUIREMENTS

Coordinate the requirements of Section 07 27 10 BUILDING AIR BARRIER SYSTEM, Section 01 91 19 BUILDING ENCLOSURE COMMISSIONING, and other building enclosure sections to provide a complete building air barrier system. Submit all materials, components and assemblies of the air barrier system together as one complete submittal package.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Qualifications of Manufacturer; G

Qualifications of Installer; G

SD-02 Shop Drawings

Fluid-Applied Membrane Air Barrier Shop Drawings; G

SD-03 Product Data

Fluid-Applied Membrane Air Barrier; G

Transition Membrane; G

Primers, Adhesives, and Mastics; G

Reinforcement; G

Safety Data Sheets; G

SD-04 Samples

Fluid-Applied Membrane Air Barrier Mockup; G

SD-06 Test Reports

Capillary Moisture Test; G

Field Peel Adhesion Test; G

Flame Propagation of Wall Assemblies; G

Site Inspections Reports; G

SD-08 Manufacturer's Instructions

Fluid-Applied Membrane Air Barrier Manufacturer's Printed
Instructions; G

Primers, Adhesives, and Mastics Printed Manufacturer's Instructions;
G

1.4 MISCELLANEOUS REQUIREMENTS

For fluid-applied membrane air barriers provide the following:

1.4.1 Shop Drawings

Submit fluid-applied membrane air barrier shop drawings showing locations and extent of barrier assemblies, transition membranes, details of all typical conditions, intersections with other envelope assemblies and materials, and membrane counterflashings. Show details for bridging of gaps in construction, treatment of inside and outside corners, expansion joints, methods of attachment of materials covering the self-adhered barrier without compromising the barrier. Indicate how miscellaneous penetrations such as conduit, pipes, electric boxes, brick ties, and similar items will be sealed.

1.4.2 Product Data

Submit manufacturer's technical data indicating compliance with performance and environmental requirements. Submit fluid-applied membrane air barrier manufacturer's printed instructions for evaluating, preparing, and treating substrates, temperature and other limitations of installation conditions, safety requirements for installation, and Safety Data Sheets. Also, submit primers, adhesives and mastics printed manufacturer's instructions for installation conditions and safety requirements. Indicate flame and smoke spread ratings for all products.

1.4.3 Mockup

Provide a mockup of the fluid-applied membrane air barrier. Apply product in an area designated by the Contracting Officer. Apply an area of not less than 54 square feet. Include all components specified as representative of the complete system. Notify the Contracting Officer a minimum of 48 hours prior to the test application. Select a test area representative of conditions to be covered including window or door openings, wall to ceiling transitions, flashings, and penetrations, as applicable.

1.4.4 Test Reports

Submit test reports indicating that capillary moisture tests and field

peel adhesion tests on all substrate materials have been performed and the changes made, if required, in order to achieve successful and lasting adhesion. Submit test reports for flame propagation of wall assemblies tested in accordance with NFPA 285.

1.5 DELIVERY, STORAGE, AND HANDLING

1.5.1 Delivery

Deliver and store materials in sufficient quantity to allow for uninterrupted flow of work. Inspect materials delivered to the site for damage and store out of weather. Deliver materials to the jobsite in their original unopened packages, clearly marked with the manufacturer's name, brand designation, description of contents, and shelf life of containerized materials. Store and handle to protect from damage.

1.5.2 Storage

Inspect materials delivered to the site for damage; unload and store out of weather in manufacturer's original packaging. Store only in dry locations, not subject to open flames or sparks, and easily accessible for inspection and handling. Protect stored materials from direct sunlight.

1.6 CAPILLARY MOISTURE TEST

Perform a capillary moisture test by plastic sheet method in accordance with ASTM D4263 on the construction mockup and substrate materials. Perform test after curing period as recommended by the air barrier manufacturer. Record mode of failure and area which failed in accordance with ASTM D4263. Once the air barrier material manufacturer has established a minimum adhesion or moisture level for the product on the particular substrate, indicate on the inspection report whether this requirement has been met. Where the manufacturer has not declared a minimum adhesion or moisture value for their product and substrate combination, the inspector must record actual values.

1.7 FIELD PEEL ADHESION TEST

Perform a field peel adhesion test on a construction mockup. Test the applied product for adhesion in accordance with manufacturer's recommendations. Perform test after curing period recommended by the manufacturer. Record mode of failure and area which failed in accordance with ASTM D4541. When the manufacturer has established a minimum adhesion level for the product on the particular substrate, the inspection report must indicate whether this requirement has been met. Where the manufacturer has not declared a minimum adhesion value for their product/substrate combination, the inspector must record actual values.

1.8 AIR BARRIER TESTING

Perform air barrier testing in accordance with Section 07 27 10 BUILDING AIR BARRIER SYSTEM and Section 01 91 19 BUILDING ENCLOSURE COMMISSIONING.

1.9 QUALITY ASSURANCE

1.9.1 Qualifications of Manufacturer

Submit documentation verifying that manufacturer of fluid-applied membrane air barrier is currently accredited by the Air Barrier Association of

America (ABAA Accreditation <https://www.airbarrier.org/>).

1.9.2 Qualifications of Installer

Submit documentation verifying that installers of the fluid-applied membrane air barrier are currently certified in accordance with the ABAA QAP Quality Assurance Program (<https://www.airbarrier.org/qap/>).

1.10 PRECONSTRUCTION MEETING

Conduct a preconstruction meeting a minimum of two weeks prior to commencing work specified in this specification Section. Agenda must include, at a minimum, construction and testing of construction mock-up, sequence of construction, coordination with substrate preparation, materials approved for use, compatibility of materials, coordination with installation of adjacent and covering materials, and details of construction. Attendance is required by representatives of related trades including covering materials, substrate materials, adjacent materials, and materials and components of the fluid-applied membrane air barrier.

1.11 ENVIRONMENTAL CONDITIONS

1.11.1 Temperature

Install fluid-applied membrane air barrier within the range of ambient and substrate temperatures as recommended in writing by the fluid-applied membrane air barrier manufacturer. Do not apply fluid-applied membrane air barrier to a damp or wet substrate. Do not apply during inclement weather or when ice, frost, surface moisture, or visible dampness is present on surfaces to be covered, or when precipitation is imminent.

1.11.2 Exposure to Weather

Protect fluid-applied membrane air barrier products from direct exposure to rain, snow, sunlight, mist, and other extreme weather conditions. Replace, at no additional cost to the Government, barrier products that have been exposed to ultraviolet (sun)light longer than allowed by manufacturer's written requirements.

PART 2 PRODUCTS

2.1 FLUID-APPLIED MEMBRANE AIR BARRIER

Provide a fluid-applied, vapor retarding, air barrier. This barrier must exhibit no visible water leakage when tested in accordance with ASTM E331 and must perform as a liquid water drainage plane. Provide thru-wall flashing to discharge incidental condensation and water penetration to the exterior of the building enclosure in addition. Provide products suitable for use within temperature ranges specified by manufacturer for the location of the project.

2.1.1 Physical Properties

- a. Air Permeance (ASTM E2178): in accordance with Section 07 27 10 BUILDING AIR BARRIER SYSTEM
- b. Air Leakage (ASTM E2357, ASTM E283/E283M): in accordance with Section 07 27 10 BUILDING AIR BARRIER SYSTEM and Section 01 91 19 BUILDING ENCLOSURE COMMISSIONING.

- c. Water Vapor Permeance (Vapor Permeable Membrane) (ASTM E96/E96M, desiccant method A): 10.0 perms.
- c. Water Vapor Permeance (Vapor Impermeable Membrane) (ASTM E96/E96M, desiccant method A): 0.1 perms or less.
- d. Pull Adhesion (ASTM D4541): Not less than 15 psi.
- e. Elongation (ASTM D412): Not less than 300 percent.
- f. Low temperature Flexibility and Crack Bridging (ASTM C1305/C1305M): Pass at minus 15 degrees F.
- g. Solids by Volume: minimum 50 percent.
- h. Flame propagation of wall assemblies (NFPA 285): Pass
- i. Resistance to Mold, Mildew and Fungal Growth (ASTM D5590): 0, No growth.

2.2 PRIMERS, ADHESIVES, AND MASTICS

Provide primers, adhesives, mastics, sealants and other accessories as recommended by manufacturer of fluid-applied membrane air barrier for a complete installation.

2.3 TRANSITION MEMBRANE

Provide as specified in Section 07 27 19.01 SELF-ADHERING AIR BARRIERS.

2.4 SHEET METAL FLASHING

Provide as specified in Section 07 60 00 FLASHING AND SHEET METAL.

2.5 JOINT SEALANTS

Provide as specified in Section 07 92 00 JOINT SEALANTS.

2.6 REINFORCEMENT

Provide fiberglass mesh tape, or fluid-applied air barrier manufacturer's approved comparable equivalent product, reinforcement at seams, edges, projections and penetrations. Reinforce all joints exceeding 1/4 inch with fiberglass mesh.

PART 3 EXECUTION

3.1 EXAMINATION

Before installing fluid-applied membrane air barrier, examine substrates, areas, and conditions under which fluid-applied membrane air barrier assemblies will be applied, with installer present, for compliance with requirements. Ensure the following conditions are met:

- a. Surfaces are sound, dry, even, and free of oil, grease, dirt, excess mortar or other contaminants detrimental to the adhesion of the membranes.

- b. Concrete and masonry surfaces are cured and dry, smooth without large voids, spalled areas or sharp protrusions. Do not proceed with installation until after minimum concrete curing period recommended by fluid-applied membrane air barrier manufacturer.
- c. Fill voids, gaps and spalled areas in substrate to provide an even plane. Strike masonry joints full flush.
- d. Verify substrate is visibly dry and free of moisture. Test for capillary moisture by plastic sheet method in accordance with ASTM D4263 and take suitable measures until substrate passes moisture test.
- e. Verify sealants used in substrates, and in joints between substrates, are compatible with fluid-applied membrane air barrier.

3.2 PREPARATION

Clean, prepare, and treat substrate in accordance with manufacturer's written instructions. Ensure clean, dust-free, and dry substrate for fluid-applied membrane air barrier application.

- a. Remove dust, dirt and other contaminants from joints and cracks before coating surfaces.
- b. Prepare, treat, and seal vertical and horizontal surfaces at terminations and penetrations through fluid-applied membrane air barrier.
- c. At changes in substrate plane, provide transition material (bead of sealant, mastic, extruded silicone sealant, membrane counterflashing or other material recommended by manufacturer) under transition membrane to eliminate all sharp 90-degree inside corners and to make a smooth transition from one plane to another.
- d. Provide mechanically fastened non-corrosive metal sheet to span gaps in substrate plane and to make a smooth transition from one plane to the other. Continuously support membrane with substrate.
- e. For exterior sheathing substrates, ensure that exterior sheathing is stabilized, with corners and edges fastened with appropriate screws. Treat all joints in accordance with the air barrier manufacturer's instructions prior to application of air barrier material. Allow sufficient time for joint treatments to fully cure before application of transition membranes and fluid-applied membrane air barrier.
- f. For concrete and masonry substrates, fill all voids and holes, particularly in mortar joints, with non-shrinking grout.
- g. Mask off and cover adjacent surfaces to protect from spillage and overspray.

3.3 INSTALLATION

3.3.1 Installation of Transition Membrane

Install transition membrane materials in accordance with the details on the drawings, Section 07 27 19.01 SELF-ADHERING AIR BARRIERS, and the following:

- a. Install transition membrane at all required locations (such as at any voids, gaps, or interstitial spaces that the fluid-applied air barrier cannot adequately protect) prior to installation of the fluid-applied membrane air barrier.
- b. Verify transition membrane is fully adhered to substrate and that its surface is clean, dry and wrinkle free prior to installation of the fluid-applied membrane air barrier.
- c. Verify transition membrane completely covers all transition areas and provides continuity of the finished fluid-applied membrane air barrier without gaps or cracks.

3.3.2 Installation of Flashing

Counterflash upper edge of thru-wall flashing and fluid-applied air barrier. Counter flashing is specified in Section 07 60 00 FLASHING AND SHEET METAL. See applicable wall-type Sections for thru-wall flashing requirements.

3.3.3 Installation of Fluid-Applied Membrane Air Barrier

Install materials in accordance with manufacturer's recommendations and the following:

- a. Apply fluid-applied membrane air barrier in single or dual coat application by spray or roller. Apply fluid-applied membrane air barrier within manufacturer's recommended temperature range for application.
- b. Apply fluid-applied membrane air barrier in manner and at rate and wet film thickness recommended by manufacturer to yield a finished dry film thickness of not less than 60 mils or as otherwise required by the manufacturer for the application substrate material and surface roughness.
- c. Apply fluid-applied membrane air barrier around all penetrations ensuring a complete and continuous air barrier. Lap fluid-applied membrane air barrier a minimum of 3 inch over transition membrane to seal leading edge.
- d. Seal membrane terminations, heads of mechanical fasteners, masonry tie fasteners, around penetrations, HVAC assemblies, plumbing and electrical assemblies, doors, windows, louvers, and other assemblies penetrating the fluid-applied membrane air barrier with a termination sealant recommended by the fluid-applied membrane air barrier manufacturer.
- e. Notify the Contracting Officer and Testing Agency upon completion of fluid-applied membrane air barrier installation. Air barrier materials and assemblies must remain exposed until tested and inspected in accordance with the ABAA protocol.
- f. Do not allow materials to come in contact with chemically incompatible materials.

3.3.4 Installation of Reinforcement

Install reinforcement at projections, corners, joints, and penetrations where applicable.

3.4 FIELD QUALITY CONTROL

3.4.1 Site Inspections and Testing

Provide site inspections and testing in accordance with the manufacturer's instructions, Section 07 27 10 BUILDING AIR BARRIER SYSTEM, Section 01 91 19 BUILDING ENCLOSURE COMMISSIONING, and this Section.

- a. Conduct inspections and testing at 5, 50, and 95 percent completion of this scope of work. Forward written inspection reports to the Contracting Officer within five working days of the inspection and test being performed.
- b. If the inspections reveal defects, promptly remove and replace defective work at no additional expense to the Government.

3.5 PROTECTION AND CLEANING

3.5.1 Protection

Protect fluid-applied membrane air barrier assemblies from damage during application and remainder of construction in accordance with manufacturer's written instructions.

Coordinate installation, testing, and inspection procedures to ensure exposure period does not exceed that recommended by the product manufacturer. Remove and replace, at no additional cost to the government, membrane products that exceed manufacturer's allowed exposure limits.

3.5.2 Cleaning of Adjacent Surfaces

Clean excess product from adjacent construction using cleaning agents and procedures as recommended in writing by the manufacturer of each type of affected construction and as acceptable to same.

3.6 CLEANUP OF SPILLS

Conduct cleanup of uncured product spillage in accordance with manufacturer's written safe handling instructions.

-- End of Section --

This page left blank.

and Tensile Adhesion Properties of Rigid
Cellular Plastics

ASTM D2126	(2020) Response of Rigid Cellular Plastics to Thermal and Humid Aging
ASTM D2842	(2019) Water Absorption of Rigid Cellular Plastics
ASTM D4541	(2022) Standard Test Method for Pull-Off Strength of Coatings Using Portable Adhesion Testers
ASTM D6226	(2021) Standard Test Method for Open Cell Content of Rigid Cellular Plastics
ASTM E84	(2023) Standard Test Method for Surface Burning Characteristics of Building Materials
ASTM E96/E96M	(2022a; E 2023) Standard Test Methods for Gravimetric Determination of Water Vapor Transmission Rate of Materials
ASTM E119	(2022) Standard Test Methods for Fire Tests of Building Construction and Materials
ASTM E283/E283M	(2019) Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Skylights, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen
ASTM E736/E736M	(2019) Standard Test Method for Cohesion/Adhesion of Sprayed Fire-Resistive Materials Applied to Structural Members
ASTM E2178	(2021a) Standard Test Method for Determining Air Leakage Rate and Calculation of Air Permeance of Building Materials
ASTM E2357	(2018) Standard Test Method for Determining Air Leakage Rate of Air Barrier Assemblies

INTERNATIONAL CODE COUNCIL (ICC)

ICC 1100	(2019) Standard for Spray-applied Polyurethane Foam Plastic Insulation
ICC IBC	(2021) International Building Code
ICC IECC	(2021) International Energy Conservation Code

INTERNATIONAL SAFETY EQUIPMENT ASSOCIATION (ISEA)

ANSI/ISEA Z87.1 (2020) Occupational and Educational
Personal Eye and Face Protection Devices

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 10 (2022; ERTA 1 2021) Standard for Portable
Fire Extinguishers

NFPA 275 (2022) Standard Method of Fire Tests for
the Evaluation of Thermal Barriers

NFPA 285 (2023) Standard Fire Test Method for
Evaluation of Fire Propagation
Characteristics of Exterior Wall
Assemblies Containing Combustible
Components

SPRAY POLYURETHANE FOAM ALLIANCE (SPFA)

SPFA TechDocs (2015) SPFA Technical Documents Library,
four categories: General, Insulation,
Roofing, Specialty

U.S. DEPARTMENT OF DEFENSE (DOD)

UFC 3-600-01 (2016; with Change 6, 2021) Fire
Protection Engineering for Facilities

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1910.132 Personal Protective Equipment

29 CFR 1910.133 Eye and Face Protection

29 CFR 1910.134 Respiratory Protection

UNDERWRITERS LABORATORIES (UL)

UL 723 (2020) UL Standard for Safety Test for
Surface Burning Characteristics of
Building Materials

1.2 DEFINITIONS

1.2.1 Long Term Thermal Resistance (LTTR)

The thermal resistance value of a closed cell foam insulation product measured using accelerated aging ASTM C1303/C1303M equivalent to the time-weighted average thermal resistance value over 15 years. Loss in thermal resistance is attributable to changes in cell gas composition caused by diffusion of air into and blowing agent out of the foam cells.

1.2.2 SPFA TechDocs

Reformatted documents, named SPFA TechDocs (https://www.sprayfoam.org/SPFA_techdocs), is a repository of technical information containing common definitions used in this Section. The site

is organized in four categories for easy reference and identification:
Roofing, Insulation, Specialty and General.

Spray Polyurethane Foam: Thermal and air barrier system consisting of
sprayed polyurethane foam (SPF).

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S"
classification. Submittals not having a "G" or "S" classification are for
information only. When used, a code following the "G" classification
identifies the office that will review the submittal for the Government.
Submit the following in accordance with Section 01 33 00 SUBMITTAL
PROCEDURES:

SD-01 Preconstruction Submittals

Qualification of Manufacturer; G

Qualification of Installer; G

Quality Control Plan; G

Safety Plan; G

Fire Prevention Plan; G

Respiratory Protection Plan; G

SD-02 Shop Drawings

Spray Foam Air Barrier System Shop Drawings

SD-03 Product Data

Blowing Agents; G

Closed Cell SPF; G

Primers, Adhesives, and Mastics; G

Sealants; G

Safety Data Sheets; G

Thermal Barrier Materials; G

Ignition Barrier Coatings; G

SD-04 Samples

Spray Foam Air Barrier Mockup; G

SD-06 Test Reports

Mockup Peel Adhesion Test; G

Thermographic Test; G

Fire-Ratings Of Thermal Ignition Barrier Materials; G

Flame Spread and Smoke Developed Index Ratings of SPF Products; G

Site Inspections Reports; G

SD-07 Certificates

Indoor Air Quality for Spray Foam Air Barrier; S

SD-08 Manufacturer's Instructions

SPF Handling, Storage, and Spray Procedures; G

Substrate Preparation; G

Thermal Barrier; G

Manufacturer's Printed Installation Instructions for Primers,
Adhesives, and Mastics; G

SD-09 Manufacturer's Field Reports

Core Samples; G

Daily Work Record; G

Visual Inspection and Thermal Scanning; G

1.4 MISCELLANEOUS REQUIREMENTS

For the spray foam air barrier system provide the following:

1.4.1 Shop Drawings

Submit spray foam air barrier system shop drawings showing locations, detailing, and extent of spray foam air barrier assemblies. Provide details of all typical conditions, intersections with other envelope assemblies and materials, membrane counter-flashings. Provide details for fire-rated assemblies and indicate materials for thermal barrier ignition barriers. Show details for bridging of gaps in construction, treatment of inside and outside corners, expansion joints, methods of attachment of materials covering the SPF without compromising the barrier. Indicate how miscellaneous penetrations such as conduit, pipes, electric boxes, brick ties, and similar items will be sealed.

1.4.2 Product Data

Submit manufacturer's technical data indicating compliance with performance and environmental requirements, manufacturer's printed

instructions for evaluating, preparing, and treating substrates, temperature and other limitations of installation conditions, safety requirements for installation, and Safety Data Sheets. Indicate flame and smoke spread ratings for all products. Submit thermal barrier ignition barrier literature including material description, physical properties, fire-ratings, and manufacturer's printed installation instructions. Also include manufacturer's printed installation instructions for primers, adhesives, and mastics.

1.4.3 Mockup

Provide a spray foam air barrier mockup of each foam system specified. Apply foam in an area designated by the Contracting Officer. Apply an area of not less than 50 square feet. Include all components specified for the finished assembly including primers, support components, expansion and contraction joints, ignition barriers, thermal barriers, and other accessories as representative of the complete system. Isolate the area and protect workers as required by 29 CFR 1910.132, 29 CFR 1910.133 and 29 CFR 1910.134. Notify the Contracting Officer a minimum of 48 hours prior to the test application. Select a test area representative of conditions to be sprayed including window or door openings, wall to ceiling transitions, flashings, and penetrations, as applicable.

1.4.4 Test Reports

Submit test reports indicating that mockup peel adhesion tests on all materials have been performed and the changes made, if required, in order to achieve successful and lasting adhesion. Submit test reports for flame spread and smoke developed index ratings of SPF products tested in accordance with ASTM E84 or UL 723. Submit test reports for flame propagation of wall assemblies tested in accordance with NFPA 285. Submit test reports for fire-ratings of thermal ignition barrier materials tested in accordance with ASTM E84 or UL 723.

1.5 DELIVERY, STORAGE, AND HANDLING

1.5.1 Delivery

Deliver and store materials in sufficient quantity to allow for uninterrupted flow of work. Inspect materials delivered to the site for damage; unload and store out of weather. Deliver materials to the jobsite in their original unopened packages, clearly marked with the manufacturer's name, brand designation, description of contents, and shelf life of containerized materials. Store and handle to protect from damage. Submit SPF Handling, Storage, and Spray Procedures in accordance with submittal procedures.

1.5.2 Storage

Store materials in clean, dry areas, away from excessive heat, sparks, and open flame. Maintain temperatures in the storage area below the materials' flash point(s) and within limits recommended by the manufacturer's printed instructions. Provide ventilation in accordance with ASSP Z9.2 to prevent build-up of flammable gases. Store all chemicals in locations that limit the risk of contact with water, acids, caustics (such as lye), alcohols, and strong oxidizing and reducing agents.

1.5.3 Handling

Handle materials and containers safely and in accordance with manufacturer's recommendations. Store liquids in airtight containers and keep containers closed except when removing materials. Do not use equipment or containers containing remains of dissimilar materials. Do not expose foam component containers to direct sunlight. Containers exposed to long periods of cold may also exhibit separation and poor performance. Do not use materials from containers with content temperatures exceeding limits specified in the manufacturers installation instructions.

Mark and remove from job site all chemicals which have been contaminated with moisture, that exceed shelf life limits, or that have been exposed to temperature extremes.

1.5.3.1 Venting and Handling of Material Containers

Partially unscrew material container and drum caps to gradually vent the containers prior to opening. Do not inhale vapors. Follow drum decontamination and disposal procedures recommended by the manufacturer or the American Chemistry Council's Center for the Polyurethanes Industry.

1.6 MOCKUP PEEL ADHESION TEST

Perform a field peel adhesion test on the construction mockup. Test the SPF for adhesion in accordance with ASTM D4541 Method B using a Type II pull tester except use a disk that is 2.25 inches in diameter and cut through the foam to separate the material attached to the disk from the surrounding material. Perform test after curing period in accordance with manufacturer's written recommendations. Record mode of failure and area which failed in accordance with ASTM D4541. Compare adhesion values with the manufacturer's established minimum values for the particular combination of material and substrate. Indicate on the inspection report whether the manufacturer's requirement has been met. Where the manufacturer has not declared a minimum adhesion value for their product and substrate combination, the inspector must record actual values.

1.7 SAFETY PROVISIONS

1.7.1 Fire Prevention

Provide a written fire prevention plan for the SPF application. Address specific fire hazards such as spontaneous combustion from exothermic heat build-up of SPF components during curing. Provide a continuous fire watch during mixing and spraying of SPF and for a minimum of two hours after completion of work at the end of each day. Maintain fire watch for additional time as required to ensure no potential ignition conditions exist.

1.7.1.1 Fire Extinguishers

Provide two fire extinguishers of minimum 15 pounds capacity each, in accordance with NFPA 10, in the immediate vicinity of the work. CAUTION: Do not discharge high pressure carbon dioxide extinguishers where explosive vapors exist since the discharge can cause a spark which will ignite the vapors.

1.7.2 Respiratory Protection Plan

Provide a written respiratory protection plan in accordance with OSHA regulation 29 CFR 1910.134 that protects installers during application and addresses separation of the area to prevent other workers from entering the work area during spraying.

1.7.3 Isolation

Isolate the work area as recommended by spray foam manufacturer's written requirements. Prevent workers without respiratory, skin, and eye Personal Protective Equipment (PPE) or training from entering the work area or otherwise being exposed to airborne chemicals from off-gassing of the insulation in excess of permissible exposure limits. Display appropriate warning signage at all work area entry points. Provide negative pressure ventilation of the spray area to minimize chemical exposure for all workers.

1.7.4 Respirators and Eye Protection

Respiratory protective devices (respirators) must meet the requirements of ASSP Z88.2. Eye and face protective equipment must meet the requirements of ANSI/ISEA Z87.1. Additionally, sprayers and workers in the immediate vicinity of the spray during indoor installation of high-pressure SPF must wear NIOSH-approved, full-face, supplied air respirators (SAR) or hoods operated in positive pressure or continuous flow mode. Workers not in the immediate vicinity of the sprayer must wear air purifying respirators (APR) with an organic gas / P100 particulate cartridge. During outdoor installation of high-pressure SPF, sprayers and workers in the immediate vicinity of the spray must wear air purifying respirators (APR) with an organic gas / P100 particulate cartridge.

Instruct personnel in the use of personal protective equipment. Maintain such equipment and inspect regularly. All workers using respirators are required to have undergone pulmonary function testing and fit testing and must provide certification that they have done so. Change APR cartridges in accordance with manufacturer's written recommendations.

1.7.5 Clothing and Gloves

Sprayers and workers must wear protective clothing and gloves in accordance with OSHA requirements during materials application. Disposable, chemically-resistant coveralls must be worn and must cover all exposed skin. Sprayers and workers must wear fabric gloves coated with nitrile, neoprene, butyl or PVC.

1.7.6 Additional Requirements

Require personnel to review the Health, Safety and Environmental Aspects of Spray Polyurethane Foam and Coverings published by the Spray Polyurethane Foam Alliance (SPFA) (<https://www.sprayfoam.org/>) and the American Chemistry Council Center for the Polyurethanes Industry. Verify compliance prior to allowing personnel on site for installation work.

1.8 QUALITY CONTROL

1.8.1 Qualification of Manufacturer

Submit documentation verifying that the manufacturer of the SPF is

currently accredited by the Air Barrier Association of America (ABAA Accreditation <https://www.airbarrier.org/>) or by the Spray Polyurethane Foam Alliance (SPFA) Professional Certification Program (PCP).

1.8.2 Qualification of Installer

Submit documentation verifying that installers of the spray foam air barrier are currently certified to properly install SPF materials. Acceptable certifications include those provided by the approved product manufacturer, by ABAA/BPQI (Building Performance Quality Institute) or by the Spray Polyurethane Foam Alliance (SPFA) Professional Certification Program (PCP). Installers must provide photo identification certification cards for inspection upon request.

1.8.3 General Quality Requirements

Provide all products and installation in accordance with the approved product manufacturer's installation instructions. SPFA TechDocs requirements (https://www.sprayfoam.org/SPFA_techdocs) may be used if manufacturers installation instructions do not address specific applications and documented best practices.

1.9 PRECONSTRUCTION MEETING

Conduct a preconstruction meeting after approval of submittals and a minimum of two weeks prior to commencing work specified in this Section. Attendance is required by the Contracting Officer's designated personnel, Contractor, and representatives of related trades including covering materials, substrate materials, adjacent materials, and materials and components of the air/thermal barrier system. Agenda must include, at a minimum, the following items:

- a. Drawings, specifications and submittals related to the SPF work;
- b. Sequence of construction;
- c. Coordination with substrate preparation work and responsibility of repairing defects in substrates. Determine method of ensuring SPF work does not begin until substrates have been inspected and accepted;
- d. Ensure that all penetrations of the substrate by other trades are completed prior to SPF installation where possible; responsibility of sealing penetrations after SPF installation should be addressed.
- e. Compatibility of materials;
- f. Construction and testing of construction mockup;
- h. Spray foam air barrier system installation;
- i. Quality control plan including methods of applying the product so that a consistent thickness across the face of the substrate is achieved.
- j. Procedures for SPF manufacturer's technical representative's onsite inspection and acceptance of substrates, contact info for the representative, frequency of visits, and distribution of copies of inspection reports. Determine where core samples will be taken and

review procedures for daily documentation of SPF application.

- k. Property protection measures and prevention of overspray and clean-up should overspray occur.
- l. Safety requirements, including review of PPE, fire prevention, safety plan, respirator plan, ventilation and separation of the work area, fall protection, and posting of warning signs. Provide a complete schedule and a detailed, written fire protection plan[including temporary isolation of the product and the work area until permanent isolation or thermal barrier is in place].

1.10 PROJECT/SITE CONDITIONS

1.10.1 Temperature and Weather

Install SPF within the range of ambient and substrate surface temperatures in accordance with manufacturer's written instructions. Do not apply SPF to damp or wet substrates. Do not apply SPF during inclement weather or when ice, frost, surface moisture, or visible dampness is present on surfaces to be covered, or when precipitation is imminent. Do not apply SPF to exterior building surfaces when wind speeds exceed 25 miles per hour. Use moisture measuring methods and equipment to verify that the moisture conditions of substrate surfaces are in accordance with SPF manufacturer requirements prior to application. Substrate temperatures must be within limits recommended by the manufacturer's printed instructions.

1.10.2 Conditions for Primers

Follow manufacturer's printed application and curing instructions regarding ambient temperature minimum limits.

1.10.3 Conditions for Ignition Barriers

Ensure that sprayed surfaces comply with manufacturer's written requirements for application coverage, thickness, and curing prior to application of ignition barrier coatings.

1.10.4 Temporary Ventilation

Provide temporary ventilation for work of this Section in accordance with manufacturer's written instructions and with OSHA requirements for this type of application.

1.11 FOAM SPRAY EQUIPMENT

1.11.1 Applicator

Install spray foam with a plural-component proportioner, hoses and spray gun system approved by the spray foam manufacturer

Use a foam spray gun approved by the foam manufacturer that does not require a flushing solvent during the spray operation.

1.11.2 Equipment Calibration

Fully calibrate the foam metering equipment to monitor each liquid component to within 2 percent of the SPF manufacturer's required metering

ratio. Calibrate spray equipment each day at the start of operations, after each restart if spraying operations have been terminated for more than one hour, whenever there is a change in fan pattern or pressure, whenever slow curing areas are noticed, whenever a change is made in hose length or working height, and after changeover between materials. Calibration consists of demonstrating that the equipment is adjusted to deliver components in proper mix and proportion. Conduct calibration tests on cardboard or plywood on a wall adjacent to the area to be sprayed.

1.11.3 Metering Equipment Requirements

Use foam metering equipment capable of developing and maintaining the SPF manufacturer's required liquid component pressures and temperatures. Foam metering equipment must have gages for visual monitoring. Equipment must provide temperature control of foam components to within the temperature ranges recommended by the foam manufacturer's printed instructions.

1.11.4 Moisture Protection

Protect surfaces of supply containers and tanks used to feed foam metering equipment from moisture.

1.11.5 Compressed Air

Supply compressed air that is in contact with SPF during mixing or atomization through moisture traps that are continuously bled.

1.11.6 Dispense Excess Materials

Do not deposit materials used for cleaning of equipment or materials dispensed for calibration purposes and establishment of spray gun pattern onto the ground. Dispense such materials into scrap containers or onto plastic film, or cardboard, and dispose of in accordance with safety requirements and jobsite regulations.

PART 2 PRODUCTS

2.1 SPRAY FOAM INSULATION

2.1.1 General

Provide a closed cell, sprayed in place, SPF that forms a continuous air /thermal barrier at the building enclosure. Provide in accordance with ASTM C1029, with the requirements of UFC 3-600-01, ICC IBC Chapter 26, ICC 1100, and NFPA 285. In the event of a conflict, the most stringent requirement applies. Provide all system components necessary for a complete, code compliant installation, whether indicated or not, including material support components, expansion and contraction joints, and accessories.

2.1.2 Physical Properties

Provide a closed cell product with the following characteristics:

a. Core Density (ASTM D1622): 1.5 to 2.5 lb per cf, nominal

b. Thermal Resistance (ASTM C518)

(1) Initial R-value per inch thickness: 7 sf·degrees F h per Btu

- (2) Aged R-value per inch thickness (180 days at 76 degrees F): 6.6
sf·degrees F·h per Btu
- c. Material Air Permeance (ASTM E2178): Less than 0.004 CFM per sf at 1.57 psf at the minimum installed thickness.
- d. Assembly Air Leakage (ASTM E2357, ASTM E283/E283M): less than 0.04 CFM per sf at 1.57 psf at the minimum installed thickness.
- e. Compressive Strength (ASTM D1621): Minimum 28.3 psi
- f. Tensile Strength (ASTM D1623)
 - (1) Medium density: 15 psi
 - (2) Roofing: 39 psi
- g. Water Vapor Permeance (ASTM E96/E96M, water method): less than 1.2 US Perms at one inch thickness
- h. Vapor Retarder (ICC IBC, ICC IECC) Class III
- i. Surface Burning Characteristics (ASTM E84 or UL 723) 4 inch thickness:
 - (1) Flame Spread (FS) Index Rating less than 75.
 - (2) Smoke Developed (SD) Index Rating less than [150. When fully encapsulated, SPF with an SD rating greater than 150 but less than 450 is permitted. Approval of SPF product is contingent upon approval of encapsulation products and assemblies.][_____].
- j. Closed Cell Content (ASTM D6226): minimum 90 percent
- k. Dimensional Stability (Humid Aging) (ASTM D2126): 15 percent at 28 days at 158 degrees F with 97 percent relative humidity.
- l. Water Absorption (ASTM D2842): Maximum 5.0 per volume
- m. Fungi Resistance (ASTM C1338): Pass, with no growth
- n. Recycled Content: Minimum 9 percent (pre- and post-consumer). Provide data identifying percentage of recycled content for closed cell spray foam air barrier.
- o. Provide product that does not require additional ignition barrier for location conditions indicated or provide product with separate ignition barrier.

2.1.3 Expansion and Contraction

Provide an assembly that allows for relative movement due to temperature, moisture, and air pressure changes. Provide expansion and contraction measures as required by the manufacturer's written recommendations.

2.1.4 Flame Spread and Smoke Developed Index Ratings

Where fire-rated materials are indicated, provide products with the appropriate markings of a qualified testing agency on the containers.

Submit fire-rating test reports. Fire-rating test reports must include flame spread (FS) and smoke developed (SD) index data. Where FS and SD values of foam products do not meet requirements, provide code-compliant ignition or thermal barrier products or alternate assemblies and verify complete encapsulation of the spray foam air barrier through product data or on shop drawings. Submit for approval in accordance with Section 01 33 00 SUBMITTAL PROCEDURES.

2.1.5 Prohibited Materials

Products that contain hexabromocyclododecane (HBCD) flame retardants are prohibited. Products that contain hydrochlorofluorocarbons (HCFCs), chlorofluorocarbons (CFCs), or other hydrofluorocarbons (HFCs), or other blowing agents with Ozone Depletion Potential (ODP) greater than 0.015 or Global Warming Potential (GWP) above 16 are prohibited. For a list of foam blowing agents with ODP and GWP values see <https://www.epa.gov/snap/substitutes-rigid-polyurethane-spray>. Provide validation of indoor air quality for spray foam air barrier that no prohibited materials are used.

2.1.6 Thermal Ignition Barrier

2.1.6.1 SPF at Other Locations

Provide a [thermal barrier][ignition barrier] in locations where SPF is exposed to the interior of the building, including attics and plenum spaces. Provide [thermal][ignition] barriers in accordance with ICC IBC Chapter 26 "Plastics," with ICC 1100, ASTM E736/E736M, and NFPA 275. Choose one or more of the following methods of separation:

- a. Building interior, other than fire-rated enclosures: Separate the SPF from the occupied interior of a building by an intumescent thermal barrier coating or thermal barrier board identical to a third party tested thermal barrier to limit the average temperature rise of the surface of the SPF to not more than 250 degrees F after 15 minutes of fire exposure (using the standard time-temperature curve of ASTM E119). Provide in accordance with NFPA 275.

2.2 TRANSITION MEMBRANE

Provide as specified in Section 07 27 19.01 SELF-ADHERING AIR BARRIERS as recommended by manufacturer.

2.3 PRIMERS, ADHESIVES, AND MASTICS

Provide primers, adhesives, mastics and other accessory materials as recommended by spray foam manufacturer's printed literature.

2.4 FLASHING

As specified in Section 07 60 00 FLASHING AND SHEET METAL.

2.5 JOINT SEALANTS

As specified in Section 07 92 00 JOINT SEALANTS. Verify compatibility with other system products.

PART 3 EXECUTION

3.1 EXAMINATION

Before installing the spray foam air barrier and with the installer present, examine substrates, areas, and conditions under which SPF will be applied, for compliance with requirements. Ensure that surfaces are structurally sound, dry, even, and free of oil, grease, dirt, excess mortar or other contaminants. Ensure that concrete surfaces are cured and dry, smooth without large voids, spalled areas or sharp protrusions. Correct defects that adversely affect the spray foam application or performance. Verify that work by other trades is in place and complete prior to application of spray foam.

3.2 PREPARATION

3.2.1 Substrate Preparation

Clean, prepare, and treat substrate according to manufacturer's written instructions. Provide clean, dust-free, and dry substrate for spray foam application.

- a. Prepare surfaces by brushing, scrubbing, scraping, or grinding to remove loose mortar, dust, oil, grease, oxidation, mill scale and other contaminants which will affect adhesion of the SPF.
- b. Wipe down metal surfaces to remove release agents or other non-compatible coatings, using clean sponges or rags soaked in a solvent compatible with the SPF.

3.2.2 Protection

Protect adjacent areas and surfaces from spray applied materials in accordance with the following:

- a. Mask and cover adjacent areas to protect from overspray.
- b. Ensure required foam stops and back up materials are in place to achieve a complete seal.
- c. Seal off ventilation equipment. Install temporary ducting and fans to provide required negative-pressure exhaust of spray fumes. Provide make-up air as required.
- d. Erect barriers, isolate area, and post warning signs to notify non-protected personnel of the requirement to avoid the spray area.

3.2.3 Fire and Explosion Hazards

Prohibit open flames, sparks, welding, and smoking in the application area. Provide and maintain fire extinguishers of appropriate type, size and distance, as required by NFPA, in the application area. Apply SPF according to manufacturer's instructions regarding maximum pass thickness and curing time. Mix batches in small enough quantities to avoid spontaneous combustion from exothermic heat build-up of SPF components during curing.

3.2.4 Warning Signs

Post warning signs at ground level adjacent to the work area and a minimum of 150 feet from the application area stating the area is off limits to unauthorized persons and warning of potential hazards. Place clearly visible and legible warning sign at entrance to primary road leading to the project facility warning of presence of combustible materials, irritating fumes, and potential of overspray damage.

3.2.5 Prime Substrate

Provide as recommended by the manufacturer for each substrate to be primed. Use primers at full strength. Do not dilute primers unless required and as recommended in writing by the manufacturer. Do not use cleaning solvents for thinning primers or other materials. Ensure that diluted primer(s) meet VOC requirements.

3.3 INSTALLATION

3.3.1 Sequencing and Coordination

Sequence the work to prevent access to the work area by other trades during foam application and curing. Limit access of non-essential workers during application. Notify the Contracting Officer 24 hours in advance of spraying operations. Ensure expansion and control joints are provided as detailed on the manufacturer's shop drawings to accommodate the expansion of each layer of the air/thermal envelope.

3.3.2 Installation of Spray Foam Air Barrier

Install materials in accordance with paragraph SAFETY PROVISIONS, in accordance with manufacturer's recommendations, and in accordance with the following:

- a. Use spray equipment that complies with foam manufacturer's recommendations for the specific type of application, and as specified herein. Record equipment settings on the Daily Work Record. Each proportioned unit can supply only one spray gun.
- b. Apply only when surfaces and environmental conditions are within limits prescribed by the material manufacturer.
- c. Continuously connect the spray foam air barrier at top of walls and roof to form a continuous integrated air barrier system around the building addition enclosure. Seal edges of barrier at junctures with rough openings.
- d. Install within manufacturer's tolerances, but not more than minus 1/4 inch or plus 1/2 inch.
- e. Sequence work to completely seal all penetrations resulting from pipes, vents, wires, conduit, electrical fixtures, structural members, or other construction. If penetrations through the spray foam air barrier are made after the initial SPF application, reapply in accordance with manufacturer's written instructions for such remedial work.
- f. Do not install SPF within 3 inches of heat emitting devices such as light fixtures and chimneys.

- g. Finished surface of SPF must be free of voids and embedded foreign objects.
- h. Remove masking materials and overspray from adjacent areas immediately after foam surface has hardened. Ensure cleaning methods do not damage work performed by other sections.
- i. Trim, as required, any excess thickness that would interfere with the application of cladding and covering system by other trades.
- j. Clean and restore surfaces soiled or damaged by work of other trades. Before cleaning and restoring damaged work, consult with other trades for appropriate and approved methods for cleaning and restoration to prevent further damage.
- k. Complete connections to other components and repair any gaps, holes or other damage using material approved by the SPF manufacturer.
- l. Provide expansion joints in the SPF application aligned with expansion joints in the building enclosure, where substrate materials change, and in accordance with manufacturer's recommendations.
- m. Provide a continuous fire watch in accordance with paragraph SAFETY PROVISIONS.

3.4 FIELD QUALITY CONTROL

3.4.1 General Site Inspections and Testing

Provide site inspections in accordance with the manufacturer's instructions, Section 07 27 10 BUILDING AIR BARRIER SYSTEM, and this Section.

- a. Conduct inspections and testing at 5, 50, and 95 percent of completion of this scope of work. Forward written inspection reports to the Contracting Officer within 5 working days of the inspection and test being performed.
- b. If inspections reveal defects, promptly remove and replace defective work at no additional expense to the Government.

3.4.2 Manufacturer Site Inspections

Manufacturer's technical representative must visit the site during the installation process to ensure the SPF and accessories are being applied in compliance with requirements. At a minimum, manufacturer's technical representative must be present at work startup and perform field inspection of the first day's completed application and at substantial completion, prior to demobilization. After each inspection, submit an inspection report signed by the manufacturer's technical representative, to the Contracting Officer within five working days. The inspection report must note overall quality of work, deficiencies, and recommended corrective actions in detail. Notify the Contracting Officer a minimum of two working days prior to site visits by manufacturer's technical representative.

3.4.3 Contractor's Site Inspections

Establish and maintain an inspection procedure to ensure compliance of the foam installation with Contract requirements. Conduct inspections and testing at 5, 50, and 95 percent completion of application. Forward written inspection reports to the Contracting Officer within five working days of the inspection and test being performed. Work not in compliance must be promptly removed and replaced or corrected, in an approved manner, at no additional cost to the Government. Quality control must include, but is not limited to, the following:

- a. Observation of environmental conditions; number and skill level of insulation workers.
- b. Verification of certification, listing, or label.
- c. Verification of proper storage and handling of materials before, during, and after installation.
- d. Inspection of SPF, support structure, primer, expansion joints, [ignition barrier,] [thermal barrier,] [vapor retarder,] and accessories.

3.4.4 Peel Adhesion Test

Conduct in accordance with test protocol indicated in Part 1 paragraph MOCKUP PEEL ADHESION TEST.

3.4.5 Visual Inspection and Thermal Scanning

Following completion of installation, inspect the SPF surface or cavity using infrared (IR) scanning as specified in ASTM C1060,. Where the IR inspection indicates construction inconsistencies including wet insulation, remove inconsistent portions of the assembly and replace insulation to correct thermal anomalies. Reinspect and document corrections to the satisfaction of the Contracting Officer.

3.4.5.1 Thermographic Test Report

Include thermographs in color and a color temperature scale to define the temperature indicated by the various colors. Identify the high temperature reading, the outdoor air temperature, the building indoor air temperature, and the wind speed and direction. Note areas of compromise in the building enclosure, and note actions required and taken to correct those areas. Final thermography test report must demonstrate that the problem areas have been corrected. Submit the complete test and analysis.

3.5 CORRECTION OF DEFICIENCIES

Upon completion of inspection, testing, or sample taking, repair damaged construction, restore substrates and finishes, and protect repaired construction. Deficiencies found during inspection must be corrected within 5 working days following notification.

3.6 CLEANUP OF SPILLS

Conduct cleanup of uncured product spillage in accordance with paragraph SAFETY PROVISIONS and the manufacturer's written safe handling instructions and SDS. In the event of a conflict, the most stringent

requirement governs.

3.7 PROTECTION AND CLEANING

3.7.1 Protection of Installed Work

Protect SPF installation from damage during application and remainder of construction period in accordance with manufacturer's written instructions. Repair damaged areas to new condition.

3.7.2 Cleaning of Adjacent Surfaces

Clean overspray from adjacent construction using cleaning agents and procedures as recommended in writing by the manufacturer of each type of affected construction and as acceptable to same.

-- End of Section --

SECTION 07 60 00

FLASHING AND SHEET METAL

08/23

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN WELDING SOCIETY (AWS)

AWS D1.2/D1.2M (2014; Errata 1 2014; Errata 2 2020)
Structural Welding Code - Aluminum

ASTM INTERNATIONAL (ASTM)

ASTM A308/A308M (2010) Standard Specification for Steel Sheet, Terne (Lead-Tin Alloy) Coated by the Hot Dip Process

ASTM A480/A480M (2023) Standard Specification for General Requirements for Flat-Rolled Stainless and Heat-Resisting Steel Plate, Sheet, and Strip

ASTM A653/A653M (2023) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process

ASTM A792/A792M (2022) Standard Specification for Steel Sheet, 55% Aluminum-Zinc Alloy-Coated by the Hot-Dip Process

ASTM B32 (2020) Standard Specification for Solder Metal

ASTM B69 (2021) Standard Specification for Rolled Zinc

ASTM B209/B209M (2021a) Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate

ASTM B221 (2021) Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes

ASTM B221M (2021) Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric)

ASTM B370 (2022) Standard Specification for Copper Sheet and Strip for Building Construction

ASTM D41/D41M	(2011; R 2016) Standard Specification for Asphalt Primer Used in Roofing, Dampproofing, and Waterproofing
ASTM D1784	(2020) Standard Specification for Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds
ASTM D2244	(2021) Standard Practice for Calculation of Color Tolerances and Color Differences from Instrumentally Measured Color Coordinates
ASTM D4214	(2007; R 2015) Standard Test Method for Evaluating the Degree of Chalking of Exterior Paint Films
ASTM D4586/D4586M	(2007; R 2018) Asphalt Roof Cement, Asbestos-Free
ASTM E2112	(2023) Standard Practice for Installation of Exterior Windows, Doors and Skylights

NATIONAL ROOFING CONTRACTORS ASSOCIATION (NRCA)

NRCA 0429	(2022) The NRCA Roofing Manual: Architectural Metal Flashing, Condensation and Air Leakage Control and Reroofing
-----------	--

SHEET METAL AND AIR CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION (SMACNA)

SMACNA 1793	(2012) Architectural Sheet Metal Manual, 7th Edition
-------------	--

1.2 GENERAL REQUIREMENTS

Finished sheet metal assemblies must form a weathertight enclosure without waves, warps, buckles, fastening stresses or distortion, while allowing for expansion and contraction without damage to the system. The sheet metal installer is responsible for cutting, fitting, drilling, and other operations in connection with sheet metal modifications required to accommodate the work of other trades. Coordinate installation of sheet metal items used in conjunction with roofing with roofing work to permit continuous, uninterrupted roofing operations.

1.2.1 General Material Requirements

All materials specified in this Section installed in conjunction with the roofing system must be provided by the roofing system manufacturer, or by a manufacturer approved by the roofing system manufacturer for use in the roofing system, and must form a part of the Warranty as required by the applicable roofing system Section.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for

information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Gutters; G

Downspouts; G

Splash Pans; G

Counterflashing; G

Flashing at Roof Penetrations and Equipment Supports; G

Reglets; G

Copings; G

Drip Edges; G

Eave Flashing; G

Recycled Content; S

SD-04 Samples

Finish Samples; G

SD-07 Certificates

Warranty on Finishes; G

SD-08 Manufacturer's Instructions

Instructions for Installation; G

SD-10 Operation and Maintenance Data

Cleaning and Maintenance; G

1.4 MISCELLANEOUS REQUIREMENTS

1.4.1 Product Data

Indicate thicknesses, dimensions, fastenings, anchoring methods, expansion joints, and other provisions necessary for thermal expansion and contraction. Scaled manufacturer's catalog data may be submitted for factory fabricated items.

1.4.2 Finish Samples

Submit two color charts and two finish sample chips from manufacturer's standard color and finish options for each type of finish indicated.

1.4.3 Operation and Maintenance Data

Submit detailed instructions for installation and quality control during installation, cleaning and maintenance, for each type of assembly indicated.

1.5 DELIVERY, HANDLING, AND STORAGE

Package and protect materials during shipment. Uncrate and inspect materials for damage, dampness, and wet-storage stains upon delivery to the job site. Remove from the site and replace damaged materials that cannot be restored to like-new condition. Handle sheet metal items to avoid damage to surfaces, edges, and ends. Store materials in dry, weather-tight, ventilated areas until installation.

PART 2 PRODUCTS

2.1 RECYCLED CONTENT

Provide products with recycled content. Provide data for each product with recycled content, identifying percentage of recycled content.

2.2 MATERIALS

Use any metal listed by NRCA 0429 or SMACNA 1793 for a particular item, unless otherwise indicated. Provide materials and configurations in accordance with NRCA 0429 or SMACNA 1793 for each material, while also meeting the minimum thickness requirements specified in this Section. Different items need not be of the same metal, except that contact between dissimilar metals must be avoided.

Provide sheet metal items in 8 to 10 foot lengths. Single pieces less than 8 feet long may be used to connect to factory-fabricated inside and outside corners, and at ends of runs. Factory fabricate corner pieces with minimum 12 inch legs. Provide accessories and other items essential to complete the sheet metal installation. Provide accessories made of the same or compatible materials as the items to which they are applied. Fabricate sheet metal items of the materials specified below and to the gage, thickness, or weight shown in Table I at the end of this section. Provide sheet metal items with mill finish unless specified otherwise. Where more than one material is listed for a particular item in Table I, each is acceptable and may be used, except as follows:

2.2.1 Exposed Sheet Metal Items

Provide exposed sheet metal items of the same material. Consider the following as exposed sheet metal: gutters, including hangers; downspouts; gravel stops and fascia; cap, valley, steeped, base, and eave flashings and related accessories.

2.2.2 Drainage

Do not use copper for an exposed item if drainage from that item will pass over exposed masonry, stonework or other metal surfaces. In addition to the metals listed in Table I, lead-coated copper may be used for such items.

2.2.3 Copper, Sheet and Strip

Provide in accordance with ASTM B370, cold-rolled temper, H 00 (standard).

2.2.4 Steel Sheet, Zinc-Coated (Galvanized)

Provide in accordance with ASTM A653/A653M, a minimum of 24 gauge, and a minimum zinc coat weighting of 90 ounces per square feet.

2.2.5 Zinc Sheet and Strip

Provide in accordance with ASTM B69, Type I, a minimum of 0.024 inch thick.

2.2.6 Steel Sheet, Aluminum Zinc-Coated

Provide in accordance with ASTM A792/A792M, a minimum of 24 gauge.

2.2.7 Stainless Steel

Provide in accordance with ASTM A480/A480M, Type 302 or 304, 2D Finish, fully annealed, dead-soft temper, a minimum of 24 gauge.

2.2.8 Terne-Coated Steel

Provide in accordance with ASTM A308/A308M, a minimum of 14 by 20 inch with minimum of 40 pound coating per double base box. ASTM A308/A308M.

2.2.9 Aluminum Alloy Sheet and Plate

Provide in accordance with ASTM B209/B209M anodized color form alloy, and temper appropriate for use. Provide material not less than 0.032-in in thickness.

2.2.9.1 Alclad

When fabricated of aluminum, fabricate the following items with Alclad 3003, Alclad 3004, or Alclad 3005, clad on both sides unless otherwise indicated.

- a. Gutters, downspouts, and hangers
- b. Gravel stops and fascia
- c. Flashing

2.2.10 Finishes

Provide exposed exterior sheet metal and aluminum with a baked on, factory applied coil fluoropolymer color coating or approved equal siliconized polyester coating. Dry film thickness of coatings must be 0.8 to 1.3 mils. Color to be selected from manufacturer's full range of color choices as indicated on the Drawings and specifications. Field applications of color coatings are prohibited and will be rejected.

2.2.10.1 Warranty on Finishes

Provide a manufacturer's warranty to repair, or replace, sheet metal flashing and trim that shows evidence of deterioration of factory-applied finishes within 20 years from date of project substantial completion.

Deterioration includes the following:

- a. Color fading more than 5 Delta E units when tested in accordance with ASTM D2244.
- b. Chalking in excess of a No. 8 rating when tested in accordance with ASTM D4214.
- c. Cracking, checking, peeling, or failure of paint to adhere to bare metal.

2.2.11 Aluminum Alloy, Extruded Bars, Rods, Shapes, and Tubes

ASTM B221.

2.2.12 Solder

Provide in accordance with ASTM B32, 95-5 tin-antimony.

2.2.13 Reglets

2.2.13.1 Polyvinyl Chloride Reglets

Provide in accordance with ASTM D1784, Type II, Grade 1, Class 14333-D, 0.075 inch minimum thickness.

2.2.13.2 Metal Reglets

Provide factory fabricated caulked type or friction type reglets with a minimum opening of 1/4 inch and a depth of 1-1/4 inch, as approved.

2.2.13.2.1 Caulked Reglets

Provide with rounded edges, temporary reinforcing cores, and accessories as required for securing to adjacent construction. Provide built-up mitered corner pieces for inside and outside corners.

2.2.13.2.2 Friction Reglets

Provide with flashing receiving slots not less than 5/8 inch deep, one inch jointing tongues, and upper and lower anchoring flanges installed at 24 inch maximum snap-lock type receiver.

2.2.14 Splash Pans

Provide splash pans where downspouts discharge onto roof surfaces and at locations indicated. Unless otherwise indicated, provide pans not less than 24 inches long by 18 inches wide with metal ribs across bottoms of pans. Provide sides of pans with vertical baffles not less than one inch high in the front, and 4 inches high in the back.

2.2.15 Copings

Unless otherwise indicated, provide copings in aluminum sheets, 8 or 10 feet long, joined by a 3/4 inch locked and soldered seam.

2.2.16 Bituminous Plastic Cement

Provide in accordance with ASTM D4586/D4586M, Type I.

2.2.17 Asphalt Primer

Provide in accordance with ASTM D41/D41M.

2.2.18 Fasteners

Use the same metal as, or a metal compatible with the item fastened. Use stainless steel fasteners to fasten. Confirm compatibility of fasteners and items to be fastened to avoid galvanic corrosion due to dissimilar materials.

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 Workmanship

Make lines and angles sharp and true. Free exposed surfaces from visible wave, warp, buckle, and tool marks. Fold back exposed edges neatly to form a 1/2 inch hem on the concealed side. Make sheet metal exposed to the weather watertight with provisions for expansion and contraction.

Make surfaces to receive sheet metal plumb and true, clean, even, smooth, dry, and free of defects and projections. For installation of items not shown in detail or not covered by specifications conform to the applicable requirements of SMACNA 1793, Architectural Sheet Metal Manual. Provide sheet metal flashing in the angles formed where roof decks abut walls, curbs, ventilators, pipes, or other vertical surfaces and wherever indicated and necessary to make the work watertight. Join sheet metal items together as shown in Table II.

3.1.2 Nailing

Confine nailing of sheet metal generally to sheet metal having a maximum width of 18 inches. Confine nailing of flashing to one edge only. Space nails evenly not over 3 inch on center and approximately 1/2 inch from edge unless otherwise specified or indicated. Face nailing is not permitted. Where sheet metal is applied to other than wood surfaces, include in shop drawings, the locations for sleepers and nailing strips required to secure the work. Secure flashing at one-half the normal interval to ensure a wind-resistant installation.

3.1.3 Cleats

Provide cleats for sheet metal 18 inches and over in width. Space cleats evenly not over 12 inches on center unless otherwise specified or indicated. Unless otherwise specified, provide cleats of 2 inches wide by 3 inches long and of the same material and thickness as the sheet metal being installed. Secure one end of the cleat with two nails and the cleat folded back over the nailheads. Lock the other end into the seam. Where the fastening is to be made to concrete or masonry, use screws and drive in expansion shields set in concrete or masonry. Pre-tin cleats for soldered seams.

3.1.4 Bolts, Rivets, and Screws

Install bolts, rivets, and screws where indicated or required. Provide compatible washers where required to protect surface of sheet metal and to

provide a watertight connection. Provide mechanically formed joints in aluminum sheets 0.040 inches or less in thickness.

3.1.5 Seams

Straight and uniform in width and height with no solder showing on the face.

3.1.5.1 Flat-lock Seams

Finish not less than 3/4 inch wide.

3.1.5.2 Lap Seams

Finish soldered seams not less than one inch wide. Overlap seams not soldered, not less than 3 inches.

3.1.5.3 Loose-Lock Expansion Seams

Not less than 3 inches wide; provide minimum one inch movement within the joint. Completely fill the joints with the specified sealant, applied at not less than 1/8 inch thick bed.

3.1.5.4 Standing Seams

Not less than one inch high, double locked without solder.

3.1.5.5 Flat Seams

Make seams in the direction of the flow.

3.1.6 Soldering

Where soldering is specified, apply to copper, terne-coated stainless steel, zinc-coated steel, and stainless steel items. Pre-tin edges of sheet metal before soldering is begun. Seal the joints in aluminum sheets of 0.040 inch or less in thickness with specified sealants. Do not solder aluminum.

3.1.6.1 Edges

Scrape or wire-brush the edges of lead-coated material to be soldered to produce a bright surface. Flux brush the seams in before soldering. Treat with soldering acid flux the edges of stainless steel to be pre-tinned. Seal the joints in aluminum sheets of 0.040 inch or less in thickness with specified sealants. Do not solder aluminum.

3.1.7 Welding and Mechanical Fastening

Use welding for aluminum of thickness greater than 0.040 inch. Aluminum 0.040 inch or less in thickness must be butted and the space backed with formed flashing plate; or lock joined, mechanically fastened, and filled with sealant as recommended by the aluminum manufacturer.

3.1.7.1 Welding of Aluminum

Use welding of the inert gas, shield-arc type. For procedures, appearance and quality of welds, and the methods used in correcting welding work, conform to AWS D1.2/D1.2M.

3.1.7.2 Mechanical Fastening of Aluminum

Use No. 12, aluminum alloy, sheet metal screws or other suitable aluminum alloy or stainless steel fasteners. Drive fasteners in holes made with a No. 26 drill in securing side laps, end laps, and flashings. Space fasteners 12 inches maximum on center. Where end lap fasteners are required to improve closure, locate the end lap fasteners not more than 2 inches from the end of the overlapping sheet.

3.1.8 Protection from Contact with Dissimilar Materials

3.1.8.1 Copper or Copper-bearing Alloys

Paint with heavy-bodied bituminous paint surfaces in contact with dissimilar metal, or separate the surfaces by means of moistureproof building felts.

3.1.8.2 Aluminum

Do not allow aluminum surfaces in direct contact with other metals except stainless steel, zinc, or zinc coating. Where aluminum contacts another metal, paint the dissimilar metal with a primer followed by two coats of aluminum paint. Where drainage from a dissimilar metal passes over aluminum, paint the dissimilar metal with a non-lead pigmented paint. Aluminum may be used over concrete construction, provided that required reglets are of stainless steel and aluminum surface in contact with concrete or masonry is coated with bituminous paint or zinc chromate primer.

3.1.8.3 Metal Surfaces

Paint surfaces in contact with mortar, concrete, or other masonry materials with alkali-resistant coatings such as heavy-bodied bituminous paint.

3.1.8.4 Wood or Other Absorptive Materials

Paint surfaces that may become repeatedly wet and in contact with metal with two coats of aluminum paint or a coat of heavy-bodied bituminous paint.

3.1.9 Expansion and Contraction

Provide expansion and contraction joints at not more than 32 foot intervals for aluminum and at not more than 40 foot intervals for other metals. Provide an additional joint where the distance between the last expansion joint and the end of the continuous run is more than half the required interval. Space joints evenly. Join extruded aluminum gravel stops and fascia by expansion and contraction joints spaced not more than 12 feet apart.

3.1.10 Counterflashing

Except where indicated or specified otherwise, insert counterflashing in reglets located from 9 to 10 inches above roof decks, extend down vertical surfaces over upturned vertical leg of base flashings not less than 3 inches. Fold the exposed edges of counterflashings 1/2 inch. Where stepped counterflashings are required, they may be installed in short

lengths a minimum 8 inches by 8 inches or may be of the preformed single piece type. Provide end laps in counterflashings not less than 3 inches and make it weathertight with plastic cement. Do not make lengths of metal counterflashings exceed 10 feet. Form flashings to the required shapes before installation. Factory form corners not less than 12 inches from the angle. Secure the flashings in the reglets with lead wedges and space not more than 18 inches apart; on short runs, place wedges closer together. Fill caulked-type reglets or raked joints which receive counterflashing with caulking compound. Turn up the concealed edge of counterflashings built into masonry or concrete walls not less than 1/4 inch and extend not less than 2 inches into the walls. Install counterflashing to provide a spring action against base flashing. Utilize two piece counterflashing components to minimize damage of counterflashing and reglets during future reroofing activities.

3.1.11 Gutters

The hung type of shape indicated and supported on underside by brackets that permit free thermal movement of the gutter. Provide gutters in sizes indicated complete with mitered corners, end caps, outlets, brackets, and other accessories necessary for installation. Bead with hemmed edge or reinforce the outer edge of gutter with a stiffening bar not less than 3/4 by 3/16 inch of material compatible with gutter. Fabricate gutters in sections not less than 8 feet. Lap the sections a minimum of one inch in the direction of flow or provide with concealed splice plate 6 inches minimum. Join the gutters, other than aluminum, by riveted and soldered joints. Join aluminum gutters with riveted sealed joints. Provide expansion-type slip joints midway between outlets. Install gutters below slope line of the roof so that snow and ice can slide clear. Support gutters on as indicated. Adjust gutters to slope uniformly to outlets, with high points occurring midway between outlets. Fabricate hangers and fastenings from compatible metals.

3.1.12 Downspouts

Space supports for downspouts according to the manufacturer's recommendation for the masonry or steel substrate. Types, shapes and sizes are indicated. Provide complete including elbows and offsets. Provide downspouts in approximately 10 foot lengths. Provide end joints to telescope not less than 1/2 inch and lock longitudinal joints. Provide gutter outlets with wire ball strainers for each outlet. Provide strainers to fit tightly into outlets and be of the same material used for gutters. Keep downspouts not less than one inch away from walls. Fasten to the walls at top, bottom, and at an intermediate point not to exceed 5 feet on center with leader straps or concealed rack-and-pin type fasteners. Form straps and fasteners of metal compatible with the downspouts.

3.1.12.1 Terminations

Neatly fit into the drainage connection the downspouts terminating in drainage lines and fill the joints with a portland cement mortar cap sloped away from the downspout. Provide downspouts terminating in splash blocks with elbow-type fittings at locations indicated. Provide splash pans as specified at locations indicated.

3.1.13 Splash Pans

Install splash pans lapped with horizontal roof flanges not less than 4

inches wide to form a continuous surface. Bend the rear flange of the pan to contour of can't strip and extend up 6 inches under the side wall covering or to height of base flashing under counterflashing.

3.1.14 Eave Flashing

One piece in width, applied in 8 to 10 foot lengths with expansion joints spaced as specified in paragraph EXPANSION AND CONTRACTION. Provide a 3/4 inch continuous fold in the upper edge of the sheet to engage cleats spaced not more than 10 inches on center. Locate the upper edge of flashing not less than 18 inches from the outside face of the building, measured along the roof slope. Fold lower edge of the flashing over and loose-lock into a continuous edge strip on the fascia. Where eave flashing intersects metal valley flashing, secure with one inch flat locked joints with cleats that are 10 inches on center.

3.1.15 Flashing at Wall Openings

Install pan flashing in the rough opening sill at penetrations in the exterior wall assemblies, such as louvers. Pan sill flashing must have end dams at both jambs a minimum of 2 in high and a rear dam of 2 in high. Flashing must comply with ASTM E2112 and SMACNA 1793.

3.1.16 Sheet Metal Covering on Flat, Sloped, or Curved Surfaces

Except as specified or indicated otherwise, cover and flash all minor flat, sloped, or curved surfaces such as crickets, bulkheads, dormers and small decks with metal sheets of the material used for flashing; maximum size of sheets, 16 by 18 inches. Fasten sheets to sheathing with metal cleats. Lock seams and solder. Lock aluminum seams as recommended by aluminum manufacturer. Provide an underlayment of roofing felt for all sheet metal covering.

3.1.17 Expansion Joints

Provide expansion joints for roofs, walls, and floors as indicated. Provide expansion joints in continuous sheet metal at 40 foot intervals for copper and stainless steel and at 32 foot intervals for aluminum,. Provide evenly spaced joints. Provide an additional joint where the distance between the last expansion joint and the end of the continuous run is more than half the required interval spacing. Conform to the requirements of Table I.

3.1.18 Flashing at Roof Penetrations and Equipment Supports

Provide metal flashing for all pipes, ducts, and conduits projecting through the roof surface and for equipment supports, guy wire anchors, and similar items supported by or attached to the roof deck.

3.2 PAINTING

Touch ups in the field may be applied only after metal substrates have been cleaned and pretreated in accordance with manufacturer's written instructions and products.

Field-paint dissimilar sheet metals in contact to separate and deter galvanic interactions.

3.2.1 Aluminum Surfaces

Clean with solvent and apply one coat of zinc-molybdate primer and one coat of aluminum paint.

3.3 CLEANING

Clean exposed sheet metal work at completion of installation. Remove grease and oil films, handling marks, contamination from steel wool, fittings and drilling debris, and scrub-clean. Free the exposed metal surfaces of dents, creases, waves, scratch marks, and solder or weld marks.

3.4 REPAIRS TO FINISH

Scratches, abrasions, and minor surface defects of finish may be repaired in accordance with the manufacturer's printed instructions and as approved. Repair damaged surfaces caused by scratches, blemishes, and variations of color and surface texture. Replace items which cannot be repaired.

3.5 FIELD QUALITY CONTROL

Establish and maintain a Quality Control Plan for sheet metal used in conjunction with roofing to assure compliance of the installed sheet metalwork with the Contract requirements. Remove work that is not in compliance with the Contract and replace or correct. Include quality control, but not be limited to, the following:

- a. Observation of environmental conditions; number and skill level of sheet metal workers; condition of substrate.
- b. Verification that specified material is provided and installed.
- c. Inspection of sheet metalwork, for proper size(s) and thickness(es), fastening and joining, and proper installation.

3.5.1 Procedure

Submit for approval prior to start of roofing work. Include a checklist of points to be observed. Document the actual quality control observations and inspections. Provide a copy of the documentation to the Contracting Officer at the end of each day.

TABLE I. SHEET METAL WEIGHTS, THICKNESSES, AND GAGES			
Sheet Metal Items	Aluminum, inch	Stainless Steel, inch	Zinc-Coated Steel, U.S. Std. Gage

TABLE I. SHEET METAL WEIGHTS, THICKNESSES, AND GAGES			
Sheet Metal Items	Aluminum, inch	Stainless Steel, inch	Zinc-Coated Steel, U.S. Std. Gage
Downspout clips and anchors	.040 clip .125 anchor	-	-
Downspout straps, 2-inch	.060	-	-
Flashings:			
Base	.040	-	24
Cap (Counter-flashing)	.032	-	26
Eave	.040	-	24
Stepped	.032	-	-
Coping	.040	-	-
Gravel stops and fascia:			
Extrusions	.075	-	-
Sheets, smooth	.050	-	24
Edge strip	.050	-	-
Gutters:			
Gutter section	.040	-	-
Continuous cleat	.032	-	24
Hangers, dimensions	1 inch by .080 inch (c)	-	-
Joint Cover plates (See Table II)	.032	-	24
Reglets (c)	-	.010	-
Splash pans	.040	-	-
(a) Brass.			
(b) May be lead weighing 4 pounds per square foot.			

TABLE I. SHEET METAL WEIGHTS, THICKNESSES, AND GAGES			
Sheet Metal Items	Aluminum, inch	Stainless Steel, inch	Zinc-Coated Steel, U.S. Std. Gage
(c) May be polyvinyl chloride.			
(d) 2.5 pound minimum lead sleeve with 4 inch flange. Where lead sleeve is impractical, refer to paragraph SINGLE PIPE VENTS for optional material.			

TABLE II. SHEET METAL JOINTS			
TYPE OF JOINT			
Item Designation	Zinc-Coated Steel and Stainless Steel	Aluminum	Remarks
Joint cap for building expansion seam, cleated joint at roof	1.25 inch single lock, standing seam, cleated	1.25 inch single lock, standing	--
Flashings			
Base	One inch 3 inch lap for expansion joint	One inch flat locked, soldered; sealed; 3 inch lap for expansion joint	Aluminum manufacturer's recommended hard setting sealant for locked aluminum joints. Fill each metal expansion joint with a joint sealing compound.
Cap-in reglet	3 inch lap	3 inch lap	Seal groove with joint sealing compound.

TABLE II. SHEET METAL JOINTS			
TYPE OF JOINT			
Item Designation	Zinc-Coated Steel and Stainless Steel	Aluminum	Remarks
Reglets	Butt joint	--	Seal reglet groove with joint sealing compound.
Eave	One inch flat locked, cleated. One inch loose locked, sealed expansion joint, cleated.	One inch flat locked, locked, cleated one inch loose locked, sealed expansion joints, cleated	Same as base flashing.
Stepped	3 inch lap	3 inch lap	--
Valley	6 inch lap cleated	6 inch lap cleated	--
Edge strip	Butt	Butt	--
Copings	Cover and Back-up Plates	Cover and Back-up Plates	
Gutters	1.5 inch lap, riveted and soldered	One inch flat locked riveted and sealed	Aluminum producers recommended hard setting sealant for locked aluminum joints.
(a) Provide a 3 inch lap elastomeric flashing with manufacturer's recommended sealant.			
(b) Seal Polyvinyl chloride reglet with manufacturer's recommended sealant.			

-- End of Section --

This page left blank.

SECTION 07 61 14.00 20

STEEL STANDING SEAM ROOFING
08/16, CHG 11 08/18)

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN IRON AND STEEL INSTITUTE (AISI)

AISI SG03-3 (2002; Suppl 2001-2004; R 2008)
Cold-Formed Steel Design Manual Set

AMERICAN SOCIETY OF SAFETY PROFESSIONALS (ASSP)

ASSP Z359.1 (2016) The Fall Protection Code

ASSP Z359.2 (2017) Minimum Requirements for a
Comprehensive Managed Fall Protection
Program

ASSP Z359.6 (2016) Specifications and Design
Requirements for Active Fall Protection
Systems

ASTM INTERNATIONAL (ASTM)

ASTM A653/A653M (2019) Standard Specification for Steel
Sheet, Zinc-Coated (Galvanized) or
Zinc-Iron Alloy-Coated (Galvannealed) by
the Hot-Dip Process

ASTM A792/A792M (2010) Standard Specification for Steel
Sheet, 55% Aluminum-Zinc Alloy-Coated by
the Hot-Dip Process

ASTM B117 (2016) Standard Practice for Operating
Salt Spray (Fog) Apparatus

ASTM D1654 (2008; R 2016; E 2017) Standard Test
Method for Evaluation of Painted or Coated
Specimens Subjected to Corrosive
Environments

ASTM D2244 (2016) Standard Practice for Calculation
of Color Tolerances and Color Differences
from Instrumentally Measured Color
Coordinates

ASTM D2247 (2015) Testing Water Resistance of
Coatings in 100% Relative Humidity

ASTM C177 (2019; E 2023) Standard Test Method for

	Steady-State Heat Flux Measurements and Thermal Transmission Properties by Means of the Guarded-Hot-Plate Apparatus
ASTM D4214	(2007; R 2015) Standard Test Method for Evaluating the Degree of Chalking of Exterior Paint Films
ASTM D522/D522M	(2014) Mandrel Bend Test of Attached Organic Coatings
ASTM D523	(2014; R 2018) Standard Test Method for Specular Gloss
ASTM D714	(2002; R 2017) Standard Test Method for Evaluating Degree of Blistering of Paints
ASTM D968	(2017) Standard Test Methods for Abrasion Resistance of Organic Coatings by Falling Abrasive
ASTM E1592	(2005; R 2012) Structural Performance of Sheet Metal Roof and Siding Systems by Uniform Static Air Pressure Difference
ASTM G152	(2013) Operating Open Flame Carbon Arc Light Apparatus for Exposure of Nonmetallic Materials
ASTM G153	(2013) Operating Enclosed Carbon Arc Light Apparatus for Exposure of Nonmetallic Materials

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1926	Safety and Health Regulations for Construction
-------------	--

SHEET METAL AND AIR CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION (SMACNA)

SMACNA 1793	(2012) Architectural Sheet Metal Manual, 7th Edition
-------------	--

U.S. DEPARTMENT OF ENERGY (DOE)

Energy Star	(1992; R 2006) Energy Star Energy Efficiency Labeling System (FEMP)
-------------	---

1.2 DEFINITIONS

1.2.1 Field-Formed Seam

Seams of panels so configured that when adjacent sheets are installed the seam is sealed utilizing mechanical or hand seamers. Crimped (45 degree bend), roll formed (180 degree bend), double roll formed (2 - 180 degree bends), and roll and lock systems are types of field-formed seam systems.

Snap together seam is not allowed.

1.2.2 Pre-Formed

Formed to the final, less field-formed seam, profile and configuration in the factory.

1.2.3 Field-Formed

Formed to the final, less field-formed seam, profile and configuration at the site of work prior to installation.

1.2.4 Roofing System

The roofing system is defined as the assembly of roofing components, including roofing panels, flashing, fasteners, fall protection system, pipe flashing, and accessories which, when assembled properly result in a watertight installation.

1.2.5 SSMRS

Standing Seam Metal Roof System (SSMRS) is abbreviation of the entire roof system specified herein with all components and parts coming from a single manufacturer's system.

1.3 SYSTEM DESCRIPTION

1.3.1 Design Requirements

- a. Panels must be field rolled form without end laps. Panels must be continuous lengths, with no joints or seams.
- b. There must be no exposed or penetrating fasteners except where shown on approved shop drawings. Fasteners into steel must be stainless steel, zinc cast head, or cadmium plated steel screws inserted into predrilled holes. There must be a minimum of two fasteners per clip.
- c. Field-formed seam type systems must be mechanically locked closed by the manufacturer's locking tool. The seam must include a continuous factory applied sealant when required by the manufacturer to withstand the wind loads specified.
- d. Roof panel anchor clips must be concealed and designed to allow for longitudinal thermal movement of the panels, except where specific fixed points are indicated. Provide for lateral thermal movement in panel configuration or with clips designed for lateral and longitudinal movement.

1.3.2 Design Conditions

Design the system to resist positive and negative loads specified herein in accordance with the AISI SG03-3. Panels must support walking loads without permanent distortion or telegraphing of the structural supports.

1.3.2.1 Wind Uplift

Compute and apply the design uplift pressures for the roof system using a basic wind speed of 115 mph (ASCE 7-10 strength level).

The design uplift force for each connection assembly must be that pressure

given for the area under consideration, multiplied by the tributary load area of the connection assembly, and multiplied by the appropriate factor of safety, as follows:

- a. Single fastener in a connection: 3.0
- b. Two or more fasteners in each connection: 2.25
- c. Maximum clip spacing shall not exceed 3 feet-0 inches.

1.3.2.2 Roof Live Loads

Loads must be applied on the horizontal projection of the roof structure. The minimum roof design live load must be 20 psf.

1.3.2.3 Thermal Movement

System must be capable of withstanding thermal movement based on a temperature range of 10 degrees F below 180 degrees F.

1.3.2.4 Deflection

Panels must be capable of supporting design loads between unsupported spans with deflection of not greater than L/180 of the span.

1.3.3 Structural Performance

The structural performance test methods and requirements of the Standing Seam Roofing Systems (SSRS) must be in accordance with ASTM E1592.

1.4 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Roofing

SD-03 Product Data

Roofing Panels

Energy Star Label for Steel Roofing Product; S

Recycled Content for Steel Roofing Product; S

Heat Island Reduction; S

Attachment Clips; G

Closures

Accessories

Fasteners

Sealants

Insulation, including Joint Sealing Measures for Vapor Barrier Facing

Fall Protection System; G

Sample Warranty Certificate; G

Submit for materials to be provided. Submit data sufficient to indicate conformance to specified requirements.

SD-04 Samples

For color selection, submit 2 by 4 inch metal sample in color, finish and texture confirm to match with existing roof.

Fall Protection System; G

SD-05 Design Data

Design Calculations; G

Fall Protection System; G

SD-06 Test Reports

Field Inspection; G

Submit manufacturer's technical representative's field inspection reports as specified in paragraph MANUFACTURER'S FIELD INSPECTION.

Structural Performance Tests

Finish Tests

SD-07 Certificates

Manufacturer's Technical Representative's Qualifications

Statement of Installer's Qualifications

Submit documentation from roofing manufacturer proving the manufacturer's technical representative meets below specified requirements. Include name, address, telephone number, and experience record.

Submit documentation proving the installer is factory-trained, has the specified experience, and authorized by the manufacturer to install the products specified.

Coil Stock Compatibility; G

Provide certification of coil compatibility with roll forming machinery to be used for forming panels without warping, waviness, and rippling not part of panel profile; to be done without damage, abrasion or marking of finish coating.

SD-08 Manufacturer's Instructions

Installation Manual; G

Submit manufacturers printed installation manual, instructions, and standard details.

SD-11 Closeout Submittals

Information Card; G

For each roofing installation, submit a typewritten card or photoengraved aluminum card containing the information listed on Form 1 located at the end of this section.

Fall Protection System; G

Warranty; G

1.5 DESIGN CALCULATIONS

Provide design calculations prepared by a professional engineer specializing in structural engineering verifying that system supplied and any additional framing meets design load criteria indicated. Coordinate calculations with manufacturer's test results. Include calculations for:

- a. Wind load uplift design pressure at roof locations specified in paragraph WIND UPLIFT.
- b. Clip spacing and allowable load per clip.
- c. Fastening of clips to structure or intermediate supports.
- d. Intermediate support spacing and framing and fastening to structure when required.
- e. Allowable panel span at anchorage spacing indicated.
- f. Safety factor used in design loading.
- g. Governing code requirements or criteria.
- h. Edge and termination details.

1.6 QUALITY ASSURANCE

1.6.1 Preroofing Conference

After submittals are received and approved but before roofing and insulation work, including associated work, is preformed, the Contractor must hold a preroofing conference to review the following:

- a. The drawings and specifications
- b. Procedure for on site inspection and acceptance of the roofing substrate and pertinent structural details relating to the roofing system

- c. Contractor's plan for coordination of the work of the various trades involved in providing the roofing system and other components secured to the roofing
- d. Safety requirements

The prerooting conference must be attended by the Contractor and personnel directly responsible for the roofing and insulation installation, mechanical and electrical work, and the roofing manufacturer's technical representative. Conflicts among those attending the prerooting conference must be resolved and confirmed in writing before roofing work, including associated work, is begun. Prepare written minutes of the prerooting conference and submit to the Contracting Officer.

1.6.2 Manufacturer

The SSMRS must be the product of a metal roofing industry - recognized manufacturer who has been in the practice of manufacturing SSMRS for a period of not less than 10 years and who has been involved in at least 5 projects same or larger in size and complexity to this project.

1.6.3 Manufacturer's Technical Representative

The representative must have authorization from manufacturer to approve field changes and be thoroughly familiar with the products and with installations in the geographical area where construction will take place. The manufacturer's representative must be an employee of the manufacturer with at least 5 years experience in installing the roof system. The representative must be available to perform field inspections and attend meetings as required herein, and as requested by the Contracting Officer.

1.6.4 Installer's Qualifications

The roofing system installer must be factory-trained, approved by the steel roofing system manufacturer to install the system, and must have a minimum of five years experience as an approved applicator with that manufacturer. The applicator must have applied five installations of same or larger size and scope as this project within the previous 3 years.

1.6.5 Single Source

Roofing panels, clips, closures, and other accessories must be standard products of the same manufacturer; must be the latest design by the manufacturer; and must have been designed by the manufacturer to operate as a complete system for the intended use.

1.6.6 Laboratory Tests For Panel Finish

The term "appearance of base metal" refers to the metal coating on steel. Panels must meet the following test requirements:

- a. Formability Test: When subjected to a 180 degree bend over a 1/8 inch diameter mandrel in accordance with ASTM D522/D522M, exterior coating film may show only slight microchecking and no loss of adhesion.
- b. Accelerated Weathering Test: Withstand a weathering test for a minimum of 2000 hours in accordance with ASTM G152 and ASTM G153, Method 1 without cracking, peeling, blistering, loss of adhesion of

the protective coating, or corrosion of the base metal. Protective coating that can be readily removed from the base metal with a penknife blade or similar instrument will be considered to indicate loss of adhesion.

- c. Chalking Resistance: After the 2000-hour weatherometer test, exterior coating may not chalk greater than No. 8 rating when measured in accordance with ASTM D4214 test procedures.

- d. Color Change Test:

After the 2000 -hour weatherometer test, exterior coating color change must not exceed 2 NBS units when measured in accordance with ASTM D2244 test procedure.

- e. Salt Spray Test: Withstand a salt spray test for a minimum of 1000 hours in accordance with ASTM B117, including the scribe requirement in the test. Immediately upon removal of the panel from the test, the coating must receive a rating of 8, few blisters in field as determined by ASTM D714; and an average rating of 6, 1/8 inch failure at scribe, as determined by ASTM D1654. Rating Schedule No. 1.

- f. Abrasion Resistance Test for Color Coating: When subjected to the falling sand test in accordance with ASTM D968, coating system must withstand a minimum of 50 liters of sand per mil thickness before appearance of base metal.

- g. Humidity Test: When subjected to a humidity cabinet test in accordance with ASTM D2247 for 1000 hours, a scored panel must show no signs of blistering, cracking, creepage, or corrosion.

- h. Gloss Test: The gloss of the finish must be 30 plus or minus 5 at an angle of 60 degrees, when measured in accordance with ASTM D523.

- i. Glare Resistance Test:

Surfaces of panels that will be exposed to the exterior must have a specular reflectance of not more than 10 when measured in accordance with ASTM D523 at an angle of 85 degrees. Specular reflectance may be obtained with striations or embossing. Requirements specified under FORMABILITY TEST will be waived if necessary to conform to this requirement.

1.6.7 Shop Drawing Requirements

Submit roofing drawings to supplement the instructions and diagrams. Include design and erection drawings containing an isometric view of the roof showing the design uplift pressures and dimensions of edge, ridge and corner zones; and show typical and special conditions including flashings, materials and thickness, dimensions, fixing lines, anchoring methods, sealant locations, sealant tape locations, fastener layout, sizes, and spacing, terminations, penetrations, attachments, and provisions for thermal movement. Details of installation must be in accordance with the manufacturer's Standard Instructions and details or the SMACNA 1793. Prior to submitting shop drawings, have drawings reviewed and approved by the manufacturer's technical engineering department.

1.6.8 Fall Arrest System

General: Provide fall restraint and fall arrest system capable of withstanding loads and stresses within limits and under conditions specified in OSHA and other applicable safety codes. Provide fall protection anchors permanently attached to the standing seam roof structure. Provide cable lifeline system to allow continuous, hands-free, travel past intermediate and corner anchors. Fall arrest post and cable system shall be designed per ASSP Z359.1, ASSP Z359.2, and ASSP Z359.6. Provide shop drawing with details and structural calculations for fall protection system signed/sealed by professional engineer in the State of Florida.

1.6.8.1 Design Requirements

Anchors and accessories comprising system of following types:

- a. Fall Protection Anchors, spaced as indicated, capable of withstanding a 5,000 pound load or safety factor of 2 meeting the requirements of OSHA 29 CFR 1926.502(d) (8).
- b. Continuous stainless steel cable lifeline restrained by single clamped mechanical terminations at anchor points, suitable for multiple slider connections along cable between anchors.
- c. Tensioning system with tension indicator.
- d. Pass-thru technology allowing workers cable shuttle to run freely past intermediate anchors without the worker having to disconnect / re-connect to the fall protection system.
- e. Design all components to provide adequate attachment to standing seam metal roof and ensure compatibility with industry standard equipment.
- f. The swing fall shall comply with ASSE/SAFE Z359.6 (5.3).
- g. The clearance safety margin shall comply with ASSE/SAFE Z359.6 (7.2.6.2).
- h. Where a worker is using a full body harness the maximum arresting force shall not exceed 1,800 pounds.

1.6.8.2 Performance Requirements

System and components tested for resistance of following loads:

- a. Fall Restraint: 2 persons simultaneously applied.
- b. Fall Arrest: 2 persons. Roof accessory attachment system to provide attachment to standing seam metal roofs:
 - (1) With only minor dimpling of panel seams.
 - (2) With only round point set screws.
 - (3) Without penetrations through roof seams or panels.
 - (4) Without use of sealers or adhesives.

(5) Without voiding roof warranty.

1.6.8.3 Fall Arrest System Testing

Perform quality control tests for each system per manufacturer's requirements.

1.7 WARRANTY

Furnish manufacturer's no-dollar-limit materials and workmanship warranty for the roofing system. The warranty period must be not less than 20 years from the date of Government acceptance of the work. The warranty must be issued directly to the Government. The warranty must provide that if within the warranty period the metal roofing system becomes non-watertight or shows evidence of corrosion, perforation, rupture or excess weathering due to deterioration of the roofing system resulting from defective materials or installed workmanship the repair or replacement of the defective materials and correction of the defective workmanship must be the responsibility of the roofing system manufacturer. Repairs that become necessary because of defective materials and workmanship while roofing is under warranty must be performed within 7 days after notification, unless additional time is approved by the Contracting Officer. Failure to perform repairs within the specified period of time will constitute grounds for having the repairs performed by others and the cost billed to the manufacturer. In addition, provide a 2 year contractor installation warranty.

1.8 DELIVERY, STORAGE AND HANDLING

Deliver, store, and handle preformed panels, bulk roofing products and other manufactured items in a manner to prevent damage or deformation.

1.8.1 Delivery

Provide adequate packaging to protect materials during shipment. Crated materials must not be uncrated until ready for use, except for inspection. Immediately upon arrival of materials at the jobsite, inspect materials for damage, dampness, and staining. Replace damaged or permanently stained materials that cannot be restored to like-new condition with satisfactory material. If materials are wet, remove the moisture and re-stack and protect the panels until used.

1.8.2 Storage

Stack materials on platforms or pallets and cover with tarpaulins or other suitable weathertight covering which prevents water trapping or condensation. Store materials so that water which might have accumulated during transit or storage will drain off. Do not store the panels in contact with materials that might cause staining, such as mud, lime, cement, fresh concrete or chemicals. Protect stored panels from wind damage.

1.8.3 Handling

Handle material carefully to avoid damage to surfaces, edges and ends.

PART 2 PRODUCTS

2.1 ROOFING PANELS

Provide panels with interlocking ribs for securing adjacent sheets and with concealed clip fastening system for securing the roof covering to structural framing members. Fasteners must not penetrate the panels. Factory prepare ends of panels to be lapped by trimming part of seam, die-setting, or swaging ends of panels. Individual sheets must be sufficiently long to cover the entire length of any unbroken roof slope. Sheets must provide not less than 12 inches of coverage (width) in place. Make provisions for expansion and contraction at both ridge and eave, consistent with the type of system to be used. Form panels from coil stock without warping, waviness or ripples not part of the panel profile, and free of damage to the finish coating system.

Provide steel roofing product that is Energy Star labeled. Provide data identifying Energy Star label for steel roofing product. Provide solar reflectance product with an initial solar reflectance greater than or equal to 0.39 and a SRI greater than or equal to 0.32 three years after installation under normal conditions. Provide emittance and reflectance percentages, solar reflectance index values, to meet sustainable third party certification requirements for Heat Island Reduction.

- a. Roof panel shall match existing roof width/height.
- b. Basis of design: Centria SRS 3 Structural Standing Seam Roof System.

2.1.1 Material

Zinc-coated steel conforming to ASTM A653/A653M, G90 coating designation or aluminum-zinc alloy coated steel conforming to ASTM A792/A792M, AZ 55 coating. Provide material with a minimum thickness of 0.023 inch thick (24 gauge) minimum except when mid field of roof is subject to design wind uplift pressures of 60 psf or greater, entire roof system must have a minimum thickness of 0.030 inch (22 gauge). Steel roofing materials must contain a minimum of 30 percent total recycled content. Provide data identifying percentage of recycled content for steel roofing product. Prior to shipment, treat mill finish panels with a passivating chemical and oil to inhibit the formation of oxide corrosion products. Dry, retreat, and re-oil panels that have become wet during shipment or storage but have not started to oxidize.

2.1.2 Texture

Smooth with raised intermediate ribs for added stiffness. Confirm match to existing roofing.

2.1.3 Finish

Factory color finish. Color shall match adjacent existing roofing.

2.1.3.1 Factory Color Finish

Provide factory applied, thermally cured coating to exterior and interior of metal roof and wall panels and metal accessories. Provide exterior finish top coat of 70 percent resin polyvinylidene fluoride with not less than 0.8 mil dry film thickness. Interior finish must consist of 0.5 mil dry film thickness backer coat. Provide exterior and interior coating

meeting test requirements specified below. Tests must have been performed on the same factory finish and thickness provided. Provide clear factory edge coating on all factory cut or unfinished edges.

2.2 ATTACHMENT CLIPS

Fabricate clips from or Series 300 stainless steel. Size, shape, thickness and capacity as required to meet the load, insulation thickness and deflection criteria specified.

2.3 SUBSTRATE MATERIALS

2.3.1 Coverboard

Provide 5/8 inch glass mat gypsum roof board ASTM C177. 0 flame spread and 0 smoke developed with tested in accordance with ASTM E84, 500 psi, Class A, non-combustible 1/2 inch thick, 4 by 8 feet board size.

2.3.2 Membrane Vapor/Air Barrier

Minimum .040 inch thick membrane comprised of .036 inches of self-adhesive rubberized asphalt integrally bonded to .004 inches of cross-laminated high density polyethylene film. Membrane shall be interleaved with disposable silicone-coated release paper until installed. Basis of Design: Perm-A-Barrier Membrane from Grace Construction.

2.3.3 Slip Sheet

Where recommended by roof panel manufacturer, provide slip sheet between roof panel and membrane underlayment. Provide 5 pound per 100 sf rosin sized unsaturated building paper for slip sheet.

2.4 ACCESSORIES

Sheet metal flashings, gutters, downspouts, trim, moldings, closure strips, pre-formed crickets, caps, equipment curbs, and other similar sheet metal accessories used in conjunction with preformed metal panels must be of the same material as used for the panels. Provide metal accessories with a factory color finish to match the roofing panels, except that such items which will be concealed after installation may be provided without the finish if they are stainless steel. Metal must be of a thickness not less than that used for the panels. Thermal spacer blocks and other thermal barriers at concealed clip fasteners must be as recommended by the manufacturer except that wood spacer blocks are not allowed.

2.4.1 Closures

2.4.1.1 Rib Closures

Corrosion resisting steel, closed-cell or solid-cell synthetic rubber, neoprene or polyvinyl chloride pre-molded to match configuration of rib opening. Material for closures must not absorb water.

2.4.1.2 Ridge Closures

Metal-clad foam or metal closure with foam secondary closure matching panel configuration for installation on surface of roof panel between panel ribs at ridge and headwall roof panel flashing conditions and

terminations. Foam material must not absorb water.

2.4.2 Fasteners

Zinc-coated steel, corrosion resisting steel, zinc cast head, or nylon capped steel, type and size specified below or as otherwise approved for the applicable requirements. Design the fastening system to withstand the design loads specified. Exposed fasteners must be gasketed or have gasketed washers on the exterior side of the covering to waterproof the penetration. Washer material must be compatible with the covering; have a minimum diameter of 3/8 inch for structural connections; and gasketed portion of fasteners or washers must be neoprene or other equally durable elastomeric material approximately 1/8 inch thick.

2.4.2.1 Screws

Not smaller than No. 14 diameter if self-tapping type and not smaller than No. 12 diameter if self-drilling and self-tapping.

2.4.2.2 Bolts

Not smaller than 1/4 inch diameter, shouldered or plain shank as required, with proper nuts.

2.4.2.3 Automatic End-Welded Studs

Automatic end-welded studs must be shouldered type with a shank diameter of not smaller than 3/16 inch and cap or nut for holding covering against the shoulder.

2.4.2.4 Rivets

Blind rivets must be stainless steel with 1/8 inch nominal diameter shank. Rivets must be threaded stem type if used for other than the fastening of trim. Rivets with hollow stems must have closed ends.

2.4.3 Sealants

Elastomeric type containing no oil or asphalt. Exposed sealant must cure to a rubberlike consistency. Concealed sealant must be the non-hardening type. Seam sealant must be factory-applied, non-skinning, non-drying, and must conform to the roofing manufacturer's recommendations.

Silicone-based sealants must not be used in contact with finished metal panels and components unless approved otherwise by the Contracting Officer.

2.4.4 GASKETS AND INSULATING COMPOUNDS

Nonabsorptive and suitable for insulating contact points of incompatible materials. Insulating compounds must be nonrunning after drying.

2.5 THERMAL INSULATION

See Section 07 22 00 ROOF DECK AND INSULATION.

2.6 PIPE FLASHING

Premolded, EPDM pipe collar with flexible aluminum ring bonded to base.

a. Products:

- (1) TW Buildex, Dektite.
- (2) The Pate Company.
- (3) Trimco.

2.7 FALL ARREST SYSTEM

Components General Requirements: All system connectors, cables and bolts shall be stainless steel Type 316 or epoxy coated aluminum. Fabricated supports required for additional support may be carbon steel with a corrosion resistant coating. However a faying surface shall be used to prevent galvanic reactions.

a. Materials:

- (1) Base Plates: Aluminum AW-6005A-T6.
- (2) Pass-through lifeline components: 304 Stainless Steel.
- (3) Lifeline Cable: 8mm diameter Stainless Steel (Grade 304) D.
Detachable Cable Shuttles: Stainless Steel (Grade 304).

b. Manufactured Assemblies:

- (1) Tensioner Set: Stainless Steel and Aluminum tensioning unit with turnbuckle and tension indicator.
- (2) Intermediate supports: Intermediate straight and elbow units to attach to CB roof anchors with adapter cap allowing cable to slide freely.
- (3) Lifeline: Continuous 8 mm stainless steel cable as tested by fall protection device manufacturer to permit worker mobility and safety.
- (4) Terminations: Terminations to attach cable to end anchors. Cable clamps are not acceptable.
- (5) Connectors: Detachable cable shuttle providing secure attachment to cable at any location.
- (6) Standard Clamps:
 - (a) Manufactured from 6061-T6 aluminum extrusions conforming to applicable ASTM standard or aluminum castings conforming to AA Aluminum Standards and Data.
 - (b) Clamp model: To match roof panel profile.
 - (c) Set screws: Stainless steel, 18-8 alloy, 3/8 inch diameter, with round nose point, two per clamp. Cup-point setscrews not permitted.
 - (d) Attachment bolts: Stainless steel, 18-8 alloy, 3/8 inch diameter with flat washers.

PART 3 EXECUTION

Do not install building construction materials that show visible evidence of biological growth.

3.1 EXAMINATION

Examine surfaces to receive standing seam metal roofing and flashing. Ensure that surfaces are plumb and true, clean, even, smooth, as dry and free from defects and projections which might affect the installation.

3.2 PROTECTION FROM CONTACT WITH DISSIMILAR MATERIALS

3.2.1 Cementitious Materials

Paint metal surfaces which will be in contact with mortar, concrete, or other masonry materials with one coat of alkali-resistant coating such as heavy-bodied bituminous paint.

3.2.2 Contact with Wood

Where metal will be in contact with wood or other absorbent material subject to wetting, seal joints with sealing compound and apply one coat of heavy-bodied bituminous paint.

3.3 INSTALLATION

Install in accordance with the approved manufacturer's erection instructions, shop drawings, and diagrams. Panels must be in full and firm contact with attachment clips. Where prefinished panels are cut in the field, or where any of the factory applied coverings or coatings are abraded or damaged in handling or installation, they must, after necessary repairs have been made with material of the same color as the weather coating, be approved before being installed. Seal completely openings through panels. Correct defects or errors in the materials. Replace materials which cannot be corrected in an approved manner with nondefective materials. Provide molded closure strips where indicated and where necessary to provide weathertight construction. Use shims as required to ensure attachment clip line is true. Use a spacing gage at each row of panels to ensure that panel width is not stretched or shortened. Provide one layer of air/vapor barrier over roof cover board. See Section 07 27 19.01 SELF-ADHERING AIR BARRIERS FOR AIR/VAPOR BARRIER and Section 07 22 00 ROOF AND DECK INSULATION FOR ROOF COVER BOARD.

3.3.1 Roof Panels

Apply roofing panels with the standing seams parallel to the slope of the roof. Install flashing to assure positive water drainage away from roof penetrations. Locate panel end laps such that fasteners do not engage supports or otherwise restrain the longitudinal thermal movement of panels. Form field-formed seam type system seams in the field with an automatic mechanical seamer approved by the manufacturer. Attach panels to the structure with concealed clips incorporated into panel seams. Clip attachment must allow roof to move independently of the structure, except at fixed points at the mid span of each roof panel.

3.3.2 Insulation Installation

See Section 07 22 00 ROOF AND DECK INSULATION

3.3.2.1 Coverboard

Fasten glass matt board to deck using flush mounted stainless steel fasteners. Install underlayment in accordance with roof panel manufacturers written recommendations in "The NRCA Roofing and Waterproofing Manual". Ensure fasteners meet load requirements.

3.3.2.2 Membrane Vapor/Air Barrier

Install self-adhered membrane wrinkle-free lapped in direction to shed water. Lap sides not less than 6 inches staggered 24 inches between courses. Roll laps with roller. Cover underlayment within seven days.

3.3.2.3 Slip Sheet

Apply slip sheet at time of roof installation where underlayment may adhere to and adversely impact roof panels, and as otherwise recommended by roof panel manufacturer.

3.3.3 Flashings

Provide flashing, related closures and accessories as indicated and as necessary to provide a weathertight installation. Install flashing to ensure positive water drainage away from roof penetrations. Flash and seal the roof at the ridge, eaves and rakes, and projections through the roof. Place closure strips, flashing, and sealing material in an approved manner that will assure complete weathertightness. Details of installation which are not indicated must be in accordance with the SMACNA 1793, panel manufacturer's approved printed instructions and details, or the approved shop drawings. Allow for expansion and contraction of flashing.

3.3.4 Flashing Fasteners

Fastener spacings must be in accordance with the panel manufacturer's recommendations and as necessary to withstand the design loads indicated. Install fasteners in roof valleys as recommended by the manufacturer of the panels. Install fasteners in straight lines within a tolerance of 1/2 inch in the length of a bay. Drive exposed penetrating type fasteners normal to the surface and to a uniform depth to seat gasketed washers properly and drive so as not to damage factory applied coating. Exercise extreme care in drilling pilot holes for fastenings to keep drills perpendicular and centered. Do not drill through sealant tape. After drilling, remove metal filings and burrs from holes prior to installing fasteners and washers. Torque used in applying fasteners must not exceed that recommended by the manufacturer. Remove panels deformed or otherwise damaged by over-torqued fastenings, and provide new panels.

3.3.5 Rib and Ridge Closure/Closure Strips

Set closure/closure strips in joint sealant material and apply sealant to mating surfaces prior to adding panel.

3.3.6 Accessory Installation

3.3.6.1 General

Install accessories with positive anchorage to building and weathertight

mounting and provide for thermal expansion. Coordinate installation with flashings and other components.

- a. Install components required for a complete metal roof panel assembly including trim, copings, ridge closures, seam covers, flashings, sealants, gaskets, fillers, closure strips, and similar items.

3.3.6.2 Flashing and Trim

Comply with performance requirements, manufacturer's written installation instructions, and SMACNA's "Architectural Sheet Metal Manual." Provide concealed fasteners where possible and set units true to line and level as indicated. Install work with laps, joints, and seams that will be permanently watertight and weather resistant. Color to match panels.

- a. Install exposed flashing and trim that is without excessive oil canning, buckling, and tool marks and that is true to line and levels indicated, with exposed edges folded back to form hems. Install sheet metal flashing and trim to fit substrates and to result in waterproof and weather-resistant performance.
- b. Expansion Provisions: Provide for thermal expansion of exposed flashing and trim. Space movement joints at a maximum of 10 feet with no joints allowed within 24 inches of corner or intersection. Where lapped or bayonet-type expansion provisions cannot be used or would not be sufficiently weather resistant and waterproof, form expansion joints of intermeshing hooked flanges, not less than 1 inch deep, filled with mastic sealant (concealed within joints).

3.3.6.3 Pipe Flashing

Form flashing around pipe penetration and metal roof panels. Fasten and seal to metal roof panels as recommended by manufacturer.

3.3.7 Fall Arrest System

a. Examination:

- (1) Examine framing, substrate and panel seaming to verify conditions comply with structural requirements for proper system performance.
- (2) Proceed with installation of roof anchors only after verifying conditions are satisfactory.

b. Preparation:

- (1) Prepare surfaces using the methods recommended by the manufacturer for achieving satisfactory substrate conditions.

c. Installation:

- (1) General: Installation of Anchor Posts to be performed by contractor according to manufacturer's instructions and recommendations. Lifeline components to be installed by a factory trained and certified installer.
- (2) Clamps:
 - (a) Install clamps in accordance with manufacturer's instructions.

(b) Place both set screws on same side of clamp.

(c) Tighten set screws to manufacturer's recommended torque which depends on the manufacturer, type & gauge of the standing seam.

d. Field Quality Control:

(1) Ensure work is inspected by a Qualified or Competent Person prior to use.

e. Adjustments and Final Inspection:

(1) Ensure all manufactured anchors have been installed in accordance with fall protection manufacturers engineering documentation and specifications.

(2) Provide Plan Drawings with any deviations in anchor locations as installed.

f. Operator Training:

(1) Instruct Owner's designated safety engineer in proper use of fall protection safety devices.

(2) Test and adjust system devices as required by manufacturer. Replace damaged or malfunctioning items.

3.4 PROTECTION OF APPLIED ROOFING

Do not permit storing, walking, wheeling, and trucking directly on applied roofing materials. Provide temporary walkways, runways, and platforms of smooth clean boards or planks as necessary to avoid damage to applied roofing materials, and to distribute weight to conform to indicated live load limits of roof construction.

3.5 CLEANING

Clean exposed sheet metal work at completion of installation. Remove metal shavings, filings, nails, bolts, and wires from roofs. Remove grease and oil films, excess sealants, handling marks, contamination from steel wool, fittings and drilling debris and scrub the work clean. Exposed metal surfaces must be free of dents, creases, waves, scratch marks, solder or weld marks and damage to the finish coating.

3.6 MANUFACTURER'S FIELD INSPECTION

Manufacturer's technical representative must visit the site as necessary during the installation process to assure panels, flashings, and other components are being installed in a satisfactory manner. Manufacturer's technical representative must perform a field inspection during the first 20 squares of roof panel installation and at substantial completion prior to issuance of warranty, as a minimum, and as otherwise requested by the Contracting Officer. Additional inspections must not exceed one for 100 squares of total roof area with the exception that follow-up inspections of previously noted deficiencies or application errors must be performed as requested by the Contracting Officer. Each inspection visit must include a review of the entire installation to date. After each inspection, submit a report, signed by the manufacturer's technical

representative, to the Contracting Officer noting the overall quality of work, deficiencies and any other concerns, and recommended corrective actions in detail. Notify Contracting Officer a minimum of 2 working days prior to site visit by manufacturer's technical representative.

3.7 COMPLETED WORK

Completed work must be plumb and true without oil canning, dents, ripples, abrasion, rust, staining, or other damage detrimental to the performance or aesthetics of the completed roof assembly.

3.8 INFORMATION CARD

For each roof, provide a typewritten card, laminated in plastic and framed for interior display or a photoengraved 0.032 inch thick aluminum card for exterior display. Card to be 8 1/2 by 11 inches minimum and contain the information listed on Form 1 at end of this section. Install card near point of access to roof, or where indicated.

3.9 FORM ONE

FORM 1 - PREFORMED STEEL STANDING SEAM ROOFING SYSTEM COMPONENTS

1. Contract Number:
2. Building Number & Location:
3. Specification Number:
4. Deck/Substrate Type:
5. Slopes of Deck/Roof Structure:
6. Insulation Type & Thickness:
7. Insulation Manufacturer:
8. Vapor Retarder: ()Yes ()No
9. Vapor Retarder Type:
10. Preformed Steel Standing Seam Roofing Description:
 - a. Manufacturer (Name, Address, & Phone No.):
 - b. Product Name: c. Width: d. Gage:
 - e. Base Metal: f. Method of Attachment:
11. Repair of Color Coating:
 - a. Coating Manufacturer (Name, Address & Phone No.):
 - b. Product Name:
 - c. Surface Preparation:
 - d. Recoating Formula:
 - e. Application Method:
12. Statement of Compliance or Exception: _____

13. Date Roof Completed:
14. Warranty Period: From _____ To _____
15. Roofing Contractor (Name & Address):
16. Prime Contractor (Name & Address):

Contractor's Signature _____ Date:

Inspector's Signature _____ Date:

-- End of Section --

SECTION 07 92 00

JOINT SEALANTS

08/23

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM C509	(2006; R 2021) Standard Specification for Elastomeric Cellular Preformed Gasket and Sealing Material
ASTM C734	(2015; R 2019) Standard Test Method for Low-Temperature Flexibility of Latex Sealants After Artificial Weathering
ASTM C919	(2022) Standard Practice for Use of Sealants in Acoustical Applications
ASTM C920	(2018) Standard Specification for Elastomeric Joint Sealants
ASTM C1193	(2016) Standard Guide for Use of Joint Sealants
ASTM C1311	(2022) Standard Specification for Solvent Release Sealants
ASTM C1521	(2019; R 2020) Standard Practice for Evaluating Adhesion of Installed Weatherproofing Sealant Joints
ASTM D217	(2021a) Standard Test Methods for Cone Penetration of Lubricating Grease
ASTM D1056	(2020) Standard Specification for Flexible Cellular Materials - Sponge or Expanded Rubber
ASTM D1667	(2022) Standard Specification for Flexible Cellular Materials - Poly (Vinyl Chloride) Foam (Closed-Cell)
ASTM D2452	(2015; R 2019) Standard Test Method for Extrudability of Oil- and Resin-Base Caulking Compounds
ASTM D2453	(2015; R 2020; E 2020) Standard Test Method for Shrinkage and Tenacity of Oil- and Resin-Base Caulking Compounds

ASTM E84 (2023) Standard Test Method for Surface
Burning Characteristics of Building
Materials

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350 (2017; Version 1.2) Standard Method for
the Testing and Evaluation of Volatile
Organic Chemical Emissions from Indoor
Sources using Environmental Chambers

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS SCS Global Services (SCS) Indoor Advantage

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168 (2017) Adhesive and Sealant Applications

UNDERWRITERS LABORATORIES (UL)

UL 2818 (2022) GREENGUARD Certification Program
For Chemical Emissions For Building
Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Sealants; G

Primers; G

Bond Breakers; G

Backstops; G

Caulking; G

Cleaning Solvents; G

SD-06 Test Reports

Field Adhesion; G

SD-07 Certificates

Indoor Air Quality For Interior Sealants; S

Indoor Air Quality For Interior Floor Joint Sealants; S

Indoor Air Quality For Interior Acoustical Sealants; S

Indoor Air Quality For Interior Caulking; S

1.3 PRODUCT DATA

Include storage requirements, shelf life, curing time, instructions for mixing and application, and accessories. Provide manufacturer's Safety Data Sheets (SDS) for each solvent, primer and sealant material proposed.

1.4 CERTIFICATIONS

1.4.1 Indoor Air Quality Certifications

Submit required indoor air quality certifications in one submittal package.

1.4.1.1 Adhesives and Sealants

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party program that products meet the requirements of this Section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited herein.

1.5 ENVIRONMENTAL CONDITIONS

Apply sealant when the ambient temperature is between 40 and 90 degrees F.

1.6 DELIVERY AND STORAGE

Deliver materials to the jobsite in unopened manufacturers' sealed shipping containers, with brand name, date of manufacture, and material designation clearly marked thereon. Label elastomeric sealant containers to identify type, class, grade, and use. Handle and store materials in accordance with manufacturer's printed instructions. Prevent exposure to foreign materials or subjection to sustained temperatures exceeding 90 degrees F or lower than 0 degrees F. Keep materials and containers closed and separated from absorptive materials such as wood and insulation.

1.7 QUALITY ASSURANCE

1.7.1 Compatibility with Substrate

Verify that each sealant is compatible for use with each joint substrate in accordance with sealant manufacturer's printed recommendations for each application.

1.7.2 Joint Tolerance

Provide joint tolerances in accordance with manufacturer's printed instructions.

1.7.3 Mock-Up

Provide a mock-up of each type of sealant using materials, colors, and techniques approved for use on the project. Approved mock-ups may be incorporated into the Work.

1.7.4 Adhesion

Provide in accordance with ASTM C1193 or ASTM C1521.

PART 2 PRODUCTS

2.1 SEALANTS

Provide sealant products that have been tested, found suitable, and documented as such by the manufacturer for the particular substrates to which they will be applied.

In areas with ambient temperatures that exceed 110 degrees F, do not use polybutene, bituminous, acrylic-latex, polyvinyl acetate latex sealants, polychloroprene (neoprene), polyvinyl chloride (PVC), and polyurethane foams, and neoprene, PVC, and styrene butadiene rubber extruded seals and closure strips due to these materials having maximum recommended surface temperature ranges from 130 to 180 degrees F.

2.1.1 Interior Sealants

Provide ASTM C920, Type S or M, Grade NS, Class 12.5, Use NT. Provide sealant products used on the interior of the building (defined as inside of the weatherproofing system) meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide certification or validation of indoor air quality for interior sealants. Location(s) and color(s) of sealant for the following (Note, color "as selected" refers to manufacturer's full range of color options):

LOCATION	COLOR
a. Small voids between walls or partitions and adjacent lockers, casework, shelving, door frames, built-in or surface mounted equipment and fixtures, and similar items.	Color to match adjacent surface
b. Perimeter of frames at doors, windows, and access panels which adjoin exposed interior concrete and masonry surfaces.	Color to match adjacent surface
c. Joints of interior masonry walls and partitions which adjoin columns, pilasters, concrete walls, and exterior walls unless otherwise detailed.	Color to match adjacent surface
d. Joints between edge members for acoustical tile and adjoining vertical surfaces.	Color to match adjacent surface
e. Interior locations, not otherwise indicated or specified, where small voids exist between materials specified to be painted.	Color to match adjacent surface

LOCATION	COLOR
f. Joints between bathtubs and ceramic tile; joints between shower receptors and ceramic tile; joints formed where non-planar tile surfaces meet.	Color to match adjacent surface
g. Joints formed between tile floors and tile base cove; joints between tile and dissimilar materials; joints occurring where substrates change.	Color to match adjacent surface
h. Behind escutcheon plates at valve pipe penetrations and showerheads in showers.	Color to match adjacent surface

2.1.2 Exterior Sealants

For joints in vertical surfaces, provide ASTM C920, Type S or M, Grade NS, Class 25, Use NT. For joints in horizontal surfaces, provide ASTM C920, Type S or M, Grade P, Class 25, Use T. Provide location(s) and color(s) of sealant as follows (Note, color "as selected" refers to manufacturer's full range of color options):

LOCATION	COLOR
a. Joints and recesses formed where frames and subsills of windows, doors, louvers, and vents adjoin masonry, concrete, or metal frames. Use sealant at both exterior and interior surfaces of exterior wall penetrations.	Match adjacent surface color
c. Masonry joints where shelf angles occur.	Match wall surface color
e. Expansion and control joints.	Match adjacent surface color
f. Interior face of expansion joints in exterior concrete or masonry walls where metal expansion joint covers are not required.	Match adjacent surface color
g. Voids where items pass through exterior walls.	Match adjacent surface color

LOCATION	COLOR
h. Metal reglets, where flashing is inserted into masonry joints, and where flashing is penetrated by coping dowels.	Match adjacent surface color
i. Metal-to-metal joints where sealant is indicated or specified.	Match adjacent surface color
j. Joints between ends of gravel stops, fascia, copings, and adjacent walls.	Match adjacent surface color

2.1.3 Floor Joint Sealants

ASTM C920, Type S or M, Grade P, Class 25, Use T. Provide sealant products used on the interior of the building (defined as inside of the weatherproofing system) meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide certification or validation of indoor air quality for interior floor joint sealants. Provide location(s) and color(s) of sealant as follows (Note, color "as selected" refers to manufacturer's full range of color options):

LOCATION	COLOR
a. Seats of metal thresholds for exterior doors.	Gray
b. Control and expansion joints in floors, slabs, ceramic tile, and walkways.	Match adjacent surface color

2.1.4 Acoustical Sealants

Rubber or polymer based acoustical sealant in accordance with ASTM C919 to have a flame spread of 25 or less and a smoke developed rating of 50 or less when tested in accordance with ASTM E84. Provide non-staining acoustical sealant with a consistency of 250 to 310 when tested in accordance with ASTM D217. Acoustical sealant must remain flexible and adhesive after 500 hours of accelerated weathering as specified in ASTM C734. Provide sealant products used on the interior of the building (defined as inside of the weatherproofing system) meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide certification or validation of indoor air quality for interior acoustical sealants.

2.1.5 Preformed Sealants

Provide preformed sealants of polybutylene or isoprene-butylene based pressure sensitive weather resistant tape or bead sealants capable of sealing out moisture, air and dust when installed as recommended by the

manufacturer. At temperatures from minus 30 to plus 160 degrees F, sealants must be non-bleeding and have no loss of adhesion.

2.2 PRIMERS

Non-staining, quick drying type and consistency as recommended by the sealant manufacturer for the particular application. Provide primers for interior applications that meet the indoor air quality requirements of the paragraph INTERIOR SEALANTS above.

2.3 BOND BREAKERS

Type and consistency as recommended by the sealant manufacturer to prevent adhesion of the sealant to the backing or to the bottom of the joint. Provide bond breakers for interior applications that meet the indoor air quality requirements of the paragraph INTERIOR SEALANTS above.

2.4 BACKSTOPS

Provide glass fiber roving, neoprene, butyl, polyurethane, or polyethylene foams free from oil or other staining elements as recommended by sealant manufacturer. Provide 25 to 33 percent oversized backing for closed cell and 40 to 50 percent oversized backing for open cell material, unless otherwise indicated. Provide backstop material that is compatible with sealant. Do not use oakum or other types of absorptive materials as backstops.

2.4.1 PVC

Provide in accordance with ASTM D1667, Grade VO 12, open-cell foam, round cross section for polyvinyl chloride (PVC) backing.

2.4.2 Synthetic Rubber

Provide in accordance with ASTM C509, Option I, Type II preformed rods or tubes for synthetic rubber backing.

2.4.3 Neoprene

Provide in accordance with ASTM D1056, closed cell expanded neoprene cord Type 2, Class C, Grade 2C2 for neoprene backing.

2.4.4 Butyl Rubber Based

Provide in accordance with ASTM C1311, from a single component, with solvent release. color as selected from manufacturer's full range of color choices .

2.4.5 Silicone Rubber Base

Provide in accordance with ASTM C920, from a single component, with solvent release, Non-sag, Type S, Grade NS, Class 100/50. Color as selected from manufacturer's full range of color choices .

2.5 CAULKING

For interior use and only where there is little or no anticipated joint movement. Provide in accordance with ASTM D2452 and ASTM D2453, for oil and resin-based caulking. Provide products used on the interior of the

building (defined as inside of the weatherproofing system) meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide certification or validation of indoor air quality for interior caulking.

2.6 CLEANING SOLVENTS

Provide type(s) recommended by the sealant manufacturer and in accordance with environmental requirements herein. Protect adjacent aluminum and bronze surfaces from solvents. Provide solvents for interior applications that meet the indoor air quality requirements of the paragraph INTERIOR SEALANTS above.

PART 3 EXECUTION

3.1 FIELD QUALITY CONTROL

Perform a field adhesion test in accordance with manufacturer's instructions and ASTM C1193, Method A or ASTM C1521, Method A, Tail Procedure. Remove sealants that fail adhesion testing; clean substrates, reapply sealants, and re-test. Test sealants adjacent to failed sealants. Submit field adhesion test report indicating tests, locations, dates, results, and remedial actions taken.

3.2 SURFACE PREPARATION

Prepare surfaces according to manufacturer's printed installation instructions. Clean surfaces from dirt, frost, moisture, grease, oil, wax, lacquer, paint, or other foreign matter that would destroy or impair adhesion. Remove oil and grease with solvent; thoroughly remove solvents prior to sealant installation. Wipe surfaces dry with clean cloths. When resealing an existing joint, remove existing caulk or sealant prior to applying new sealant. For surface types not listed below, provide in accordance with sealant manufacturer's printed instructions for each specific surface.

3.2.1 Steel Surfaces

Remove loose mill scale by sandblasting or, if sandblasting is impractical or would damage finished work, scraping and wire brushing. Remove protective coatings by sandblasting or using a residue free solvent. Remove resulting debris and solvent residue prior to sealant installation.

3.2.2 Aluminum or Bronze Surfaces

Remove temporary protective coatings from surfaces that will be in contact with sealant. When masking tape is used as a protective coating, remove tape and residual adhesive prior to sealant application. For removing protective coatings and final cleaning, use non-staining solvents recommended by the manufacturer of the item(s) containing aluminum or bronze surfaces.

3.2.3 Concrete and Masonry Surfaces

Where surfaces have been treated with curing compounds, oil, or other such materials, remove materials by sandblasting or wire brushing. Remove laitance, efflorescence and loose mortar from the joint cavity. Remove resulting debris prior to sealant installation.

3.2.4 Wood Surfaces

Ensure wood surfaces that will be in contact with sealants are free of splinters, sawdust and other loose particles.

3.3 SEALANT PREPARATION

Do not add liquids, solvents, or powders to sealants. Mix multicomponent elastomeric sealants in accordance with manufacturer's printed instructions.

3.4 APPLICATION

3.4.1 Joint Width-To-Depth Ratios

Acceptable Ratios:

JOINT WIDTH	JOINT DEPTH	
	Minimum	Maximum
For metal, glass, or other nonporous surfaces:		
1/4 inch (minimum)	1/4 inch	1/4 inch
over 1/4 inch	1/2 of width	Equal to width
For wood, concrete, masonry, stone:		
1/4 inch (minimum)	1/4 inch	1/4 inch
over 1/4 inch to 1/2 inch	1/4 inch	Equal to width
over 1/2 inch to 1 inch	1/2 inch	5/8 inch
Over 1 inch	prohibited	

Unacceptable Ratios: Where joints of acceptable width-to-depth ratios have not been provided, clean out joints to acceptable depths and grind or cut to acceptable widths without damage to the adjoining work. Grinding is prohibited at metal surfaces.

3.4.2 Unacceptable Sealant Use

Do not install sealants in lieu of other required building enclosure weatherproofing components such as flashing, drainage components, and joint closure accessories, or to close gaps between walls, floors, roofs, windows, and doors, that exceed acceptable installation tolerances. Remove sealants that have been used in an unacceptable manner and correct building enclosure deficiencies to comply with contract documents requirements.

3.4.3 Masking Tape

Place masking tape on the finished surface on one or both sides of joint cavities to protect adjacent finished surfaces from primer or sealant

smears. Remove masking tape within 10 minutes of joint filling and tooling.

3.4.4 Backstops

Provide backstops dry and free of tears or holes. Tightly pack the back or bottom of joint cavities with backstop material to provide joints in specified depths. Provide backstops where indicated and where backstops are not indicated but joint cavities exceed the acceptable maximum depths specified in JOINT WIDTH-TO-DEPTH RATIOS Table.

3.4.5 Primer

Clean out loose particles from joints immediately prior to application of. Apply primer to joints in concrete masonry units, wood, and other porous surfaces in accordance with sealant manufacturer's printed instructions. Do not apply primer to exposed finished surfaces.

3.4.6 Bond Breaker

Provide bond breakers to surfaces not intended to bond in accordance with, sealant manufacturer's printed instructions for each type of surface and sealant combination specified.

3.4.7 Sealants

Provide sealants compatible with the material(s) to which they are applied. Do not use a sealant that has exceeded its shelf life or has jelled and cannot be discharged in a continuous flow from the sealant gun. Apply sealants in accordance with the manufacturer's printed instructions with a gun having a nozzle that fits the joint width. Work sealant into joints so as to fill the joints solidly without air pockets. Tool sealant after application to ensure adhesion. Apply sealant uniformly smooth and free of wrinkles. Upon completion of sealant application, roughen partially filled or unfilled joints, apply additional sealant, and tool smooth as specified. Apply sealer over sealants in accordance with the sealant manufacturer's printed instructions.

3.5 PROTECTION AND CLEANING

3.5.1 Protection

Protect areas adjacent to joints from sealant smears. Masking tape may be used for this purpose if removed 5 to 10 minutes after the joint is filled and no residual tape marks remain.

3.5.2 Final Cleaning

Upon completion of sealant application, remove remaining smears and stains and leave the work in a clean and neat condition.

- a. Masonry and Other Porous Surfaces: Immediately remove fresh sealant that has been smeared on adjacent masonry, rub clean with a solvent, and remove solvent residue, in accordance with sealant manufacturer's printed instructions. Allow excess sealant to cure for 24 hours then

remove by wire brushing or sanding. Remove resulting debris.

- b. Metal and Other Non-Porous Surfaces: Remove excess sealant with a solvent moistened cloth. Remove solvent residue in accordance with solvent manufacturer's printed instructions.

-- End of Section --

This page left blank.

SECTION 08 11 13

STEEL DOORS AND FRAMES

08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN WELDING SOCIETY (AWS)

AWS D1.1/D1.1M (2020; Errata 1 2021) Structural Welding Code - Steel

ASTM INTERNATIONAL (ASTM)

ASTM A653/A653M (2023) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process

ASTM A879/A879M (2012; R 2017) Standard Specification for Steel Sheet, zinc Coated by the Electrolytic Process for Applications Requiring Designation of the Coating Mass on Each Surface

ASTM A924/A924M (2022a) Standard Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process

ASTM C578 (2022) Standard Specification for Rigid, Cellular Polystyrene Thermal Insulation

ASTM C591 (2022) Standard Specification for Unfaced Preformed Rigid Cellular Polyisocyanurate Thermal Insulation

ASTM C612 (2014; R 2019) Standard Specification for Mineral Fiber Block and Board Thermal Insulation

ASTM D2863 (2019) Standard Test Method for Measuring the Minimum Oxygen Concentration to Support Candle-Like Combustion of Plastics (Oxygen Index)

BUILDERS HARDWARE MANUFACTURERS ASSOCIATION (BHMA)

ANSI/BHMA A156.115 (2016) Hardware Preparation in Steel Doors and Steel Frames

STEEL DOOR INSTITUTE (SDI/DOOR)

SDI/DOOR 111	(2009) Recommended Details for Standard Steel Doors, Frames, and Accessories and Related Components
SDI/DOOR 113	(2013; R2018) Standard Practice for Determining the Steady-State Thermal Transmittance of Steel Door and Frame Assemblies
SDI/DOOR A250.4	(2018) Test Procedure and Acceptance Criteria for Physical Endurance for Steel Doors, Frames and Frame Anchors
SDI/DOOR A250.6	(2015) Recommended Practice for Hardware Reinforcing on Standard Steel Doors and Frames
SDI/DOOR A250.8	(2017) Specifications for Standard Steel Doors and Frames
SDI/DOOR A250.11	(2012) Recommended Erection Instructions for Steel Frames

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

- Doors; G
- Frames; G
- Accessories
- Schedule of Doors; G
- Schedule of Frames; G

SD-03 Product Data

- Doors; G
- Recycled Content for Steel Door Product; S
- Frames; G
- Recycled Content for Steel Frame Product; S
- Accessories

1.3 DELIVERY, STORAGE, AND HANDLING

Deliver doors, frames, and accessories undamaged and with protective wrappings or packaging. Provide temporary steel spreaders securely fastened to the bottom of each welded frame. Store doors and frames on platforms under cover in clean, dry, ventilated, and accessible locations, with 1/4 inch airspace between doors. Remove damp or wet packaging immediately and wipe affected surfaces dry. Replace damaged materials with new.

PART 2 PRODUCTS

2.1 STANDARD STEEL DOORS

SDI/DOOR A250.8, except as specified otherwise. Prepare doors to receive door hardware as specified in Section 08 71 00 DOOR HARDWARE. Undercut where indicated. Provide exterior doors with top edge closed flush and sealed to prevent water intrusion. Provide doors at 1-3/4 inch thick, unless otherwise indicated. Provide door material that uses a minimum of 25 percent recycled content. Provide data indicating percentage of recycled content for steel door product. Provide exterior glazing in accordance with ASMT E1300 and ASTM E1996. Exterior doors and frames must be tested in accordance with ASTM E330/E330M based on the wind pressures shown on the structural drawings and AAMA/WDMA/CSA 101/IS 2/A440. .

2.1.1 Classification - Level, Performance, Model

2.1.1.1 Heavy Duty Doors

SDI/DOOR A250.8, Level 2, physical performance Level B, Model 2, with core construction as required by the manufacturer for interior doors, of size(s) and design(s) indicated. Where vertical stiffener cores are required, the space between the stiffeners must be filled with board insulation.

2.1.1.2 Maximum Duty Doors

SDI/DOOR A250.8, Level 4, physical performance Level A, Model 2 with core construction as required by the manufacturer and for indicated exterior doors, of size(s) and design(s) indicated. Where vertical stiffener cores are required, the space between the stiffeners must be filled with board insulation.

2.2 INSULATED STEEL DOOR SYSTEMS

Provide insulated steel doors and frames in accordance with SDI/DOOR 113 at entrances and where indicated. Meet energy requirements including Solar Heat Gain Coefficient (SHGC) and U-factor. Provide insulated steel doors with a core of polyurethane foam; face sheets, edges, and frames of galvanized steel not lighter than 18 gage, 16 gage, and 16 gage respectively; magnetic weatherstripping; nonremovable-pin hinges; thermal-break aluminum threshold; and vinyl door bottom. Provide to doors and frames a phosphate treatment, rust-inhibitive primer, and baked acrylic enamel finish. Test doors in accordance with SDI/DOOR A250.4 and meet the requirements for Level C. Prepare doors to receive specified hardware. Provide doors 1-3/4 inch thick.

2.3 ACCESSORIES

2.3.1 Astragals

For pairs of exterior steel doors which will not have aluminum astragals or removable mullions, as specified in Section 08 71 00 DOOR HARDWARE provide overlapping steel astragals with the doors.

2.3.2 Moldings

Provide moldings around glass of interior and exterior doors and louvers of interior doors. Provide nonremovable moldings on outside of exterior doors and on corridor side of interior doors. Other moldings may be stationary or removable. Secure inside moldings to stationary moldings, or provide snap-on moldings.

2.4 INSULATION CORES

Provide insulating cores at all exterior doors, and provide an apparent U-factor of .48 in accordance with SDI/DOOR 113 and conforming to:

- a. Rigid Cellular Polyisocyanurate Foam: ASTM C591, Type I or II, foamed-in-place or in board form, with oxygen index of not less than 22 percent when tested in accordance with ASTM D2863; or
- b. Rigid Polystyrene Foam Board: ASTM C578, Type I or II; or
- c. Mineral board: ASTM C612, Type I.

2.5 STANDARD STEEL FRAMES

SDI/DOOR A250.8, Level 4, except as otherwise specified. Form frames to sizes and shapes indicated, with welded corners. Provide steel frames for doors, unless otherwise indicated. Provide frame product that uses a minimum of 25 percent recycled content. Provide data indicating percentage of recycled content for steel frame product.

2.5.1 Welded Frames

Continuously weld frame faces at corner joints. Mechanically interlock or continuously weld stops and rabbets. Grind welds smooth.

Weld frames in accordance with the recommended practice of the Structural Welding Code Sections 1 through 6, AWS D1.1/D1.1M and in accordance with the practice specified by the producer of the metal being welded.

2.5.2 Stops and Beads

Provide form and loose stops and beads from 20 gage steel. Provide for glazed and other openings in standard steel frames. Secure beads to frames with oval-head, countersunk Phillips self-tapping sheet metal screws or concealed clips and fasteners. Space fasteners approximately 12 to 16 inch on center. Miter molded shapes at corners. Butt or miter square or rectangular beads at corners.

2.5.3 Terminated Stops

Where indicated, terminate interior door frame stops 6 inch above floor. Do not terminate stops of frames for soundproof doors.

2.5.4 Cased Openings

Fabricate frames for cased openings of same material, gage, and assembly as specified for metal door frames, except omit door stops and preparation for hardware.

2.5.5 Anchors

Provide anchors to secure the frame to adjoining construction. Provide steel anchors, zinc-coated not lighter than 18 gage.

2.5.5.1 Wall Anchors

Provide at least three anchors for each jamb. For frames which are more than 7.5 feet in height, provide one additional anchor for each jamb for each additional 2.5 feet or fraction thereof.

- a. Masonry: Provide anchors of corrugated or perforated steel straps or 3/16 inch diameter steel wire, adjustable or T-shaped;
- b. Stud partitions: Weld or otherwise securely fasten anchors to backs of frames. Design anchors to be fastened to closed steel studs with sheet metal screws, and to open steel studs by wiring or welding;
- c. Completed openings: Secure frames to previously placed concrete or masonry with expansion bolts in accordance with SDI/DOOR 111

2.5.5.2 Floor Anchors

Provide floor anchors drilled for 3/8 inch anchor bolts at bottom of each jamb member. Where floor fill occurs, terminate bottom of frames at the indicated finished floor levels and support by adjustable extension clips resting on and anchored to the structural slabs.

2.6 EXTERIOR FRAMES

Provide thermal insulation in all exterior frames. Provide frames of a minimum Level 4, with frames of a minimum thickness of 0.067 inch, 14 gage.

2.7 HARDWARE PREPARATION

Drill and tap doors and frames to receive finish hardware. Prepare doors and frames for hardware in accordance with the applicable requirements of SDI/DOOR A250.8 and SDI/DOOR A250.6. For additional requirements refer to ANSI/BHMA A156.115. Drill and tap for surface-applied hardware at the project site. Build additional reinforcing for surface-applied hardware into the door at the factory. Punch door frames, with the exception of frames that will have weatherstripping gasketing, to receive a minimum of two rubber or vinyl door silencers on lock side of single doors and one silencer for each leaf at heads of double doors. Set lock strikes out to provide clearance for silencers.

2.8 FINISHES

2.8.1 Hot-Dip Zinc-Coated and Factory-Primed Finish

Fabricate exterior and interior doors and frames from hot dipped zinc coated steel, alloyed type, that complies with ASTM A924/A924M and ASTM A653/A653M. The coating weight must meet or exceed the minimum requirements for coatings having 0.4 ounces per square foot, total both sides, i.e., A40. Repair damaged zinc-coated surfaces by the application of zinc dust paint. Thoroughly clean and chemically treat to insure maximum paint adhesion. Factory prime as specified in SDI/DOOR A250.8.

2.8.2 Electrolytic Zinc-Coated Anchors and Accessories

Provide electrolytically deposited zinc-coated steel in accordance with ASTM A879/A879M, Commercial Quality, Coating Class A. Phosphate treat and factory prime zinc-coated surfaces as specified in SDI/DOOR A250.8.

2.9 FABRICATION AND WORKMANSHIP

Provide finished doors and frames that are strong and rigid, neat in appearance, and free from defects, waves, scratches, cuts, dents, ridges, holes, warp, and buckle. Provide molded members that are clean cut, straight, and true, with joints coped or mitered, well formed, and in true alignment. Dress exposed welded and soldered joints smooth. Design door frame sections for use with the wall construction indicated. Corner joints must be well formed and in true alignment. Conceal fastenings where practicable. On wraparound frames for masonry partitions, provide a throat opening 1/8 inch larger than the actual masonry thickness. Frames in exposed masonry walls or partitions to allow sufficient space between the inside back of trim and masonry to receive caulking compound.

2.10 PROVISIONS FOR GLAZING

Materials are specified in Section 08 81 00, GLAZING.

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 Frames

Set frames in accordance with SDI/DOOR A250.11. Plumb, align, and brace securely until permanent anchors are set. Anchor bottoms of frames with expansion bolts or powder-actuated fasteners. Build in or secure wall anchors to adjoining construction.

3.1.2 Doors

Hang doors in accordance with clearances specified in SDI/DOOR A250.8. After erection and glazing, clean and adjust hardware.

3.2 PROTECTION

Protect doors and frames from damage. Repair damaged doors and frames prior to completion and acceptance of the project or replace with new, as directed. Wire brush rusted frames until rust is removed. Clean thoroughly. Apply an all-over coat of rust-inhibitive paint of the same

type used for shop coat.

3.3 CLEANING

Upon completion, clean exposed surfaces of doors and frames thoroughly.
Remove mastic smears and other unsightly marks.

-- End of Section --

This page left blank.

SECTION 08 14 00

WOOD DOORS

08/16, CHG 1: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by the basic designation only.

AMERICAN FOREST FOUNDATION (AFF)

ATFS STANDARDS (2015) American Tree Farm System Standards of Sustainability 2015-2020

CALIFORNIA AIR RESOURCES BOARD (CARB)

CARB 93120 (2007) Airborne Toxic Control Measure (ATCM) to Reduce Formaldehyde Emissions from Composite Wood Products

CSA GROUP (CSA)

CSA Z809-08 (R2013) Sustainable Forest Management

FOREST STEWARDSHIP COUNCIL (FSC)

FSC STD 01 001 (2015) Principles and Criteria for Forest Stewardship

PROGRAMME FOR ENDORSEMENT OF FOREST CERTIFICATION (PEFC)

PEFC ST 2002:2013 (2015) PEFC International Standard Chain of Custody of Forest Based Products Requirements

SUSTAINABLE FOREST INITIATIVE (SFI)

SFI 2015-2019 (2015) Standards, Rules for Label Use, Procedures and Guidance

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

40 CFR 770 Formaldehyde Standards for Composite Wood Products

WINDOW AND DOOR MANUFACTURERS ASSOCIATION (WDMA)

ANSI/WDMA I.S.1A (2013) Interior Architectural Wood Flush Doors

ANSI/WDMA I.S.6A (2013) Interior Architectural Stile and Rail Doors

WOODWORK INSTITUTE (WI)

NAAWS 3.1 (2017; 2018 Errata Edition) North American
Architectural Woodwork Standards

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Doors; G

Submit drawings or catalog data showing each type of door unit ; include descriptive data of head and jamb weatherstripping with installation instructions. Indicate within drawings and data the door types and construction, sizes, thickness, methods of assembly, and glazing.

SD-03 Product Data

Doors; G

Recycled Content for Door Cores; S

Accessories

Water-resistant Sealer

Sample Warranty

Fire Resistance Rating; G

SD-04 Samples

Doors

Prior to the delivery of wood doors, submit a sample section of each type of door which shows the stile, rail, veneer, finish, and core construction.

Door Finish Colors; G

Submit a minimum of three color selection samples , minimum 3 by 5 inches in size representing wood stain for selection by the Contracting Officer.

SD-06 Test Reports

Cycle-Slam

Hinge Loading Resistance

Submit cycle-slam test report for doors tested in accordance with

ANSI/WDMA I.S.1A, and hinge loading resistance test report for doors tested in accordance with ANSI/WDMA I.S.6A.

SD-07 Certificates

Certificates of Grade

Certified Sustainably Harvested Stile and Rail Wood Doors; S

Certified Sustainably Harvested Flush Wood Doors; S

Indoor Air Quality for Particleboard and Agrifiber Door Cores: S

SD-11 Closeout Submittals

Warranty

1.3 CERTIFICATIONS

1.3.1 Certified Wood Grades

Provide certificates of grade from the grading agency.

1.3.2 Certified Sustainably Harvested Wood

Provide wood certified as sustainably harvested by FSC STD 01 001, ATFS STANDARDS, CSA Z809-08, SFI 2015-2019, or other third party program certified by PEFC ST 2002:2013. Provide a letter of Certification of Sustainably Harvested Wood signed by the wood supplier. Identify certifying organization and their third party program name and indicate compliance with chain-of-custody program requirements. Submit sustainable wood certification data; identify each certified product on a line item basis. Submit copies of invoices bearing certification numbers.

1.3.3 Indoor Air Quality Certification

1.3.3.1 Composite Wood, Wood Structural Panel and Agrifiber Products

For purposes of this specification, composite wood and agrifiber products include particleboard, medium density fiberboard (MDF), wheatboard, strawboard, panel substrates, and door cores. Provide products certified to meet requirements of both 40 CFR 770 and CARB 93120. Provide current product certification documentation from certification body.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver doors to the site in an undamaged condition and protect against damage and dampness. Stack doors flat under cover. Support on blocking, a minimum of 4 inch thick, located at each end and at the midpoint of the door. Store doors in a well-ventilated building so that they will not be exposed to excessive moisture, heat, dryness, direct sunlight, or extreme changes of temperature and humidity. Do not store in a building under construction until concrete, masonry work, and plaster are dry. Replace defective or damaged doors with new ones.

1.5 WARRANTY

Warrant doors free of defects as set forth in the door manufacturer's standard door warranty.

PART 2 PRODUCTS

2.1 DOORS

Provide doors of the types, sizes, and designs indicated free of urea-formaldehyde resins.

2.1.1 Flush Doors

Conform to ANSI/WDMA I.S.1A for flush doors. Hardwood stile edge bands of doors receives a natural finish, compatible with face veneer. Provide mill option for stile edge of doors scheduled to be painted. No visible finger joints will be accepted in stile edge bands. When used, locate finger-joints under hardware. Provide certified sustainably harvested flush wood doors.

2.1.1.1 Interior Flush Doors

Provide staved lumber, particleboard, or agrifiber core, Type II flush doors conforming to ANSI/WDMA I.S.1A with faces of select premium white birch. Hardwood veneers must be plain sliced book matched. Door cores must have a minimum recycled content of 45 percent. Provide data identifying percentage of recycled content for door cores. Products must contain no added urea-formaldehyde resins. Provide certification of indoor air quality for particleboard and agrifiber door cores.

2.2 ACCESSORIES

2.2.1 Door Light Openings

Provide glazed openings with the manufacturer's standard wood moldings. Provide moldings for doors to receive natural finish of the same wood species and color as the wood face veneers. Flush type moldings for flush doors.

2.2.2 Additional Hardware Reinforcement

Provide the minimum lock blocks to secure the specified hardware. The measurement of top, bottom, and intermediate rail blocks are a minimum 125 mm 5 inch by full core width. Comply with the manufacturer's labeling requirements for reinforcement blocking, but not mineral material similar to the core.

2.3 FABRICATION

2.3.1 Marking

Stamp each door with a brand, stamp, or other identifying mark indicating quality and construction of the door.

2.3.2 Quality and Construction

Identify the standard on which the construction of the door was based, identify the standard under which preservative treatment was made, and identify doors having a Type I glue bond.

2.3.3 Preservative Treatment

Treat doors scheduled for restrooms, janitor closets and other possible wet locations including exterior doors with a water-repellent preservative treatment and so marketed at the manufacturer's plant.

2.3.4 Adhesives and Bonds

ANSI/WDMA I.S.1A. Use Type I bond for doors in high humidity areas and Type II bond for other interior doors. Provide a nonstaining adhesive on doors with a natural finish.

2.3.5 Prefitting

Provide factory finished and factory prefitted doors for the specified hardware, door frame and door-swing indicated. Machine and size doors at the factory by the door manufacturer in accordance with the standards under which the doors are produced and manufactured. The work includes sizing, beveling edges, mortising, and drilling for hardware and providing necessary beaded openings for glass and louvers. Provide the door manufacturer with the necessary hardware samples, and frame and hardware schedules to coordinate the work.

2.3.6 Finishes

2.3.6.1 Factory Finish

Provide doors finished at the factory by the door manufacturer as follows:
NAAWS 3.1 Section 1500, specification for System No. 4 Conversion varnish alkyd urea or System No. 5 Vinyl catalyzed. The coating is NAAWS 3.1 premium, medium rubbed sheen, closed grain effect. Use stain when required to produce the finish specified for color. Seal edges, cutouts, trim, and wood accessories, and apply two coats of finish compatible with the door face finish. Touch-up finishes that are scratched or marred, or where exposed fastener holes are filled, in accordance with the door manufacturer's instructions. Match color and sheen of factory finish using materials compatible for field application.

2.3.6.2 Color

Provide door finish colors in accordance with drawings.

2.3.7 Water-Resistant Sealer

Provide manufacturer's standard water-resistant sealer compatible with the specified finishes.

2.4 SOURCE QUALITY CONTROL

Meet or exceed the following minimum performance criteria of stiles of "B" and "C" label fire doors utilizing standard mortise leaf hinges:

- a. Cycle-slam: Standard Duty Doors: 250,000 cycles with no loose hinge screws or other visible signs of failure when tested in accordance with the requirements of ANSI/WDMA I.S.1A .
- b. Hinge loading resistance: Averages of ten test samples not less than Standard Duty doors: 400 pounds force when tested for direct screw withdrawal in accordance with ANSI/WDMA I.S.6A using a No. 12, 1-1/4

inch long, steel, fully threaded wood screw. Drill 5/32 inch pilot hole, use 1-1/2 inch opening around screw for bearing surface, and engage screw full, except for last 1/8 inch. Do not use a steel plate to reinforce screw area.

PART 3 EXECUTION

3.1 INSTALLATION

Do not install building construction materials that show visual evidence of biological growth.

Before installation, seal top and bottom edges of doors with the approved water-resistant sealer. Seal cuts made on the job immediately after cutting using approved water-resistant sealer. Fit, trim, and hang doors with a 1/16 inch minimum, 1/8 inch maximum clearance at sides and top, and a 3/16 inch minimum, 1/4 inch maximum clearance over thresholds. Provide 3/8 inch minimum, 7/16 inch maximum clearance at bottom where no threshold occurs. Bevel edges of doors at the rate of 1/8 inch in 2 inch. Door warp must not exceed 1/4 inch when measured in accordance with ANSI/WDMA I.S.1A.

-- End of Section --

SECTION 08 31 00

ACCESS DOORS AND PANELS

05/17, CHG 1: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN WELDING SOCIETY (AWS)

AWS D1.1/D1.1M (2020; Errata 1 2021) Structural Welding Code - Steel

ASTM INTERNATIONAL (ASTM)

ASTM A36/A36M (2019) Standard Specification for Carbon Structural Steel

ASTM A653/A653M (2023) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process

ASTM A666 (2023) Standard Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate and Flat Bar

ASTM A1008/A1008M (2021a) Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable

MASTER PAINTERS INSTITUTE (MPI)

MPI 79 (2016) Primer, Alkyd, Anti-Corrosive for Metal

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Access Doors And Panels; G

SD-03 Product Data

Access Doors And Panels; G

Hardware Including Locks and Keys; G

Accessories; G

Recycled Content; S

SD-04 Samples

Finishes; G

1.3 MISCELLANEOUS REQUIREMENTS

For access doors and panels provide the following:

1.3.1 Shop Drawings

For field assembled access doors and panels, provide plans, elevations, sections, and details for each type of access door and panel assembly. Indicate frame, surface and edge construction, materials, and accessories. Indicate types of finished surfaces and details for panel edge conditions. Provide a door schedule with a unique number for each access door and panel, specific location in the project, location of hinges and hardware for each door.

1.3.2 Product Data

For shop assembled access doors and panels, provide literature indicating sizes, types, frame and edge construction, finishes, hardware, accessories such as gaskets, seals and weatherstripping, and location of each door and panel in the project. Provide details of adjoining work for each condition indicated.

1.3.3 Finish Samples

Submit two color charts from manufacturer's standard color and finish options for each type of frame and panel assembly finish indicated.

1.4 PERFORMANCE REQUIREMENTS

1.4.1 Access Panels for Wet Areas

Provide panel assemblies that will be located in wet areas with corrosion resistant finishes and hardware and water resistant gasketing.

1.5 DELIVERY, STORAGE, AND PROTECTION

Protect from corrosion, deformation, and other types of damage. Store items in an enclosed area free from contact with soil and weather. Remove and replace damaged items with new items.

PART 2 PRODUCTS

2.1 RECYCLED CONTENT

Provide products with recycled content. Provide data for each product with recycled content, identifying percentage of recycled content.

2.2 MATERIALS

2.2.1 Steel Plates, Shapes, and Bars

Provide in accordance with ASTM A36/A36M.

2.2.2 Sheet Steel

Provide cold rolled steel sheet substrate in accordance with ASTM A1008/A1008M, Commercial Steel (CS), exposed.

2.2.3 Stainless Steel

Provide in accordance with ASTM A666, type 302 or 304.

2.2.4 Metallic Coated Steel Sheet

Provide in accordance with ASTM A653/A653M, Commercial Steel (CS), Type B; with minimum G60 (Z180) or A60 (ZF180) metallic coating.

2.2.5 Hardware

Provide automatic closing devices. Provide latch releases operable from insides of doors.

2.2.6 Hinges

Provide concealed spring hinges, 175 degrees of opening, with removable hinge pins to allow removal of door panel from frame. Provide hinges of same steel as door and frame or in accordance with manufacturer's written recommendations. If providing non-continuous hinges, provide in numbers required to maintain alignment of door panel with frame. Provide coatings as necessary to permanently protect dissimilar metals from contact with one another; see Part 3 herein for more information.

2.2.7 Locks

Unless otherwise indicated, provide flush screwdriver operated cam lock. Provide plastic sleeve or stainless steel bushings to protect holes in surface finishes for screwdriver to access lock. tamper proof screws (spanner head locks) for access panels in locations requiring such security.

2.2.8 Accessories

Provide anchors in size, number and location on four sides to secure access door to substrate. Provide anchors in types as recommended by manufacturer's written installation instructions for each substrate indicated. Provide shims, bushings, clips, gaskets, and other devices as necessary for a complete installation.

2.3 FABRICATION

2.3.1 Thickness, Size, Edges

Fabricate frames for access doors of steel not lighter than 16 gage with welded joints and anchorage for securing to adjacent construction. Provide doors a minimum of 24 by 24 inches and of not lighter than 16 gage steel, with stiffened edges and welded attachments. Provide with eased

(lightly rounded) edges, without burrs, snags or sharpness and exposed welds ground smooth.

2.3.2 Welding

Provide in accordance with AWS D1.1/D1.1M.

2.4 ACCESS ASSEMBLY TYPES

Unless indicated otherwise, provide flush-face steel access doors and panels with steel frames and flanges.

2.4.1 Recessed Doors

Provide recessed access doors with gypsum wallboard bead flanges. Depth of door panel recess must accommodate the installed thickness of the finish material of the wall assembly for a flush finished condition of the wall and the access panel face. Reinforce panel and frame to prevent sagging.

2.5 FINISHES

Provide steel frame and panel surfaces with a shop applied prime coat. Field paint frames and panels to match wall and ceiling surfaces in which they occur. Provide exposed fastenings that approximately match the color and finish of the each material to which fastenings are applied.

PART 3 EXECUTION

3.1 PREPARATION

Field verify all measurements prior to fabrication. Verify access door locations and sizes provide required maintenance access to installed building services components. Protect existing construction and completed work from damage during installation.

3.2 GENERAL INSTALLATION REQUIREMENTS

Install items at locations indicated, in accordance with manufacturer's written instructions. Include materials and parts as necessary for a complete installation of each item. Conceal fastenings where practicable. Poor matching of holes to fasteners is cause for rejection of the work.

3.3 ACCESS LOCATIONS

Install removable access panels directly below each valve, flow indicator, damper, air splitter or other utility requiring access that is located above ceilings, other than at acoustical panel ceilings, and that would otherwise not be accessible. Install access doors and panels permitting access to service valves, traps, dampers, cleanouts, and other mechanical, electrical and conveyor control items concealed in walls and partitions.

3.4 ACCESS LOCATIONS IN WET AREAS

When possible, avoid locating access panels in wet areas. When such locations cannot be avoided, provide moisture resistant assemblies as indicated in Part I herein.

3.5 FIELD PAINTING

Field painting primed access doors in accordance with the requirements of Section 09 90 00 PAINTS AND COATINGS.

3.6 DISSIMILAR MATERIALS

Where dissimilar metals are in contact, protect surfaces with a coating in accordance with MPI 79 to prevent galvanic or corrosive action.

3.7 ADJUSTMENT

Adjust hardware so that door panel opens freely. Adjust door when closed center door panel in frame.

3.8 ENVIRONMENTAL CONDITIONS

Do not paint surfaces when damp or exposed to weather, when surface temperature is below 45 degrees F or over 95 degrees F, unless approved by the Contracting Officer.

-- End of Section --

This page left blank.

SECTION 08 33 13

COILING COUNTER DOORS

05/09, CHG 2: 11/12

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM A240/A240M (2023a) Standard Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Detail Drawings; G

SD-03 Product Data

Warranty
Rolling Counter Doors
Installation
Cleaning

SD-10 Operation and Maintenance Data

SD-11 Closeout Submittals

Rolling Counter Door (Non-Rated)

1.3 QUALITY ASSURANCE

Submit Detail Drawings showing elevations of each door type, details of anchorage, details of construction, location and description of hardware, shape and thickness of materials, details of joints and connections, and details of guides and fittings. Include a schedule showing the location of each counter door with the drawings.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver rolling counter doors to the jobsite wrapped in a protective

covering with the brands and names clearly marked thereon. Store rolling counter doors in accordance with the manufacturer's instructions in a dry location that is adequately ventilated and free from dust, water, or other contaminants, and in a manner that permits easy access for inspecting and handling. Handle doors carefully to prevent damage. Replace damaged items that cannot be restored to like-new condition.

1.5 WARRANTY

Provide manufacturer's standard performance guarantees or warranties that extend beyond a 1 year period. Submit no later than 30 days prior to final inspection.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Furnish rolling counter doors of the type, size, and design indicated on the drawings. Provide the standard product of a manufacturer regularly engaged in the production of rolling counter doors. Provide each door with a permanent label showing the manufacturer's name and address and the model number of the door. Submit Manufacturer's descriptive data and catalog cuts.

2.2 BASIC COMPONENTS

2.2.1 Curtain

Fabricate the curtain of 22 gauge stainless steel slats conforming to ASTM A240/A240M, Type 304 or Type 430. Provide thickness of slat material as required by width of opening. Use slats approximately 1-1/4 to 1-1/2 inch wide with a depth of crown of 1/2 inch. Fit alternate slats with endlocks to maintain curtain alignment. Provide bottom of curtain with angle or tubular bar reinforcement matching the curtain, and fitted with a resilient bottom seal.

2.2.2 Jamb Guides

Furnish guides of 13 gauge minimum thickness stainless steel conforming to ASTM A240/A240M, Type 304 or Type 430.

2.2.3 Counterbalance Shaft Assembly

Furnish the curtain coiled around a steel tube of sufficient thickness and diameter to prevent deflection exceeding 0.03 inch per foot. Provide a barrel containing oil tempered helical steel torsion springs capable of sufficient torque to counterbalance the weight of the curtain. Calculate the springs to provide a minimum of 7,500 operating cycles (one complete cycle of door operation will begin with the door in the closed position, move to the full open position and return to the closed position).

2.2.4 Brackets

Furnish brackets of a minimum 12 gauge thickness steel if flat plate, or 16 gauge thickness if there are a minimum of 3 returns of 3/4 inch width.

2.2.5 Hood

Provide a hood of 24 gauge stainless steel conforming to ASTM A240/A240M,

Type 304 or Type 430.

2.2.6 Locks

Lock the curtain at each side of the bottom bar by an integral slide bolt. Locate lock on the Laundry Room 101 room side of the counter door. Provide keying conforming to Section 08 71 00 DOOR HARDWARE.

2.3 ROLLING COUNTER DOOR (NON-RATED)

Construct rolling counter doors, curtains, guides and hood components of stainless steel conforming to the requirements specified herein. Submit Six complete copies of Data Package 2 for Rolling Counter Doors (Non-Rated) and Fire-Rated Rolling Counter Doors (next paragraph) in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA. Provide a list of the parts recommended by the manufacturer to be replaced after 1 year and 3 years of service.

2.4 INTEGRAL FRAME ROLLING COUNTER DOOR (RATED OR NON-RATED)

Furnish integral frame rolling counter door of stainless steel. Form jambs to create guides for the curtain. Provide head and jambs of 16 gauge thickness. Provide counter of 14 gauge thickness.

2.5 FINISH

Exposed parts of the counter door, including the curtain, bottom rail, guides, and hood must be of uniform finish and appearance. Furnish stainless steel with a No. 4 finish. Give all other steel parts a shop coat of primer paint standard with the manufacturer.

PART 3 EXECUTION

3.1 INSTALLATION

Install doors in accordance with approved detail drawings and manufacturer's instructions. Accurately locate anchors and inserts for guides, brackets, hardware, and other accessories. Upon completion, warped, twisted, or distorted doors are not acceptable. Lubricate, properly adjust, and demonstrate doors to operate freely.

3.2 OPERATION

3.2.1 Manual Operation

Provide curtain operated by means of [manual push-up with lift handles or continuous full width lift bar] [manual crank with removable handle].

3.3 FIELD FINISHING

Factory prime doors to receive field finishing as required, and then finish in accordance with Section 09 90 00 PAINTS AND COATINGS.

3.4 CLEANING

Clean aluminum and stainless steel doors in accordance with manufacturer's approved instructions. Submit Manufacturer's preprinted installation and cleaning instructions.

-- End of Section --

SECTION 08 33 23

OVERHEAD COILING DOORS

08/20, CHG 1: 02/22

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)

ASCE 7-16 (2017; Errata 2018; Supp 1 2018) Minimum Design Loads and Associated Criteria for Buildings and Other Structures

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE FUN IP (2021) Fundamentals Handbook, I-P Edition

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B29.400 (2001; (R 2008) (R 2013) (R 2018) (R 2023)) Combination, "H" Type Mill Chains, and Sprockets

ASTM INTERNATIONAL (ASTM)

ASTM A36/A36M (2019) Standard Specification for Carbon Structural Steel

ASTM A47/A47M (1999; R 2022; E 2022) Standard Specification for Ferritic Malleable Iron Castings

ASTM A53/A53M (2022) Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless

ASTM A123/A123M (2017) Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products

ASTM A153/A153M (2023) Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware

ASTM A307 (2021) Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 PSI Tensile Strength

ASTM A653/A653M (2023) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by

the Hot-Dip Process

ASTM A666	(2023) Standard Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate and Flat Bar
ASTM A780/A780M	(2020) Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings
ASTM A924/A924M	(2022a) Standard Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process
ASTM B221	(2021) Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes
ASTM B221M	(2021) Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric)
ASTM E84	(2023) Standard Test Method for Surface Burning Characteristics of Building Materials
ASTM E330/E330M	(2014; R 2021) Standard Test Method for Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference
ASTM F568M	(2007) Standard Specification for Carbon and Alloy Steel Externally Threaded Metric Fasteners

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA ICS 1	(2022) Standard for Industrial Control and Systems: General Requirements
NEMA ICS 2	(2000; R 2020) Industrial Control and Systems Controllers, Contactors, and Overload Relays Rated 600 V
NEMA ICS 6	(1993; R 2016) Industrial Control and Systems: Enclosures
NEMA MG 1	(2021) Motors and Generators
NEMA ST 1	(1988; R 1994; R 1997) Specialty Transformers (Except General Purpose Type)

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2023) National Electrical Code
---------	---------------------------------

UNDERWRITERS LABORATORIES (UL)

UL 325 (2017; Reprint Feb 2020) UL Standard for
Safety Door, Drapery, Gate, Louver, and
Window Operators and Systems

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Overhead Coiling Doors; G
Counterbalancing Mechanism; G
Electric Door Operators; G
Bottom Bars; G
Guides; G
Mounting Brackets; G
Hood; G
Installation Drawings; G

SD-03 Product Data

Overhead Coiling Doors; G
Hardware; G
Counterbalancing Mechanism; G
Electric Door Operators; G
Recycled content for steel curtain slats; S
Recycled content for stainless steel curtain slats; S

SD-05 Design Data

Overhead Coiling Doors; G
Hardware; G
Counterbalancing Mechanism; G
Electric Door Operators; G

SD-10 Operation and Maintenance Data

Operation and Maintenance Manuals, Data Package 2; G

SD-11 Closeout Submittals

Warranty; G

1.3 QUALITY CONTROL

Provide assemblies bearing a permanent label for each door showing the manufacturer's name and address, and the model/serial number of the door.

Provide oversized assemblies with a listing agency oversize label, or a certificate signed by an official of the manufacturing company certifying that the door and operator are designed to meet the specified requirements.

1.3.1 Warranty

Furnish a written guarantee that the helical spring and counterbalance mechanism are free from defects in material and workmanship for not less than two years after completion and acceptance of the project.

Warrant that upon notification by the Government, any defects in material, workmanship, and door operation are immediately correct within the same time period covered by the guarantee, at no cost to the Government.

1.3.2 Operation And Maintenance Submittals

Submit 6 copies of the operation and maintenance manuals 30 calendar days prior to testing the Overhead Coiling Door Assemblies. Update and resubmit data for final approval no later than 30 calendar days prior to cContract completion.

Submit Operation and Maintenance Manuals for Overhead Coiling Door Assemblies, including the following items:

Electric Door Operators

Hood

Counterbalancing Mechanism

Painting

Provide operation and maintenance manuals which are consistent with manufacturer's standard brochures, schematics, printed instructions, operating procedures, and safety precautions.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver doors to the jobsite wrapped in a protective covering with the brands and names clearly marked thereon. Store doors in an adequately ventilated dry location that is free from dirt and dust, water, or other contaminants. Store in a manner that permits easy access for inspection and handling. Handle doors carefully to prevent damage. Remove damaged items that cannot be restored to like-new condition and provide new items.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Provide overhead coiling doors with interlocking slats, complete with anchoring and door hardware, guides, hood, and operating mechanisms, and designed for use on openings as indicated. Doors must be spring counterbalanced, rolling type, and designed for use on exterior openings, as indicated. Doors must be operated by electric-power with auxiliary hand chain operation. Doors to be surface-mounted type with guides at jambs set back a sufficient distance to provide a clear opening when door is in open position. Mount exterior doors on interior face of walls.

2.1.1 Design Requirements

2.1.1.1 Door Detail Shop Drawings

Provide installation drawings for door assemblies which show: elevations of each door type, shape and thickness of materials, finishes, details of joints and connections, details of guides and fittings, rough opening dimensions, location and description of hardware, anchorage locations, and counterbalancing mechanism and door operator details. Show locations of replaceable fusible links on wiring diagrams for power, signal and controls. For motor-operated doors include supporting brackets for motors, location, type, and ratings of motors, and safety devices. Include a schedule showing the location of each door with the drawings.

2.1.2 Performance Requirements

2.1.2.1 Wind Loading

Design and fabricate door assembly to withstand the wind loading pressure as indicated on the Structural drawings. Provide test data showing compliance with ASTM E330/E330M. Sound engineering principles may be used to interpolate or extrapolate test results to door sizes not specifically tested. Ensure that the complete assembly meets or exceeds the requirements of ASCE 7-16.

2.1.2.2 Operational Cycle Life

Design all portions of the door, hardware and operating mechanism that are subject to movement, wear, or stress fatigue to operate through a minimum number of 10 cycles per day. One complete cycle of door operation is defined as when the door is in the closed position, moves to the fully open position, and returns to the closed position.

2.2 COMPONENTS

2.2.1 Overhead Coiling Doors

2.2.1.1 Curtain Materials and Construction

Provide curtain slats fabricated from Grade A steel sheets conforming to ASTM A653/A653M, with the additional requirement of a minimum yield point of 33,000 psi. Provide 18 gauge sheets, Grade 40 steel with galvanized steel zinc coating in conformance with ASTM A653/A653M and ASTM A924/A924M. Provide steel curtain slats containing a minimum of 20 percent recycled content. Submit data identifying percentage of recycled content for steel

curtain slats.

Fabricate doors from interlocking cold-rolled slats, with section profiles as specified, designed to withstand the specified wind loading. Ensure the provided slats are continuous without splices for the width of the door.

Provide slats filled with manufacturer's standard thermal insulation, complying with the maximum flame-spread and smoke-developed indexes of 75 and 450, respectively, according to ASTM E84. Enclose the insulation completely within the slat faces on the interior surface of the slats.

2.2.1.2 Insulated Curtains

Form curtains from manufacturer's standard shapes of interlocking slats. Supply a slat system with a minimum R-value of 4 when calculated in accordance with ASHRAE FUN IP. Slats to consist of a urethane or polystyrene core not less than 11/16 inch thick, completely enclosed within metal facings. Slat steel thickness as required by the size of the door to meet specified performance requirements. The insulated slat assembly requires a flame spread rating of not more than 25 and a smoke development factor of not more than 50 when tested in accordance with ASTM E84.

2.2.1.3 Curtain Bottom Bar

Install curtain bottom bars as pairs of angles or using extrusions from the manufacturer's standard steel, stainless and aluminum extrusions not less than 2.0 by 2.0 inches by 0.188 inch. Do not use aluminum on doors more than 16 feet wide. Ensure steel extrusions conform to ASTM A36/A36M. Stainless steel extrusions conforming to ASTM A666, Type 304. Aluminum extrusions conforming to ASTM B221. Galvanize angles and fasteners in accordance with ASTM A653/A653M and ASTM A924/A924M. Coat welds and abrasions with paint conforming to ASTM A780/A780M.

2.2.1.4 Endlocks (and Windlocks)

Provide endlocks of Grade B cast steel conforming to ASTM A47/A47M, galvanized in accordance with ASTM A153/A153M. Secure locks at every other curtain slat.

2.2.1.5 Weather Stripping

Provide a hood baffle inside the hood that is a minimum 1/16 inch thick sheet of vinyl, neoprene rubber or equivalent. Provide guide weather stripping that is a minimum 1/16 inch thick sheet of vinyl, neoprene rubber, or equivalent.

Provide bottom bar weather-stripping that is a minimum 1/16 inch thick sheet of vinyl, neoprene rubber, or equivalent.

2.2.1.6 Locking Devices

Ensure that the slide bolt engages through slots in tracks for locking by padlock, located on both left and right jamb sides, operable from coil side.

Provide a locking device assembly which includes cylinder lock, operating handle, cam plate, and adjustable locking bars to engage through slots in

tracks.

2.2.1.7 Safety Interlock

Equip power-operated doors with a safety interlock switch to disengage power supply when the door is locked, or provide an operator with an internal lock sensing device to prevent the door opening when the door is locked.

2.2.2 Hardware

Ensure that all hardware conforms to ASTM A153/A153M, ASTM A307, and ASTM F568M.

2.2.2.1 Guides

Fabricate curtain jamb guides from the manufacturer's standard angles or channels of same material and finish as curtain slats unless otherwise indicated. Provide guides with sufficient depth or incorporate a steel locking bar to retain the curtain in place under the wind pressure specified. Ensure curtain operates smoothly. Slot bolt holes for track adjustment. Securely attach guides to adjoining construction with not less than 3/8 inch diameter bolts, spaced near each end and not over 30 inches apart.

Fabricate with structural steel angles. Provide windlock bars of same material when windlocks are required to meet specified wind load. Flare the top of inner and outer guide angles outwards to form bellmouth for smooth entry of curtain into guides. Provide removable guide stoppers to prevent over travel of curtain and bottom bar.

2.2.2.2 Hood

Provide a hood with a minimum 24-gauge galvanized sheet metal, flanged at top for attachment to header and flanged at bottom to provide longitudinal stiffness. The hood encloses the curtain coil and counterbalance mechanism.

Hoods for openings more than 12 feet in width must have intermediate support brackets to prevent excessive sag. Provide a weather baffle at the lintel or inside the hood of each exterior door.

2.2.3 Counterbalancing Mechanism

Counterbalance doors by means of manufacturer's standard mechanism with an adjustable-tension, steel helical torsion spring mounted, around a steel shaft and contained in a spring barrel connected to top of curtain with barrel rings. Use grease-sealed or self-lubricating bearings for rotating members.

2.2.3.1 Brackets

Provide the manufacturer's standard mounting brackets with one located at each end of the counterbalance barrel conforming to ASTM A36/A36M. Provide brackets of hot-rolled steel.

Brackets will be of 1/4 inch minimum thick steel plates, with permanently sealed ball bearings. Designed to enclose ends of coil and provide support of counterbalance pipe at each end.

2.2.3.2 Counterbalance Barrels

Curtain must roll up on a barrel supported at head of opening on brackets and be balanced by a torsion spring system in the barrel. Fabricate spring barrel of manufacturer's standard hot-formed, structural-quality, welded or seamless carbon-steel pipe, conforming to ASTM A53/A53M or equivalent. Ensure the barrel is of sufficient diameter and wall thickness to support rolled-up curtain without distortion of slats. Limit barrel deflection to not more than 0.03 inch per foot of span under full load.

a. Barrel

Provide steel pipe capable of supporting curtain load with maximum deflection of 0.03 inches per foot of width.

b. Spring Balance

Provide an oil-tempered, heat-treated steel helical torsion spring assembly designed for proper balance of door. Ensure that effort to operate manually operated units does not exceed 25 lbs. At least 80 percent of the door weight must be counterbalanced at any position. Provide wheel for applying and adjusting spring torque.

2.2.4 Electric Door Operators

Provide electrical wiring and door operating controls conforming to the applicable requirements of NFPA 70 and UL 325. The door manufacturer must furnish automatic control and safety devices, including extra flexible type SO cable and spring-loaded automatic takeup reel or equivalent device, as required for proper operation of the doors. Conduit, wiring, and mounting of controls are specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM.

Electric door-operator assemblies need to be the sizes and capacities recommended and provided by the door manufacturer for specified doors. Furnish complete assemblies with electric motors and factory-prewired motor controls, starter, gear reduction units, solenoid-operated brakes, clutch, remote-control stations, manual or automatic control devices, and accessories as required for proper operation of the doors.

Design the operators so that motors may be removed without disturbing the limit-switch adjustment and affecting the emergency auxiliary operators.

Provide a manual operator of crank-gear or chain-gear mechanisms with a release clutch to permit manual operation of doors in case of power failure. Arrange the emergency manual operator so that it may be put into and out of operation from floor level, and its use does not affect the adjustment of the limit switches. Provide an electrical or mechanical device that automatically disconnects the motor from the operating mechanism when the emergency manual operating mechanism is engaged.

2.2.4.1 Door-Operator Types

Provide a bench mounted operator mounted to the right or left door head plate and connected to the door drive shaft with drive chain and

sprockets. Side room is required for this type of mounting.

2.2.4.2 Electric Motors

Provide motors which are the high-starting-torque, reversible, constant-duty electrical type with overload protection of sufficient torque and horsepower to move the door in either direction from any position. Ensure they produce a door-travel speed of not less than 8 nor more than 12 inches per second without exceeding the horsepower rating.

Provide motors which conform to NEMA MG 1 designation, temperature rating, service factor, enclosure type, and efficiency to the requirements specified. Motors must be suitable for operation on current of the characteristics indicated. Single-phase motors must not have commutation or more than one starting contact. Motor enclosures must be the drip-proof type or NEMA TEFC and TENV type. Install motors in approved locations.

2.2.4.3 Motor Bearings

Select bearings with bronze-sleeve or heavy-duty ball or roller antifriction type with full provisions for the type of thrust imposed by the specific duty load.

Pre-lubricate and factory seal bearings in motors less than 1/2 horsepower.

Equip motors coupled to worm-gear reduction units with either ball or roller bearings.

Equip bearings in motors 1/2 horsepower or larger with lubrication service fittings. Fit lubrication fittings with color-coded plastic or metal dust caps.

In any motor, bearings that are lubricated at the factory for extended duty periods do not need to be lubricated for a given number of operating hours. Display this information on an appropriate tag or label on the motor with instructions for lubrication cycle maintenance.

2.2.4.4 Motor Starters, Controls, and Enclosures

Provide each door motor with: a factory-wired, unfused, disconnect switch; a reversing, across-the-line magnetic starter with thermal overload protection; 24-volt operating coils with a control transformer limit switch; and a safety interlock assembled in a NEMA ICS 6 type enclosure as specified herein. Ensure control equipment conforms to NEMA ICS 1 and NEMA ICS 2.

Provide adjustable switches, electrically interlocked with the motor controls and set to stop the door automatically at the fully open and fully closed position.

2.2.4.5 Control Enclosures

Provide control enclosures that conform to NEMA ICS 6 for general purpose NEMA Type 1.

2.2.4.6 Transformer

Provide starters with 230/460 to 115 volt control transformers with one secondary fuse when required to reduce the voltage on control circuits to 24volts or less. Provide a transformer conforming to NEMA ST 1.

2.2.4.7 Sensing-Edge Device

Provide each door with a pneumatic or electric sensing device that meets UL 325, extends the full width of the door, and is located within a U-section neoprene or rubber astragal, mounted on the bottom rail of the bottom door section. Device needs to immediately stop and reverse the door upon contact with an obstruction in the door opening or upon failure of the device or any component of the control system and cause the door to return to its user-defined open position. Any momentary door-closing circuit must be automatically locked out and the door must be operable manually or with constant pressure controls until the failure or damage has been corrected. A sensing device is not a substitute for a limit switch.

Connect sensing device to the control circuit through a retracting cord and reel.

2.2.4.8 Remote-Control Stations

Remote control stations must be at least 5 feet above the floor line, and all switches must be located so that the operator will have complete visibility of the door at all times. Provide interior remote control stations that are full-guarded, momentary-contact three-button, heavy-duty, surface-mounted NEMA ICS 6 type enclosures as specified. Mark buttons "OPEN," "CLOSE," and "STOP." The "OPEN" and "STOP" buttons must be of the type requiring only momentary pressure to operate. The "CLOSE" button must be of the type either requiring constant pressure to maintain the closing motion of the door or momentary pressure when installed with a monitored entrapment detection device which, upon failure of the device or any component of the control system, cause the door to return to its full open position. When the door is in motion and the "STOP" button is pressed, ensure the door stops instantly and remains in the stopped position. From the stopped position, the door may then be operated in either direction by the "OPEN" or "CLOSE" buttons. When the door is in motion, and the "CLOSE" button of the constant pressure type is released, the door must stop and remain in the stop position or reverse to the user set up position; from the stop position, the door may then be operated in either direction by the "OPEN" or "CLOSE" buttons. Controls must be adjustable to automatically stop the doors at their fully open and closed positions. Open and closed positions must be readily adjustable.

2.2.4.9 Speed-Reduction Units

Provide speed-reduction units consisting of hardened-steel worm and bronze worm gear assemblies or planetary gear reducers running in oil or grease and inside a sealed casing, coupled to the motor through a flexible coupling. Drive shafts need to rotate on ball- or roller-bearing assemblies that are integral with the unit.

Provide minimum ratings of speed reduction units in accordance with AGMA

provisions for class of service.

Ground worm gears to provide accurate thread form; machine teeth for all other types of gearing. Surface harden all gears.

Provide antifriction type bearings equipped with oil seals.

2.2.4.10 Chain Drives

Provide roller chains that are a power-transmission series steel roller type conforming to ASME B29.400, with a minimum safety factor of 10 times the design load.

Heat-treat or otherwise harden roller-chain side bars, rollers, pins, and bushings.

Provide high-carbon steel chain sprockets with machine-cut hardened teeth, finished bore and keyseat, and hollow-head setscrews.

2.2.4.11 Brakes

Provide 360-degree shoe brakes or shoe and drum brakes. Ensure the brakes are solenoid-operated and electrically interlocked to the control circuit to set automatically when power is interrupted.

2.2.4.12 Clutches

Ensure clutches are friction type or adjustable centrifugal type.

2.2.4.13 Weather/Smoke Seal Sensing Edge

Provide automatic stop control by an automatic sensing switch within neoprene astragal extending the full width of door bottom bar.

Provide an electric sensing edge device. Ensure the door immediately stops downward travel when contact occurs before door fully closes. Provide a self-monitoring sensing edge connection to the motor operator.

2.2.5 Surface Finishing

Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes. Noticeable variations in the same metal component are not acceptable. Variations in appearance of adjoining components are acceptable if they are within the range of approved samples and are assembled or installed to minimize contrast.

2.2.5.1 Galvanized and Shop-Primed Finish

Surfaces specified must have a zinc coating, a phosphate treatment, and a shop prime coat of rust-inhibitive paint. The galvanized coating must conform to ASTM A653/A653M, coating designation Z275 (G90), for steel sheets, and ASTM A123/A123M for iron and steel products. The weight of coatings for products must be as designated in Table I of ASTM A123/A123M for the thickness of base metal to be coated. The prime coat must be a type especially developed for materials treated by phosphates and adapted to application by dipping or spraying. Repair damaged zinc-coated surfaces by the materials and methods conforming to ASTM A780/A780M and spot prime. At the option of the Contractor, a two-part system including

bonderizing, baked-on epoxy primer, and baked-on enamel top coat may be applied to slats and hoods before forming, in lieu of prime coat specified.

PART 3 EXECUTION

3.1 INSTALLATION

Install overhead coiling door assembly, anchors and inserts for guides, brackets, motors, switches, hardware, and other accessories in accordance with approved detail drawings and manufacturer's written instructions. Upon completion of installation, ensure doors are free from all distortion.

Install overhead coiling doors, motors, hoods, and operators at the mounting locations as indicated for each door in the Contract Documents and as required by the manufacturer.

Install overhead coiling doors, switches, and controls along accessible routes in compliance with regulatory requirements for accessibility and as required by the manufacturer.

3.1.1 Field Painted Finish

Ensure field painted steel doors and frames are in accordance with Section 09 90 00 PAINTS AND COATINGS and the manufacturer's written instructions. Protect the weather stripping from paint. Ensure that the finishes are free of scratches or other blemishes.

3.2 ADJUSTING AND CLEANING

3.2.1 Acceptance Provisions

After installation, adjust the hardware and moving parts. Lubricate bearings and sliding parts as recommended by manufacturer to provide smooth operating functions for ease movement, free of warping, twisting, or distortion of the door assembly.

Adjust seals to provide a weather-tight fit around entire perimeter.

Engage a factory-authorized service representative to perform startup service and checks according to the manufacturer's written instructions.

Test the door opening and closing operation when activated by controls system. Adjust controls and safeties. Replace damaged and malfunctioning controls and equipment. Reset the door-closing mechanism after a successful test.

Test and make final adjustment of new doors at no additional cost to the Government.

3.2.1.1 Maintenance and Adjustment

Not more than 90 calendar days after completion and acceptance of the project, examine, lubricate, test, and re-adjust doors as required for proper operation.

3.2.1.2 Cleaning

Clean doors in accordance with manufacturer's approved instructions.

SECTION 08 34 00

SPECIAL FUNCTION DOORS

08/20, CHG 1: 02/22

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ARCHITECTURAL MANUFACTURERS ASSOCIATION (AAMA)

AAMA 2604 (2017a) Voluntary Specification, Performance Requirements and Test Procedures for High Performance Organic Coatings on Aluminum Extrusions and Panels

ASTM INTERNATIONAL (ASTM)

ASTM F710 (2022) Standard Practice for Preparing Concrete Floors to Receive Resilient Flooring

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 80 (2022) Standard for Fire Doors and Other Opening Protectives

NFPA 101 (2024) Life Safety Code

NFPA 105 (2022) Standard for Smoke Door Assemblies and Other Opening Protectives

NFPA 252 (2022) Standard Methods of Fire Tests of Door Assemblies

1.2 RELATED DOCUMENTS

Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.3 SUMMARY

Section includes: Interior Aluminum-Framed Top-Hung Sliding Doors (Door 106C at Training Rooms 106/107)

1.4 RELATED REFERENCES

ANSI - American National Standards Institute

a. ANSI 156.18 Materials and Finishes

b. ANSI A117.1 Specifications for making buildings and facilities usable by physically handicapped people.

BHMA - Builders Hardware Manufacturers Association

DHI - Door and Hardware Institute

NFPA - National Fire Protection Association

- a. NFPA 80 - Fire Doors and Windows
- b. NFPA 101 - Life Safety code
- c. NFPA 105 - Smoke and Draft Control Door Assemblies
- d. NFPA 252 - Fire Tests of Doors Assemblies

1.5 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Submit manufacturer's shop drawings, including plans, elevations, sections, and details, indicating dimensions, tolerances, materials, components, hardware, finish, options, and accessories. Shop Drawings to show required blocking by others.

SD-03 Product Data

Submit manufacturer's product data, including installation instructions.

SD-04 Samples

Submit manufacturer's samples of the following sliding door components:

Aluminum Frame finish sample.

SD-06 Test Reports

Submit acoustical reports or UL1784 as applicable.

SD-07 Certificates

Submit manufacturer's certification that materials comply with specified requirements and are suitable for intended application.

SD-11 Closeout Submittals

Submit manufacturer's standard warranty for complete system

1.6 QUALITY ASSURANCE

1.6.1 Product Options

Drawings indicate size, profiles, and dimensional requirements of interior aluminum frames and doors.

1.6.2 Source

Obtain sliding aluminum framed doors and hardware from single source.

1.6.2.1 Manufacturer's Qualifications

Manufacturer regularly engaged for past 5 years in manufacture of sliding doors similar to that specified.

1.7 PERFORMANCE

Aluminum perimeter frames with integral acoustic seals at all door/frame interfaces. Verify frame thickness suitable for required application. Soft-closing mechanism at both sides of door integrated with top track. Soft Closers tested to a minimum of 150,000 cycles. Concealed door guide. Manufacturer to 3rd party acoustical performance test data. Manufacturer to submit 3rd party test data on air infiltration and/or smoke ratings as applicable.

1.8 DELIVERY, STORAGE, AND STORAGE

Delivery and Acceptance Requirements: Deliver materials to site in manufacturer's original, unopened containers and packaging, with labels clearly identifying product name and manufacturer. Notify manufacturer immediately of any shipping damage.

1.8.1 Requirements

- a. Store and handle materials in accordance with manufacturer's instructions.
- b. Keep materials in manufacturer's original, unopened containers and packaging until installation.
- c. Store materials in clean, dry area indoors.
- d. Protect materials and finish during storage, handling, and installation to prevent damage.

PART 2 PRODUCTS

2.1 MANUFACTURERS

2.1.1 Basis of Design

AD SYSTEMS 2201 100th St. SW, Everett, WA 98204 | Website:
<http://specADsystems.com> | Phone: 425-740-6011 |
ADSystems.Estimating@allegion.com

ExamSlide™ High Performance Barn (Sliding) Door System by AD Systems.

2.2 INTERIOR SLIDING ALUMINUM-FRAMED DOORS AND PARTITIONS

2.2.1 Frame Profiles

Extruded aluminum frame "wrap" frame with integral vertical jamb (stile pocket). Frames required to complete seal around door leaf. Gasketing required at all frame to door interfacing. Exposed gaskets at jamb to be silicone.

2.2.2 Finish

Specify standard hardcoat (Kynar) finish in Light Sequin other custom (Kynar or other architectural paint) color option. Consult AD Systems for availability.

- a. Standard: Painted Hardcoat (Kynar) Finish. Meets AAMA 2604 Standard Colors: Light Sequin 789G048

2.2.3 Door Leafs

All Doors to be factory machined for hardware including pilot and function holes. Leading edge of door to be fully finished.

2.2.3.1 Aluminum Stile & Rail Door

- a. 3-1/2" stiles plus 1/2" stop
- b. 10" bottom rail
- c. Glazing: sound enhanced laminated glass with opaque inner layer.

2.2.4 Door Components

2.2.4.1 Single Top Track

Anodized finish aluminum track.

2.2.4.2 Valances

- a. Extruded aluminum with integral end caps.
- b. Standard square valance.

2.2.4.3 Top Rollers

Tandem nylon roller sized to match door weight.

2.2.4.4 Concealed Floor Guide

Integral Jamb floor guide by AD Systems.

2.2.4.5 Soft-Closers

Soft-closing dampeners at [one] both sides of door leaf. Demonstrate soft closers as tested to 150k cycles.

2.2.4.6 Handles

Standard Straight Pull: 12" long x 1" diameter. Finish: US32D Satin

Stainless Steel.

PART 3 EXECUTION

3.1 EXAMINATION

Examine wall openings to receive sliding doors for plumb, level, and square. Note: Finish door operation will be affected by out of tolerance framing. Verify dimensions of wall openings. Examine surfaces to receive top and bottom guide. Notify Architect of conditions that would adversely affect installation or subsequent use of sliding doors. Verify that surfaces are smooth and flat with maximum variation of 3/16 inch in 10 feet, and are ready to receive Work. Prepare substrate in accordance with ASTM F710 and flooring manufacturer's recommendations. Remove sub-floor ridges and bumps. Fill low spots, cracks, joints, holes, and other defects with subfloor filler.

Apply, trowel, and float filler to leave a smooth, flat, hard surface. Repair all floor irregularities.

Fill or level cracks, holes and depressions 1/8 inch wide or wider, and protrusions more than 1/32 inch, unless more stringent requirements are required by manufacturer's written instructions.

Do not begin installation until unacceptable conditions are corrected. Base of door side to be flush with rubber base acceptable.

3.2 INSTALLATION

Install sliding doors in accordance with manufacturer's instructions at locations indicated on the Drawings.

Install sliding doors plumb, level, square, and in proper alignment.

Install sliding doors to close against walls without gaps.

Install sliding doors to open and close smoothly.

Anchor sliding doors securely in place to supports.

3.3 ADJUSTING

Adjust sliding doors for proper operation in accordance with manufacturer's instructions. Adjust sliding doors to operate smoothly without binding. Repair minor damages to finish in accordance with manufacturer's instructions and as approved by Architect.

3.4 CLEANING

Clean sliding doors promptly after installation in accordance with manufacturer's instructions. Do not use harsh cleaning materials or methods that could damage materials or finish.

3.5 PROTECTION

Protect installed sliding doors from damage during construction.

-- End of Section --

This page left blank.

SECTION 08 71 00

DOOR HARDWARE
02/16, CHG 4: 02/22

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM E283 (2019) Standard Test Method for Determining the Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen

BUILDERS HARDWARE MANUFACTURERS ASSOCIATION (BHMA)

ANSI/BHMA A156.1 (2021) Butts and Hinges
ANSI/BHMA A156.3 (2020) Exit Devices
ANSI/BHMA A156.4 (2013) Door Controls - Closers
ANSI/BHMA A156.5 (2020) Cylinder and Input Devices for Locks
ANSI/BHMA A156.6 (2021) Architectural Door Trim
ANSI/BHMA A156.7 (2016) Template Hinge Dimensions
ANSI/BHMA A156.8 (2021) Door Controls - Overhead Stops and Holders
ANSI/BHMA A156.13 (2017) Mortise Locks & Latches Series 1000
ANSI/BHMA A156.16 (2018) Auxiliary Hardware
ANSI/BHMA A156.18 (2020) Materials and Finishes
ANSI/BHMA A156.21 (2019) Thresholds
ANSI/BHMA A156.22 (2021) Gasketing
ANSI/BHMA A156.25 (2013) Electrified Locking Devices
ANSI/BHMA A156.31 (2013) Electric Strikes and Frame Mounted Actuators
ANSI/BHMA A156.36 (2010) Auxiliary Locks

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70 (2020; TIA 22-1; ERTA 1 2022) National

Electrical Code

STEEL DOOR INSTITUTE (SDI/DOOR)

SDI/DOOR A250.8 (2017) Specifications for Standard Steel
Doors and Frames

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

36 CFR 1191 Americans with Disabilities Act (ADA)
Accessibility Guidelines for Buildings and
Facilities; Architectural Barriers Act
(ABA) Accessibility Guidelines

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Manufacturer's Detail Drawings; G

Verification of Existing Conditions; G

Hardware Schedule; G

Keying System; G

SD-03 Product Data

Hardware Items; G

SD-08 Manufacturer's Instructions

Installation

SD-10 Operation and Maintenance Data

Hardware Schedule Items, Data Package 1; G

SD-11 Closeout Submittals

Key Bitting

1.3 SHOP DRAWINGS

Submit manufacturer's detail drawings indicating all hardware assembly components and interface with adjacent construction. Indicate power components and wiring coordination for electrified hardware. Base shop drawings on verified field measurements and include verification of existing conditions.

1.4 PRODUCT DATA

Indicate fire-ratings at applicable components. Provide documentation of ABA/ADA accessibility compliance of applicable components, as required by

36 CFR 1191 Appendix D - Technical.

1.5 HARDWARE SCHEDULE

Provide Hardware Item List and Hardware Schedule containing the following information, and additional information as needed to identify the complete make up of each hardware set and its application to each opening:

1.5.1 Hardware Item List:

- a. Hardware Type
- b. Item Number
- c. Quantity
- d. Size(s)
- e. Reference Publication / Type Number
- f. Manufacturer's Name / Catalog Number
- g. Key Control Symbols
- h. UL Mark (If fire rated and listed)
- i. BHMA Finish(es)
- j. Remarks

1.5.2 Hardware Schedule

- a. Hardware Set Number
- b. Opening Number(s)
- c. Opening Description (single/double leaf, hand, size, door/frame material)
- d. Fire Rating
- e. Sound Rating
- f. Hardware Items
- g. Quantity
- h. Size
- i. BHMA Finish
- j. Remarks

In addition, submit hardware schedule data package 1 in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA.

1.6 KEY BITTING CHART REQUIREMENTS

1.6.1 Requirements

Submit key bitting charts to the Contracting Officer prior to completion of the work. Include:

- a. Complete listing of all keys (e.g. AA1 and AA2).
- b. Complete listing of all key cuts (AA1-123456, AA2-123458).
- c. Tabulation showing which key fits which door.
- d. Copy of floor plan showing doors and door numbers.
- e. Listing of 20 percent more key cuts than are presently required in each master system.

1.7 QUALITY ASSURANCE

1.7.1 Hardware Manufacturers and Modifications

Provide, as far as feasible, locks, hinges, and closers of one lock, hinge, or closer manufacturer's make. Modify hardware as necessary to provide features indicated or specified.

1.7.2 Key Shop Drawings Coordination Meeting

Prior to the submission of the key shop drawing, the Contracting Officer, Contractor, Door Hardware Subcontractor, using Activity and Base Locksmith must meet to discuss and coordinate key requirements for the facility.

1.8 DELIVERY, STORAGE, AND HANDLING

Deliver hardware in original individual containers, complete with necessary appurtenances including fasteners and instructions. Mark each individual container with item number as shown on hardware schedule. Deliver permanent keys and removable cores to the Contracting Officer, either directly or by certified mail. Deliver construction master keys with the locks.

PART 2 PRODUCTS

2.1 TEMPLATE HARDWARE

Hardware applied to metal or to prefinished doors must be manufactured using a template. Provide templates to door and frame manufacturers in accordance with ANSI/BHMA A156.7 for template hinges. Coordinate hardware items to prevent interference with other hardware.

2.2 HARDWARE ITEMS

Clearly and permanently mark with the manufacturer's name or trademark, hinges, pivots, locks, latches, exit devices, bolts and closers where the identifying mark is visible after the item is installed. For closers with covers, the name or trademark may be beneath the cover. Coordinate electrified door hardware components with corresponding components specified in Division 28 ELECTRONIC SECURITY SYSTEMS (ESS).

2.2.1 Hinges

Provide in accordance with ANSI/BHMA A156.1. Provide hinges that are 4-1/2 by 4-1/2 inch unless otherwise indicated. Construct loose pin hinges for interior doors and reverse-bevel exterior doors so that pins are non-removable when door is closed. Other anti-friction bearing hinges may be provided in lieu of ball bearing hinges.

2.2.2 Locks and Latches

- a. At exterior locations provide locksets of full stainless steel type 302 or 304 construction including fronts, strike, escutcheons, knobs, bolts and all interior working parts. Marine Grade I, fully non-ferrous.
- b. In non-air-conditioned interior environments or humid interior environments, provide interior locksets on the same Marine Grade I, fully non-ferrous as exterior locksets.

2.2.2.1 Mortise Locks and Latches

Provide in accordance with ANSI/BHMA A156.13, Series 1000, Operational Grade 1, Security Grade 2. Provide mortise locks with escutcheons not less than 7 by 2-1/4 inch with a bushing at least 1/4 inch long. Cut escutcheons to fit cylinders and provide trim items with straight, beveled, or smoothly rounded sides, corners, and edges. Provide knobs and roses of mortise locks with screwless shanks and no exposed screws.

2.2.2.2 Auxiliary Locks

Provide in accordance with ANSI/BHMA A156.36, Grade 1.

2.2.3 Exit Devices

Provide in accordance with ANSI/BHMA A156.3, Grade 1. Provide adjustable strikes for rim type and vertical rod devices. Provide open back strikes for pairs of doors with mortise and vertical rod devices. Provide touch bars in lieu of conventional crossbars and arms. Provide escutcheons not less than 7 by 2-1/4 inch.

2.2.4 Cylinders and Cores

Provide cylinders and cores for new locks, including locks provided under other sections of this specification. Provide cylinders and cores with seven pin tumblers. Provide cylinders from the products of one manufacturer, and provide cores from the products of one manufacturer, use CORMAX (Eglin Standard). Rim cylinders, mortise cylinders, and knobs of bored locksets have interchangeable cores which are removable by special control keys. Stamp each interchangeable core with a key control symbol in a concealed place on the core.

2.2.5 Electrified Hardware

Comply with the requirements of NFPA 70 for wiring of electrified hardware.

2.2.5.1 Electric Strikes and Frame Mounted Actuators

Provide in accordance with ANSI/BHMA A156.31, Grade 1. Provide electric strikes and actuators as required to meet operational requirements.

Provide electric strikes that remain secure during power failure. Provide strikes and actuators with a minimum opening force of 2300 pounds.

Provide facility interface devices that use direct current (dc) power to energize the solenoids. Provide electric strikes and actuators that incorporate end-of-line resistors to facilitate line supervision by the system. If not incorporated into the electric strike or local controller, provide metal oxide resistors (MOVs) to protect the controller from reverse current surges.

2.2.5.1.1 Solenoid

Provide actuating solenoid for strikes and actuators that are rated for continuous duty, cannot dissipate more than 12 Watts and must operate on 12 or 24 Volts dc. Inrush current cannot exceed 1 ampere and the holding current cannot be greater than 500 milliamperes. Actuating solenoid must move from fully secure to fully open positions in less than 500 milliseconds.

2.2.5.1.2 Signal Switches

Provide strikes and actuators with signal switches to indicate to the system when the bolt is not engaged or the strike mechanism is unlocked. Signal switches must report a forced entry to the system.

2.2.5.1.3 Tamper Resistance

Provide strike guards that prevent tampering with the latch bolt of the locking hardware or the latch bolt keeper of the electric strike. Strike guards to bolt through the door using tamper resistant screws. Provide strike guards made of 1/8 inch thick brass and that are 11-1/14 inch high by 1-5/8 inch wide, with a minimum 5/32 inch wide offset.

2.2.5.1.4 Coordination

Provide electric strikes and actuators of a size, weight and profile compatible with each specified door frame. Field verify installation clearances prior to procurement.

2.2.5.1.5 Mounting Method

Provide electric strikes and actuators suitable for use with single and double doors, with mortise or rim type hardware specified, and for right or left hand mounting as specified. In double door installations, locate the lock in the active leaf and monitor the fixed leaf.

2.2.5.2 Electrified Mortise Locks

Provide in accordance with ANSI/BHMA A156.25, Grade 1. Provide electrified mortise locks that remain secure during power failure. Provide facility interface devices that use dc power to energize solenoids. Provide solenoids, resistors, and signal switches in accordance with paragraph ELECTRIC STRIKES AND FRAME MOUNTED ACTUATORS.

2.2.5.2.1 Power Transfer Hinges

Provide power transfer hinges with each electrified lock that route power and monitoring signals from the lockset to the door frame. Coordinate power transfer hinges with door frames.

2.2.5.3 GFGI Card Readers and Keypad Access Control Hardware

Card reader and keypad devices are provided and installed by the Government. Coordinate access control hardware, power and wiring, with corresponding key pad/card reader devices and systems being provided and installed by the Government (GFGI) by another contract to provide a complete and operational door locking system.

2.2.6 Keying System

Provide a construction master keying system.

The Contractor will provide permanent cylinders with cores and blank keys for mortise locksets, auxiliary locks, and exit devices. Provide cylinders of Grade 1 products from one manufacturer. Notify the Contracting Officer 90 days prior to the required delivery of the cylinders to the Base Locksmith. Provide temporary cores and keys for the Contractor's use during construction, and for testing of locksets.

2.2.7 Lock Trim

Provide cast, forged, or heavy wrought construction and commercial plain design for lock trim.

2.2.7.1 Lever Handles

Provide lever handles. Provide in accordance with ANSI/BHMA A156.3 for mortise locks of lever handles for exit devices. Provide lever handle locks with a breakaway feature (such as a weakened spindle or a shear key) to prevent irreparable damage to the lock when force in excess of that specified in ANSI/BHMA A156.13 is applied to the lever handle. Provide lever handles return to within 1/2 inch of the door face.

2.2.8 Keys

Provide one file key, one duplicate key, and one working key for each key change and for each master keying system. Provide one additional working key for each lock of each keyed-alike group. Provide 2 great grand master keys, 10 construction master keys, and 2 control keys for removable cores. Stamp each key with appropriate key control symbol and "U.S. property - do not duplicate." Do not place room number on keys.

2.2.9 Door Bolts

Provide in accordance with ANSI/BHMA A156.16. Provide dustproof strikes for bottom bolts, except at doors having metal thresholds. Provide automatic latching flush bolts in accordance with ANSI/BHMA A156.3, Type 25.

2.2.10 Closers

Provide in accordance with ANSI/BHMA A156.4, Series C02000, Grade 1, with PT 4C. Provide with brackets, arms, mounting devices, fasteners, full size covers, and other features necessary for the particular application. Size closers in accordance with manufacturer's printed recommendations, or provide multi-size closers, Sizes 1 through 6, and list sizes in the Hardware Schedule. Provide manufacturer's 10 year warranty.

Use stainless steel inside bracketed or door mounted closers on exterior doors. On interior doors use closers of 302 or 304 stainless steel or non-ferrous materials. On surface-mounted closers use or apply rust inhibiting finish on all ferrous parts. Also apply this finish on concealed closers.

2.2.10.1 Identification Marking

Engrave each closer with manufacturer's name or trademark, date of manufacture, and manufacturer's size designation in locations that will be visible after installation.

2.2.11 Overhead Holders

Provide in accordance with ANSI/BHMA A156.8.

2.2.12 Door Protection Plates

Provide in accordance with ANSI/BHMA A156.6.

2.2.12.1 Sizes of Kick Plates

2 inch less than door width for single doors; 1 inch less than door width for pairs of doors. Provide 10 inch kick plates for flush doors.

2.2.13 Door Stops and Silencers

Provide in accordance with ANSI/BHMA A156.16. Silencers Type L03011. Provide three silencers for each single door, two for each pair.

2.2.14 Thresholds

Provide in accordance with ANSI/BHMA A156.21. Use J35100, with vinyl or silicone rubber insert in face of stop, for exterior doors opening out, unless specified otherwise.

2.2.15 Weatherstripping Gasketing

Provide in accordance with ANSI/BHMA A156.22. Provide the type and function designation where specified in paragraph HARDWARE SCHEDULE. Provide a set to include head and jamb seals, sweep strips, and, for pairs of doors, astragals. Air leakage of weatherstripped doors not to exceed 1.25 cubic feet per minute of air per square foot of door area when tested in accordance with ASTM E283. Provide weatherstripping with one of the following:

2.2.15.1 Extruded Aluminum Retainers

Extruded aluminum retainers not less than 0.050 inch wall thickness with vinyl, neoprene, silicone rubber, or polyurethane inserts. Provide clear (natural) anodized aluminum.

2.2.15.2 Interlocking Type

Zinc or bronze not less than 0.018 inch thick.

2.2.15.3 Spring Tension Type

Spring bronze or stainless steel not less than 0.008 inch thick.

2.2.16 Soundproofing Gasketing

Provide in accordance with ANSI/BHMA A156.22. Provide adjustable doorstops at heads, jambs and automatic door bottoms in accordance with the hardware set, of extruded aluminum, clear (natural) anodized, surface applied, with vinyl fin seals between plunger and housing. Provide doorstops with solid neoprene tube, silicone rubber, or closed cell sponge gasket. Provide door bottoms with adjustable operating rod and silicone rubber or closed cell sponge neoprene gasket. Provide doorstops that are mitered at corners. Provide type and function designation where specified in paragraph HARDWARE SETS.

2.2.17 Auxiliary Hardware (Other than locks)

Provide in accordance with ANSI/BHMA A156.16, Grade 1.

2.2.18 Special Tools

Provide special tools, such as spanner and socket wrenches and dogging keys, as required to service and adjust hardware items.

2.3 FASTENERS

Provide fasteners of type, quality, size, and quantity appropriate to the specific application. Fastener finish to match hardware. Provide stainless steel or nonferrous metal fasteners in locations exposed to weather. Verify metals in contact with one another are compatible and will avoid galvanic corrosion when exposed to weather.

2.4 FINISHES

Provide in accordance with ANSI/BHMA A156.18. Provide hardware in BHMA 630 finish (satin stainless steel), unless specified otherwise. Provide items not manufactured in stainless steel in BHMA 626 finish (satin chromium plated) over brass or bronze, except aluminum paint finish for surface door closers, and except BHMA 652 finish (satin chromium plated) for steel hinges. Provide hinges for exterior doors in stainless steel with BHMA 630 finish. Furnish exit devices in BHMA 626 finish in lieu of BHMA 630 finish except where BHMA 630 is specified under paragraph HARDWARE SETS. Match exposed parts of concealed closers to lock and door trim. Match hardware finish for aluminum doors to the doors.

2.5 KEY CABINET AND CONTROL SYSTEM

Provide in accordance with ANSI/BHMA A156.5, Type required to yield a capacity (number of hooks) 50 percent greater than the number of key changes used for door locks.

PART 3 EXECUTION

3.1 INSTALLATION

Provide hardware in accordance with manufacturers' printed installation instructions. Fasten hardware to wood surfaces with full-threaded wood screws or sheet metal screws. Provide machine screws set in expansion

shields for fastening hardware to solid concrete and masonry surfaces. Provide toggle bolts where required for fastening to hollow core construction. Provide through bolts where necessary for satisfactory installation.

3.1.1 Weatherstripping Installation

Provide full contact, weathertight seals that allow operation of doors without binding the weatherstripping.

3.1.1.1 Stop Applied Weatherstripping

Fasten in place with color matched sheet metal screws not more than 9 inch on center after doors and frames have been finish painted.

3.1.1.2 Interlocking Type Weatherstripping

Provide interlocking, self adjusting type on heads and jambs and flexible hook type at sills. Nail weatherstripping to door 1 inch on center and to heads and jambs at 4 inch on center.

3.1.1.3 Spring Tension Type Weatherstripping

Provide spring tension type on heads and jambs. Provide bronze nails with bronze. Provide stainless steel nails with stainless steel. Space nails not more than 1-1/2 inch on center.

3.1.2 Soundproofing Installation

Provide as specified for stop applied weatherstripping.

3.1.3 Threshold Installation

Extend thresholds the full width of the opening and notch end for jamb stops. Set thresholds in a full bed of sealant and anchor to floor with cadmium-plated, countersunk, steel screws in expansion sleeves. For aluminum thresholds placed on top of concrete surfaces, coat the underside surfaces that are in contact with the concrete with fluid applied waterproofing as a separation measure prior to placement.

3.2 HARDWARE LOCATIONS

Provide in accordance with SDI/DOOR A250.8, unless indicated or specified otherwise.

- a. Kick and Armor Plates: Push side of single-acting doors. Both sides of double-acting doors.
- b. Mop Plates: Bottom flush with bottom of door.

3.3 KEY CABINET AND CONTROL SYSTEM

Locate where directed. Tag one set of file keys and one set of duplicate keys. Place other keys in appropriately marked envelopes, or tag each key. Provide complete instructions for setup and use of key control system. On tags and envelopes, indicate door and room numbers or master or grand master key.

3.4 FIELD QUALITY CONTROL

After installation, protect hardware from paint, stains, blemishes, and other damage until acceptance of work. Submit notice of testing 15 days before scheduled, so that testing can be witnessed by the Contracting Officer. Adjust hinges, locks, latches, bolts, holders, closers, and other items to operate properly. Demonstrate that permanent keys operate respective locks, and give keys to the Contracting Officer. Correct, repair, and finish, errors in cutting and fitting and damage to adjoining work.

3.5 HARDWARE SETS

See Hardware Sets at end of this Section.

-- End of Section --

This page left blank.

Hardware Set: 01

Opening#
100B

Quantity	Heading	Description	Finish	Manufacturer	ANSI
6	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
2	Exit Devices	Grade 1, Type 08, F03	630		
2	Pulls	Equal to YKK Smart Series	630		
2	Closers	C02021 Surface	689		
1 Set	Weatherstripping	R3Y164 x Insert, Equal to Pemko 303AV	719		
1	Astragal	ROD435, Equal to Pemko 351V			
1	Door Bottom	ROD435, Equal to Pemko 345A			
1	Threshold	Panic J36130 x Insert	719		
1	Stop	Floor L02141 or Wall L02251	626 or 630		
1	Card Reader	Card Reader		By Security Contractor	
1	Power Supply	12 or 24v dcx Amperage as Required for Load		By Hardware Supplier	
1	Power Transfer	Equal to Von Duprin EPT10			
1	Rain Drip	R3Y036 x Opening Width + 4 inches	MIL		
1	Cylinder	7-Pin Rim or Mortise Cylinder Housing	Match Door Hardware		
1	Core	IC7 Best Coremax Combined Core			

General Comments: HARDWARE PROVIDED MUST MEET WINDLOAD/IMPACT AND AT/FP REQUIREMENTS FOR THIS PROJECT.

Operating Comments:

1 Provide exit devices with motorized retraction.

2 Using authorized credential retracts exit device latch bolt. Exit switch (REX) monitors bar position, latch position switch monitors latch bolt or deadlocking actuator position, Latch bolt retraction may be energized for extended periods via programming of software for this purpose. Hardware to be fail secure (electrically unlocked).

Hardware Set: 02

Opening#
100C

Quantity	Heading	Description	Finish	Manufacturer	ANSI
6	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
2	Exit Devices	Grade 1, Type 3, F01 No Outside Trim	630		
2	Closers	C02021 Surface	689		
1 Set	Weatherstripping	R3Y164 x Insert	719		
1	Astragal	ROD435, Equal to Pemko 351V			
1	Door Bottom	ROD435, Equal to Pemko 345A			
1	Rain Drip	R3Y036 x Opening Width + 4 inches	MIL		
1	Threshold	Panic J36130 x Insert	719		
1	Exit Alarm	A156.29 Equal to Detex EAX500			

General Comments: HARDWARE PROVIDED MUST MEET WINDLOAD/IMPACT AND AT/FP REQUIREMENTS FOR THIS PROJECT.

Operating Comments:

1 Exit only, no outside trim. Local alarm

Hardware Set: 03

Opening#
101

Quantity	Heading	Description	Finish	Manufacturer	ANSI
3	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
1	Lockset	Mortise Set F05 Classroom Lock	630		
1	Core	IC7 Best Coremax Combined Core	626		
2	Kickplates	J102.05 B4E CSK 10" x 34"	US32D		
1	Wallstop	L02251			

General Comments:

Operating Comments:

Hardware Set: 04

Opening#

102, 106B, 107B, 108B, 111B

Quantity	Heading	Description	Finish	Manufacturer	ANSI
3	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
1	Exit Devices	Grade 1, Type 3, F01 No Outside Trim	630		
1	Closers	C02021 Surface	689		
1 Set	Weatherstripping	R3Y164 x Insert	719		
1	Door Bottom	ROD435, Equal to Pemko 345A			
1	Rain Drip	R3Y036 x Opening Width + 4 inches	MIL		
1	Threshold	Panic J36130 x Insert	719		
1	Hold Open	L01382 (only at Door 102)	US32D		

General Comments: HARDWARE PROVIDED MUST MEET WINDLOAD/IMPACT AND AT/FP REQUIREMENTS FOR THIS PROJECT.

Operating Comments:

Hardware Set: 05

Opening#
103

Quantity	Heading	Description	Finish	Manufacturer	ANSI
3	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
1	Closers	C02021 Surface	639		
1 Set	Weatherstripping	R3Y164 x Insert	719		
1	Door Bottom	ROD435, Equal to Pemko 345A			
1	Rain Drip	R3Y036 x Opening Width + 4 inches	MIL		
1	Threshold	Panic J36130 x Insert	719		
1	Hold Open	L01382 (only at Door 102)	US32D		
1	Lockset	Mortise Set F02 Privacy Lock	630		
1	Core	IC7 Best Coremax Combined Core			

General Comments: HARDWARE PROVIDED MUST MEET WINDLOAD/IMPACT AND AT/FP REQUIREMENTS FOR THIS PROJECT.

Operating Comments:

Hardware Set: 06

Opening#
104

Quantity	Heading	Description	Finish	Manufacturer	ANSI
3	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
1	Lockset	Mortise Set F07 Storeroom Lock	630		
1	Core	IC7 Best Coremax Combined Core	626		
1	Stop	L02251			
1	Closer	C02021 Surface	639		
1 Set	Gasketing	ROD165, Equal to Pemko 303AV	719		
1	Door Bottom	ROD435, Equal to Pemko 345A			
2	Kickplate	J102.05 B45 ESK 10" x 34"	US32D		

General Comments:

Operating Comments:

Hardware Set: 07

Opening#

105A, 105B, 105C, 105D

Quantity	Heading	Description	Finish	Manufacturer	ANSI
3	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
1	Lockset	Bored F76 Privacy Set	630		
1	Stop	L02251			

General Comments:

Operating Comments:

Hardware Set: 08

Opening#

106A, 107A, 108A, 109

Quantity	Heading	Description	Finish	Manufacturer	ANSI
3	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
1	Lockset	Mortise Set F05	630		
1	Core	IC7 Best Coremax Combined Core	626		
1	Closer	C02021 Surface	639		
1	Electric Strike	ANSI A156.31 Grade 1 (SDC 55 Series or Equal)	630		
1	Door Position Switch	Balanced Magnetic Switch		By Security Contractor	
1	Card Reader	Card Reader		By Security Contractor	
1	Power Supply	12 or 24v dcx Amperage as Required for Load		By Hardware Supplier	
1	Power Transfer	Equal to Von Duprin EPT10			
1	Stop	L02251			

General Comments:

Operating Comments:

1 Using authorized credentials releases electronic strike. Electric strike to be fail safe (electrically unlocked). Provide temperature control module if recommended by hardware manufacturer.

Hardware Set: 09

Opening#
Not Used

Hardware Set: 10

Opening#

110

Quantity	Heading	Description	Finish	Manufacturer	ANSI
3	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
1	Lockset	Mortise Set F07 Storeroom Lock	630		
1	Core	IC7 Best Coremax Combined Core	626		
1	Closer	C02021 Surface	639		
1	Stop	L02251	MIL		
1	Rain Drip	R3Y036 x Opening Width + 4 inches			
1	Door Bottom	ROD 435, Equal to Pemko 345A			
1 Set	Weatherstripping	ROY 164 x insert equal to Pemko 303AV	719		
1	Threshold	J32330 x LAR	719		

General Comments:

Operating Comments:

Hardware Set: 11

Opening#
111A

Quantity	Heading	Description	Finish	Manufacturer	ANSI
3	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
1	Exit Devices	Grade 1, Type 08, F04	630		
1	Closer	C02021 Surface	639		
1	Stop	Floor L02141 or Wall L02251			

General Comments:

Operating Comments:

Hardware Set: 12

Opening#

112

Quantity	Heading	Description	Finish	Manufacturer	ANSI
6	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
1	Lockset	Mortise Set F07 Storeroom Lock	630		
1	Dummy Trim	Match Lockset			
1	Flushbolt	L04081			
1	Rain Drip	R3Y036 x Opening Width + 4 inches	MIL		
1	Astragal	ROD435, Equal to Pemko 351V			
1	Door Bottom	ROD435, Equal to Pemko 345A			
1 Set	Weatherstripping	R3Y164 x Insert	719		
1	Threshold	Saddle J32330 x LAR	719		

General Comments: HARDWARE PROVIDED MUST MEET WINDLOAD/IMPACT AND AT/FP REQUIREMENTS FOR THIS PROJECT.

Operating Comments:

Hardware Set: 13

Opening#
113A

Quantity	Heading	Description	Finish	Manufacturer	ANSI
6	Hinges	A5111 4-1/2" x 4-1/2" x NRP	US32D		
1	Lockset	Mortise Set F07 Storeroom Lock	630		
1	Dummy Trim	Match Lockset			
1	Flushbolt	L04081			

General Comments:

Operating Comments:

This page left blank.

SECTION 08 81 00

GLAZING

08/11

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI Z97.1 (2009; Errata 2010) Safety Glazing Materials Used in Buildings - Safety Performance Specifications and Methods of Test

ASTM INTERNATIONAL (ASTM)

ASTM C1036 (2010e1) Standard Specification for Flat Glass

ASTM C1048 (2012; E 2012) Standard Specification for Heat-Treated Flat Glass - Kind HS, Kind FT Coated and Uncoated Glass

ASTM C1172 (2009e1) Standard Specification for Laminated Architectural Flat Glass

ASTM C1184 (2005) Standard Specification for Structural Silicone Sealants

ASTM C509 (2006; R 2011) Elastomeric Cellular Preformed Gasket and Sealing Material

ASTM C864 (2005; R 2011) Dense Elastomeric Compression Seal Gaskets, Setting Blocks, and Spacers

ASTM C920 (2014a) Standard Specification for Elastomeric Joint Sealants

ASTM D2287 (2012) Nonrigid Vinyl Chloride Polymer and Copolymer Molding and Extrusion Compounds

ASTM D395 (2003; R 2008) Standard Test Methods for Rubber Property - Compression Set

ASTM E1300 (2012a; E 2012) Determining Load Resistance of Glass in Buildings

GLASS ASSOCIATION OF NORTH AMERICA (GANA)

GANA Glazing Manual (2004) Glazing Manual

GANA Sealant Manual	(2008) Sealant Manual
GANA Standards Manual	(2008) Engineering Standards Manual
INSULATING GLASS MANUFACTURERS ALLIANCE (IGMA)	
IGMA TB-3001	(1990) Guidelines for Sloped Glazing
IGMA TM-3000	(1997) Glazing Guidelines for Sealed Insulating Glass Units
IGMA TR-1200	(1983) Commercial Insulating Glass Dimensional Tolerances
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA)	
Energy Star	(1992; R 2006) Energy Star Energy Efficiency Labeling System (FEMP)
U.S. GREEN BUILDING COUNCIL (USGBC)	
LEED NC	(2009) Leadership in Energy and Environmental Design(tm) New Construction Rating System
U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)	
16 CFR 1201	Safety Standard for Architectural Glazing Materials

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. The following shall be submitted in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Installation; G

Drawings showing complete details of the proposed setting methods, mullion details, edge blocking, size of openings, frame details, materials, and types and thickness of glass.

SD-03 Product Data

Insulating Glass; G

Documentation for Energy Star qualifications and compliance with specification requirements.

Glazing Accessories

Manufacturer's descriptive product data, handling and storage recommendations, installation instructions, and cleaning instructions.

Local/Regional Materials; (LEED NC)

Documentation indicating distance between manufacturing facility and the project site. Indicate distance of raw material origin from the project site. Indicate relative dollar value of local/regional materials to total dollar value of products included in project.

SD-04 Samples

Insulating Glass; G
Glazing Compound
Glazing Tape
Sealant; G

Two 8 by 10 inch samples of each of the following: tinted glass, reflective glass, and insulating glass units.

Three samples of each indicated material.

SD-07 Certificates

Insulating Glass

Certificates stating that the glass meets the specified requirements. Labels or manufacturers marking affixed to the glass will be accepted in lieu of certificates.

Glazing Accessories

Certificates from the manufacturer attesting that the units meet the luminous and solar radiant transmission requirements for heat absorbing glass.

SD-08 Manufacturer's Instructions

Setting and sealing materials
Glass setting

Submit glass manufacturer's recommendations for setting and sealing materials and for installation of each type of glazing material specified.

1.3 SYSTEM DESCRIPTION

Glazing systems shall be fabricated and installed watertight and airtight to withstand thermal movement and wind loading without glass breakage, gasket failure, deterioration of glazing accessories, and defects in the work. Glazed panels shall comply with the safety standards, as indicated in accordance with ANSI Z97.1. Glazed panels shall comply with indicated wind/snow loading in accordance with ASTM E1300. Glazing in exterior door assemblies shall comply with ATFP (UFC 4-010-01, 9 Feb 2012 and Change 1, 1 Oct 2013) required in Section 08 11 16.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver products to the site in unopened containers, labeled plainly with manufacturers' names and brands. Store glass and setting materials in safe, enclosed dry locations and do not unpack until needed for installation. Handle and install materials in a manner that will protect them from damage.

1.5 ENVIRONMENTAL REQUIREMENTS

Do not start glazing work until the outdoor temperature is above 40 degrees F and rising, unless procedures recommended by the glass manufacturer and approved by the Contracting Officer are made to warm the glass and rabbet surfaces. Provide ventilation to prevent condensation of moisture on glazing work during installation. Do not perform glazing work during damp or rainy weather.

1.6 SUSTAINABLE DESIGN REQUIREMENTS

1.6.1 Local/Regional Materials

See Section 01 33 29 LEED(tm) DOCUMENTATION for cumulative total local material requirements. Glazing materials may be locally available.

1.7 WARRANTY

1.7.1 Warranty for Insulating Glass Units

Warranty insulating glass units against development of material obstruction to vision (such as dust, fogging, or film formation on the inner glass surfaces) caused by failure of the hermetic seal, other than through glass breakage, for a 10-year period following acceptance of the work. Provide new units for any units failing to comply with terms of this warranty within 45 working days after receipt of notice from the Government.

1.7.2 Monolithic Opacified Laminated Glass

Manufacturer shall warrant the opacifier film on the spandrel to be free of peeling for a period of five years after Date of Substantial Completion. Warranty shall be signed by manufacturer.

PART 2 PRODUCTS

2.1 GLASS

ASTM C1036, unless specified otherwise. In doors and sidelights, provide safety glazing material conforming to 16 CFR 1201.

2.1.1 Annealed Glass

Annealed glass shall be Type I transparent flat type, Class 1 - clear, Quality q3 - glazing select, conforming to ASTM C1036.

2.1.2 Laminated Glass

ASTM C1172, Kind LA fabricated from two nominal 1/8 inch pieces of Type I, Class 1, Quality q3, flat annealed transparent glass conforming to ASTM C1036. Flat glass shall be laminated together with a minimum of

0.030 inchthick, clear polyvinyl butyral interlayer.

2.1.3 Mirrors

2.1.3.1 Glass Mirrors

Glass for mirrors shall be Type I transparent flat type, Class 1-clear, Glazing Quality q1 1/4 inch thick conforming to ASTM C1036. Glass shall be coated on one surface with silver coating, copper protective coating, and mirror backing paint. Silver coating shall be highly adhesive pure silver coating of a thickness which shall provide reflectivity of 83 percent or more of incident light when viewed through 1/4 inch thick glass, and shall be free of pinholes or other defects. Copper protective coating shall be pure bright reflective copper, homogeneous without sludge, pinholes or other defects, and shall be of proper thickness to prevent "adhesion pull" by mirror backing paint. Mirror backing paint shall consist of two coats of special scratch and abrasion-resistant paint, and shall be baked in uniform thickness to provide a protection for silver and copper coatings which will permit normal cutting and edge fabrication.

2.1.4 Ceramic-Opacified Spandrel Glass

Ceramic-opacified spandrel glass shall be Kind HS heat-strengthened pransparnet flat type, Condition B, coated with a colored ceramic material on No. 2 surface, Quality q3 - glazing select, 1/4 inch thick, conforming toASTM C1048. Color shall be gray. Spandrel glass shall be part of the inner light of an insulating glass unit with the color ceramic material applied to the #4 surface of the inner laminated glass unit. Refer to insulating glass unit specifications for same performance and quality requirements.

2.1.5 Heat-Strengthened Glass

ASTM C1048, Kind HS (heat strengthened), Condition A (uncoated), Type I, Class 1 (clear) interior and 2 (tinted heat absorbing) exterior, Quality q3, 1/4 inch thick.

2.1.6 Tempered Glass

ASTM C1048, Kind FT (fully tempered), Condition A (uncoated), Type I, Class 1 (transparent) or 2 (tinted heat absorbing), Quality q3, 1/4 inch thick, conforming to ASTM C1048 and GANA Standards Manual. Color must be as indicated in Section 09 06 90.

2.2 INSULATING GLASS UNITS

2.2.1 Insulating Glass Units (Low-E, Laminated)

Two panes of glass separated by a dehydrated airspace, filled with argon gas and hermetically sealed.

Insulated glass units shall have a Solar Heat Gain Coefficient (SHGC) maximum of 0.26 and a U-factor maximum of 0.29 (winter)/0.26 (summer) Btu per square foot by hr by degree F. Visible Transmittance (TVIS) of 0.40 or less.

Exterior door glass shall meet Impact criteria.

Dimensional tolerances shall be as specified in IGMA TR-1200. Spacer shall be black, roll-formed, thermally broken aluminum, with bent or tightly welded or keyed and sealed joints to completely seal the spacer periphery and eliminate moisture and hydrocarbon vapor transmission into airspace through the corners. Primary seal shall be compressed polyisobutylene and the secondary seal shall be a specially formulated silicone.

The inner light shall be ASTM C1172, kind LA fabricated from nominal 1/4 inch thick pieces of Type I, Class I, Quality q3 flat annealed transparent glass conforming to ASTM C1036 with a minimum 0.030 inch thick polyvinyl butyral interlayer. The outer light shall be ASTM C1048, Kind FT (fully tempered) Type I, Class 2 (tinted gray) with low-e coating on #2 surface, Quality q4, 1/4 inch thick.

2.3 SETTING AND SEALING MATERIALS

Provide as specified in the GANA Glazing Manual, IGMA TM-3000, IGMA TB-3001, and manufacturer's recommendations, unless specified otherwise herein. Do not use metal sash putty, nonskinning compounds, nonresilient preformed sealers, or impregnated preformed gaskets. Materials exposed to view and unpainted shall be gray or neutral color. Exterior glazing unit and frame assembly and materials shall meet ATFP (UFC 4-010-01) and Large Missile Impact Test Criteria required in Section 08 11 16.

2.3.1 Putty and Glazing Compound

Glazing compound shall be as recommended by manufacturer for face-glazing metal sash. Putty and glazing compounds shall not be used with insulating glass or laminated glass.

2.3.2 Glazing Compound

Use for face glazing metal sash. Do not use with insulating glass units or laminated glass.

2.3.3 Sealants

Provide elastomeric and structural sealants (as required to meet wind, impact and ATFP criteria).

2.3.3.1 Elastomeric Sealant

ASTM C920, Type S, Grade NS, Class 12.5, Use G. Use for channel or stop glazing metal sash. Sealant shall be chemically compatible with setting blocks, edge blocks, and sealing tapes, with sealants used in manufacture of insulating glass units. Color of sealant shall be white.

2.3.3.2 Structural Sealant

ASTM C1184, Type S.

2.3.4 Joint Backer

Joint backer shall have a diameter size at least 25 percent larger than joint width; type and material as recommended in writing by glass and sealant manufacturer.

2.3.5 Preformed Channels

Neoprene, vinyl, or rubber, as recommended by the glass manufacturer for the particular condition.

2.3.6 Sealing Tapes

Preformed, semisolid, PVC-based material of proper size and compressibility for the particular condition, complying with ASTM D2287. Use only where glazing rabbet is designed for tape and tape is recommended by the glass or sealant manufacturer. Provide spacer shims for use with compressible tapes. Tapes shall be chemically compatible with the product being set.

2.3.7 Setting Blocks and Edge Blocks

Closed-cell neoprene setting blocks shall be dense extruded type conforming to ASTM C509 and ASTM D395, Method B, Shore A durometer between 70 and 90. Edge blocking shall be Shore A durometer of 50 (plus or minus 5). Silicone setting blocks shall be required when blocks are in contact with silicone sealant. Profiles, lengths and locations shall be as required and recommended in writing by glass manufacturer. Block color shall be black.

2.3.8 Glazing Gaskets

Glazing gaskets shall be extruded with continuous integral locking projection designed to engage into metal glass holding members to provide a watertight seal during dynamic loading, building movements and thermal movements. Glazing gaskets for a single glazed opening shall be continuous one-piece units with factory-fabricated injection-molded corners free of flashing and burrs. Glazing gaskets shall be in lengths or units recommended by manufacturer to ensure against pull-back at corners. Glazing gasket profiles shall be as indicated on drawings.

2.3.8.1 Fixed Glazing Gaskets

Fixed glazing gaskets shall be closed-cell (sponge) smooth extruded compression gaskets of cured elastomeric virgin neoprene compounds conforming to ASTM C509, Type 2, Option 1.

2.3.8.2 Wedge Glazing Gaskets

Wedge glazing gaskets shall be high-quality extrusions of cured elastomeric virgin neoprene compounds, ozone resistant, conforming to ASTM C864, Option 1, Shore A durometer between 65 and 75.

2.3.8.3 Aluminum Framing Glazing Gaskets

Glazing gaskets for aluminum framing shall be permanent, elastic, non-shrinking, non-migrating, watertight and weathertight.

2.3.9 Accessories

Provide as required for a complete installation, including glazing points, clips, shims, angles, beads, and spacer strips. Provide noncorroding metal accessories. Provide primer-sealers and cleaners as recommended by the glass and sealant manufacturers.

2.4 MIRROR ACCESSORIES

2.4.1 Mastic

Mastic for setting mirrors shall be a polymer type mirror mastic resistant to water, shock, cracking, vibration and thermal expansion. Mastic shall be compatible with mirror backing paint, and shall be approved by mirror manufacturer.

2.4.2 Mirror Frames

Mirrors shall be provided with mirror frames (J-mold channels) fabricated of one-piece roll-formed Type 304 stainless steel with No. 4 brushed satin finish and concealed fasteners which will keep mirrors snug to wall. Frames shall be 1-1/4 by 1/4 by 1/4 inch continuous at top and bottom of mirrors. Concealed fasteners of type to suit wall construction material shall be provided with mirror frames.

2.4.3 Mirror Clips

Concealed fasteners of type to suit wall construction material shall be provided with clips.

PART 3 EXECUTION

3.1 PREPARATION

Preparation, unless otherwise specified or approved, shall conform to applicable recommendations in the GANA Glazing Manual, GANA Sealant Manual, IGMA TB-3001, IGMA TM-3000, and manufacturer's recommendations. Determine the sizes to provide the required edge clearances by measuring the actual opening to receive the glass. Grind smooth in the shop glass edges that will be exposed in finish work. Leave labels in place until the installation is approved, except remove applied labels on heat-absorbing glass and on insulating glass units as soon as glass is installed. Securely fix movable items or keep in a closed and locked position until glazing compound has thoroughly set.

3.2 GLASS SETTING

Shop glaze or field glaze items to be glazed using glass of the quality and thickness specified or indicated. Glazing, unless otherwise specified or approved, shall conform to applicable recommendations in the GANA Glazing Manual, GANA Sealant Manual, IGMA TB-3001, IGMA TM-3000, and manufacturer's recommendations. Aluminum windows, wood doors, and wood windows may be glazed in conformance with one of the glazing methods described in the standards under which they are produced, except that face puttying with no bedding will not be permitted. Handle and install glazing materials in accordance with manufacturer's instructions. Use beads or stops which are furnished with items to be glazed to secure the glass in place. Verify products are properly installed, connected, and adjusted.

3.2.1 Sheet Glass

Cut and set with the visible lines or waves horizontal.

3.2.2 Insulating Glass Units

Do not grind, nip, or cut edges or corners of units after the units have left the factory. Springing, forcing, or twisting of units during setting will not be permitted. Handle units so as not to strike frames or other objects. Installation shall conform to applicable recommendations of IGMA TB-3001 and IGMA TM-3000.

3.2.3 Installation of Laminated Glass

Sashes which are to receive laminated glass shall be weeped to the outside to allow water drainage into the channel.

3.3 CLEANING

Clean glass surfaces and remove labels, paint spots, putty, and other defacement as required to prevent staining. Glass shall be clean at the time the work is accepted.

3.4 PROTECTION

Glass work shall be protected immediately after installation. Glazed openings shall be identified with suitable warning tapes, cloth or paper flags, attached with non-staining adhesives. Reflective glass shall be protected with a protective material to eliminate any contamination of the reflective coating. Protective material shall be placed far enough away from the coated glass to allow air to circulate to reduce heat buildup and moisture accumulation on the glass. Upon removal, separate protective materials for reuse or recycling. Glass units which are broken, chipped, cracked, abraded, or otherwise damaged during construction activities shall be removed and replaced with new units.

3.5 WASTE MANAGEMENT

Disposal and recycling of waste materials, including corrugated cardboard recycling, shall be in accordance with the Waste Management Plan. Close and seal tightly all partly used sealant containers and store protected in well-ventilated, fire-safe area at moderate temperature.

-- End of Section --

This page left blank.

SECTION 08 91 00

METAL WALL LOUVERS

08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AIR MOVEMENT AND CONTROL ASSOCIATION INTERNATIONAL, INC. (AMCA)

AMCA 500-L (2015) Laboratory Methods of Testing Louvers for Rating

AMCA 511 (2010; R 2016) Certified Ratings Program for Air Control Devices

ALUMINUM ASSOCIATION (AA)

AA DAF45 (2003; Reaffirmed 2009) Designation System for Aluminum Finishes

AMERICAN ARCHITECTURAL MANUFACTURERS ASSOCIATION (AAMA)

AAMA 611 (2014) Voluntary Specification for Anodized Architectural Aluminum

ASTM INTERNATIONAL (ASTM)

ASTM A653/A653M (2023) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process

ASTM A1008/A1008M (2021a) Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable

ASTM B209 (2014) Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate

ASTM B209M (2014) Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate (Metric)

ASTM B221 (2021) Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes

ASTM B221M (2021) Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric)

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Wall Louvers

SD-03 Product Data

Metal Wall Louvers

SD-04 Samples

Wall Louver Samples; G

1.3 DELIVERY, STORAGE, AND PROTECTION

Deliver materials to the site in an undamaged condition. Carefully store materials off the ground to provide proper ventilation, drainage, and protection against dampness. Louvers must be free from nicks, scratches, and blemishes. Replace defective or damaged materials with new.

1.4 DETAIL DRAWINGS

Show all information necessary for fabrication and installation of wall louvers. Indicate materials, sizes, thicknesses, fastenings, and profiles.

1.5 COLOR SAMPLES

Colors of finishes for wall louver samples must closely approximate colors indicated. Where color is not indicated, submit the manufacturer's standard colors to the Contracting Officer for selection.

PART 2 PRODUCTS

2.1 MATERIALS

2.1.1 Galvanized Steel Sheet

ASTM A653/A653M, coating designation G90.

2.1.2 Aluminum Sheet

ASTM B209, alloy 3003 or 5005 with temper as required for forming.

2.1.3 Extruded Aluminum

ASTM B221, alloy 6063-T5 or -T52.

2.1.4 Stainless Steel

Type 302 or 304, with 2B finish.

2.1.5 Cold Rolled Steel Sheet

ASTM A1008/A1008M, Class 1, with matte finish. Use for interior louvers only.

2.2 METAL WALL LOUVERS

Wind driven rain resistant type, with bird screens and made to withstand a wind load of pounds per square foot as indicated on the Structural drawings. Wall louvers must bear the AMCA certified ratings program seal for air performance and water penetration in accordance with AMCA 500-L and AMCA 511. The rating must show a water penetration of 0.20 or less ounce per square foot of free area at a free velocity of 800 feet per minute.

2.2.1 Extruded Aluminum Louvers

Fabricated of extruded 6063-T5 or -T52 aluminum with a wall thickness of not less than 0.081 inch.

2.2.2 Mullions and Mullion Covers

Same material and finish as louvers. Provide mullions for all louvers more than 5 feet in width at not more than 5 feet on centers. Provide mullion covers on both faces of joints between louvers.

2.2.3 Screens and Frames

For aluminum louvers, provide 1/2 inch square mesh, 14 or 16 gage aluminum or 1/4 inch square mesh, 16 gage aluminum bird screening. Mount screens in removable, rewirable frames of same material and finish as the louvers.

2.3 FASTENERS AND ACCESSORIES

Provide stainless steel screws and fasteners for aluminum louvers and zinc-coated or stainless steel screws and fasteners for steel louvers. Provide other accessories as required for complete and proper installation.

2.4 FINISHES

2.4.1 Aluminum

Exposed aluminum surfaces must be factory finished with an anodic coating. Color must be as indicated.

2.4.1.1 Anodic Coating

Clean exposed aluminum surfaces and provide an anodized finish conforming to AA DAF45 and AAMA 611. Finish must be:

- a. Architectural Class I (0.7 mil or thicker), designation AA-M10-C22-A42, integral color anodized.

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 Wall Louvers

Install using stops or moldings, flanges, strap anchors, or jamb fasteners as appropriate for the wall construction and in accordance with manufacturer's recommendations.

3.1.2 Door Louvers

Install louvers in wood doors by using metal "Z" or "L" moldings. Fasten moldings to door with screws.

3.1.3 Screens and Frames

Attach frames to louvers with screws or bolts.

3.2 PROTECTION FROM CONTACT OF DISSIMILAR MATERIALS

3.2.1 Copper or Copper-Bearing Alloys

Paint copper or copper-bearing alloys in contact with dissimilar metal with heavy-bodied bituminous paint or separate with inert membrane.

3.2.2 Aluminum

Where aluminum contacts metal other than zinc, paint the dissimilar metal with a primer and two coats of aluminum paint.

3.2.3 Metal

Paint metal in contact with mortar, concrete, or other masonry materials with alkali-resistant coatings such as heavy-bodied bituminous paint.

3.2.4 Wood

Paint wood or other absorptive materials that may become repeatedly wet and in contact with metal with two coats of aluminum paint or a coat of heavy-bodied bituminous paint.

-- End of Section --

SECTION 09 22 00

SUPPORTS FOR PLASTER AND GYPSUM BOARD

02/10

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM A463/A463M	(2010; R 2015) Standard Specification for Steel Sheet, Aluminum-Coated, by the Hot-Dip Process
ASTM A653/A653M	(2020) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM C645	(2014; E 2015) Nonstructural Steel Framing Members
ASTM C754	(2018) Standard Specification for Installation of Steel Framing Members to Receive Screw-Attached Gypsum Panel Products
ASTM C1629/C1629M	(2023) Standard Classification for Abuse-Resistant Nondecorated Interior Gypsum Panel Products and Fiber-Reinforced Cement Panels

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Metal Support Systems

Submit for the erection of metal framing,. Indicate materials, sizes, thicknesses, and fastenings.

SD-03 Product Data

Metal Support Systems

Recycled Content For Metal Support Systems

1.3 DELIVERY, STORAGE, AND HANDLING

Deliver materials to the job site and store in ventilated dry locations permitting easy access for inspection and handling. If materials are stored outdoors, stack materials off the ground, supported on a level platform, and fully protected from the weather. Handle materials carefully to prevent damage. Remove damaged items and provide new items.

PART 2 PRODUCTS

2.1 MATERIALS

Provide steel materials for metal support systems with galvanized coating ASTM A653/A653M, G-60; aluminum coating ASTM A463/A463M, T1-25; or a 55-percent aluminum-zinc coating.

Provide metal support systems containing a minimum of 20 percent recycled content. Provide data identifying percentage of recycled content for metal support systems.

2.1.1 Materials for Attachment of Gypsum Wallboard

2.1.1.1 Nonload-Bearing Wall Framing and Furring

ASTM C645, but not thinner than 0.0329 inch minimum thickness security wall framing studs and tracks shall be 16 gauge thickness.

2.1.1.2 Nonload-Bearing Wall Framing of Abuse Resistant Gypsum Wallboard

ASTM C1629/C1629M.

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 Systems for Attachment of Gypsum Wallboard

3.1.1.1 Suspended and Furred Ceiling Systems

ASTM C754, except provide framing members 16 inches o.c. unless indicated otherwise.

3.1.1.2 Non-loadbearing Wall Framing and Furring

ASTM C754, except as indicated otherwise.

3.1.1.3 UL Fire-Rated Assemblies

Provide UL rated tested assembly for top of wall conditions for interior fire-rated and STC rated metal stud and gypsum board wall assemblies.

3.2 ERECTION TOLERANCES

Provide framing members which will be covered by finish materials such as wallboard, plaster, or ceramic tile set in a mortar setting bed, within the following limits:

- a. Layout of walls and partitions: 1/4 inch from intended position;

- b. Plates and runners: 1/4 inch in 8 feet from a straight line;
- c. Studs: 1/4 inch in 8 feet out of plumb, not cumulative; and
- d. Face of framing members: 1/4 inch in 8 feet from a true plane.

Provide framing members which will be covered by ceramic tile set in dry-set mortar, latex-portland cement mortar, or organic adhesive within the following limits:

- a. Layout of walls and partitions: 1/4 inch from intended position;
- b. Plates and runners: 1/8 inch in 8 feet from a straight line;
- c. Studs: 1/8 inch in 8 feet out of plumb, not cumulative; and
- d. Face of framing members: 1/8 inch in 8 feet from a true plane.

-- End of Section --

This page left blank.

SECTION 09 24 23

STUCCO
05/09

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM A1064/A1064M	(2015) Standard Specification for Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete
ASTM A653/A653M	(2015; E 2016) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM C1063	(2014c) Standard Practice for Installation of Lathing and Furring to Receive Interior and Exterior Portland Cement-Based Plaster
ASTM C150/C150M	(2015) Standard Specification for Portland Cement
ASTM C206	(2003; R 2009) Standard Specification for Finishing Hydrated Lime
ASTM C841	(2003; R 2013) Installation of Interior Lathing and Furring
ASTM C847	(2014) Standard Specification for Metal Lath
ASTM C897	(2005; R 2009) Aggregate for Job-Mixed Portland Cement-Based Plasters
ASTM C926	(2014a) Application of Portland Cement-Based Plaster
ASTM D1784	(2011) Standard Specification for Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation

identifies the office that will review the submittal for the Government.
Submit the following in accordance with Section 01 33 00 SUBMITTAL
PROCEDURES:

SD-02 Shop Drawings

Lath

SD-03 Product Data

Proportions and Mixing

SD-04 Samples

Colored Stucco Finish Coat
Sample Panel

SD-11 Closeout Submittals

LEED Documentation

1.3 QUALITY ASSURANCE

Submit a SAMPLE PANEL as follows: A sample panel of stucco, constructed at the jobsite, and located as directed, to demonstrate installation procedures, texture and color, prior to proceeding with any stucco work; panel size shall be a minimum of 4 feet wide x 8 feet high; containing each type accessory proposed for use and constructed in the vertical position. Sample panel shall have exposed reinforcement at the edges. Each phase of installation such as framing, scratch coat, brown coat, finish coat and curing procedures shall be demonstrated in the construction of the panel. Submit one 12 inch square of reinforcement and one 12 inch length of each accessory proposed for use, prior to constructing the sample panel. Sample panel to match existing stucco.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver packaged materials to the site in the original packages and containers with labels intact and seals unbroken. Keep cementitious materials dry and stored off the ground, under cover and away from damp surfaces until ready to be used. Aggregate shall be covered to prevent the absorption or loss of moisture.

1.5 ENVIRONMENTAL REQUIREMENTS

Do not apply stucco when the ambient temperature is 40 degrees F or lower, or when a drop in temperature below 40 degrees F is expected within 48 hours after application.

PART 2 PRODUCTS

2.1 PORTLAND CEMENT

Portland cement shall conform to ASTM C150/C150M, gray portland cement Type I.

2.2 COLORED STUCCO FINISH COAT

Colored stucco finish coat shall be a factory mixed acrylic polymer or

elastomeric acrylic coating with interegral color and texture (medium sand). Color and texture shall match existing. Submit samples including both a fabricated portion of unit of work and color samples.

2.3 LIME

Lime shall conform to ASTM C206, Type S.

2.4 SAND

Sand aggregate for job-mixed base coat and job-mixed finish coat stucco shall conform to ASTM C897.

2.5 ACCESSORIES

Accessories shall be rigid polyvinyl chloride (PVC), except that cornerite and striplath shall be formed from steel sheets with manufacturer's standard galvanized coating. Vinyl members shall be in accordance with ASTM D1784. Welded wire corner reinforcements shall be zinc coated, galvanized 17 gauge steel wire conforming to ASTM A1064/A1064M. Furring shall include hangers, bolts, inserts, clips, fastenings, and attachments of number, size, and design to develop the full strength of the members.

2.6 HOT DIP GALVANIZED METAL LATH

Metal lath shall conform to ASTM C847 with G60 hot dip galvanized coating ASTM A653/A653M, types and weights in accordance with the various spacing shown in ASTM C841. Lath for vertical application on steel and wood framing supports shall be expanded metal and shall have paper backing with a minimum vapor permeance of 5 perms. Expanded metal or wire lath shall be fabricated in a manner to provide not less than 1/4 inch keying between wire and paper backing and keying shall be obtained by a uniform series of slots in a perforated face paper woven between the wires. Attach lath to structural wall substrate with galvanized or stainless steel fasteners.

2.7 WATER

Provide clean, fresh, potable water, free from amounts of oils, acids, alkalis and organic matter that would be injurious to the stucco.

PART 3 EXECUTION

3.1 FRAMING

Framing shall be installed as indicated.

3.2 CONTROL JOINTS

Control joints shall be located as indicated on the drawings. Prefabricated control joint members shall be installed prior to the application of the stucco. Control joints shall be cleared of all stucco within the control area after stucco application and prior to final stucco set.

3.3 LATH

Install lath in accordance with ASTM C841 or ASTM C1063 except as otherwise specified. Metal and wire lath shall be applied straight, without buckles and with joints staggered. End laps of metal lath shall

be not less than 1 inch. When paper-backed lath is used, the paper shall be split from the lath at all lap areas to provide a paper to paper and lath to lath lap. Horizontal joints shall be shiplapped. Lath shall be interrupted at all control joints. Submit drawings showing details of construction for reinforcement, furring, and grounds; including manufacturer's installation instructions for stucco materials, and locations where each mix and coating thickness will be used.

3.3.1 On Concrete and Masonry

Fasten lath every 8 inches vertically and every 16 inches horizontally. Where wood supports adjoin masonry or concrete in the same direction, provide casing bead, control joints, or reinforcement as indicated.

3.3.2 Over Metal Flashings

Lath over metal flashings shall lap the flashings not less than 2 inches and shall be extended vertically for a height of not less than 6 inches.

3.3.3 Special Shapes, Profiles, and Contours

Special shapes, profiles, and contours shall be formed with wood, metal or aluminum furring and reinforcing.

3.4 FURRING

Furring shall be installed to true lines and surfaces and shall be rigidly supported and secured in place.

3.5 PREPARATION OF SURFACES

Preparation of surfaces for application of stucco to solid bases such as stone, masonry or concrete shall conform to the applicable requirements of ASTM C926.

3.6 PROPORTIONS AND MIXING

Proportions and mixing for job-mixed base coat shall conform to the applicable requirements of ASTM C926. Colored finish coat shall be factory mixed. Submit detailed description of the proposed job-mix proportions for base coats; including identification of thickness of coats.

3.7 STUCCO APPLICATION

Stucco shall be applied in three coats to a thickness of not less than 1 inch as measured from the back plane of metal reinforcement (to match adjacent stucco face), exclusive of ribs or dimples or from the face of solid backing or support, with or without metal reinforcement, to the finished stucco surface, including moderate texture variations. Stucco application shall conform to the applicable requirements of ASTM C926 and the following:

3.7.1 Workmanship

Items or features of the work in connection with or adjoining the stucco shall be in place, plumb, straight, and true prior to beginning the stucco work. Metal and wire lath, where required, shall be in place and positioned to provide a good key at back of lath. Where lath is applied

over copper, the copper shall be given a heavy coat of bituminous paint. Masonry surfaces to receive stucco shall be evenly dampened immediately prior to application of stucco. Each stucco coat shall be applied continuously in one general direction, without allowing mortar to dry at edges. Where it is impossible to work the full dimension of a wall surface in a continuous operation, jointing shall be made at a break, opening, or other natural division of the surface. Edges to be joined shall be dampened slightly to produce a smooth confluence. Exterior corners of stucco shall be slightly rounded. Stucco on soffit surfaces shall be pitched forward to form a drip.

3.7.2 Scratch Coat

Apply scratch coat not less than 3/8 inch thick under sufficient pressure to form good keys and to completely embed the reinforcement. Before the scratch coat has set, it shall be lightly scratched in one direction and vertical surfaces shall be scratched in the horizontal direction only. The scratch coat shall be fog cured for a minimum of 72 hours.

3.7.3 Brown Coat

Evenly dampen the scratch coat to obtain uniform suction before the brown coat is applied. There shall be no visible water on the surface when the brown coat is applied. The brown coat shall be applied to the scratch coat with sufficient pressure to force the stucco into the scratches and shall be brought to a plumb, true, even plane with rod or straightedge. When set sufficiently, the brown coat shall be uniformly floated with a dry float to promote densification of the coat and to provide a surface receptive to bonding of the finish coat. Brown coat shall be fog cured for a minimum of 72 hours.

3.7.4 Finish Coat

Dampen surfaces of the brown coat not more than 1 hour before the finish coat is to be applied to a uniform wetness with no free-standing water on the surface. The finish coat shall have a medium sand texture finish and shall conform to the approved sample. Fog cure the finish coat for a minimum of 48 hours. Take care to prevent staining.

3.7.5 Surface Tolerance

When a 10 foot straightedge is placed at any location on the finished surface of the stucco, excluding rough-textured finish, the surface shall not vary more than 1/8 inch from the straightedge.

3.8 CURING AND PROTECTION

Perform fog curing by applying a fine mist of water to the stucco. Exercise care during fog curing to avoid erosion damage of the stucco surfaces. Do not use a solid stream of water. Fog not less than three times daily. Protect the stucco from the direct rays of the sun during severe drying conditions using canvas, cloth or other approved sheet material.

3.9 PATCHING AND POINTING

Replace or patch loose, cracked, damaged or defective work as directed. Patching shall match existing work in texture and color and shall be finished flush.

-- End of Section --

SECTION 09 29 00

GYPSUM BOARD

08/16

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI A108.11 (1992; Reaffirmed 2005) Specifications for Interior Installation of Cementitious Backer Units

ASTM INTERNATIONAL (ASTM)

ASTM C1002 (2014) Standard Specification for Steel Self-Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs

ASTM C1047 (2014a) Standard Specification for Accessories for Gypsum Wallboard and Gypsum Veneer Base

ASTM C1396/C1396M (2014a) Standard Specification for Gypsum Board

ASTM C475/C475M (2015) Joint Compound and Joint Tape for Finishing Gypsum Board

ASTM C840 (2016) Standard Specification for Application and Finishing of Gypsum Board

ASTM C954 (2015) Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Steel Studs from 0.033 in. (0.84 mm) to 0.112 in. (2.84 mm) in Thickness

ASTM C1629/C1629M (2023) Standard Classification for Abuse-Resistant Nondecorated Interior Gypsum Panel Products and Fiber-Reinforced Cement Panels

ASTM D3273 (2021) Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350 (2010; Version 1.1) Standard Method for
the Testing and Evaluation of Volatile
Organic Chemical Emissions from Indoor
Sources using Environmental Chambers

GREEN SEAL (GS)

GS-36 (2013) Adhesives for Commercial Use

GYPSUM ASSOCIATION (GA)

GA 214 (2010) Recommended Levels of Gypsum Board
Finish

GA 216 (2010) Application and Finishing of Gypsum
Panel Products

GA 600 (2009) Fire Resistance Design Manual

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS SCS Global Services (SCS) Indoor Advantage

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168 (2017) Adhesive and Sealant Applications

UNDERWRITERS LABORATORIES (UL)

UL 2818 (2022) GREENGUARD Certification Program
For Chemical Emissions For Building
Materials, Finishes And Furnishings

UL Fire Resistance (2014) Fire Resistance Directory

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation;
submittals not having a "G" designation are for Contractor Quality Control
approval. Submit the following in accordance with Section 01 33 00
SUBMITTAL PROCEDURES:

SD-03 Product Data

Cementitious Backer Units in showerWater-Resistant Gypsum Backing
Board at toilets and janitor closetAccessories

Submit for each type of gypsum board and for cementitious backer
units.

Certifications

Gypsum Board

Water-Resistant Gypsum Backing Board

SD-07 Certificates

Asbestos Free Materials; G

Certify that gypsum board types, gypsum backing board types, cementitious backer units, and joint treating materials do not contain asbestos.

Indoor Air Quality; G

SD-08 Manufacturer's Instructions

Material Safety Data Sheets

SD-10 Operation and Maintenance Data

Manufacturer Maintenance Instructions

SD-11 Closeout Submittals

Recycled Content for Gypsum Board; S

Recycled Content for Paper Facing and Gypsum Cores; S

Indoor Air Quality for Gypsum Board; S

VOC Content of Joint Compound; S

Indoor Air Quality for Non-aerosol Adhesives; S

Indoor Air Quality for Aerosol Adhesives; S

1.3 CERTIFICATIONS

1.3.1 Indoor Air Quality Certifications

Submit required indoor air quality certifications in one submittal package.

1.3.1.1 Ceiling and Wall Systems

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide validation by other third-party program that products meet the requirements of this paragraph. Provide current product certification documentation from certification body. Gypsum wall board and panels must meet the emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type).

1.3.1.2 Adhesives and Sealants

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide validation by other third-party program that products meet the requirements of this paragraph. Sealants and non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) must meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) must meet

either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of GS-36. Provide current product certification documentation from certification body.

1.4 DELIVERY, STORAGE, AND HANDLING

1.4.1 Delivery

Deliver materials in the original packages, containers, or bundles with each bearing the brand name, applicable standard designation, and name of manufacturer, or supplier.

1.4.2 Storage

Keep materials dry by storing inside a sheltered building. Where necessary to store gypsum board outside, store off the ground, properly supported on a level platform, and protected from direct exposure to rain, snow, sunlight, and other extreme weather conditions. Provide adequate ventilation to prevent condensation. Store per manufacturer's recommendations for allowable temperature and humidity range. Do not store gypsum wallboard with materials which have high emissions of volatile organic compounds (VOCs) or other contaminants. Do not store panels near materials that may offgas or emit harmful fumes, such as kerosene heaters, fresh paint, or adhesives. Do not use materials that have visible moisture or biological growth.

1.4.3 Handling

Neatly stack gypsum board flat to prevent sagging or damage to the edges, ends, and surfaces.

1.5 QUALIFICATIONS

Furnish type of gypsum board work specialized by the installer with a minimum of 3 years of documented successful experience.

1.6 SCHEDULING

The gypsum wallboard must be taped, finished and primed before the installation of the highly-emitting materials. The gypsum wallboard must be installed after the installation and ventilation period of the highly-emitting materials.

Commence application only after the area scheduled for gypsum board work is completely weathertight. The heating, ventilating, and air-conditioning systems must be complete and in operation prior to application of the gypsum board. If the mechanical system cannot be activated before gypsum board is begun, the gypsum board work may proceed in accordance with an approved plan to maintain the environmental conditions specified below. Apply gypsum board prior to the installation of finish flooring and acoustic ceiling.

1.7 ENVIRONMENTAL REQUIREMENTS

Do not expose the gypsum board to excessive sunlight prior to gypsum board application. Maintain a continuous uniform temperature of not less than 50 degrees F and not more than 80 degrees F for at least one week prior to the application of gypsum board work, while the gypsum board application

is being done, and for at least one week after the gypsum board is set. Shield air supply and distribution devices to prevent any uneven flow of air across the plastered surfaces. Provide ventilation to exhaust moist air to the outside during gypsum board application, set, and until gypsum board jointing is dry. In glazed areas, keep windows open top and bottom or side to side 3 to 4 inches. Reduce openings in cold weather to prevent freezing of joint compound when applied. For enclosed areas lacking natural ventilation, provide temporary mechanical means for ventilation. In unglazed areas subjected to hot, dry winds or temperature differentials from day to night of 20 degrees F or more, screen openings with cheesecloth or similar materials. Avoid rapid drying. During periods of low indoor humidity, provide minimum air circulation following gypsum boarding and until gypsum board jointing complete and is dry.

PART 2 PRODUCTS

2.1 PRODUCT SUSTAINABILITY CRITERIA

For products in this section, where applicable and to extent allowed by performance criteria, provide and document the following:

2.1.1 Recycled Content for Gypsum Board Materials

Recycled content is identified for some products in this section. Other products listed in this section may be available with recycled content; identify those products that meet project requirements for recycled content.

2.1.2 Reduce Volatile Organic Compounds (VOC) (LOW-EMITTING MATERIALS) for Products

Reduced VOC content is identified for some products in this section. Other products listed in this section may be available with reduced VOC content; identify those products that meet project requirements for reduced VOC content.

2.2 MATERIALS

Conform to specifications, standards and requirements specified. Provide gypsum board types, gypsum backing board types, and joint treating materials manufactured from asbestos free materials only. Submit Material Safety Data Sheets and manufacturer maintenance instructions for gypsum materials including adhesives.

2.2.1 Gypsum Board

ASTM C1396/C1396M. Gypsum board must contain a minimum of 10 percent post-consumer recycled content, or a minimum of 40 percent post-industrial recycled content. Provide data identifying percentage of recycled content for gypsum board. Paper facings must contain a minimum of 100 percent post-consumer recycled paper content. Gypsum cores must contain a minimum of 95 percent post-industrial recycled gypsum content. Provide data identifying percentage of recycled content for paper facing and gypsum cores. Provide certification of indoor air quality for gypsum board.

2.2.1.1 Regular

48 inch wide, 5/8 inch thick, tapered edges.

2.2.1.2 Mold Resistant / Anti-Microbial Gypsum

ASTM D3273. 48 inch wide, [1/2] [5/8] inch thick, [tapered][tapered and featured] edges.

2.2.2 Regular Water-Resistant Gypsum Backing Board

ASTM C1396/C1396M Provide at restrooms/janitor closet

2.2.2.1 Regular

48 inch wide, 5/8 inch thick, tapered edges.

2.2.2.2 Abuse Resistant

Comply with ASTM C1629/C1629M for abuse resistance. Heavy duty, 48 inch wide, 5/8 inch thick tapered edges. Provide in gym and hallway.

2.2.3 Joint Treatment Materials

ASTM C475/C475M. Product must be low emitting VOC types with VOC limits not exceeding 50 g/L. Provide data identifying VOC content of joint compound. Use all purpose joint and texturing compound containing inert fillers and natural binders, including lime compound. Pre-mixed compounds must be free of antifreeze, vinyl adhesives, preservatives, biocides and other slow releasing compounds.

2.2.3.1 Embedding Compound

Specifically formulated and manufactured for use in embedding tape at gypsum board joints and compatible with tape, substrate and fasteners.

2.2.3.2 Finishing or Topping Compound

Specifically formulated and manufactured for use as a finishing compound.

2.2.3.3 All-Purpose Compound

Specifically formulated and manufactured to serve as both a taping and a finishing compound and compatible with tape, substrate and fasteners.

2.2.3.4 Setting or Hardening Type Compound

Specifically formulated and manufactured for use with fiber glass mesh tape.

2.2.3.5 Joint Tape

Use cross-laminated, tapered edge, reinforced paper, or fiber glass mesh tape recommended by the manufacturer.

2.2.4 Fasteners

2.2.4.1 Screws

ASTM C1002, Type "G", Type "S" or Type "W" steel drill screws for fastening gypsum board to gypsum board, wood framing members and steel framing members less than 0.033 inch thick. ASTM C954 steel drill screws for fastening gypsum board to steel framing members 0.033 to 0.112 inch

thick. Provide cementitious backer unit screws with a polymer coating.

Screws that penetrate through RF foil shielding system shall be conductive without any coating to allow screw to ground to RF foil shielding system.

2.2.5 Adhesives

Provide certification of indoor air quality for non-aerosol adhesives applied on the interior of the building (inside of the weatherproofing system). Provide certification of indoor air quality for aerosol adhesives used on the interior of the building (inside of the weatherproofing system).

2.2.5.1 Adhesive for Fastening Gypsum Board to Metal Framing

Not permitted.

2.2.5.2 Adhesive for Fastening Gypsum Board to Wood Framing

Not permitted.

2.2.5.3 Adhesive for Laminating

Not permitted.

2.2.6 Gypsum Studs

Provide one inch minimum thickness and 6 inch minimum width. Studs may be of one inch thick gypsum board or multilayers fastened to required thickness. Conform to ASTM C1396/C1396M for material and GA 216 for installation.

2.2.7 Shaftwall Liner Panel

ASTM C1396/C1396M. Conform to the UL Fire Resistance for the Design Numbers(s) indicated for shaftwall liner panels. Manufacture liner panel for cavity shaftwall system, with water-resistant paper faces, bevel edges, single lengths to fit required conditions, 1 inch thick, by 24inch wide.

2.2.8 Accessories

ASTM C1047. Fabricate from corrosion protected steel or plastic designed for intended use. Accessories manufactured with paper flanges are not acceptable. Flanges must be free of dirt, grease, and other materials that may adversely affect bond of joint treatment. Provide prefinished or job decorated materials.

2.2.9 Water

Provide clean, fresh, and potable water.

PART 3 EXECUTION

3.1 EXAMINATION

3.1.1 Framing and Furring

Verify that framing and furring are securely attached and of sizes and

spacing to provide a suitable substrate to receive gypsum board and cementitious backer units. Verify that all blocking, headers and supports are in place to support plumbing fixtures and to receive soap dishes, grab bars, towel racks, and similar items. Do not proceed with work until framing and furring are acceptable for application of gypsum board and cementitious backer units.

3.1.2 Gypsum Board

Verify that surfaces of gypsum board to be bonded with an adhesive are free of dust, dirt, grease, and any other foreign matter. Do not proceed with work until surfaces are acceptable for application of gypsum board with adhesive.

3.1.3 Masonry and Concrete Walls

Verify that surfaces of masonry and concrete walls to receive gypsum board applied with adhesive are dry, free of dust, oil, form release agents, protrusions and voids, and any other foreign matter. Do not proceed with work until surfaces are acceptable for application of gypsum board with adhesive.

3.2 APPLICATION OF GYPSUM BOARD

Apply gypsum board to framing and furring members in accordance with ASTM C840 or GA 216 and the requirements specified. Apply gypsum board with separate panels in moderate contact; do not force in place. Stagger end joints of adjoining panels. Neatly fit abutting end and edge joints. Use gypsum board of maximum practical length; select panel sizes to minimize waste. Cut out gypsum board to make neat, close, and tight joints around openings. In vertical application of gypsum board, provide panels in lengths required to reach full height of vertical surfaces in one continuous piece. Lay out panels to minimize waste; reuse cutoffs whenever feasible. Surfaces of gypsum board and substrate members may be bonded together with an adhesive. Treat edges of cutouts for plumbing pipes, screwheads, and joints with water-resistant compound as recommended by the gypsum board manufacturer. Minimize framing by floating corners with single studs and drywall clips. Install 5/8 inch gypsum ceiling board over framing at 24 inch on center. Provide type of gypsum board for use in each system specified herein as indicated.

3.2.1 Adhesive Application to Interior Masonry or Concrete Walls

Apply in accordance with ASTM C840, System VI or GA 216.

3.2.2 Application of Gypsum Board to Steel Framing and Furring

Apply in accordance with ASTM C840, System VIII or GA 216.

3.2.3 Arches and Bending Radii

Apply gypsum board in accordance with ASTM C840, System IX or GA 216.

3.2.4 Floating Interior Angles

Minimize framing by floating corners with single studs and drywall clips. Locate the attachment fasteners adjacent to ceiling and wall intersections in accordance with ASTM C840, System XII or GA 216, for single-ply and two-ply applications of gypsum board to wood framing.

3.2.5 Control Joints

Install expansion and contraction joints in ceilings and walls in accordance with ASTM C840, System XIII or GA 216. Fill control joints between studs in fire-rated construction with firesafing insulation to match the fire-rating of construction.

3.3 APPLICATION OF CEMENTITIOUS BACKER UNITS

3.3.1 Application

In wet areas, apply cementitious backer units in accordance with ANSI A108.11. Place a 15 lb asphalt impregnated, continuous felt paper membrane behind cementitious backer units, between backer units and studs or base layer of gypsum board. Place membrane with a minimum 6 inch overlap of sheets laid shingle style.

3.3.2 Joint Treatment

ANSI A108.11.

3.3.3 SOUND RATED ASSEMBLIES

Designated assemblies with STC Ratings shall be installed per the testing methods, details, and components of the tested assemblies, including but not limited to; sealing of penetrations, perimeter terminations, and acoustical insulation. Electrical, fire alarm and comm outlet boxes shall be sealed using acoustical putty pads.

3.4 FINISHING OF GYPSUM BOARD

Tape and finish gypsum board in accordance with ASTM C840, GA 214 and GA 216. Finish plenum areas above ceilings to Level 1 in accordance with GA 214. Finish walls and ceilings without critical lighting to receive flat paints, light textures, or wall coverings to Level 4 in accordance with GA 214. Unless otherwise specified, finish all gypsum board walls, partitions and ceilings to Level 5 in accordance with GA 214. Provide joint, fastener depression, and corner treatment. Tool joints as smoothly as possible to minimize sanding and dust. Do not use self-adhering fiber glass mesh tape with conventional drying type joint compounds; use setting or hardening type compounds only. Provide treatment for water-resistant gypsum board as recommended by the gypsum board manufacturer. Protect workers, building occupants, and HVAC systems from gypsum dust.

3.4.1 Uniform Surface

Wherever gypsum board is to receive eggshell, semigloss or gloss paint finish, or where severe, up or down lighting conditions occur, finish gypsum wall surface in accordance to GA 214 Level 5. In accordance with GA 214 Level 5, apply a thin skim coat of joint compound to the entire gypsum board surface, after the two-coat joint and fastener treatment is complete and dry.

3.5 SEALING

Seal openings around pipes, fixtures, and other items projecting through gypsum board and cementitious backer units as specified in Section 07 92 00 JOINT SEALANTS. Apply material with exposed surface flush with gypsum

board or cementitious backer units.

3.6 FIRE-RESISTANT ASSEMBLIES

Wherever fire-rated construction is indicated, provide materials and application methods, including types and spacing of fasteners, wall and ceiling framing in accordance with the specifications contained in UL Fire Resistance for the Design Number(s) indicated, or GA 600 for the File Number(s) indicated. Joints of fire-rated gypsum board enclosures must be closed and sealed in accordance with UL test requirements or GA requirements. Seal penetrations through rated partitions and ceilings tight in accordance with tested systems.

3.7 PATCHING

Patch surface defects in gypsum board to a smooth, uniform appearance, ready to receive finishes.

3.8 SHAFTWALL FRAMING

Install the shaftwall system in accordance with the system manufacturer's published instructions. Coordinate bucks, anchors, blocking and other items placed in or behind shaftwall framing with electrical and mechanical work. Patch or replace fireproofing materials which are damaged or removed during shaftwall construction.

3.9 WASTE MANAGEMENT

As specified in Waste Management Plan and as follows. Separate clean waste gypsum products from contaminants. Do not include wood, plastic, metal, asphalt-impregnated gypsum board, or any gypsum board coated with glass fiber, vinyl, decorative paper, or other finish. Place in designated area and protect from moisture and contamination.

Identify manufacturer's policy for collection or return of remaining construction scrap, unused material, demolition scrap, and packaging material. Institute demolition and construction recycling to take advantage of manufacturer's programs. When such a service is not available, seek local recyclers to reclaim the materials.

-- End of Section --

SECTION 09 30 10

CERAMIC, QUARRY, AND GLASS TILING

08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI A108/A118/A136.1 (2019) American National Standard
Specifications for the Installation of
Ceramic Tile

ANSI A137.1 (2019) American National Standards
Specifications for Ceramic Tile

ASTM INTERNATIONAL (ASTM)

ASTM C241/C241M (2021) Standard Test Method for Abrasion
Resistance of Stone Subjected to Foot
Traffic

ASTM C373 (2018; R 2023) Standard Test Methods for
Determination of Water Absorption and
Associated Properties by Vacuum Method for
Pressed Ceramic Tiles and Glass Tiles and
Boil Method for Extruded Ceramic Tiles and
Non-tile Fired Ceramic Whiteware Products

ASTM C648 (2020) Standard Test Method for Breaking
Strength of Ceramic Tile

ASTM C1027 (2009; R 2017) Standard Test Method for
Determining Visible Abrasion Resistance of
Glazed Ceramic Tile

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350 (2017; Version 1.2) Standard Method for
the Testing and Evaluation of Volatile
Organic Chemical Emissions from Indoor
Sources using Environmental Chambers

GREEN SEAL (GS)

GS-36 (2013) Adhesives for Commercial Use

MARBLE INSTITUTE OF AMERICA (MIA)

MIA Design Manual (2016) Dimension Stone Design Manual

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS SCS Global Services (SCS) Indoor Advantage

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168 (2017) Adhesive and Sealant Applications

TILE COUNCIL OF NORTH AMERICA (TCNA)

TCNA Hdbk (2017) Handbook for Ceramic, Glass, and
Stone Tile Installation

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

36 CFR 1191 Americans with Disabilities Act (ADA)
Accessibility Guidelines for Buildings and
Facilities; Architectural Barriers Act
(ABA) Accessibility Guidelines

UNDERWRITERS LABORATORIES (UL)

UL 2818 (2022) GREENGUARD Certification Program
For Chemical Emissions For Building
Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Detail Drawings

SD-03 Product Data

Porcelain Tile; G

Recycled Content for Porcelain Tile

Mosaic Tile; G

Recycled Content for Mosaic Tile

Transition Strips; G

Metal Strips; G

Mortar, Grout, and Adhesive; G

Cementitious Backer Units

SD-04 Samples

Tile; G

Accessories; G

Transition Strips; G

Metal Strips; G

Grout; G

SD-07 Certificates

Indoor Air Quality for Adhesives

Indoor Air Quality for Sealants

Water Absorption Rates

SD-08 Manufacturer's Instructions

Manufacturer's Approved Cleaning Instructions

SD-10 Operation and Maintenance Data

Porcelain Tile, Data Package 1

Mosaic Tile, Data Package 1

Transition Strips, Data Package 1; G

Metal Strips, Data Package 1; G

1.3 CERTIFICATIONS

1.3.1 Indoor Air Quality Certifications

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited in this Section.

1.3.2 Water Absorption Rates Certification

Provide certification for each tile type indicating compliance with the following water absorption (wa) rates per ANSI A137.1 criteria as tested per ASTM C373 requirements.

- a. Porcelain and Mosaic Tile (Impervious): Provide water absorption (wa) of 0.5 percent or less.

1.4 QUALITY ASSURANCE

Provide installers having a minimum of two years of experience with a company specializing in performing the type of work described. Each type and color of tile to be provided from a single source. Each type and color of mortar, adhesive, and grout to be provided from the same source.

1.5 DELIVERY, STORAGE, AND HANDLING

Ship tiles in sealed packages and clearly marked with the grade, type of tile, producer identification, and country of origin. Deliver materials to the project site in manufacturer's original unopened containers with seals unbroken and labels and hallmarks intact. Protect materials from weather, and store them under cover in accordance with manufacturer's printed instructions. Store and handle tiles per manufacturer's instructions for gauged porcelain tile and gauged porcelain tile panels/slabs.

1.6 ENVIRONMENTAL REQUIREMENTS

Do not perform ceramic tile work unless the substrate and ambient temperature is at least 50 degrees F and rising. Maintain temperature above 50 degrees F while the work is being performed and for at least 7 days after completion of the work. When temporary heaters are used, ventilate the area to the outside to avoid carbon dioxide damage to new tilework.

1.7 WARRANTY

Provide manufacturer's warranty to repair or replace defective tiling materials and workmanship, including tile, mortar and grout products and installation as a system, for a period of one year from date of final acceptance of the work..

1.8 EXTRA MATERIALS

Supply an extra 2 percent of each type tile used in clean and marked cartons.

PART 2 PRODUCTS

2.1 TILE

Provide tiles that comply with ANSI A137.1 and are standard grade tiles. Provide a minimum breaking strength of 125 lbs. for wall tile and 250 lbs. for floor tile in accordance with ASTM C648. Provide floor tiles with a minimum wet dynamic coefficient of friction (DCOF) value of 0.42 when tested in accordance with ANSI A137.1 requirements. Provide glazed floor tile with a Class IV-Commercial classification as rated by the manufacturer when tested in accordance with ASTM C1027 for visible abrasion resistance as related to foot traffic. For materials like tile, accessories, and transition strips submit samples of sufficient size to show color range, pattern, type and joints.

Submit manufacturers' descriptive product data for each type of ceramic, quarry and glass tiling indicated. Include manufacturers' literature, finishes, profiles and thicknesses of materials.

Submit manufacturers' operations and maintenance data for each type of ceramic, quarry and glass tiling indicated in accordance with Section 01 78 23 OPERATIONS AND MAINTENANCE DATA.

2.1.1 Porcelain Tile

Provide unglazed through body (surface color and pattern go all the way

through the tile body), rectified porcelain tile. Blend tiles in factory and in a packages to have same color range and continuous blend for installation. Provide nominal tile size(s) of 12 by 24 inch and 5/16 inch thick.

Provide porcelain tiling materials that contain a minimum of 10 percent recycled content. Provide data identifying percentage of recycled content for porcelain tile.

2.1.2 Mosaic Tile

Furnish unglazed, mosaic tile composed of porcelain. Blend tiles in factory and in a packages to have same color range and continuous blend for installation. Provide nominal tile size(s) of 1/2-inch by 1/2-inch.

Provide mosaic tiling materials that contain a minimum of 3 percent recycled content. Provide data identifying percentage of recycled content for mosaic tile.

2.2 WATER

Provide potable water.

2.3 MORTAR, GROUT, AND ADHESIVE

Provide non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide aerosol adhesives used on the interior of the building meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of GS-36. For products located on the interior of the building (inside of the weatherproofing system, provide certification or validation of indoor air quality for adhesives. Provide bond coat, mortar, and grout supplied from the same manufacturer.

2.3.1 Latex-Portland Cement Mortar

TCNA Hdbk.

2.3.2 Urethane Grout

TCNA Hdbk; premixed, urethane, water-based grout with color consistency and antimicrobial protection; no color fading, streaking or shading, chemical and stain resistant; and UV stable.

2.3.3 Sealants

Comply with applicable regulations regarding toxic and hazardous materials and as specified. Provide sealant that does not change the color or alter the appearance of the grout. Refer to Section 07 92 00 JOINT SEALANTS.

Provide sealants used on the interior of the building (defined as inside of the weatherproofing system) meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. For products located on the interior of the building (inside of the weatherproofing system), provide certification or

validation of indoor air quality for sealants.

2.4 SUBSTRATES

Refer to Section 09 29 00 GYPSUM BOARD for cementitious backer units.

2.4.1 Cementitious Backer Units

Provide cementitious backer unit, for use as tile substrate as indicated, in accordance with TCNA Hdbk. Furnish 1/2 inch thick cementitious backer units.

2.5 MISCELLANEOUS TRIMS

2.5.1 Transition Strips

Provide anodized aluminum transitions between tile and resilient flooring. Provide types as recommended by flooring manufacturer for both edges and transitions of flooring materials specified. Categorize marble Group A as classified by MIA Design Manual. Provide transition strips that comply with 36 CFR 1191 requirements.

2.5.2 Metal Strips

Provide Cove, and L-shape, trim shapes, height to match tile and setting thickness, designed specifically for flooring, and wall applications. Provide anodized aluminum cove strip where floor tile abuts wall tile for sanitary transition and elimination of cove tile base. Provide extruded square, anodized aluminum edging at tile surfaces with exposed outside and inside corners. Provide profiles appropriate for finished floor and wall materials as indicated.

2.6 WATERPROOF MEMBRANE

2.6.1 General

Manufacturer's standard product that complies with ANSI A108/A118/A136.1 and is recommended by the manufacturer for the application indicated. Include reinforcement and accessories recommended by manufacturer.

2.6.2 Chlorinated-Polyethylene Shower Waterproof Membrane

Nonplasticized, chlorinated polyethylene faced on both sides with nonwoven polyester fabric; 0.040 inch nominal thickness.

2.7 CRACK ISOLATION MEMBRANE

2.7.1 General

Manufacturer's standard product that complies with ANSI A108/A118/A136.1 and is recommended by the manufacturer for the application indicated. Include reinforcement and accessories recommended by manufacturer.

2.7.2 Chlorinated-Polyethylene Crack Isolation Membrane

Nonplasticized, chlorinated polyethylene faced on both sides with nonwoven polyester fabric; 0.030 inch nominal thickness.

2.8 COLOR, TEXTURE, AND PATTERN

Provide color, pattern and texture as specified in drawings; colors listed are not intended to limit the selection of equal colors from other manufacturers.

PART 3 EXECUTION

3.1 PREPARATORY WORK AND WORKMANSHIP

Inspect surface to receive tile in conformance to the requirements of TCNA Hdbk for surface conditions for the type setting bed specified and for workmanship. Provide variations of tiled surfaces that fall within maximum values shown below:

TYPE	WALLS	FLOORS
Dry-Set Mortar	1/8 inch in 8 ft.	1/8 inch in 10 ft.
Organic Adhesives	1/8 inch in 8 ft.	1/16 inch in 3 ft.
Latex-Portland Cement Mortar	1/8 inch in 8 ft.	1/8 inch in 10 ft.
Epoxy	1/8 inch in 8 ft.	1/8 inch in 10 ft.

3.2 GENERAL INSTALLATION REQUIREMENTS

Do not start tile work until roughing in for mechanical and electrical work has been completed and tested, and built-in items requiring membrane waterproofing have been installed and tested. Close space, in which tile is being set, to traffic and other work. Keep closed until tile is firmly set. Do not start floor tile installation in spaces requiring wall tile until after wall tile has been installed. Apply tile in colors and patterns indicated in the area shown on the drawings. Install tile with the respective surfaces in true even planes to the elevations and grades shown. Provide special shapes as required for sills, jambs, recesses, offsets, external corners, and other conditions to provide a complete and neatly finished installation. Solidly back tile bases and coves with mortar. Do not walk or work on newly tiled floors without using kneeling boards or equivalent protection of the tiled surface. Keep traffic off horizontal portland cement mortar installations for at least 72 hours. Keep all traffic off epoxy installed floors for at least 40 hours after grouting, and heavy traffic off for at least 7 days, unless otherwise specifically authorized by manufacturer. Dimension and draw detail drawings at a minimum scale of 1/4 inch = 1 foot. Include drawings of pattern at inside corners, outside corners, termination points and location of all equipment items such as thermostats, switch plates, mirrors and toilet accessories mounted on surface. Submit drawings showing ceramic tile pattern elevations and floor plans. Submit manufacturer's preprinted installation instructions.

Do not install building construction materials that show visual evidence of biological growth.

3.3 INSTALLATION OF SUBSTRATES

3.3.1 Cementitious Backer Units

Install in accordance with manufacturer's written instructions.

3.4 INSTALLATION OF WALL TILE

Install wall tile in accordance with the TCNA Hdbk, and with grout joints as recommended by the manufacturer for the type of tile.

3.4.1 Dry-Set Mortar and Latex-Portland Cement Mortar

Use latex-portland cement to install tile in accordance with TCNA Hdbk method W244C-24. Use latex-portland cement when installing porcelain ceramic tile.

3.4.2 Urethane Grout

Prepare and install urethane grout in accordance with TCNA Hdbk.

3.5 INSTALLATION OF FLOOR TILE

Install floor tile in accordance with TCNA Hdbk method F113-24 and with grout joints as recommended by the manufacturer for the type of tile.

3.5.1 Latex-Portland Cement

Use latex-portland cement mortar to install tile directly over properly cured, plane, clean concrete slabs in accordance with TCNA Hdbk method WF113-24. Use latex-portland cement when installing porcelain ceramic tile.

3.5.2 Ceramic Tile Grout

Prepare and install ceramic tile grout in accordance with TCNA Hdbk. Provide and apply manufacturer's standard product for sealing grout joints in accordance with manufacturer's recommendations.

3.5.3 Waterproof and Crack Isolation Membranes

Install as indicated in accordance with manufacturer's written instructions.

3.6 INSTALLATION OF MISCELLANEOUS TRIMS

3.6.1 Transition Strips

Install transition strips where indicated, in a manner similar to that of the ceramic tile floor and as recommended by the manufacturer. Provide thresholds full width of the opening. Install head joints at ends not exceeding 1/4 inch in width and grouted full.

3.6.2 Metal Trims

Install trim where indicated. Embed anchoring leg in setting mortar in accordance with manufacturer's instructions. During grouting of tile joints, immediately wipe grout from finish surface.

3.7 EXPANSION JOINTS

Form and seal joints as specified in Section 07 92 00 JOINT SEALANTS.

3.7.1 Walls

Provide expansion joints at control joints in backing material. Wherever backing material changes, install an expansion joint to separate the different materials.

3.7.2 Floors

Provide expansion joints over construction joints, control joints, and expansion joints in concrete slabs in accordance with TCNA Hdbk method EJ171 type to suit conditions. Provide expansion joints where tile abuts restraining surfaces such as perimeter walls, curbs and columns and at intervals of 20 to 25 feet each way in large interior floor areas. Extend expansion joints through setting-beds and fill.

3.8 CLEANING AND PROTECTING

Upon completion, thoroughly clean tile surfaces in accordance with manufacturer's approved cleaning instructions. Do not use acid for cleaning glazed tile. Clean floor tile with resinous grout or with factory mixed grout in accordance with printed instructions of the grout manufacturer. After the grout has set, provide a protective coat of a noncorrosive soap or other approved method of protection for tile wall surfaces. Cover tiled floor areas with building paper before foot traffic is permitted over the finished tile floors. Provide board walkways on tiled floors that are to be continuously used as passageways by workmen. Replace damaged or defective tiles.

-- End of Section --

This page left blank.

SECTION 09 51 00

ACOUSTICAL CEILINGS

08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM A641/A641M	(2019) Standard Specification for Zinc-Coated (Galvanized) Carbon Steel Wire
ASTM A653/A653M	(2020) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM A1008/A1008M	(2021a) Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable
ASTM B633	(2019) Standard Specification for Electrodeposited Coatings of Zinc on Iron and Steel
ASTM C423	(2009a) Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method
ASTM C635/C635M	(2017) Standard Specification for Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-In Panel Ceilings
ASTM C636/C636M	(2013) Standard Practice for Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-In Panels
ASTM C834	(2017) Standard Specification for Latex Sealants
ASTM E413	(2016) Classification for Rating Sound Insulation
ASTM E580/E580M	(2020) Standard Practice for Installation of Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels in Areas Subject to Earthquake Ground Motions
ASTM E795	(2016) Standard Practices for Mounting

Test Specimens During Sound Absorption
Tests

ASTM E1111/E1111M	(2014) Standard Test Method for Measuring the Interzone Attenuation of Open Office Components
ASTM E1264	(2019) Acoustical Ceiling Products
ASTM E1414/E1414M	(2021a) Standard Test Method for Airborne Sound Attenuation Between Rooms Sharing a Common Ceiling Plenum
ASTM E1477	(1998a; R 2017; E 2018) Standard Test Method for Luminous Reflectance Factor of Acoustical Materials by Use of Integrating-Sphere Reflectometers

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350	(2010; Version 1.1) Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers
--------------------	--

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS	SCS Global Services (SCS) Indoor Advantage
-----	--

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168	(2017) Adhesive and Sealant Applications
------------------	--

U.S. DEPARTMENT OF DEFENSE (DOD)

UFC 3-301-01	(2023) Structural Engineering
--------------	-------------------------------

UNDERWRITERS LABORATORIES (UL)

UL 2818	(2022) GREENGUARD Certification Program For Chemical Emissions For Building Materials, Finishes And Furnishings
---------	---

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Approved Detail Drawings

SD-03 Product Data

Acoustical Ceiling Systems

Recycled Content for Type IV Ceiling Tiles

Recycled Content for Suspension Systems

Acoustical Performance

SD-04 Samples

Acoustical Ceiling Tiles

Ceiling Suspension System

SD-06 Test Reports

SD-07 Certificates

Indoor Air Quality for Type IV Ceiling Tiles; S

Indoor Air Quality for Sealants

1.3 CERTIFICATIONS

1.3.1 Indoor Air Quality Certifications

1.3.1.1 Ceiling Tiles

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this section. Provide current product certification documentation from certification body.

1.3.1.2 Sealants

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited in this Section.

1.4 DELIVERY, STORAGE. AND HANDLING

Deliver materials to the site in the manufacturer's original unopened containers with brand name and type clearly marked. Carefully handle and store materials in dry, watertight enclosures. Immediately before installation, store acoustical units for not less than 24 hours at the same temperature and relative humidity as the space where they will be installed in order to assure proper temperature and moisture acclimation.

1.5 ENVIRONMENTAL REQUIREMENTS

Maintain a uniform temperature of not less than 60 degrees F nor more than 85 degrees F and a relative humidity of not more than 70 percent for 24 hours before, during, and 24 hours after installation of acoustical units.

1.6 SCHEDULING

Complete and dry interior finish work such as plastering, concrete and

terrazzo work before ceiling installation. Complete mechanical, electrical, and other work above the ceiling line; install and start operating heating, ventilating, and air conditioning systems in order to maintain temperature and humidity requirements.

1.7 WARRANTY

Provide manufacturer's warranty to repair or replace defective materials and workmanship including but not limited to, sagging and warping of panels and rusting and of grid systems, for a period of 30 from date of final acceptance of the work.

1.8 EXTRA MATERIALS

Furnish spare tiles, from the same lot as those installed, of each color at the rate of 5 tiles for each 1000 tiles installed.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Coordinate the entire ceiling system with other details, like the location of access panels and ceiling penetrations, for instance, shown on the drawings. The Contractor is responsible for the final assembly and performance of the specified work. Provide the location and extent of acoustical treatment as shown on the approved detail drawings. Submit drawings showing suspension system, method of anchoring and fastening, details, and reflected ceiling plan.

2.1.1 Acoustical Performance

2.1.1.1 Ceiling Sound Transmission

Provide ceiling systems with the specified Ceiling Attenuation Class (CAC) ratings as determined in accordance with ASTM E1414/E1414M and ASTM E413. Provide sound attenuators over light fixtures, air terminals and other ceiling penetrations, provide acoustical blanket insulation on top of the ceiling or adjacent to partitions to provide lightweight acoustical plenum barriers above partitions as required to achieve the specified CAC ratings. Provide test ceiling continuous at the partition and assembled in the suspension system in the same manner that the ceiling will be installed on the project.

2.1.1.2 Ceiling Sound Absorption

Determine the Noise Reduction Coefficient (NRC) in accordance with ASTM C423. Determine Articulation Class (AC) in accordance with ASTM E1111/E1111M.

2.1.2 Light Reflectance

Determine light reflectance factor in accordance with ASTM E1477 test method.

2.2 ACOUSTICAL UNITS

Submit samples of each type of acoustical unit and each type of suspension grid tee section showing texture, finish, and color. Conform acoustical units to ASTM E1264, Class A, and the following requirements:

2.2.1 Units for Exposed-Grid System ACT-1

2.2.1.1 Type ACT1

IV (non-asbestos mineral fiber with membrane-faced overlay). Provide Type IV Acoustical Ceiling Tiles containing a minimum of 80 percent recycled content. Provide data identifying percentage of recycled content for Type IV ceiling tiles. Provide certification of indoor air quality for Type IV Ceiling Tiles.

2.2.1.2 Flame Spread

Class A, 25 or less

2.2.1.3 Pattern, Form

E, Form 2

2.2.1.4 Minimum NRC

0.80 when tested on mounting Type E-400 of ASTM E795.

2.2.1.5 Minimum Light Reflectance Coefficient

LR-1, 0.87 or greater

2.2.1.6 Nominal Size

24 by 24 inch

2.2.1.7 Edge Detail

Beveled Tegular

2.2.1.8 Finish

Factory-applied latex paint with DuraBrite acoustically transparent membrane. See paragraph COLORS AND STANDARDS.

2.2.1.9 Minimum CAC

35

2.2.2 Unit Acoustical Absorbers

Provide individually mounted sound absorbing plaques composed of glass fibers or non-asbestos mineral fibers and having a NRC range of not less than 0.60 - 0.70 when tested in accordance with ASTM C423 and reported as a 4 frequency average.

2.3 SUSPENSION SYSTEM

Provide standard exposed-grid direct hung, concealed, downward access standard width flange as indicated suspension system conforming to ASTM C635/C635M for intermediate-duty systems. Provide surfaces exposed to view of aluminum or steel with a factory-applied white baked-enamel finish. Provide wall molding having a flange of not less than 15/16 inch. Provide mitered corners. Provide a suspension system with a maximum

deflection of 1/360 of the span length capable of supporting the finished ceiling, light fixtures, air diffusers, and accessories, as shown. Conform seismic details to the guidance in UFC 3-301-01 and ASTM E580/E580M.

Provide Suspension System containing a minimum of 15 percent recycled content. Provide data identifying percentage of recycled content for suspension systems.

2.4 HANGERS

Provide hangers and attachment capable of supporting a minimum 300 pound ultimate vertical load without failure of supporting material or attachment.

2.4.1 Wires

Conform wires to ASTM A641/A641M, Class 1, 0.08 inch (12 gauge) in diameter.

2.4.2 Straps

Provide straps of 1 by 3/16 inch galvanized steel conforming to ASTM A653/A653M, with a light commercial zinc coating or ASTM A1008/A1008M with an electrodeposited zinc coating conforming to ASTM B633, Type RS.

2.4.3 Rods

Provide 3/16 inch diameter threaded steel rods, zinc or cadmium coated.

2.5 FINISHES

Use manufacturer's standard textures, patterns and finishes as specified for acoustical units and suspension system members. Treat ceiling suspension system components to inhibit corrosion.

2.6 COLORS AND PATTERNS

Use colors and patterns for acoustical units and suspension system components as specified in Section 09 06 00 SCHEDULES FOR FINISHES and as indicated; colors listed are not intended to limit the selection of equal colors from other manufacturers.

2.7 ACOUSTICAL SEALANT

Conform acoustical sealant to ASTM C834, nonstaining. Provide sealants used on the interior of the building (defined as inside of the weatherproofing system) in accordance with requirements of Section 07 92 00 JOINT SEALANTS. that meet either emissions requirements of CDPH SECTION 01350 (limit the requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. For products located on the interior of the building (inside of the weatherproofing system), provide certification of indoor air quality for Sealants.

PART 3 EXECUTION

3.1 INSTALLATION

Do not install building construction materials that show visual evidence

of biological growth.

Examine surfaces to receive directly attached acoustical units for unevenness, irregularities, and dampness that would affect quality and execution of the work. Rid areas, where acoustical units will be cemented, of oils, form residue, or other materials that reduce bonding capabilities of the adhesive. Complete and dry interior finish work such as plastering, concrete, and terrazzo work before installation. Complete and approve mechanical, electrical, and other work above the ceiling line prior to the start of acoustical ceiling installation. Provide acoustical work complete with necessary fastenings, clips, and other accessories required for a complete installation. Do not expose mechanical fastenings in the finished work. Lay out hangers for each individual room or space. Provide hangers to support framing around beams, ducts, columns, grilles, and other penetrations through ceilings. Keep main runners and carrying channels clear of abutting walls and partitions. Provide at least two main runners for each ceiling span. Wherever required to bypass an object with the hanger wires, install a subsuspension system so that all hanger wires will be plumb.

3.1.1 Suspension System

Install suspension system in accordance with ASTM C636/C636M and as specified herein. Do not suspend hanger wires or other loads from underside of steel decking.

3.1.1.1 Plumb Hangers

Install hangers plumb and not pressing against insulation covering ducts and pipes. Where lighting fixtures are supported from the suspended ceiling system, provide hangers at a minimum of four hangers per fixture and located not more than 6 inch from each corner of each fixture.

3.1.1.2 Splayed Hangers

Splay (slope or slant) hangers around obstructions, offsetting the resulting horizontal force by bracing, countersplaying, or other acceptable means.

3.1.2 Wall Molding

Provide wall molding where ceilings abut vertical surfaces. Miter corners where wall moldings intersect or install corner caps. Secure wall molding not more than 3 inch from ends of each length and not more than 16 inch on centers between end fastenings. Provide wall molding springs at each acoustical unit in semi-exposed or concealed systems.

3.1.3 Acoustical Units

Install acoustical units in accordance with the approved installation instructions of the manufacturer. Ensure that edges of acoustical units are in close contact with metal supports, with each other, and in true alignment. Arrange acoustical units so that units less than one-half width are minimized. Hold units in exposed-grid system in place with manufacturer's standard hold-down clips, if units weigh less than 1 psf or if required for fire resistance rating.

3.1.4 Acoustical Sealant

Seal all joints around pipes, ducts or electrical outlets penetrating the ceiling. Apply a continuous ribbon of acoustical sealant on vertical web of wall or edge moldings.

3.2 CLEANING

Following installation, clean dirty or discolored surfaces of acoustical units and leave them free from defects. Remove units that are damaged or improperly installed and provide new units as directed.

-- End of Section --

SECTION 09 62 38

STATIC-CONTROL FLOORING

08/17, CHG 1: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM E648	(2023) Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source
ASTM F150	(2006; R 2013) Standard Test Method for Electrical Resistance of Conductive and Static Dissipative Resilient Flooring
ASTM F1700	(2020) Standard Specification for Solid Vinyl Floor Tile
ASTM F1861	(2021) Standard Specification for Resilient Wall Base
ASTM F1869	(2023) Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride
ASTM F2170	(2019a) Standard Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in situ Probes

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350	(2017; Version 1.2) Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers
--------------------	--

ELECTROSTATIC DISCHARGE ASSOCIATION (ESD)

ESD S6.1	(2019) Standard for the Protection of Electrostatic Discharge Susceptible Items - Grounding
----------	---

GREEN SEAL (GS)

GS-36	(2013) Adhesives for Commercial Use
-------	-------------------------------------

RESILIENT FLOOR COVERING INSTITUTE (RFCI)

FLOORSCORE	FLOORSCORE IAQ Certification
------------	------------------------------

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS SCS Global Services (SCS) Indoor Advantage

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168 (2017) Adhesive and Sealant Applications

UNDERWRITERS LABORATORIES (UL)

UL 2818 (2022) GREENGUARD Certification Program
For Chemical Emissions For Building
Materials, Finishes And Furnishings

1.2 SCHEDULING

Schedule static-control flooring work after any other work which would damage the finished surface of the flooring.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval.. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Static-Control Resilient Flooring; G

Accessories

Adhesives

Warranty

SD-04 Samples

Static-Control Resilient Flooring; G

Moldings; G

Accessories; G

SD-06 Test Reports

Fire Resistance

Moisture, Alkalinity and Bond

Testing

SD-07 Certificates

Indoor Air Quality for Static-Dissipative Vinyl Tile; S

SD-08 Manufacturer's Instructions

Static-Control Resilient Flooring; G

Accessories; G

SD-10 Operation and Maintenance Data

Static-Control Resilient Flooring; G

Accessories; G

1.3.1 Samples

1.3.1.1 Static-Control Resilient Flooring

Submit three samples of each indicated color and type of flooring, base, moldings, and accessories sized a minimum 2-1/2 by 4 inch.

1.3.1.2 Moldings

Submit three pieces of each type at least 12 inches long.

1.3.1.3 Operations and Maintenance Data

- a. Submit Data Package 1 in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA.
- b. Submit three copies of manufacturer's maintenance instructions for each type of flooring material describing recommended type of cleaning equipment and materials, spotting and cleaning methods, and cleaning cycles.

1.4 CERTIFICATIONS

1.4.1 Indoor Air Quality Certifications

1.4.1.1 Floor Covering Materials

Provide Static-Dissipative Vinyl Tile and wall base products certified to meet indoor air quality requirements by FLOORSCORE, UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section. Provide current product certification documentation from certification body.

1.4.1.2 Adhesives

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section. Provide current product certification documentation from certification body.

1.5 EXTRA MATERIALS

Provide extra material from same dye lot for future maintenance. Provide a minimum of 5 percent of total square yards of each flooring and base type, pattern, and color.

1.6 QUALITY ASSURANCE

The flooring manufacturer will approve the Qualifications of Applicator and certify that he/she has a minimum of 3 years of experience in the application of the materials to be used.

1.7 DELIVERY, STORAGE, AND HANDLING

Deliver materials to the building site in original unopened containers bearing the manufacturer's name, style name, pattern color name and number, size, production run, project identification, handling instructions and related information. Observe ventilation and safety procedures specified in the Safety Data Sheets (SDS). Do not store flooring near materials that may off-gas or emit harmful fumes, such as kerosene heaters, fresh paint, or adhesives.

1.7.1 Static-Control Resilient Flooring

Store materials in a clean, dry, secure, and well-ventilated area free from strong contaminant sources and residues with ambient air temperature range as recommended by the manufacturer but not less than 68 degrees F or more than 85 degrees F. Stack materials according to manufacturer's recommendations. Protect materials from the direct flow of heat from hot-air registers, radiators and other heating fixtures and appliances.

1.8 ENVIRONMENTAL CONDITIONS

Provide temporary ventilation during work of this section.

1.8.1 Static-Control Resilient Flooring

Maintain areas in which resilient flooring is to be installed at a temperature range as recommended by the manufacturer but not less than 68 degrees F or more than 85 degrees F for 3 days before application, during application and 2 days after application, unless otherwise directed by the flooring manufacturer for the flooring being installed. Maintain a minimum temperature range as recommended by the manufacturer but not less than 55 degrees F thereafter for the duration of the contract. Provide adequate ventilation to remove moisture from area and to comply with regulations limiting concentrations of hazardous vapors.

1.9 WARRANTY

1.9.1 Static-Control Resilient Flooring

Provide manufacturer's standard performance guarantees or warranties including a five year wear warranty and ten year conductivity warranty.

PART 2 PRODUCTS

2.1 STATIC-CONTROL RESILIENT FLOORING

2.1.1 Static-Dissipative Resilient Flooring

2.1.1.1 Static-Dissipative Vinyl Tile

Static-dissipative vinyl tile must be a homogeneous vinyl product and conform to ASTM F1700. Provide electrical resistance from surface to surface and surface to ground between 1,000,000 ohms (1.0×10^6 to the 6th)

and 1,000,000,000 ohms (1.0×10 to the 9th) when tested in accordance with ASTM F150. Tile must be 12 inches square and 1/8 inch thick.

Provide certification of indoor air quality for Static-Dissipative Vinyl Tile.

2.2 WALL BASE

2.2.1 Resilient Base

Resilient base must conform to ASTM F1861, Type TS (vulcanized thermoset rubber), or Type TP (thermoplastic rubber), Style B (coved - installed with resilient flooring). Provide 4 inch high and a minimum 1/8 inch thick wall base. Provide preformed corners in matching height, shape, and color.

2.3 ADHESIVES

Provide conductive adhesive as recommended by the manufacturer of the static-control flooring. Provide conductive adhesive for carpet tile that is also releasable as recommended by the manufacturer. Provide adhesive for wall base as recommended by the wall base manufacturer.

Provide non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) that meet either emissions requirements of CDPH SECTION 01350 (use the office or classroom requirements, regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide aerosol adhesives used on the interior of the building that meet either emissions requirements of CDPH SECTION 01350 (use the office or classroom requirements, regardless of space type) or VOC content requirements of GS-36. Provide certification or validation of indoor air quality for adhesives.

2.4 MOLDINGS

Provide heavy duty tapered moldings of rubber and types as recommended by flooring manufacturer for both edges and transitions of flooring materials specified. Provide vertical lip on molding of maximum 1/4 inch. Provide bevel change in level between 1/4 and 1/2 inch with a slope no greater than 1:2. Provide color to match resilient base.

2.5 ACCESSORIES

Use accessories recommended by the manufacturer of the flooring.

2.6 ELECTRICAL GROUND CONNECTION

Provide an electrical ground connection that meets the requirements of ESD S6.1. Connection between the static-control floor system and the external grounding system must be provided. Contact with the static-control floor system must be with conductive grounding strip and must have the greater of the following: a minimum contact area of 9 square inch or the dimensions recommended by the manufacturer. Provide the grounding conductor recommended by the manufacturer of the flooring. Connect and install the grounding conductor as recommend by the flooring manufacturer.

2.7 MANUFACTURER'S COLOR, PATTERN AND TEXTURE

Provide color, pattern and texture as indicated on drawings. Provide flooring in any one continuous area or replacement of damaged flooring in continuous area from same production run with same shade and pattern.

PART 3 EXECUTION

3.1 SURFACE PREPARATION

Before any work under this section is begun, defects such as rough or scaling concrete, low spots, high spots, and uneven surfaces must be corrected, and damaged portions of concrete slabs must be repaired in accordance with flooring manufacturer's recommended instructions. Floor must be in a level plane with a maximum variation of 1/8 inch every 10 feet, except where indicated as sloped. Repair cracks and irregularities and prepare the subfloor in accordance with flooring manufacturer's recommended instructions. Curing and sealing compounds should not be used on concrete surfaces to receive flooring unless they have been tested and approved by the flooring manufacturer. In addition, remove paint, varnish, oils, release agents, sealers, waxes, and adhesives, as required by the flooring product in accordance with manufacturer's printed installation instructions. If a curing compound is required, it must be coordinated for compatibility with the flooring adhesive.

3.2 MOISTURE, ALKALINITY AND BOND TESTS

Determine the suitability of the concrete subfloor for receiving the flooring with regard to moisture content and pH level by moisture and alkalinity tests. Conduct moisture testing in accordance with ASTM F1869 or ASTM F2170, unless otherwise recommended by the flooring manufacturer. Conduct alkalinity testing as recommended by the flooring manufacturer. Determine the compatibility of the flooring adhesives to the concrete floors by a bond test in accordance with the flooring manufacturer's recommendations.

3.3 GENERAL INSTALLATION

Do not install building construction materials that show visual evidence of biological growth.

3.4 INSTALLATION OF STATIC-CONTROL RESILIENT TILE FLOORING

Install static-control resilient flooring, ground connections and accessories in accordance with the approved manufacturer's installation instructions. Tile lines and joints must be kept square, symmetrical, tight, and even. Tile at the perimeter of the area to be finished may vary as necessary to maintain full-size tiles in the field, but no perimeter tile may be less than one-half the field tile size, except where irregular shaped rooms make it impossible. Tile must be cut, fitted, and scribed to walls, partitions, and projections after field flooring has been applied. Install grounding strips in accordance with manufacturer's installation instructions. Protect edges of flooring material meeting hard surface flooring with molding and install in accordance with the molding manufacturer's printed instructions.

3.5 INSTALLATION OF WALL BASE

3.5.1 Resilient Base

Install wall base in accordance with manufacturer's printed installation instructions. Prepare and apply adhesives in accordance with manufacturer's printed directions. Tighten base joints and make even with adjacent resilient flooring. Fill voids along the top edge of base at masonry walls with caulk. Roll entire vertical surface of base with hand roller, and press toe of base with a straight piece of wood to ensure proper alignment. Avoid excess adhesive in corners.

3.6 CLEANING AND PROTECTION

The flooring must be cleaned in accordance with the manufacturer's recommendations. Flooring must be protected by a covering of heavy-duty building paper before foot traffic is permitted. Lap and secure edges of kraft paper protection to provide a continuous cover. Boardwalks must be placed over flooring in areas where subsequent building operations might damage the floor. Remove and replace flooring that becomes loose, broken, or curled prior to acceptance, or flooring that does not conform to resistance requirements of ASTM F150.

3.7 TESTING

Test the flooring in accordance with and conform to the requirements of ESD S6.1.

-- End of Section --

This page left blank.

SECTION 09 65 00

RESILIENT FLOORING
08/10, CHG 3: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM F710	(2022) Standard Practice for Preparing Concrete Floors to Receive Resilient Flooring
ASTM F1482	(2021) Standard Practice for Installation and Preparation of Panel Type Underlayments to Receive Resilient Flooring
ASTM F1861	(2021) Standard Specification for Resilient Wall Base
ASTM F1869	(2023) Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride
ASTM F2169	(2015; R 2020; E 2020) Standard Specification for Resilient Stair Treads
ASTM F2170	(2019a) Standard Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in situ Probes

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350	(2017; Version 1.2) Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers
--------------------	--

GREEN SEAL (GS)

GS-36	(2013) Adhesives for Commercial Use
-------	-------------------------------------

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS	SCS Global Services (SCS) Indoor Advantage
-----	--

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168	(2017) Adhesive and Sealant Applications
------------------	--

UNDERWRITERS LABORATORIES (UL)

UL 2818

(2022) GREENGUARD Certification Program
For Chemical Emissions For Building
Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Resilient Flooring and Accessories

SD-03 Product Data

Resilient Flooring and Accessories; G

Adhesives

Wall Base

Stair Treads, Risers and Stringers

SD-04 Samples

Resilient Flooring and Accessories; G

SD-06 Test Reports

Moisture, Alkalinity and Bond Tests; G

SD-07 Certificates

Indoor Air Quality for Wall Base; S

Indoor Air Quality for Adhesives; S

SD-08 Manufacturer's Instructions

Surface Preparation

Installation

SD-10 Operation and Maintenance Data

Resilient Flooring and Accessories

1.3 CERTIFICATES

1.3.1 Indoor Air Quality

Submit required indoor air quality certifications and validations in one submittal package.

1.3.1.1 Floor Covering Materials

Provide Rubber stair and risers, and wall base products certified to meet indoor air quality requirements by FLOORSCORE, UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification by other third-party programs. Provide current product certification documentation from certification body.

1.3.1.2 Adhesives, Caulking and Sealants

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited herein.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver materials to the building site in original unopened containers bearing the manufacturer's name, style name, pattern color name and number, production run, project identification, and handling instructions. Store materials in a clean, dry, secure, and well-ventilated area free from strong contaminant sources and residues with ambient air temperature maintained above 68 degrees F and below 85 degrees F, stacked according to manufacturer's recommendations. Remove resilient flooring products from packaging to allow ventilation prior to installation. Protect materials from the direct flow of heat from hot-air registers, radiators and other heating fixtures and appliances. Observe ventilation and safety procedures specified in the MSDS. Do not store rubber surface products with materials that have a high capacity to adsorb volatile organic compound (VOC) emissions. Do not store exposed rubber surface materials in occupied spaces.

1.5 ENVIRONMENTAL REQUIREMENTS

Maintain areas to receive resilient flooring at a temperature above 68 degrees F and below 85 degrees F for 3 days before application, during application and 2 days after application, unless otherwise directed by the flooring manufacturer for the flooring being installed. Maintain a minimum temperature of 55 degrees F thereafter. Provide adequate ventilation to remove moisture from area and to comply with regulations limiting concentrations of hazardous vapors.

1.6 SCHEDULING

Schedule resilient flooring application after the completion of other work which would damage the finished surface of the flooring.

1.7 WARRANTY

Provide manufacturer's standard performance guarantees or warranties that extend beyond a one year period.

1.8 EXTRA MATERIALS

Provide extra flooring material of each color and pattern at the rate of 5 square feet for each 1000 square feet of flooring installed. Provide extra wall base material composed of 20 linear feet of each type, color and pattern. Package all extra materials in original properly marked containers bearing the manufacturer's name, brand name, pattern color name and number, production run, and handling instructions. Provide extra materials from the same lot as those installed. Leave extra stock at the site in location assigned by Contracting Officer.

PART 2 PRODUCTS

2.1 WALL BASE

Conform to ASTM F1861, Type TS (vulcanized thermoset rubber) or Type TP (thermoplastic rubber) Style B (coved - installed with resilient flooring). Provide 4 inch high and a minimum 1/8 inch thick wall base. Provide preformed corners in matching height, shape, and color.

Provide certification of indoor air quality for Wall Base.

2.2 STAIR TREADS, RISERS AND STRINGERS

Conform to ASTM F2169, Type TS (vulcanized thermoset rubber) . Conform to ASTM F2169 for surface of treads Class 2 raised stonelike pattern and have Group 2 strip of contrasting color of same material. Provide square nosing. Provide either a one piece nosing/tread/riser or a two piece nosing/tread design with a matching coved riser.

2.3 MOULDING

Provide tapered mouldings of rubber and types as recommended by flooring manufacturer for both edges and transitions of flooring materials specified. Provide vertical lip on moulding of maximum 1/4 inch. Provide bevel change in level between 1/4 and 1/2 inch with a slope no greater than 1:2.

2.4 ADHESIVES

Provide adhesives for flooring, base and accessories as recommended by the manufacturer and comply with local indoor air quality standards. Submit manufacturer's descriptive data, documentation stating physical characteristics, and mildew and germicidal characteristics.

Provide non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) that meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide aerosol adhesives used on the interior of the building that meet either emissions requirements of CDPH SECTION 01350 (use the office or classroom requirements, regardless of space type) or VOC content requirements of GS-36. Provide certification or validation of indoor air quality for adhesives.

2.5 POLISH/FINISH

Not required.

2.6 CAULKING AND SEALANTS

Provide caulking and sealants in accordance with Section 07 92 00 JOINT SEALANTS.

2.7 MANUFACTURER'S COLOR, PATTERN AND TEXTURE

Provide color, pattern and texture for resilient flooring and accessories as indicated on the drawings. Color listed is not intended to limit the selection of equal colors from other manufacturers. Provide flooring in any one continuous area or replacement of damaged flooring in continuous area from same production run with same shade and pattern. Submit manufacturer's descriptive data and three samples of each indicated color and type of flooring, base, mouldings, and accessories sized a minimum 2-1/2 by 4 inch. Submit Data Package 1 in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA.

PART 3 EXECUTION

3.1 EXAMINATION

Examine and verify that site conditions are in agreement with the design package. Report all conditions that will prevent a proper installation. Do not take any corrective action without written permission from the Government. Work will proceed only when conditions have been corrected and accepted by the installer. Submit manufacturer's printed installation instructions for all flooring materials and accessories, including preparation of substrate, seaming techniques, and recommended adhesives.

3.2 SURFACE PREPARATION

Provide a smooth, true, level plane for surface preparation of the flooring, except where indicated as sloped. Floor to be flat to within 3/16 inch in 10 feet. Prepare subfloor in accordance with flooring manufacturer's recommended instructions. Prepare the surfaces of lightweight concrete slabs (as defined by the flooring manufacturer) as recommended by the flooring manufacturer. Comply with ASTM F710 for concrete subfloor preparation. Floor fills or toppings may be required as recommended by the flooring manufacturer. Install underlayments, when required by the flooring manufacturer, in accordance with manufacturer's recommended printed installation instructions. Comply with ASTM F1482 for panel type underlayments. Before any work under this section is begun, correct all defects such as rough or scaling concrete, chalk and dust, cracks, low spots, high spots, and uneven surfaces. Repair all damaged portions of concrete slabs as recommended by the flooring manufacturer. Remove concrete curing and sealer compounds from the slabs, other than the type that does not adversely affect adhesion. Remove paint, varnish, oils, release agents, sealers, waxes, and adhesives, as required by the flooring product in accordance with manufacturer's printed installation instructions.

3.3 MOISTURE, ALKALINITY AND BOND TESTS

Determine the suitability of the concrete subfloor for receiving the

resilient flooring with regard to moisture content and pH level by moisture and alkalinity tests. Conduct moisture testing in accordance with ASTM F1869 or ASTM F2170, unless otherwise recommended by the flooring manufacturer. Conduct alkalinity testing as recommended by the flooring manufacturer. Determine the compatibility of the resilient flooring adhesives to the concrete floors by a bond test in accordance with the flooring manufacturer's recommendations. Submit copy of test reports for moisture and alkalinity content of concrete slab, and bond test stating date of test, person conducting the test, and the area tested.

3.4 GENERAL INSTALLATION

Do not install building construction materials that show visual evidence of biological growth.

3.5 PLACING MOULDING

Provide moulding where flooring termination is higher than the adjacent finished flooring and at transitions between different flooring materials. When required, locate moulding under door centerline. Moulding is not required at doorways where thresholds are provided. Secure moulding with adhesive as recommended by the manufacturer. Prepare and apply adhesives in accordance with manufacturer's printed directions.

3.6 PLACING WALL BASE

Install wall base in accordance with manufacturer's printed installation instructions. Prepare and apply adhesives in accordance with manufacturer's printed directions. Tighten base joints and make even with adjacent resilient flooring. Fill voids along the top edge of base at masonry walls with caulk. Roll entire vertical surface of base with hand roller, and press toe of base with a straight piece of wood to ensure proper alignment. Avoid excess adhesive in corners.

3.7 PLACING STAIR TREADS, RISERS, AND STRINGERS

Secure and install stair treads, risers, and stringers in accordance with manufacturer's printed installation instructions. Cover the surface of treads and risers the full width of the stairs. Provide equal length pieces butted together to cover the treads and risers for stairs wider than manufacturer's standard lengths. Provide stringer angles on both the wall and banister sides of the stairs, and landing trim.

3.8 CLEANING

Immediately upon completion of installation of flooring in a room or an area, dry and clean the flooring and adjacent surfaces to remove all surplus adhesive. Clean flooring as recommended in accordance with manufacturer's printed maintenance instructions and within the recommended time frame. As required by the manufacturer, apply the recommended number of coats and type of polish and finish in accordance with manufacturer's written instructions.

3.9 PROTECTION

From the time of installation until acceptance, protect flooring from damage as recommended by the flooring manufacturer. Remove and replace flooring which becomes damaged, loose, broken, or curled and wall base which is not tight to wall or securely adhered.

SECTION 09 65 66

RESILIENT ATHLETIC FLOORING

08/16, CHG 1: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM C920	(2018) Standard Specification for Elastomeric Joint Sealants
ASTM D395	(2016; E 2017) Standard Test Methods for Rubber Property - Compression Set
ASTM D412	(2016; R 2021) Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers - Tension
ASTM D1054	(2002; R 2007) Rubber Property - Resilience Using a Rebound Pendulum
ASTM D1894	(2014) Static and Kinetic Coefficients of Friction of Plastic Film and Sheeting
ASTM D2632	(2015; R 2019) Standard Test Method for Rubber Property-Resilience by Vertical Rebound
ASTM E648	(2019a) Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source
ASTM F1303	(2004; R 2021) Standard Specification for Sheet Vinyl Floor Covering with Backing
ASTM F1869	(2023) Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride
ASTM F2170	(2019a) Standard Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in situ Probes
ASTM F2772	(2011) Standard Specification for Athletic Performance Properties of Indoor Sports Floor Systems
ASTM G21	(2015; R 2021; E 2021) Standard Practice for Determining Resistance of Synthetic Polymeric Materials to Fungi

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350 (2017; Version 1.2) Standard Method for
the Testing and Evaluation of Volatile
Organic Chemical Emissions from Indoor
Sources using Environmental Chambers

CARPET AND RUG INSTITUTE (CRI)

CRI GL CUSHION Green Label Cushion Program

CRI GLP QM (2017) Green Label Plus Quality Manual

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION (ISO)

ISO 9001 (2015) Quality Management Systems-
Requirements

ISO 14001 (2015) Environmental Management Systems -
Requirements with Guidance for Use

RESILIENT FLOOR COVERING INSTITUTE (RFCI)

FLOORSCORE FLOORSCORE IAQ Certification

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS SCS Global Services (SCS) Indoor Advantage

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1113 (2016) Architectural Coatings

SCAQMD Rule 1168 (2017) Adhesive and Sealant Applications

UNDERWRITERS LABORATORIES (UL)

UL 2818 (2022) GREENGUARD Certification Program
For Chemical Emissions For Building
Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S"
classification. Submittals not having a "G" or "S" classification are for
information only. When used, a code following the "G" classification
identifies the office that will review the submittal for the Government.
Submit the following in accordance with Section 01 33 00 SUBMITTAL
PROCEDURES:

SD-02 Shop Drawings

Approved Detail Drawings; G

SD-03 Product Data

Installation

Indoor Air Quality for Rubber Flooring; S

Indoor Air Quality for Adhesives; S

Indoor Air Quality for Primer; S

Indoor Air Quality for Game Line Marking Materials; S

SD-04 Samples

Flooring

SD-06 Test Reports

Laboratory Test Results

SD-07 Certificates

Indoor Air Quality for Indoor-Outdoor Carpeting

Indoor Air Quality for Sheet Rubber Composition Flooring

Indoor Air Quality for Sheet Vinyl Composition Flooring

Indoor Air Quality for Wall Base

SD-11 Closeout Submittals

Warranty

1.3 QUALITY ASSURANCE

1.3.1 Shop Drawings

Provide approved detail drawings showing, as a minimum, installation details and locations of borders, patterns, and locations of floor seams.

1.3.2 Manufacturer Qualifications

Manufacturer must have at least ten years active experience in the manufacturing and marketing of indoor resilient athletic flooring, and be a certified manufacturer in accordance with ISO 9001 and ISO 14001. Manufacturer must also have an authorized installer training program.

1.3.3 Installer Qualifications

Installer must have at least five years of experience in the installation of resilient athletic flooring, and have experience on at least five projects of similar size, type and complexity as this Project. Installer must also utilize workers for this Project who are competent in techniques required by manufacturer of resilient athletic flooring installation indicated.

1.3.4 Laboratory Test Results

1.3.4.1 Performance Properties

Provide certification documents indicating testing per ASTM F2772 has been performed and the product being supplied complies with the ASTM category/classification specified for this project. Information from product catalogs or sales literature is not sufficient.

1.3.4.2 Shock Absorption

Shock absorption (force reduction) test results certified by an independent testing laboratory certified to perform such testing.

- a. ASTM test must be from certified North American laboratories.
- b. EN and DIN test must be from certified European laboratories.

1.3.4.3 Fire Performance

Provide fire performance test results.

1.3.5 Fire Test Characteristics

As determined by testing identical products according to ASTM E648, Class 1, by a qualified testing agency acceptable to authorities having jurisdiction.

1.3.6 Athletic Performance Properties

Comply with ASTM F2772 Performance Level C2 for force reduction and ball rebound.

1.3.7 Adhesive Application

Adhesive applied and poured-in-place flooring must be installed by an experienced floor applicator approved by the manufacturer.

1.3.8 Flooring Material Samples

Submit three samples minimum 9 x 11 inches of each color of flooring material required and manufacturer's certificates stating that the resilient athletic flooring materials conform to the specified requirements. Labels or markings affixed to manufacturer's products attesting that products meet requirements specified herein will be accepted in lieu of certificates.

1.4 CERTIFICATIONS

1.4.1 Indoor Air Quality Certifications

Submit required indoor air quality certifications in one submittal package.

1.4.1.1 Floor Covering Materials

Provide rubber composition tile, sheet rubber composition flooring, sheet vinyl composition flooring, and wall base products certified to meet indoor air quality requirements by FLOORSORE, UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or

validation by other third-party program that products meet the requirements of this Section. Provide resilient mat underlay products certified to meet indoor air quality requirements by FLOORSCORE, UL 2818 (GreenGuard) Gold, SCS Global Services Indoor Advantage Gold, CRI GL CUSHION or provide certification or validation by other third-party program that products meet the requirements of this Section. Provide indoor-outdoor carpeting products certified to meet indoor air quality requirements by UL 2818 (GreenGuard) Gold, SCS Global Services Indoor Advantage Gold, CRI GLP QM or provide certification or validation by other third-party program that products meet the requirements of this Section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited herein.

1.5 DELIVERY, STORAGE, AND HANDLING

Deliver Materials in manufacturer's original unopened containers with labels intact. Do not deliver materials to the installation area or installed before all work that may damage the materials or the finished floor, such as overhead work, is completed. Store materials in a clean, dry area. Maintain materials in storage at temperatures recommended by the manufacturer. Store protection boards flat and off the ground.

- a. Store flooring and installation materials in protected dry spaces, with ambient temperatures maintained within range recommended by manufacturer, but less than 55 degrees F nor more than 85 degrees F.
- b. Store the indoor resilient athletic surfacing rolls in an upright position on a smooth flat surface immediately upon delivery to Project.

1.6 WARRANTY

1.6.1 Manufacturer's Warranty

Manufacturer's standard form in which manufacturer agrees to repair or replace sports flooring that fails within specified warranty period. Material warranty must be direct from the product manufacturer. Material warranties from separate or third party insurance providers are not valid. Material warranties from private label distributors are not valid.

Failures include, but are not limited to, the following:

- a. Material manufacturing defects.
- b. Surface wear and deterioration to the point of wear-through.
- c. Failure due to substrate moisture exposure not exceeding 80 percent relative humidity when tested according to ASTM F2170 or 5 pounds moisture vapor emission rate when tested according to ASTM F1869.

1.6.1.1 Warranty Period

For materials: Minimum of 2 years from date of Substantial Completion. For surface wear: minimum of 15 years from date of Substantial Completion.

1.6.2 Installer's Warranty

Installer's standard form in which installer agrees to repair or replace sports flooring that fails due to poor workmanship or faulty installation

within the specified warranty period.

1.7 COORDINATION

Coordinate layout and installation of flooring with other gymnasium equipment.

1.8 EXTRA MATERIALS

1.8.1 Flooring

Furnish extra sheet goods of each color at the rate of 5 feet for each color and type installed. Must be from the same lot as those installed.

1.8.2 Carpeting

Extra material from same dye lot consisting of full width continuous broadloom must be provided for maintenance. A minimum of 10% percent of total square yards of each carpet type, pattern, and color must be provided.

PART 2 PRODUCTS

2.1 FLOORING MATERIALS

2.1.1 Indoor-Outdoor Turf RM2

Carpet-type flooring that is spike proof consisting of a surface layer of rugged polypropylene fibers combined with a vulcanized rubber base layer artificial turf pattern consisting of a top layer of rugged polypropylene fibers combined with a vulcanized rubber base layer. Minimum total thickness must be 17 mm. Finished surface pile must be minimum 15 mm height. Test results for resistance to soil bacteria or fungi must show no sustained growth or discoloration after 21 days when tested in accordance with ASTM G21. Product must meet emissions requirements of CDPH SECTION 01350. Provide certification or validation of indoor air quality for Indoor-Outdoor Carpeting.

2.1.2 Sheet Rubber Composition Flooring Type RM1, RM3A, RM4, RM3B

Provide prefabricated, homogeneous, sheet rubber flooring, minimum 14.5 mm thick, and textured all-purpose finish of post-consumer vulcanized composition rubber granules encapsulated in wear and water resistant elastomeric network with fusion bonded reprocessed EPDM surface layer.

Base Layer: 12 mm
Base Layer RM3B: 5 mm
Surface Layer All: 2.5 mm

Provide roll type flooring not less than 48 inches wide. Flooring must have a minimum tensile stress at 100 percent elongation of 220 psi and a minimum ultimate elongation of 250 percent when tested in accordance with ASTM D412. Flooring must be able to withstand 50 percent compression for 72 hours at 72 degrees F with a residual deformation of less than 10 percent when tested in accordance with ASTM D395. Flooring must provide a 55 plus or minus 5 percent rebound when tested in accordance with ASTM D1054. Product must meet emissions requirements of CDPH SECTION 01350. Provide certification or validation of indoor air quality for Sheet Rubber Composition Flooring.

2.1.3 Sheet Vinyl Composition Flooring Type RM6

Provide sheet vinyl flooring consisting of a solid polyvinyl chloride material that conforms to the chemical resistance requirements of ASTM F1303. Provide flooring not less than 70 inches wide and a minimum thickness of 7 mm. Provide smooth texture floor surface. Flooring must have a minimum coefficient of friction of 0.75 when tested in accordance with ASTM D1894. Provide flooring with an average thickness loss of 8.0 mils plus or minus 1 mil. Rebound resilience of flooring must be greater than 12 percent and less than 30 percent when tested in accordance with ASTM D2632. Product must meet emissions requirements of CDPH SECTION 01350. Provide certification or validation of indoor air quality for Sheet Vinyl Composition Flooring.

2.2 RESILIENT MAT UNDERLAY

Provide prefabricated resilient mat underlay consisting of granulated indoor/outdoor rubber mat bound with polyurethane for shock absorption. Mat thickness must be _____ inches. Product must meet emissions requirements of CDPH SECTION 01350. Provide certification or validation of indoor air quality for Resilient Mat Underlay.

2.3 ADHESIVES

Adhesive must be as recommended by the flooring manufacturer and correspond to the specified flooring product and to the substrate. Adhesive products used on the interior of the building (defined as inside of the weatherproofing system) must meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide validation of indoor air quality for adhesives.

2.4 CRACK FILLER/LEVELER FOR CONCRETE SURFACES

Provide crack filler/leveler for concrete floor surfaces as recommended by flooring manufacturer.

2.5 EDGING STRIPS

Provide strips of the same material and design as recommended by flooring manufacturer.

2.6 PRIMER

Concrete primer must be as recommended by flooring manufacturer and correspond to the specified flooring product and to the substrate. For interior applications (defined as inside of the weatherproofing system) of primer, provide products meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1113. Provide validation of indoor air quality for primer.

2.7 GAME LINE MATERIAL

Game line material must be as recommended by the flooring manufacturer and correspond to the specified flooring product. For interior applications (defined as inside of the weatherproofing system) of game line marking materials, provide products meeting either emissions requirements of

CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1113. Provide validation of indoor air quality for game line marking materials. Turf shall have side markers at every 3 feet and center ladder.

2.8 SEALANTS

provide sealants in accordance with Section 07 92 00 JOINT SEALANTS.

2.9 MANUFACTURERS COLOR

Color must be in accordance with Section 09 06 00 SCHEDULES FOR FINISHES and drawings.

PART 3 EXECUTION

3.1 PREPARATION

Concrete surfaces must be completely cured and dry. Do not use curing agents, sealers, or hardeners to aid in the curing of the concrete slab. Surfaces must be free of paint spots, and other foreign materials. Surfaces must be ground down or leveled with an approved leveling compound to a tolerance of plus or minus 1/8 inch within a 10 foot radius. Cracks, construction joints, or damaged portions of floor must be filled with crack filler for concrete surfaces. Expansion joints must be filled and sealed in accordance with the approved installation instructions of the manufacturer. All sealants must be in accordance with ASTM C920. Expansion joints must not be filled with a material that will make them inoperable.

3.2 MOISTURE TEST

Confirm that the moisture content of concrete subfloors is in the range recommended by the flooring manufacturer before floor installation.

3.3 INSTALLATION

Do not install building construction materials that show visual evidence of biological growth.

3.3.1 General Requirements

Installation must be in accordance with the approved installation instructions. Tile or sheet flooring must be rolled with a medium-sized roller in both directions to release entrapped air. Submit manufacturer's descriptive data and catalog cuts indicating materials of construction and physical characteristics. Installation, cleaning and maintenance instructions must be included.

3.3.2 Molded Rubber Base

Install base in accordance with the approved installation instructions of the manufacturer of the base.

3.3.3 Indoor-Outdoor Carpeting

Apply flooring as recommended by the manufacturer.

3.3.4 Sheet Vinyl Composition Flooring

Prime the concrete slab in accordance with approved installation instructions. Install flooring as recommended by the manufacturer.

3.3.5 Sheet Rubber Composition Flooring

Sheet flooring must be dry cut and layed out flat a minimum of 24 hours prior to adhering to the substrate. Single cut end seams. Cut edge seams through overlapping sheets, then snap into place to ensure tight seams. Weight seams as required.

3.3.6 Line Marking and Finishing

After installation is complete, clean the floor surface in accordance with installation instructions. Lay out, mask, and paint line marking according to approved detail drawings and approved installation instructions. Finish in accordance with the manufacturer's recommendations.

3.4 PROTECTION

Protect the installed flooring from soiling and damage with heavy reinforced, nonstaining kraft paper, plywood, or hardboard sheets as required. Lap and secure edges of kraft paper protection to provide a continuous cover. Remove protective covering when directed by the Contracting Officer.

-- End of Section --

This page left blank.

SECTION 09 84 20

ACOUSTICAL WALL PANELS

08/16, CHG 1: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM C423 (2023) Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method

ASTM E84 (2023) Standard Test Method for Surface Burning Characteristics of Building Materials

CALIFORNIA AIR RESOURCES BOARD (CARB)

CARB 93120 (2007) Airborne Toxic Control Measure (ATCM) to Reduce Formaldehyde Emissions from Composite Wood Products

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350 (2017; Version 1.2) Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers

FOREST STEWARDSHIP COUNCIL (FSC)

FSC STD 01 001 (2015) Principles and Criteria for Forest Stewardship

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 101 (2024) Life Safety Code

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Approved Detail Drawings; G

SD-03 Product Data

Installation

Acoustical Wall Panels; G

Indoor Air Quality for Composite Wood and Agrifiber Products

SD-04 Samples

Acoustical Wall Panels; G

SD-07 Certificates

Acoustical Wall Panels

SD-11 Closeout Submittals

Warranty

1.3 CERTIFICATIONS

1.3.1 Certified Sustainably Harvested Wood

Provide wood certified as sustainably harvested by FSC STD 01 001. Provide a letter of Certification of Sustainably Harvested Wood signed by the wood supplier. Identify certifying organization and their third party program name and indicate compliance with chain-of-custody program requirements. Submit sustainable wood certification data; identify each certified product on a line item basis. Submit copies of invoices bearing certification numbers.

1.4 DELIVERY, STORAGE, AND HANDLING

Protect materials delivered and placed in storage from the weather, humidity and temperature variations, dirt, dust, or other contaminants.

1.5 WARRANTY

Provide manufacturer's standard performance guarantees or warranties that extend beyond a one year period.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

2.1.1 Design

Provide cementitious wood acoustical wall panel materials in the manufacturer's standard sizes and finishes of the type, design and configuration indicated.

2.1.1.1 Sustainably Harvested Wood

Wood Panels must contain a minimum of 50 percent certified sustainably harvested wood. Provide documentation that certified sustainably harvested wood is used and identify percentage.

Composite wood and agrifiber products must contain no added urea-formaldehyde resins. Products containing composite wood and agrifiber components must meet emissions requirements of either CARB 93120 or CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type). Provide validation of indoor air quality for composite wood and agrifiber products.

Provide cementitious wood acoustical wall panels consisting of prefinished, factory assembled, seamless fabric covered, fiber glass or mineral fiber core system as described below manufactured to the dimensions and configurations shown on the approved detail drawings; submit drawings showing plan locations, elevations and details of method of anchorage, shape and thickness of materials. Perimeter edges must be reinforced by either an aluminum frame or a formulated resin edge hardener. Acoustical wall panels must comply with the interior finish requirements of NFPA 101. Submit manufacturer's descriptive data and catalog cuts; 3 samples of each color range specified; and certificates of compliance from an independent laboratory accredited by the National Laboratory Accreditation Program of the National Institute of Standards. A label or listing from the testing laboratory will be acceptable evidence of compliance. Wall panels must conform to the following:

2.1.1.2 Panel Width

Panel width must be as detailed.

2.1.1.3 Panel Height

Panel height must be as detailed.

2.1.1.4 Thickness

Panel thickness and mounting as required to meet the indicated NRC range of 0.60.

2.1.1.5 Fire Rating for the Complete Composite System

Class A, 200 or less smoke density and flame spread less than 25, when tested in accordance with ASTM E84.

2.1.1.6 Substrate

Cementitious wood fiber, painted or printed with digital photos.

2.1.1.7 Noise Reduction Coefficient (NRC) Range

0.50-0.60 ASTM C423

2.1.1.8 Edge Detail

Bevel.

2.1.1.9 Core Type

Cementitious wood fiber.

2.1.1.10 Mounting Acoustical Panels

Mount acoustical panels by manufacturer's standard mechanical fasteners, direct attach over furring strips.

2.2 COLOR

In accordance with Section 09 06 00 SCHEDULES FOR FINISHES and as indicated. Color listed is not intended to limit the selection of equal colors from other manufacturers.

PART 3 EXECUTION

3.1 SURFACE CONDITIONS

Must be clean, smooth, oil free and prepared in accordance with panel manufacturer's instructions. Do not begin installation until all wet work, such as, plastering, painting, and concrete are completely dry.

3.2 INSTALLATION

Panel installation must be by personnel familiar with and normally engaged in installation of acoustical wall panels. Apply panels in accordance with the manufacturer's installation instructions. Submit manufacturer's installation instructions and recommended cleaning instructions.

3.3 CLEANING

Following installation, clean dirty or stained panel surfaces in accordance with manufacturer's instructions and leave free from defects. Remove and replace panels that are damaged, discolored, or improperly installed.

-- End of Section --

SECTION 09 90 00

PAINTS AND COATINGS

02/21

PART 1 GENERAL

1.1 RELATED REQUIREMENTS

1.1.1 Painting Included

Where a space or surface is indicated to be painted, include the following unless indicated otherwise.

- a. Surfaces behind portable objects and surface mounted articles readily detachable by removal of fasteners, such as screws and bolts.
- b. New factory finished surfaces that require identification or color coding and factory finished surfaces that are damaged during performance of the work.
- c. Existing coated surfaces that are damaged during performance of the work.

1.1.1.1 Exterior Painting

Includes new surfaces, and existing coated surfaces, of exterior doors. Also included are existing coated surfaces made bare by cleaning operations. Refer to Section 09 96 00 High Performance Coatings for exterior steel/deck and interior steel.

1.1.1.2 Interior Painting

Includes new surfaces, existing uncoated surfaces, and existing coated surfaces of the building and appurtenances as indicated and existing coated surfaces made bare by cleaning operations. Where a space or surface is indicated to be painted, include the following items, unless indicated otherwise.

- a. Exposed columns, girders, beams, joists, and metal deck; and
- b. Other contiguous surfaces.

1.1.2 Painting Excluded

Do not paint the following unless indicated otherwise.

- a. Surfaces concealed and made inaccessible by panelboards, fixed ductwork, machinery, and equipment fixed in place.
- b. Surfaces in concealed spaces. Concealed spaces are defined as enclosed spaces above suspended ceilings, furred spaces.
- c. Steel to be embedded in concrete.
- d. Copper, stainless steel, aluminum, anodized aluminum, brass, and lead except existing coated surfaces.

- e. Hardware, fittings, and other factory finished items.

1.1.3 Mechanical and Electrical Painting

Includes field coating of interior new and existing surfaces.

- a. Where a space or surface is indicated to be painted, include the following items unless indicated otherwise.
 - (1) Exposed piping, conduit, and ductwork;
 - (2) Supports, hangers, air grilles, and registers;
 - (3) Miscellaneous metalwork and insulation coverings.
- b. Do not paint the following, unless indicated otherwise:
 - (1) New zinc-coated, aluminum, and copper surfaces under insulation
 - (2) New aluminum jacket on piping
 - (3) New interior ferrous piping under insulation.

1.2 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN CONFERENCE OF GOVERNMENTAL INDUSTRIAL HYGIENISTS (ACGIH)

ACGIH 0100 (2017; Suppl 2020) Documentation of the Threshold Limit Values and Biological Exposure Indices

ASTM INTERNATIONAL (ASTM)

ASTM D235 (2002; R 2012) Mineral Spirits (Petroleum Spirits) (Hydrocarbon Dry Cleaning Solvent)

ASTM D523 (2014; R 2018) Standard Test Method for Specular Gloss

ASTM D4214 (2007; R 2015) Standard Test Method for Evaluating the Degree of Chalking of Exterior Paint Films

ASTM D4263 (1983; R 2018) Standard Test Method for Indicating Moisture in Concrete by the Plastic Sheet Method

ASTM D4444 (2013; R 2018) Standard Test Method for Laboratory Standardization and Calibration of Hand-Held Moisture Meters

ASTM D6386 (2016a) Standard Practice for Preparation of Zinc (Hot-Dip Galvanized) Coated Iron and Steel Product and Hardware Surfaces for Painting

ASTM F1869 (2016a) Standard Test Method for Measuring
Moisture Vapor Emission Rate of Concrete
Subfloor Using Anhydrous Calcium Chloride

CENTERS FOR DISEASE CONTROL AND PREVENTION (CDC)

Intelligence Bulletin 65 (2013) Occupational Exposure to Carbon
Nanotubes and Nanofibers

MASTER PAINTERS INSTITUTE (MPI)

MPI 3 (2016) Primer, Alkali Resistant, Water
Based

MPI 11 (2016) Latex, Exterior Semi-Gloss, MPI
Gloss Level 5

MPI 4 (2016) Interior/Exterior Latex Block Filler

MPI 23 (2015) Primer, Metal, Surface Tolerant

MPI 42 (2012) Textured Coating, Latex, Flat

MPI 47 (2016) Alkyd, Interior, Semi-Gloss (MPI
Gloss Level 5)

MPI 48 (2016) Alkyd, Interior, Gloss (MPI Gloss
Level 6-7)

MPI 49 (2015) Alkyd, Interior, Flat (MPI Gloss
Level 1)

MPI 51 (2016) Alkyd, Interior, (MPI Gloss Level
3)2

MPI 52 (2016) Latex, Interior, (MPI Gloss Level 3)

MPI 76 (2016) Primer, Alkyd, Quick Dry, for Metal

MPI 95 (2015) Primer, Quick Dry, for Aluminum

MPI 101 (2016) Primer, Epoxy, Anti-Corrosive, for
Metal

MPI 134 (2015) Primer, Galvanized, Water Based

MPI 107 (2016) Primer, Rust-Inhibitive, Water Based

MPI 139 (2016) Latex, Interior, High Performance
Architectural, (MPI Gloss Level 3)

MPI ASM (2019) Architectural Painting
Specification Manual

MPI GPS-1-14 (2014) Green Performance Standard GPS-1-14

MPI GPS-2-14 (2014) Green Performance Standard GPS-2-14

MPI MRM (2015) Maintenance Repainting Manual

SOCIETY FOR PROTECTIVE COATINGS (SSPC)

SSPC 7/NACE No.4 (2007) Brush-Off Blast Cleaning

SSPC Glossary (2011) SSPC Protective Coatings Glossary

SSPC PA 1 (2016) Shop, Field, and Maintenance Coating of Metals

SSPC SP 1 (2015) Solvent Cleaning

SSPC SP 2 (2018) Hand Tool Cleaning

SSPC SP 3 (2018) Power Tool Cleaning

SSPC SP 6/NACE No.3 (2007) Commercial Blast Cleaning

SSPC SP 10/NACE No. 2 (2015) Near-White Blast Cleaning

SSPC VIS 1 (2002; E 2004) Guide and Reference Photographs for Steel Surfaces Prepared by Dry Abrasive Blast Cleaning

SSPC VIS 3 (2004) Guide and Reference Photographs for Steel Surfaces Prepared by Hand and Power Tool Cleaning

SSPC VIS 4/NACE VIS 7 (1998; E 2000; E 2004) Guide and Reference Photographs for Steel Surfaces Prepared by Waterjetting

SSPC-SP WJ-1/NACE WJ-1 (2012) Clean to Bare Substrate, Waterjet Cleaning of Metals

SSPC-SP WJ-2/NACE WJ-2 (2012) Very Thorough Cleaning, Waterjet Cleaning of Metals

SSPC-SP WJ-3/NACE WJ-3 (2012) Thorough Cleaning, Waterjet Cleaning of Metals

SSPC-SP WJ-4/NACE WJ-4 (2012) Light Cleaning, Waterjet Cleaning of Metals

U.S. ARMY CORPS OF ENGINEERS (USACE)

EM 385-1-1 (2014) Safety -- Safety and Health Requirements Manual

U.S. DEPARTMENT OF DEFENSE (DOD)

MIL-STD-101 (2014; Rev C) Color Code for Pipelines and for Compressed Gas Cylinders

U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA)

EPA Method 24 (2000) Determination of Volatile Matter Content, Water Content, Density, Volume

Solids, and Weight Solids of Surface
Coatings

U.S. GENERAL SERVICES ADMINISTRATION (GSA)

FED-STD-313

(2018) Material Safety Data,
Transportation Data and Disposal Data for
Hazardous Materials Furnished to
Government Activities

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1910.1000

Air Contaminants

1.3 DEFINITIONS

1.3.1 Qualification Testing

Qualification testing is the performance of all test requirements listed in the product specification. This testing is accomplished by MPI to qualify each product for the MPI Approved Product List, and may also be accomplished by Contractor's third-party testing lab if an alternative to Batch Quality Conformance Testing by MPI is desired.

1.3.2 Batch Quality Conformance Testing

Batch quality conformance testing determines that the product provided is the same as the product qualified to the appropriate product specification. This testing must be accomplished by an MPI testing lab.

1.3.3 Coating

SSPC Glossary; (1) A liquid, liquefiable, or mastic composition that is converted to a solid protective, decorative, or functional adherent film after application as a thin layer; (2) Generic term for paint, lacquer, enamel.

1.3.4 DFT or dft

Dry film thickness, the film thickness of the fully cured, dry paint or coating.

1.3.5 DSD

Degree of Surface Degradation, the MPI system of defining degree of surface degradation. Five levels are generically defined under the Assessment sections in the MPI MRM, MPI Maintenance Repainting Manual.

1.3.6 INT

MPI short term designation for an interior coating system.

1.3.7 Loose Paint

Paint or coating that can be removed with a dull putty knife.

1.3.8 mil / mils

The English measurement for 0.001 inch or one one-thousandth of an inch.

1.3.9 MPI Gloss Levels

MPI system of defining gloss. Seven gloss levels (G1 to G7) are generically defined under the Evaluation sections of the MPI Manuals. Traditionally, Flat refers to G1/G2, Eggshell refers to G3, Semigloss refers to G5, and Gloss refers to G6.

Gloss levels are defined by MPI as follows:

Gloss Level	Description	Units at 60 degree angle	Units at 80 degree angle
G1	Matte or Flat	0 to 5	10 max
G2	Velvet	0 to 10	10 to 35
G3	Eggshell	10 to 25	10 to 35
G4	Satin	20 to 35	35 min
G5	Semi-Gloss	35 to 70	
G6	Gloss	70 to 85	
G7	High Gloss		

Gloss is tested in accordance with ASTM D523. Historically, the Government has used Flat (G1 / G2), Eggshell (G3), Semi-Gloss (G5), and Gloss (G6).

1.3.10 MPI System Number

The MPI coating system number in each MPI Division found in either the MPI Architectural Painting Specification Manual or the Maintenance Repainting Manual and defined as an exterior (EXT/REX) or interior system (INT/RIN).

1.3.11 Paint

SSPC Glossary; (1) Any pigmented liquid, liquefiable, or mastic composition designed for application to a substrate in a thin layer that is converted to an opaque solid film after application. Used for protection, decoration, identification, or to serve some other functional purposes; (2) Application of a coating material.

1.3.12 RIN

MPI short term designation for an interior coating system used in repainting projects or over existing coating systems.

1.4 SCHEDULING

Allow paint, polyurethane, varnish, and wood stain installations to cure prior to the installation of materials that adsorb VOCs.

1.5 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for

Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

Samples of specified materials may be taken and tested for compliance with specification requirements.

SD-02 Shop Drawings

Piping Identification

SD-03 Product Data

Coating; G

Product Data Sheets

SD-04 Samples

Color; G

SD-07 Certificates

Qualification Testing laboratory for coatings; G

Indoor Air Quality for Paints and Primers

Indoor Air Quality for Consolidated Latex Paints

SD-08 Manufacturer's Instructions

Application Instructions

Mixing

Manufacturer's Safety Data Sheets

SD-10 Operation and Maintenance Data

Coatings, Data Package 1; G

1.6 QUALITY ASSURANCE

1.6.1 Regulatory Requirements

1.6.1.1 Environmental Protection

In addition to requirements specified elsewhere for environmental protection, provide coating materials that conform to the restrictions of the local Air Pollution Control District and regional jurisdiction. Notify Contracting Officer of any paint specified herein which fails to conform.

1.6.1.2 Lead Content

Do not use coatings having a lead content over 0.06 percent by weight of nonvolatile content.

1.6.1.3 Chromate Content

Do not use coatings containing zinc-chromate or strontium-chromate.

1.6.1.4 Asbestos Content

Provide asbestos-free materials.

1.6.1.5 Mercury Content

Provide materials free of mercury or mercury compounds.

1.6.1.6 Silica

Provide abrasive blast media containing no free crystalline silica.

1.6.1.7 Human Carcinogens

Provide materials that do not contain ACGIH 0100 confirmed human carcinogens (A1) or suspected human carcinogens (A2).

1.6.1.8 Carbon Based Fibers / Tubes

Materials must not contain carbon based fibers such as carbon nanotubes or carbon nanofibers. Intelligence Bulletin 65 ranks toxicity of carbon nanotubes on a par with asbestos.

1.6.2 Coating Contractor's Qualification

Submit the name, address, telephone number, and e-mail address of the Contractor that will be performing all surface preparation and coating application. Submit evidence that key personnel have successfully performed surface preparation and application of coatings on a minimum of three similar projects within the past three years. List information by individual and include the following:

- a. Name of individual and proposed position for this work.
- b. Information about each previous assignment including:

Position or responsibility

Employer (if other than the Contractor)

Name of facility owner

Mailing address and telephone number of facility owner

Name of individual in facility owner's organization who can be contacted as a reference

Location, size and description of structure

Dates work was carried out

Description of work carried out on structure

1.6.3 Approved Products List

The current MPI, "Approved Product List" which lists paint by brand, label, product name and product code as of the date of Contract award, will be used to determine compliance with the submittal requirements of this specification. The Contractor may choose to use a subsequent MPI "Approved Product List", however, only one list may be used for the entire Contract and each coating system is to be from a single manufacturer. Provide all coats on a particular substrate from a single manufacturer. No variation from the MPI Approved Products List is acceptable.

1.6.4 Paints and Coatings Indoor Air Quality Certifications

Provide paint and coating products certified to meet indoor air quality requirements by MPI GPS-1-14, MPI GPS-2-14 or provide certification by other third-party programs. Provide current product certification documentation from certification body.

Provide certification of Indoor Air Quality for Paints and Primers.
Provide certification of Indoor Air Quality for Consolidated Latex Paints.
Submit required indoor air quality certifications in one submittal package.

1.6.5 Field Samples and Tests

The Contracting Officer may choose up to two coatings that have been delivered to the site to be tested at no cost to the Government. Take samples of each chosen product as specified in the paragraph SAMPLING PROCEDURE. Test each chosen product as specified in the paragraph TESTING PROCEDURE. Remove products from the job site which do not conform, and replace with new products that conform to the referenced specification. Test replacement products that failed initial testing as specified in the paragraph TESTING PROCEDURE at no cost to the Government.

1.6.5.1 Sampling Procedure

Select paint at random from the products that have been delivered to the job site for sample testing. The Contractor must provide one quart samples of the selected paint materials. Take samples in the presence of the Contracting Officer, and label, and identify each sample. Provide labels in accordance with the paragraph PACKAGING, LABELING, AND STORAGE.

1.6.5.2 Testing Procedure

Provide Batch Quality Conformance Testing for specified products, as defined by and performed by MPI. As an alternative to Batch Quality Conformance Testing, the Contractor may provide Qualification Testing for specified products above to the appropriate MPI product specification, using the third-party laboratory approved under the paragraph QUALIFICATION TESTING laboratory for coatings. Include the backup data and summary of the test results within the qualification testing lab report. Provide a summary listing of all the reference specification requirements and the result of each test. Clearly indicate in the summary whether the tested paint meets each test requirement. Note that Qualification Testing may take 4 to 6 weeks to perform, due to the extent of testing required.

Submit name, address, telephone number, FAX number, and e-mail address of the independent third party laboratory selected to perform testing of

coating samples for compliance with specification requirements. Submit documentation that laboratory is regularly engaged in testing of paint samples for conformance with specifications, and that employees performing testing are qualified. If MPI is chosen to perform the Batch Quality Conformance testing, the above submittal information is not required, only a letter is required from the Contractor stating that MPI will perform the testing.

1.7 PACKAGING, LABELING, AND STORAGE

Provide paints in sealed containers that legibly show the Contract specification number, designation name, formula or specification number, batch number, color, quantity, date of manufacture, manufacturer's formulation number, manufacturer's directions including any warnings and special precautions, and name and address of manufacturer. Furnish pigmented paints in containers not larger than 5 gallons. Store paints and thinners in accordance with the manufacturer's written directions, and as a minimum, stored off the ground, under cover, with sufficient ventilation to prevent the buildup of flammable vapors, and at temperatures between 40 to 95 degrees F.

1.8 SAFETY AND HEALTH

Comply with applicable Federal, State, and local laws and regulations, and with the ACCIDENT PREVENTION PLAN, including the Activity Hazard Analysis as specified in Section 01 35 26 GOVERNMENTAL SAFETY REQUIREMENTS and in Appendix A of EM 385-1-1. Include in the Activity Hazard Analysis the potential impact of painting operations on painting personnel and on others involved in and adjacent to the work zone.

1.8.1 Toxic Materials

To protect personnel from overexposure to toxic materials, conform to the most stringent guidance of:

- a. The applicable manufacturer's Safety Data Sheets (SDS) or local regulation.
- b. 29 CFR 1910.1000.
- c. ACGIH 0100, threshold limit values.

Submit manufacturer's Safety Data Sheets for coatings, solvents, and other potentially hazardous materials, as defined in FED-STD-313.

1.9 ENVIRONMENTAL REQUIREMENTS

Comply, at minimum, with manufacturer recommendations for space ventilation during and after installation. Isolate area of application from rest of building when applying high-emission paints or coatings.

1.9.1 Coatings

Do not apply coating when air or substrate conditions are:

- a. Less than 5 degrees F above dew point;
- b. Below 50 degrees F or over 95 degrees F, unless specifically

pre-approved by the Contracting Officer and the product manufacturer. Do not, under any circumstances, violate the manufacturer's application recommendations.

PART 2 PRODUCTS

2.1 MATERIALS

Conform to the coating specifications and standards referenced in PART 3. Submit Product Data Sheets for specified coatings and solvents. Provide preprinted cleaning and maintenance instructions for all coating systems. Submit Manufacturer's Instructions on Mixing: Detailed mixing instructions, minimum and maximum application temperature and humidity, pot life, and curing and drying times between coats.

2.2 COLOR SELECTION OF FINISH COATS

Provide colors of finish coats as indicated or specified. Allow Contracting Officer to select colors not indicated or specified. Manufacturers' names and color identification are used for the purpose of color identification only. Named products are acceptable for use only if they conform to specified requirements. Products of other manufacturers are acceptable if the colors are approximately the colors indicated and the product conforms to specified requirements.

Provide color, texture, and pattern of wall coating systems in accordance with Section 09 06 00 SCHEDULES FOR FINISHES . Submit manufacturer's samples of paint colors. Cross reference color samples to color scheme as indicated. Submit color stencil codes. Tint each coat progressively darker to enable confirmation of the number of coats.

PART 3 EXECUTION

3.1 PROTECTION OF AREAS AND SPACES NOT TO BE PAINTED

Prior to surface preparation and coating applications, remove, mask, or otherwise protect hardware, hardware accessories, machined surfaces, radiator covers, plates, lighting fixtures, public and private property, and other such items not to be coated that are in contact with surfaces to be coated. Following completion of painting, reinstall removed items by workmen skilled in the trades. Restore surfaces contaminated by coating materials, to original condition and repair damaged items.

3.2 SURFACE PREPARATION

Remove dirt, splinters, loose particles, grease, oil, disintegrated coatings, and other foreign matter and substances deleterious to coating performance as specified for each substrate before application of paint or surface treatments. Remove oil and grease prior to mechanical cleaning. Schedule cleaning so that dust and other contaminants will not fall on wet, newly painted surfaces. Spot-prime exposed ferrous metals such as nail heads on or in contact with surfaces to be painted with water-thinned paints, with a suitable corrosion-inhibitive primer capable of preventing flash rusting and compatible with the coating specified for the adjacent areas. Refer to MPI ASM and MPI MRM for additional more specific substrate preparation requirements.

3.2.1 Additional Requirements for Preparation of Surfaces With Existing Coatings

Before application of coatings, perform the following on surfaces covered by soundly-adhered coatings, defined as those which cannot be removed with a putty knife:

- a. Test existing finishes for lead before sanding, scraping, or removing. If lead is present, refer to paragraph Toxic Materials.
- b. Wipe previously painted surfaces to receive solvent-based coatings, except stucco and similarly rough surfaces clean with a clean, dry cloth saturated with mineral spirits, ASTM D235 or as specified in MPI MRM. Wipe the surfaces dry with a clean, dry, lint free cloth. Wipe immediately preceding the application of the first coat of any coating, unless specified otherwise.
- c. Sand existing glossy surfaces to be painted to reduce gloss. Brush, and wipe clean with a damp cloth to remove dust.
- d. The requirements specified are minimum. Comply also with the application instructions of the paint manufacturer and specific surface preparation requirements as outlined in MPI MRM Exterior Surface Preparation and Interior Surface Preparation.
- e. Thoroughly clean previously painted surfaces specified to be repainted or damaged during construction of all grease, dirt, dust or other foreign matter.
- f. Remove blistering, cracking, flaking and peeling or otherwise deteriorated coatings.
- g. Remove chalk so that when tested in accordance with ASTM D4214, the chalk resistance rating is no less than 8.
- h. Roughen slick surfaces. Repair damaged areas such as, but not limited to, nail holes, cracks, chips, and spalls with suitable material to match adjacent undamaged areas.
- i. Feather and sand smooth edges of chipped paint.
- j. Clean rusty metal surfaces in accordance with SSPC requirements. Use solvent, mechanical, or chemical cleaning methods to provide surfaces suitable for painting.
- k. Provide new, proposed coatings that are compatible with existing coatings.

3.2.2 Existing Coated Surfaces with Minor Defects

Sand, spackle, and treat minor defects to render them smooth. Minor defects are defined as scratches, nicks, cracks, gouges, spalls, alligatoring, chalking, and irregularities due to partial peeling of previous coatings.

3.2.3 Removal of Existing Coatings

Remove existing coatings from the following surfaces:

- a. Surfaces containing large areas of minor defects;
- b. Surfaces containing more than 20 percent peeling area; and
- c. Surfaces designated by the Contracting Officer, such as surfaces where rust shows through existing coatings.

3.3 PREPARATION OF METAL SURFACES

3.3.1 Existing and New Ferrous Surfaces

- a. Ferrous Surfaces including Shop-coated Surfaces and Small Areas That Contain Rust, Mill Scale and Other Foreign Substances: Solvent clean or detergent wash in accordance with SSPC SP 1 to remove oil and grease. Where shop coat is missing or damaged, clean according to SSPC SP 2, SSPC SP 3, SSPC SP 6/NACE No.3, or SSPC SP 10/NACE No. 2. Protect shop-coated ferrous surfaces from corrosion by treating and touching up corroded areas immediately upon detection.
- b. Surfaces With More Than 20 Percent Rust, Mill Scale, and Other Foreign Substances: Clean entire surface in accordance with SSPC SP 6/NACE No.3 / SSPC-SP WJ-3/NACE WJ-3.

3.3.2 Final Ferrous Surface Condition:

3.3.2.1 Tool Cleaned Surfaces

Comply with SSPC SP 2 and SSPC SP 3. Use as a visual reference, photographs in SSPC VIS 3 for the appearance of cleaned surfaces.

3.3.2.2 Abrasive Blast Cleaned Surfaces

Comply with SSPC 7/NACE No.4, SSPC SP 6/NACE No.3, and SSPC SP 10/NACE No. 2. Use as a visual reference, photographs in SSPC VIS 1 for the appearance of cleaned surfaces.

3.3.2.3 Waterjet Cleaned Surfaces

Comply with SSPC-SP WJ-1/NACE WJ-1, SSPC-SP WJ-2/NACE WJ-2, SSPC-SP WJ-3/NACE WJ-3 or SSPC-SP WJ-4/NACE WJ-4. Use as a visual reference, photographs in SSPC VIS 4/NACE VIS 7 for the appearance of cleaned surfaces.

3.3.3 Galvanized Surfaces

- a. New or Existing Galvanized Surfaces With Only Dirt and Zinc Oxidation Products: Clean with solvent, or non-alkaline detergent solution in accordance with SSPC SP 1. Completely remove coating by brush-off abrasive blast if the galvanized metal has been passivated or stabilized. Do not "passivate" or "stabilize" new galvanized steel to be coated. If the absence of hexavalent stain inhibitors is not documented, test as described in ASTM D6386, Appendix X2, and remove by one of the methods described therein.

3.3.4 Non-Ferrous Metallic Surfaces

Aluminum and aluminum-alloy, lead, copper, and other nonferrous metal surfaces.

Surface Cleaning: Solvent clean in accordance with SSPC SP 1 and wash with mild non-alkaline detergent to remove dirt and water soluble contaminants.

3.4 PREPARATION OF CONCRETE AND CEMENTITIOUS SURFACE

3.4.1 Concrete and Masonry

- a. Curing: Allow concrete, stucco and masonry surfaces to cure at least 30 days before painting, and concrete slab on grade to cure at least 90 days before painting.
- b. Surface Cleaning: Remove the following deleterious substances.
 - (1) Dirt, Chalking, Grease, and Oil: Wash new and existing uncoated surfaces with a solution composed of 1/2 cup trisodium phosphate, 1/4 cup household detergent, and 4 quarts of warm water. Then rinse thoroughly with fresh water. Wash existing coated surfaces with a suitable detergent and rinse thoroughly. For large areas, water blasting may be used.
 - (2) Fungus and Mold: Wash , existing coated, and existing uncoated surfaces with a solution composed of 1/2 cup trisodium phosphate, 1/4 cup household detergent, one quart 5 percent sodium hypochlorite solution and 3 quarts of warm water. Rinse thoroughly with fresh water.
 - (3) Paint and Loose Particles: Remove by wire brushing.
 - (4) Efflorescence: Remove by scraping or wire brushing followed by washing with a 5 to 10 percent by weight aqueous solution of hydrochloric (muriatic) acid. Do not allow acid to remain on the surface for more than five minutes before rinsing with fresh water. Do not acid clean more than 4 square feet of surface, per workman, at one time.
 - (5) Removal of Existing Coatings: For surfaces to receive textured coating MPI 42, remove existing coatings including soundly adhered coatings if recommended by textured coating manufacturer.
- c. Cosmetic Repair of Minor Defects: Repair or fill mortar joints and minor defects, including but not limited to spalls, in accordance with manufacturer's recommendations and prior to coating application.
- d. Allowable Moisture Content: Latex coatings may be applied to damp surfaces, but not to surfaces with droplets of water. Do not apply epoxies to damp vertical surfaces as determined by ASTM D4263 or horizontal surfaces that exceed 3 lbs of moisture per 1000 square feet in 24 hours as determined by ASTM F1869. In all cases follow manufacturer's recommendations. Allow surfaces to cure a minimum of 30 days before painting.

3.4.2 Gypsum Board, Plaster, and Stucco

3.4.2.1 Surface Cleaning

Verify that plaster and stucco surfaces are free from loose matter and that gypsum board is dry. Remove loose dirt and dust by brushing with a soft brush, rubbing with a dry cloth, or vacuum-cleaning prior to

application of the first coat material. A damp cloth or sponge may be used if paint is water-based.

3.4.2.2 Repair of Minor Defects

Prior to painting, repair joints, cracks, holes, surface irregularities, and other minor defects with patching plaster or spackling compound and sand smooth.

3.4.2.3 Allowable Moisture Content

Latex coatings may be applied to damp surfaces, but not surfaces with droplets of water. Do not apply epoxies to damp surfaces as determined by ASTM D4263. Verify that new plaster to be coated has a maximum moisture content of 8 percent, when measured in accordance with ASTM D4444, Method A, unless otherwise authorized. In addition to moisture content requirements, allow new plaster to age a minimum of 30 days before preparation for painting.

3.5 APPLICATION

3.5.1 Coating Application

- a. Comply with applicable federal, state and local laws enacted to ensure compliance with Federal Clean Air Standards. Apply coating materials in accordance with SSPC PA 1. SSPC PA 1 methods are applicable to all substrates, except as modified herein.
- b. At the time of application, paint must show no signs of deterioration. Maintain uniform suspension of pigments during application.
- c. Unless otherwise specified or recommended by the paint manufacturer, paint may be applied by brush, roller, or spray. Use trigger operated spray nozzles for water hoses. Use rollers for applying paints and enamels of a type designed for the coating to be applied and the surface to be coated. Wear protective clothing and respirators when applying oil-based paints or using spray equipment with any paints.
- d. Only apply paints, except water-thinned types, to surfaces that are completely free of moisture as determined by sight or touch.
- e. Thoroughly work coating materials into joints, crevices, and open spaces. Pay special attention to ensure that all edges, corners, crevices, welds, and rivets receive a film thickness equal to that of adjacent painted surfaces.
- f. Apply each coat of paint so that dry film is of uniform thickness and free from runs, drops, ridges, waves, pinholes or other voids, laps, brush marks, and variations in color, texture, and finish. Completely hide all blemishes.
- g. Touch up damaged coatings before applying subsequent coats. Broom clean and clear dust from interior areas before and during the application of coating material.

3.5.2 Mixing and Thinning of Paints

Reduce paints to proper consistency by adding fresh paint, except when

thinning is mandatory to suit surface, temperature, weather conditions, application methods, or for the type of paint being used. Obtain written permission from the Contracting Officer to use thinners. Verify that the written permission includes quantities and types of thinners to use.

When thinning is allowed, thin paints immediately prior to application with not more than one pint of suitable thinner per gallon. The use of thinner does not relieve the Contractor from obtaining complete hiding, full film thickness, or required gloss. Thinning cannot cause the paint to exceed limits on volatile organic compounds. Do not mix paints of different manufacturers.

3.5.3 Two-Component Systems

Mix two-component systems in accordance with manufacturer's instructions. Follow recommendation by the manufacturer for any thinning of the first coat to ensure proper penetration and sealing for each type of substrate.

3.5.4 Coating Systems

- a. Systems by Substrates: Apply coatings that conform to the respective specifications listed in the following Tables:

Table for Interior Applications	
MPI Division	Substrate Application
MPI Division 3	Interior Concrete Paint Table
MPI Division 4	Interior Concrete Masonry Units Paint Table
MPI Division 5	Interior Metal, Ferrous and Non-Ferrous Paint Table
MPI Division 6	Interior Wood Paint Table
MPI Division 9	Interior Plaster, Gypsum Board, Textured Surfaces Paint Table

- b. Minimum Dry Film Thickness (DFT): Apply paints, primers, varnishes, enamels, undercoats, and other coatings to a minimum dry film thickness of 1.5 mil each coat unless specified otherwise in the Tables. Coating thickness, where specified, refers to the minimum dry film thickness.
- c. Coatings for Surfaces Not Specified Otherwise: Coat unspecified surfaces the same as surfaces having similar conditions of exposure.
- d. Existing Surfaces Damaged During Performance of the Work, Including New Patches In Existing Surfaces: Coat surfaces with the following:
- (1) One coat of primer.
 - (2) One coat of undercoat or intermediate coat.
 - (3) One topcoat to match adjacent surfaces.
- e. Existing Coated Surfaces To Be Painted: Apply coatings conforming to

the respective specifications listed in the Tables herein, except that pretreatments, sealers and fillers need not be provided on surfaces where existing coatings are soundly adhered and in good condition. Do not omit undercoats or primers.

3.6 COATING SYSTEMS FOR METAL

Apply coatings of Tables in MPI Division 5 for Exterior and Interior.

- a. Apply specified ferrous metal primer to steel surfaces on the same day that surface is cleaned, to surfaces that meet all specified surface preparation requirements at time of application.
- b. Inaccessible Surfaces: Prior to erection, use one coat of specified primer on metal surfaces that will be inaccessible after erection.
- c. Shop-primed Surfaces: Touch up exposed substrates and damaged coatings to protect from rusting prior to applying field primer.
- d. Surface Previously Coated with Epoxy or Urethane: Apply MPI 101, 1.5 mils DFT immediately prior to application of epoxy or urethane coatings.
- e. Pipes and Tubing: The semitransparent film applied to some pipes and tubing at the mill is not to be considered a shop coat. Overcoat these items with the specified ferrous-metal primer prior to application of finish coats.
- f. Exposed Nails, Screws, Fasteners, and Miscellaneous Ferrous Surfaces. On surfaces to be coated with water thinned coatings, spot prime exposed nails and other ferrous metal with latex primer MPI 107.

3.7 COATING SYSTEMS FOR CONCRETE AND CEMENTITIOUS SUBSTRATES

Apply coatings of Tables in MPI Division 3, 4 and 9 for Exterior and Interior.

3.8 PIPING IDENTIFICATION

Piping Identification, Including Surfaces In Concealed Spaces: Provide in accordance with MIL-STD-101. Place stenciling in clearly visible locations. On piping not covered by MIL-STD-101, stencil approved names or code letters, in letters a minimum of 1/2 inch high for piping and a minimum of 2 inches high elsewhere. Stencil arrow-shaped markings on piping to indicate direction of flow using black stencil paint.

3.9 INSPECTION AND ACCEPTANCE

In addition to meeting previously specified requirements, demonstrate mobility of moving components, including swinging and sliding doors, cabinets, and windows with operable sash, for inspection by the Contracting Officer. Perform this demonstration after appropriate curing and drying times of coatings have elapsed and prior to invoicing for final payment.

3.10 WASTE MANAGEMENT

As specified in the Waste Management Plan and as follows. Do not use kerosene or any such organic solvents to clean up water based paints.

Properly dispose of paints or solvents in designated containers. Close and seal partially used containers of paint to maintain quality as necessary for reuse. Store in protected, well-ventilated, fire-safe area at moderate temperature. Place materials defined as hazardous or toxic waste in designated containers.

3.11 PAINT TABLES

All DFT's are minimum values. Use only materials with a MPI GPS-1-14 green check mark having a minimum MPI "Environmentally Friendly" E1 E2 E3 rating based on VOC (EPA Method 24) content levels. Acceptable products are listed in the MPI Green Approved Products List, available at <http://www.specifygreen.com/APL/ProductIdxByMPInum.asp>.

3.11.1 Exterior Paint Tables

3.11.1.1 MPI Division 5: Exterior Metal, Ferrous and Non-Ferrous Paint TableB. Exterior Galvanized Surfaces

(1) New Galvanized surfaces

Waterborne Primer / Latex				
New Galvanized Surfaces	Primer	Intermediate	Topcoat	System DFT
EXT 5.3H-G5 (Semigloss)	MPI 134	MPI 11	MPI 11	4.5 mils
Topcoat: Coating to match adjacent surfaces.				

3.11.2 Interior Paint Tables

3.11.2.1 MPI Division 3: Interior Concrete Paint Table

A. New and uncoated existing and Existing, previously painted Concrete, vertical surfaces, not specified otherwise

Latex					
New, uncoated Existing	Existing, previously painted	Primer	Intermediate	Topcoat	System DFT
MPI INT 3.1A-G3 (Eggshell)	MPI RIN 3.1A-G3 (Eggshell)	MPI 3	MPI 52	MPI 52	4 mils

Topcoat: Coating to match adjacent surfaces.					

3.11.2.2 MPI Division 4: Interior Concrete Masonry Units Paint Table

A. New and uncoated Existing Concrete Masonry

High Performance Architectural Latex					
New, uncoated Existing	Filler	Primer	Intermediate	Topcoat	System DFT
MPI INT 4.2D-G3 (Eggshell)	MPI 4	N/A	MPI 139	MPI 139	11 mils
Fill all holes in masonry surface					

B. Existing, Previously Painted Concrete Masonry

High Performance Architectural Latex					
Existing, previously painted	Filler	Primer	Intermediate	Topcoat	System DFT
MPI RIN 4.2K-G3 (Eggshell)	N/A	MPI 139	MPI 139	MPI 139	4.5 mils

--	--	--	--	--	--

3.11.2.3 MPI Division 5: Interior Metal, Ferrous and Non-Ferrous Paint Table

A. Interior Steel / Ferrous Surfaces

(1) Metal, Mechanical, Electrical, Surfaces adjacent to painted surfaces (Match surrounding finish), exposed copper piping, and miscellaneous metal items not otherwise specified except floors, hot metal surfaces, and new prefinished equipment

High Performance Architectural Latex				
New, uncoated Existing	Primer	Intermediate	Topcoat	System DFT
MPI INT 5.1R-G3 (Eggshell)	MPI 76	MPI 139	MPI 139	5 mils
Topcoat: Coating to match adjacent surfaces.				

(3) Metal in toilets, restrooms, shower areas, areas requiring a high degree of sanitation, and other high-humidity areas not otherwise specified except floors, hot metal surfaces, and new prefinished equipment

Alkyd				
New, uncoated Existing	Primer	Intermediate	Topcoat	System DFT
MPI INT 5.1E-G3 (Eggshell)	MPI 76	MPI 51	MPI 51	5.25 mils
MPI INT 5.1E-G5 (Semigloss)	MPI 76	MPI 47	MPI 47	5.25 mils
MPI INT 5.1E-G6 (Gloss)	MPI 76	MPI 48	MPI 48	5.25 mils

Topcoat: Coating to match adjacent surfaces.

Alkyd; For Hand Tool Cleaning				
New, uncoated Existing	Primer	Intermediate	Topcoat	System DFT
MPI INT 5.1T-G3 (Eggshell)	MPI 23	MPI 51	MPI 51	5.25 mils
MPI INT 5.1T-G5 (Semigloss)	MPI 23	MPI 47	MPI 47	5.25 mils
MPI INT 5.1T-G6 (Gloss)	MPI 23	MPI 48	MPI 48	5.25 mils
Topcoat: Coating to match adjacent surfaces.				

(5) Miscellaneous non-ferrous metal items not otherwise specified except floors, hot metal surfaces, and new prefinished equipment. Match surrounding finish

High Performance Architectural Latex				
New, uncoated Existing	Primer	Intermediate	Topcoat	System DFT
MPI INT 5.4F-G3 (Eggshell)	MPI 95	MPI 139	MPI 139	5 mils
Topcoat: Coating to match adjacent surfaces.				

Alkyd				
New, uncoated Existing	Primer	Intermediate	Topcoat	System DFT
MPI INT 5.4J-G2 (Flat)	MPI 95	MPI 49	MPI 49	5 mils
MPI INT 5.4J-G3 (Eggshell)	MPI 95	MPI 51	MPI 51	5 mils

MPI INT 5.4J-G5 (Semigloss)	MPI 95	MPI 47	MPI 47	5 mils
MPI INT 5.4J-G6 (Gloss)	MPI 95	MPI 48	MPI 48	5 mils
Topcoat: Coating to match adjacent surfaces.				

-- End of Section --

SECTION 09 96 00

HIGH-PERFORMANCE COATINGS

07/07

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM B117	(2016) Standard Practice for Operating Salt Spray (Fog) Apparatus
ASTM D2794	(1993; R 2010) Resistance of Organic Coatings to the Effects of Rapid Deformation (Impact)
ASTM D3359	(2009; E 2010; R 2010) Measuring Adhesion by Tape Test
ASTM D4060	(2010) Abrasion Resistance of Organic Coatings by the Taber Abraser
ASTM D4541	(2009; E 2010) Pull-Off Strength of Coatings Using Portable Adhesion Testers
ASTM D522	(1993a; R 2008) Mandrel Bend Test of Attached Organic Coatings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Submit Material, Equipment and Fixture List in accordance with paragraph entitled, "Delivery, Handling and Storage," of this section.

SD-03 Product Data

Submit manufacturer's catalog data for the following items including manufacturer's name and identification. Data shall include detailed analysis of each special coating material required for the project, with all the coating constituents measured as percentages of the total weight of the coating. Manufacturer's data concerning surface preparation, application recommendations and requirements, thinning, and average coverage per gallon shall be included. Performance criteria for each

material shall be reported per listed ASTM test methods for the type/method/duration/number of cycles listed shall be included.

Organic Zinc Rich Moisture Cured Urethane Primer; G
Epoxy Coatings; G
Polyurethane Coatings; G

SD-04 Samples

Color Chips; G

Submit sample Color Chips in accordance with paragraph entitled, "Delivery, Handling and Storage," of this section.

SD-07 Certificates

Submit certificates for following items showing conformance with the referenced standards contained in this section.

Organic Zinc Rich Moisture Cured Urethane Primer
Epoxy Coatings
Polyurethane Coatings

1.3 DELIVERY, HANDLING AND STORAGE

Special coating materials must be delivered to the project in their original containers bearing manufacturer's name, descriptive label, and coating formulations. Provide new and unopened containers.

Special coating materials must be stored in tightly closed containers in a covered, well-ventilated area where they will not be exposed to excessive heat, fumes, sparks, flame, or direct sunlight. Protect water-based coatings against freezing.

Solvents, thinners, and equipment cleaners must be stored with the same care as the coating materials with ambient temperatures continuously maintained at a minimum 45 degrees F.

Submit Material, Equipment and Fixture List consisting of a list of proposed equipment to be used in performance of construction work.

Submit three color chips 3 inch by 4 inch or manufacture pull-down of each finish color and gloss as scheduled.

1.4 FIELD TESTS

Government may take dry-film tests from time to time on finished surfaces. Apply additional coatings to surfaces where there is less than the minimum specified dry-film thickness.

Manufacturer's recommended procedures regarding acceptable recoat windows and surface preparation prior to recoating shall be honored.

1.5 PROTECTIONS AND SAFETY PRECAUTIONS

Protect adjacent materials and equipment against damage from spillage, dripping, and spatter of coating materials. Building materials and equipment must be left clean and with all damaged surfaces corrected. Provide "WET PAINT" signs to indicate newly painted surfaces.

Provide forced ventilation for interior spaces during application and drying of coatings to prevent the buildup of toxic or explosive concentrations of solvent vapors.

Provide fire extinguishers of the required quantity and correct type to combat flammable liquid fires.

Dispose of rags that are used to wipe up coating materials, solvents, and thinners by drenching them with water and placing in a covered metal container.

1.6 QUALITY ASSURANCE

Comply with Society for Protective Coatings (SSPC) standards indicated and all written recommendations of the coating system manufacturer, including surface preparations, and installation environmental conditions.

PART 2 PRODUCTS

2.1 BASIS OF DESIGN AND STANDARD OF QUALITY

Products of Tnemec Company, Inc. (6800 Corporate Drive, Kansas City, MO 64120) are listed as the basis of design and standard of quality by which all submitted products shall be evaluated.

Products of other manufacturers of equal quality and which provide equal performance to the specified products will be evaluated for approval by the Government when properly submitted.

Any product which alters the generic chemistry of the components that makeup the specified systems, the total number of coats to be applied and/or the total dry film thicknesses of the installed systems shall be rejected.

Submittals shall include all pertinent product data, independent third party test reports, product samples and side by side comparisons of the substitution to the specified products in order to be considered complete for evaluation by the Government. Incomplete submittals shall be rejected.

2.2 HIGH PERFORMANCE COATING SYSTEMS

Provide high performance coating on all new exposed steel (interior and exterior) and interior frame. Provide at underside of exposed metal deck at porch.

2.2.1 Ferrous Metal Surface Coatings

Coatings on ferrous metal surfaces must consist of a shop applied moisture cured urethane organic zinc rich prime coat, epoxy intermediate coat and polyurethane or Polyfunctional hybrid urethane finish coat. Comply with 2.4 COATING SCHEDULE, System A. Zinc pigment in the cured film of the shop applied moisture cured urethane organic zinc rich primer must not be less than 83 percent of the total weight of the coating material. Apply shop primer with a total dry-film thickness of not less than 2.5 mils. Provide an epoxy-based intermediate coat and polyurethane or polyfunctional hybrid urethane finish coat as specified.

2.2.2 Galvanized Metal Surface Coatings

Coatings on galvanized metal surfaces must consist of an epoxy prime coat and polyurethane finish coat. Comply with 2.5 COATING SCHEDULE, System B. Provide an epoxy-based primer and polyurethane finish coat as specified.

2.3 HIGH PERFORMANCE COATING PRODUCT PERFORMANCE CRITERIA

2.3.1 General

Provide submittal data for each of the listed performance tests by type, method, duration and/or number of cycles for each material as listed herein:

2.3.2 Organic Zinc Rich Moisture Cured Urethane Primer

Basis of Design: Tnemec Series 90G-1K97 Tneme-Zinc
Product Type: Organic Zinc Rich Moisture Cured Urethane
Performance Criteria:

Adhesion: ASTM D3359 (Method B, Type II Tester)/ASTM D4541
Flexibility & Elongation: ASTM D522
Humidity: ASTM D 4585 - 15,000 Hours
Immersion: ASTM D 870 (Tap Water) - 2 Years/ASTM D 870
(Deionized water @ 140°F) - 2,000 Hours
Impact: ASTM D2794 - Average of 3 Tests
Prohesion: ASTM G 85 - 9,000 Hours
Salt Fog Spray: ASTM B117 - 20,000 Hours

2.3.3 Polyamide Epoxy

Basis of Design: Tnemec Series 1095 Endura-Shield
Product Type: Aliphatic Acrylic Polyurethane
Performance Criteria:

Abrasion: ASTM D4060 (CS-17 Wheel, 1,000 gram load) - 1,000 Cycles
Adhesion: ASTM D3359 (Method B, 5mm Crosshatch)/ASTM D 4541
(Method B, Type II)/ASTM D 4541 (Method E, Type V)
Exterior Exposure: ASTM D 4141 (Method C, EMMAQUA) - 1,000 MJ
UV Exposure
Flexibility & Elongation: ASTM D522 (Methods A & B, Conical Mandrel)
Humidity: ASTM D 4585 - 4,000 Hours
Impact: ASTM D2794
Prohesion: ASTM G 85 - 10,000 Hours
QUV Exposure: ASTM D 4587 (UVA-340 Bulbs, Cycle 4: 8 Hours UV/4
Hours Condensation) - 5,000 Hours
Salt Spray: ASTM B117 - 10,000 Hours

2.3.4 Polyfunctional Hybrid Urethane

Basis of Design: Tnemec Series 740 UVX
Product Type: Polyfunctional Hybrid Urethane
Performance Criteria:

Abrasion: ASTM D 4060 (CS-17 Wheel, 1,000 gram load) - 1,000 Cycles
Adhesion: ASTM D 4541 (Method B, Type II Tester)/ASTM D 4541 (Method
E, Type V Tester)
Cleanability: MIL-PRF 85285D, Section 4.6.13
Flexibility & Elongation: ASTM D522 (Method A, Conical Mandrel)/ASTM
D 522 (Method A, Conical Mandrel)
Fungal/Mold/Mildew Resistance: ASTM D 5590 - 4 Weeks Exposure
Hardness: ASTM D 3363

Humidity: ASTM D 4585 - 2,000 Hours
QUV Exposure: ASTM D 4587 (UVA-340 Bulbs, 8 Hours UV/4 Hours Dark) -
10,000 Hours
Salt Spray: ASTM B117 - 2,500 Hours

2.4 COATING SYSTEM A: FERROUS METAL SUBSTRATES, EXTERIOR EXPOSURE

Surface Preparation: SSPC SP6/NACE No. 3 Commercial Blast Cleaning
Shop Primer: Tnemec Series 90G-1K97 Tneme-Zinc at 2.5 to 3.5 mils DFT
Field Touch Up: Tnemec Series 90G-1K97 Tneme-Zinc at 2.5 to 3.5 mils DFT
Stripe Coat: Tnemec Series 66HS Hi-Build Epoxoline at 4.0 to 6.0 mils DFT
Intermediate: Tnemec Series 66HS Hi-Build Epoxoline at 4.0 to 6.0 mils DFT
Finish: Tnemec Series 740 UVX at 2.0 to 5.0 mils DFT
Total Coating System Thickness: 8.5 to 14.5 mils DFT
Total Number of Full Coats: Three (3)

2.5 COATING SYSTEM B: GALVANIZED METAL SUBSTRATES

Surface Preparation: ASTM D 6386
Primer: Tnemec Series 66HS Hi-Build Epoxoline at 4.0 to 6.0 mils DFT
Intermediate: Tnemec Series 1095 Endura-Shield at 2.5 to 5.0 mils DFT
Finish: Tnemec Series 1095 Endura-Shield 2.5 to 5.0 mils DFT
Total Coating System Thickness: 9.0 to 16.0 mils DFT
Total Number of Coats: Three (3)

PART 3 EXECUTION

3.1 SURFACE PREPARATION

3.1.1 Shop Primed Steel Substrates

Abrasive blast in accordance with SSPC SP-6/NACE No. 3 Commercial Blast Cleaning to achieve a minimum angular anchor profile of 1.5 mils. Shop applied primer shall be installed in a controlled environment sufficient to comply with high-performance coating manufacturer's stipulated application conditions, including proper abrasive media blast surface preparation and applicable temperature and humidity range values during application and cure. Shop application at a third party facility within these guidelines is acceptable.

3.1.1.1 Field Touch Up of Shop Primed Steel Substrates

Remove loose or damaged shop applied primer and clean exposed steel in accordance with SSPC SP11 Power Tool Cleaning to Bare Metal. Clean using methods recommended in writing by coating manufacturer.

3.1.1.2 Galvanized-Metal Substrates

Remove all soluble and insoluble contaminants and corrosion. Remove any storage stains per Section 6.2 of ASTM D 6386. Sweep (abrasive) blast per ASTM D 6386 to achieve a uniform anchor profile (1.0 - 2.0 mils).

3.2 COATING MATERIAL PREPARATION

3.2.1 General

Mix and prepare coating materials in accordance with the coating manufacturer's printed instructions for the particular material and coat to be applied. Keep materials which are not in actual use in closed

containers.

Coating materials that have been mixed with an automatic shaker must be allowed to stand to let air bubbles escape, then given a final hand mixing before application. Stir materials so as to produce a mixture of uniform density. Stir at frequent intervals during application to prevent skinning. Do not stir film which may form on the surface of the material. Remove film and strain, if necessary.

3.2.2 Thinning

Thinning must be done in accordance with coating manufacturer's printed directions for the particular material and coat.

3.2.3 Tinting

Prime and intermediate coats of paint must be a slightly different tint from the finish coat to facilitate identification of each coat. Tinting must be done by the coating manufacturer and clearly identified as to color and coat.

3.3 APPLICATION OF COATING MATERIALS

3.3.1 General

Do not perform exterior painting in damp or rainy weather. Interior painting must not be allowed until the building is enclosed and has thoroughly dried out. Do not allow painting below 50 degrees F and above 95 degrees F. Painting application must be in accordance with the coating manufacturer's recommendations, and as specified.

Application of coatings must be done by skilled applicators. Apply coatings to clean and properly prepared surfaces. Apply coatings carefully with clean, high-quality application equipment. Allow sufficient time between coats to ensure complete drying and curing. Surfaces must be sanded and dusted between coatings, as required, to produce a surface free of visible defects. High gloss coatings and clear finishes must be lightly sanded between coats to ensure bond of following coats.

Apply coats to the surfaces in an even film. Do not accept cloudiness, spotting, holidays, laps, application marks, runs, sags, and other similar surface imperfections. Remove defective coating applications and recoat as directed.

Coating lines such as wainscots must be sharp, true, and well-defined. Tape may be used to establish coating lines, providing tape is removed before ragging or sawtooth edges form.

Surfaces, including edges, corners, crevices, welds, and other similar changes in surface plane, must receive a dry-film thickness not less than specified. Apply stripe coat of primer or intermediate coat product to all sharp edges, corners, protrusions, etc. as required to ensure full specified DFT is achieved.

3.3.2 Brush Application

Brushes must be clean and the proper size and type for high-quality application of the specified coating materials. Slow-dry coatings must be

brushed out. Quick-dry coatings must be brushed only enough to spread out evenly.

3.3.3 Roller Application

Roller covers must be clean and of the proper nap length, nap texture, and material for high-quality application of the specified coating materials.

Roller application must be done carefully and must be equivalent in all respects to the same coats applied by high-quality brush application.

3.3.4 Spray Application

Spray equipment must be as recommended by the coating system manufacturer for each product used. Use of undersized or non-compliant equipment shall not be allowed. Equipment must be clean and operated by workmen skilled in high quality application of coating materials.

Spray application of coatings must be limited to finish coats on metal frame works, siding, decking, wire mesh, and other surfaces where hand work would be inferior. Sprayed coatings must be carefully applied and equivalent in all respects to the same coats applied by high quality brush application. Each spray coat must be permitted to cure before the succeeding coat is applied. Do not permit doubling back with application equipment, for the purpose of building up film thickness of two coats in one operation.

Surfaces adjacent to areas to be spray coated shall be covered to prevent damage from overspray, coating rebound, and spray drift.

3.4 ACCEPTANCE PROVISIONS

3.4.1 Repairing

Remove damaged and unacceptable portions of completed work and replace with new work to match adjacent surfaces at no additional cost to the Government.

3.4.2 Cleaning

At end of each workday, remove rubbish, empty cans, rags, and other discarded materials from Project site.

After completing coating application, clean spattered surfaces. Remove spattered coatings by washing, scraping, or other methods. Do not scratch or damage adjacent finished surfaces.

Application equipment must be cleaned promptly and thoroughly with a suitable solvent after each use and stored in a clean, covered, well-ventilated container.

Protect work of other trades against damage from coating operation. Correct damage by cleaning, repairing, replacing, and recoating, as approved by Architect, and leave in an undamaged condition. At completion of construction activities of other trades, touch up and restore damaged or defaced coated surfaces.

-- End of Section --

This page left blank.

SECTION 10 14 00.10

EXTERIOR SIGNAGE
08/17, CHG 1: 11/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ALUMINUM ASSOCIATION (AA)

AA DAF45 (2003; Reaffirmed 2009) Designation System
for Aluminum Finishes

AMERICAN WELDING SOCIETY (AWS)

AWS C1.1M/C1.1 (2019) Recommended Practices for
Resistance Welding

ASTM INTERNATIONAL (ASTM)

ASTM B26/B26M (2018; E 2018) Standard Specification for
Aluminum-Alloy Sand Castings

ASTM B108/B108M (2019) Standard Specification for
Aluminum-Alloy Permanent Mold Castings

ASTM B209 (2014) Standard Specification for Aluminum
and Aluminum-Alloy Sheet and Plate

ASTM B209M (2014) Standard Specification for Aluminum
and Aluminum-Alloy Sheet and Plate (Metric)

ASTM B221 (2021) Standard Specification for Aluminum
and Aluminum-Alloy Extruded Bars, Rods,
Wire, Profiles, and Tubes

ASTM B221M (2021) Standard Specification for Aluminum
and Aluminum-Alloy Extruded Bars, Rods,
Wire, Profiles, and Tubes (Metric)

1.2 GENERAL REQUIREMENTS

Exterior signage must be provided by a single manufacturer. Exterior signage will be made up of two sizes of letters - text will be confirmed with users prior to fabrication. Letters must conform to the requirements specified, and must be provided at the locations indicated. Submit exterior signage schedule in electronic media with spread sheet format. Spread sheet must include sign location, letter type and size including mounting accessories, and message. Signs must be complete with related components for a complete installation. Each sample must consist of finished letters and symbols. Samples may be installed in the work, provided each sample is identified and location recorded. Submit three color samples for each size letter and mounting accessories.

1.2.1 Wind Load Requirements

Exterior signage must be designed to withstand windloads as noted on Structural drawings. Submit design analysis and supporting calculations performed in support of specified signage.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. Submit the following in accordance with Section 01 33 00

SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Approved Detail Drawings; G

SD-03 Product Data

Exterior Signage; G

Wind Load Requirements

SD-04 Samples

Exterior Signage; G

SD-10 Operation and Maintenance Data

Protection and Cleaning; G

1.4 QUALIFICATIONS

Dimensional letters must be the standard product of a manufacturer regularly engaged in the manufacture of the products. Items of equipment must essentially duplicate equipment that has been in satisfactory use at least 2 years prior to bid opening.

1.5 DELIVERY AND STORAGE

Materials must be wrapped for shipment and storage, delivered to the jobsite in manufacturer's original packaging, and stored in a clean, dry area in accordance with manufacturer's instructions.

1.6 WARRANTY

Manufacturer's standard performance guarantees or warranties that extend beyond a one year period must be provided.

PART 2 PRODUCTS

2.1 DIMENSIONAL BUILDING LETTERS

2.1.1 Fabrication

Letters must be fabricated from cast aluminum . Letters must be cleaned

by chemical etching or cleaned ultrasonically in a special degreasing bath. Letters must be packaged for protection until installation.

2.1.2 Typeface

Typeface must be helvetica medium .

2.1.3 Size

Letter size must be 16-inches and 6-inches. Contractor to include (20) twenty 16-inch letters and (25) twenty-five 6-inch letters..

2.1.4 Finish

Medium bronze anodized finish must be provided.

2.1.5 Mounting

Threaded studs for cmu/stucco wall of number and size as recommended by manufacturer, must be used for concealed anchorage.

2.2 ALUMINUM ALLOY PRODUCTS

Aluminum alloy products must conform to ASTM B209 for sheet or plate, ASTM B221 for extrusions and ASTM B26/B26M or ASTM B108/B108M for castings. Aluminum extrusions must be provided at least 1/8 inch thick and aluminum plate or sheet at least 16 gauge thick. Welding for aluminum products must conform to AWS C1.1M/C1.1.

2.3 ANODIC COATING

Anodized finish must conform to AA DAF45 as follows:

Integrated color anodized designation AA-M10-C22-A32, Architectural Class 0.4 to 0.7 mil. Medium bronze anodized.

PART 3 EXECUTION

3.1 INSTALLATION

Dimensional letters must be installed in accordance with approved manufacturer's instructions at locations shown on the approved detail drawings; submit drawings showing elevations of each type of sign; dimensions, details, and methods of mounting or anchoring; shape and thickness of materials; and details of construction. Location and message must be included. Signs must be installed plumb and true at mounting heights indicated, and by method shown or specified. Submit manufacturer's installation instructions and cleaning instructions.

3.1.1 Anchorage

Anchorage and fastener materials must be in accordance with approved manufacturer's instructions for the indicated substrate. Anchorage not otherwise specified or indicated must include slotted inserts, expansion shields, and powder-driven fasteners when approved for concrete; toggle bolts and through bolts for masonry; machine carriage bolts for steel; lag bolts and screws for wood.

3.1.2 Protection and Cleaning

The work must be protected against damage during construction. Sign surfaces must be cleaned in accordance with manufacturer's instructions. Submit six copies of maintenance instructions listing routine maintenance procedures, possible breakdowns and repairs, and troubleshooting guides. The instructions must include simplified diagrams for the equipment as installed. Signs must be cleaned, as required, at time of cover removal.

-- End of Section --

SECTION 10 14 00.20

INTERIOR SIGNAGE

08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by basic designation only.

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

36 CFR 1191

Americans with Disabilities Act (ADA)
Accessibility Guidelines for Buildings and
Facilities; Architectural Barriers Act
(ABA) Accessibility Guidelines

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Installation

SD-03 Product Data

Room Identification And Directional Signage System; G

SD-04 Samples

Interior Signage; G

Room Identification Signage System; G

SD-08 Manufacturer's Instructions

Installation

SD-10 Operation and Maintenance Data

Approved Manufacturer's Instructions

Protection and Cleaning

1.3 EXTRA MATERIALS

Provide 2 extra frames and extra stock of the following: blank plates of each color and size for all sign types included in project. 2 changeable message strips for sign type . Provide 2 paper inserts and laser print templates to support end-user printing copy one copy of the software for user produced signs and inserts after project completion and equipment

necessary for removal of signage parts and pieces.

1.4 QUALITY ASSURANCE

1.4.1 Samples

Submit interior signage samples of each of the following sign types showing typical quality, workmanship and color: Room Identification Signage System. Approved samples may be installed in the work, provided each sample is identified and location recorded.

1.4.2 Detail Drawings

Submit detail drawings showing elevations of each type of sign, dimensions, details and methods of mounting or anchoring, mounting height, shape and thickness of materials, and details of construction. Include a schedule showing the location, each sign type, and message.

1.4.3 Sign Fabricator

Sign Fabricator to follow room number strategies created by designer. The room numbering system to be reviewed and approved by the Contracting Officer and command end users during the shop drawing phase, and prior to fabrication.

1.5 DELIVERY, STORAGE, AND HANDLING

Package materials to prevent damage and deterioration during shipment, handling, storage and installation. Deliver products to the jobsite in manufacturer's original packaging and store in a clean, dry area in accordance with manufacturer's instructions.

1.6 WARRANTY

Provide manufacturer's warranty to repair or replace defective interior signage materials and workmanship for a period of 2 years from date of final acceptance of the work.

PART 2 PRODUCTS

2.1 ROOM IDENTIFICATION SIGNAGE SYSTEM - GENERAL DESCRIPTION

Provide signs that are standard products of manufacturers regularly engaged in the manufacture of such products that essentially duplicate signs that have been in satisfactory use at least 2 years prior to bid opening. Signs must match building standard language.

Signage shall be constructed with a front plastic laminate plate, fused to a plastic backer plate.

2.2 ARCHITECTURAL SIGNAGE SYSTEM

2.2.1 Typography

- a. Type style: Helvetica Medium. Copy shall be a true, clean, accurate reproduction of typeface(s) specified. Copy shall be all upper case. Letter spacing shall be normal and interline spacing shall be set by manufacturer.

- b. Arrows and symbols shall be black.
- c. Grade II Braille utilizing perfectly round, clear raster beads.

2.2.2 Surface Applied Photopolymer

Integral graphics and braille achieved by photomechanical stratification processes. Photopolymer used for ADA compliant graphics shall be of the type that has a minimum durometer reading of 90. Tactile graphics shall be raised 1/32 inch from the first surface of plaque by photomechanical stratification process.

2.2.3 Character Proportions and Heights

Letters and numbers on signs conform to 36 CFR 1191.

2.2.4 Raised and Braille Characters and Pictorial Symbol Signs (Pictograms)

Raised letters and numbers on signs shall conform to 36 CFR 1191.

2.3 SIGNS

2.3.1 Architectural Signage System

The signage system shall utilize modular components and a decorative laminate face with applied graphics including all tactile requirements in adherence to ADA specifications.

All signs, including emergency evacuation plan and informational sign shall have a matching appearance and constructed utilizing the same manufacturing process to assure a consistent look throughout.

2.3.2 Materials

Sign face shall be made of .035 standard grade, high pressure surface laminate. A painted sign face shall not be acceptable.

The sign core shall be thermo-set composite polyester based resin, color impregnated of .25 thickness. The expansion co-efficient of the core and laminate shall be matched to prevent warping and delamination. An acrylic core shall not be acceptable.

Tactile lettering shall be precision machined, raised 1/32 inch, matte polycarbonate and (select subsurface colored for scratch resistance or foil stamped for a brushed metal appearance).

Signs shall incorporate a metal accent bar. Bars shall be dyed, brushed anodized (select aluminum, brass, bronze or black) .125 inch thick.

2.3.3 Standard Colors

Face/background color shall be as indicated on the drawings.

Standard tactile colors shall match manufacturer's ADA standard color selection.

Core/backer color shall be black and polished to a satin luster.

2.3.4 Construction

The signage system shall utilize standard, interchangeable components that can be used singly or in combination.

The signage system shall be capable of accepting paper or acetate inserts to allow changing and updating as required. Insert modules shall have a .080 thickness non-glare acrylic window and shall be inlayed flush to sign face for a smooth, seamless appearance.

The signage system shall be a uniform 8-1/2 inch width to accommodate inserts printed on standard width paper.

Manufacturer shall provide a Word template containing layout, font, color, artwork and trim lines to allow owner to produce inserts on an ink jet printer.

The signage system shall include modules allowing for inserts, notice holders, occupancy sliders, marker, magnetic, and cork pin boards. All modules shall be flush to sign face for a smooth, seamless appearance.

The signage system shall utilize an acrylic sphere for Grade II Braille inserted directly into a mark and scratch resistant, high pressure laminate sign face. Braille dots are to be pressure fit in high tolerance milled holes. Braille dots shall be half hemispherical domed and protruding a minimum .025 high in compliance with California State code.

Sign face shall be neoprene adhesive vulcanized to a composite core and precision machined together to a 90-degree angle. Edges shall be, smooth void of chips, burrs, sharp edges, marks and polished to a satin luster.

The signage system shall incorporate a shim plate. The shim shall raise the sign off the wall allowing for cleaning and/or painting without removal.

Sign contractor responsible for:

Site evaluation
Location plan
All graphics including evacuation plan

2.3.5 Evacuation Plan Sign

Indicate path of travel and building exits clearly.

PART 3 EXECUTION

3.1 INSTALLATION

Signs shall be installed plumb and true and in accordance with approved manufacturer's instructions at locations shown on the detail drawings. Submit six copies of operating instructions outlining the step-by-step procedures required for system operation. The instructions shall include simplified diagrams for the system as installed, the manufacturer's name, model number, service manual, parts list, and brief description of all equipment and their basic operating features. Each set shall be permanently bound and shall have a hard cover. The following identification shall be inscribed on the covers: the words "OPERATING AND MAINTENANCE INSTRUCTIONS", name and location of the facility, name of the

Contractor, and contract number. Mounting height and mounting location shall conform to 36 CFR 1191. Required blocking shall be installed. Signs on doors or other surfaces shall not be installed until finishes on such surfaces have been installed. Signs installed on glass surfaces shall be installed with matching blank back-up plates in accordance with manufacturer's instructions and requirements of Section 01 78 23 OPERATION AND MAINTENANCE DATA, package 1.

3.1.1 Anchorage

Anchorage shall be in accordance with approved manufacturer's instructions. Anchorage not otherwise specified or shown shall include slotted inserts, expansion shields, and powder-driven fasteners when approved for concrete; toggle bolts and through bolts for masonry; machine carriage bolts for steel; lag bolts and screws for wood. Exposed anchor and fastener materials shall be compatible with metal to which applied and shall have matching color and finish. Foam tape pads and adhesives shall not be used. Signs mounted to painted gypsum board surfaces shall be removable for painting maintenance.

3.1.2 Protection and Cleaning

Protect the work against damage during construction. Hardware and electrical equipment shall be adjusted for proper operation. Glass, frames, and other sign surfaces shall be cleaned at completion of sign installation in accordance with the manufacturer's approved instructions and the requirements of Section 01 78 23 OPERATION AND MAINTENANCE DATA, Package 1. Submit six copies of maintenance instructions listing routine procedures, repairs, and guides.

3.2 Sign Placement

Locate signs in accordance with drawings.

-- End of Section --

This page left blank.

SECTION 10 26 00

WALL AND DOOR PROTECTION
08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ALUMINUM ASSOCIATION (AA)

AA DAF45 (2003; Reaffirmed 2009) Designation System
for Aluminum Finishes

ASTM INTERNATIONAL (ASTM)

ASTM B221 (2021) Standard Specification for Aluminum
and Aluminum-Alloy Extruded Bars, Rods,
Wire, Profiles, and Tubes

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350 (2010; Version 1.1) Standard Method for
the Testing and Evaluation of Volatile
Organic Chemical Emissions from Indoor
Sources using Environmental Chambers

GREEN SEAL (GS)

GS-36 (2013) Adhesives for Commercial Use

SOCIETY OF AUTOMOTIVE ENGINEERS INTERNATIONAL (SAE)

SAE J1545 (2005; R 2021) Instrumental Color
Difference Measurement for Exterior
Finishes, Textiles and Colored Trim

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168 (2017) Adhesive and Sealant Applications

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Corner Guards

SD-03 Product Data

Corner Guards

Recycled content for aluminum component of corner guards; S

SD-04 Samples

Corner Guards; G

SD-07 Certificates

Indoor air quality for adhesives

SD-10 Operation and Maintenance Data

Corner Guards, Data Package 1

1.3 CERTIFICATIONS

1.3.1 Indoor Air Quality

PART 2 PRODUCTS

2.1 CORNER GUARDS

2.1.1 Resilient Corner Guards

Provide surface mounted corner guards, radius formed to profile shown. Provide corner guards that must extend from the top of the base. Furnish mounting hardware, cushions, and base plates. Provide assembly consisting of a snap-on corner guard formed from high impact resistant resilient material, mounted on a continuous aluminum retainer. Extruded aluminum retainer conforms to ASTM B221, alloy 6063, temper T5 or T6. Provide aluminum components that contain a minimum of 35 percent recycled content. Provide data identifying percentage of recycled content for aluminum component of corner guards. Furnish factory fabricated end closure caps for top and bottom of surface mounted corner guards.

2.2 TRIM, FASTENERS AND ANCHORS

Provide vinylaluminum trim, fasteners and anchors for each specific installation as indicated.

2.3 FINISH

Submit samples indicating color and texture of materials requiring color and finish.

2.3.1 Aluminum Finish

Provide aluminum finish accordance with AA DAF45. Provide concealed aluminum with mill finish as fabricated, uniform in natural color and free from surface blemishes.

2.3.2 Resilient Material Finish

Provide resilient material finish of embossed velour texture with colors

in accordance with SAE J1545.

2.4 ADHESIVES

Provide adhesive for resilient material in accordance with manufacturers recommendations. Provide sealants and non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) that meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) the VOC content requirements of SCAQMD Rule 1168, or VOC content requirements of GS-36. Provide certification of indoor air quality for adhesives.

2.5 COLOR

Provide color as specified in Section 09 06 00 SCHEDULES FOR FINISHES and as indicated; colors listed are not intended to limit the selection of equal colors from other manufacturers.

PART 3 EXECUTION

3.1 INSTALLATION

Do not install items that show visual evidence of biological growth. Install items on surfaces that are clean, smooth, and free of obstructions.

-- End of Section --

This page left blank.

SECTION 10 28 13

TOILET ACCESSORIES

08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

U.S. DEPARTMENT OF DEFENSE (DOD)

MIL-STD-1691 (1994; Rev F) Construction and Material
Schedule for Military Medical and Dental
Facilities

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Product Schedule

Submit product Schedule indicating types, quantities, sizes, and installation locations by room for each toilet accessory item required. Identify locations using room designations indicated on the drawings.

SD-03 Product Data

Recycled content for stainless steel toilet accessories

SB (Item A5030) Fold-down Bench, Wall mounted; G

SD Wall Mounted Soap Dispenser, SS; G

WB Bullet Top Handsfree Wastebasket; G

MH Mop Broom Holder; G

PTD (Item A5080) Dispenser, Paper Towel, SS, Surface Mounted

SND (Item A5090) Disposal, Sanitary Napkin, SS, Surface Mounted; G

WH (Item A5145) Hook, Garment, Double, SS, Surface Mounted; G

Item A5145 Hook, Garment, Double, SS, Surface Mounted

Item A5200 Dispenser, Toilet Tissue, SS, 2-Roll, Surface Mntd

Submit catalog numbers, literature, data sheets, construction

details, profiles, anchoring and mounting requirements ,including cutouts in other work and substrate preparation, ,electrical characteristics, and other pertinent data for each toilet accessory item to evaluate function, materials, dimensions and appearance.

SD-10 Operation and Maintenance Data

SB (Item A5030) Fold-down Bench, Wall mounted; G

SD Wall Mounted Soap Dispenser, SS; G

WB Bullet Top Handsfree Wastebasket; G

MH Mop Broom Holder; G

PTD (Item A5080) Dispenser, Paper Towel, SS, Surface Mounted

SND (Item A5090) Disposal, Sanitary Napkin, SS, Surface Mounted; G

WH (Item A5145) Hook, Garment, Double, SS, Surface Mounted; G

Item A5145 Hook, Garment, Double, SS, Surface Mounted

Item A5200 Dispenser, Toilet Tissue, SS, 2-Roll, Surface Mntd

Submit Data Package 1 for each toilet accessory item, and Data Package 2 for each electrical toilet accessory item, in accordance with Section 01 78 23 OPERATIONS AND MAINTENANCE DATA.

1.3 DELIVERY, STORAGE, AND HANDLING

Wrap toilet accessories for shipment and storage, then deliver to the jobsite in manufacturer's original packaging, and store in a clean, dry area protected from construction damage and vandalism.

1.4 WARRANTY

Provide manufacturer's warranty to repair or replace defective materials and workmanship for a period of one year from date of final acceptance of the work.

PART 2 PRODUCTS

2.1 ACCESSORY ITEMS

Provide toilet accessories where indicated in accordance with Contractor-provided product schedule. Conform to the requirements for accessory items specified herein which are based on MIL-STD-1691 Joint Schedule Numbers (JSN). Provide each accessory item complete with the necessary mounting plates of sturdy construction with corrosion resistant surface.

Provide stainless steel products listed herein manufactured from materials containing a minimum of 50 percent recycled content. Provide data identifying percentage of recycled content for stainless steel toilet accessories.

2.1.1 Anchors and Fasteners

Provide corrosion-resistant anchors and fasteners capable of developing a restraining force commensurate with the strength of the accessory to be mounted and suited for use with the supporting construction. Provide tamperproof design exposed fasteners with finish to match the accessory. Provide fasteners proposed for use for each type of wall construction and mounting.

2.1.2 Finishes

Except where noted otherwise, provide the following finishes on metal:

Metal	Finish
Stainless steel	No. 4 satin finish
Carbon steel, copper alloy, and brass	Chromium plated, bright

2.1.3 SB (Item A5030) Fold Down Wall Mounted Bench

Wall mounted shower seat. Frame made of 18 gauge stainless steel with satin finish. Seat made of one piece of 1/2 inch thick nonporous solid phenolic with slots to permit water to drain, secured to frame with stainless steel carriage bolts and acorn nuts. Mounting hardware included. Seat to support a minimum static load of 250 pounds. Hinge seat to fold up when not in use.

Approximate size: 34 inches wide by 22 inches deep by 1/2 inch thick.

2.1.4 PTD (Item A5080) Dispenser, Paper Towel, SS, Surface Mounted

Surface mounted unit constructed of stainless steel with satin finish, welded construction, and have full length piano hinge, tumbler lock, refill indicator. Unit has smooth corners, free of burrs and sharp edges. Unit has a capacity of one roll of paper towels.

Approximate size: 11 inches wide by 8 inches high by 6 inches deep.

2.1.5 SND (Item A5090) Disposal, Sanitary Napkin, SS, Surface Mounted

Surface mounted sanitary napkin receptacle. Unit made of stainless steel with satin finish and all welded construction. Unit has piano hinge attached at the top and an integral finger depression for opening. For use with disposable paper liners, available separately. Unit may be attached to wall or toilet partition.

Approximate size: 7 inches wide by 4 inches deep by 10 inches high.

2.1.6 Item A5145 Hook, Garment, Double, SS, Surface Mounted

Surface mounted double garment hook made of stainless steel with satin finish. For use on door back or wall. Hook comes with concealed mounting bracket secured to concealed wall plate. Mounting hardware included. Flange size is approximately 2 inches by 2 inches.

2.1.7 TTD (Item A5200) Dispenser, Toilet Tissue, SS, 2-Roll, Surface Mounted

Concealed surface mounted, double roll, toilet tissue dispenser of stainless steel. Unit holds and dispenses two standard 5-1/4 inch diameter rolls of toilet tissue. Spindles are free-spinning for non-controlled delivery, chrome-plated plastic equipped with heavy-duty internal springs.

Approximate size: 7 inches diameter by 4 inches deep.

2.1.8 SD Wall Mounted Soap Dispenser

Type 316 stainless steel, heavy duty soap dispenser with corrosion resistant valve to dispense soap. Capacity 40 fl oz. 7 inch by 6-1/8 inch by 3-5/16 inch size.

Basis of Design: Bobrick B-18615

2.1.9 [Sub Title]

[Text]

2.1.10 [Sub Title]

[Text]

PART 3 EXECUTION

3.1 INSTALLATION

Do not install items that show visual evidence of biological growth. Provide the same finish for the surfaces of fastening devices exposed after installation as the attached accessory. Provide oval exposed screw heads. Install accessories at the location and height indicated. Protect exposed surfaces of accessories with strippable plastic or by other means until the installation is accepted. After acceptance of accessories, remove and dispose of strippable plastic protection. Coordinate accessory manufacturer's mounting details with other trades as their work progresses. Use sealants for brackets, plates, anchoring devices and similar items in showers (a silicone sealant specified in Section 07 92 00 JOINT SEALANTS) as they are set to provide a watertight installation. After installation, thoroughly clean exposed surfaces and restore damaged work to its original condition or replace with new work.

3.1.1 Surface Mounted Accessories

Mount on concealed backplates, unless specified otherwise. Conceal fasteners on accessories without backplates. Install accessories with corrosion-resistant fasteners as required by the construction. Install backplates in the same manner, or provide with lugs or anchors set in mortar, as required by the construction. Fasten accessories mounted on gypsum board and plaster walls without solid backing into the metal or wood studs, or to backplates secured to metal studs.

3.2 CLEANING

Clean material in accordance with manufacturer's recommendations. Do not use alkaline or abrasive agents. Take precautions to avoid scratching or

marring exposed surfaces.

-- End of Section --

This page left blank.

SECTION 10 44 16

FIRE EXTINGUISHERS

11/19

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 1 (2024) Fire Code
NFPA 10 (2022; ERTA 1 2021) Standard for Portable Fire Extinguishers
NFPA 101 (2024) Life Safety Code

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1910.157 (2003) Portable Fire Extinguishers

UNDERWRITERS LABORATORIES (UL)

UL 299 (2012; May 2021) Dry Chemical Fire Extinguishers

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Fire Extinguishers; G

Accessories; G

Cabinets; G

Wall Brackets; G

Schedule; G

SD-03 Product Data

Fire Extinguishers; G

Accessories; G

Cabinets; G

Wall Brackets; G

Replacement Parts List; G

SD-07 Certificates

Fire Extinguishers Certifications; G

Manufacturer's Warranty with Inspection Tag; G

1.3 DELIVERY, STORAGE, AND HANDLING

Protect materials from weather, soil, and damage during delivery, storage, and construction.

Deliver materials in their original packages, containers, or bundles bearing the brand name and the name and type of the material.

1.4 WARRANTY

Guarantee that Fire Extinguishers are free of defects in materials, fabrication, finish, and installation and that they will remain so for a period of not less than six years after completion.

Submit the manufacturer's warranty with inspection tag.

1.5 PROJECT SCHEDULE

For fire extinguishers. Coordinate final fire extinguisher schedule with fire protection cabinet schedule to ensure proper fit and function. Use same designations indicated on Drawings.

PART 2 PRODUCTS

Submit fabrication drawings consisting of fabrication and assembly details performed in the factory and product data for the following items: Fire Extinguishers; Accessories, cabinets, Wall Brackets.

2.1 SYSTEM DESCRIPTION

2.1.1 Types

Submit fire extinguishers certifications showing compliance with local codes and regulations.

Provide fire extinguishers conforming to NFPA 10. Provide quantity and placement in compliance with the applicable sections of NFPA 1, NFPA 101, and 29 CFR 1910.157.

Provide dry chemical type fire extinguishers compliant with UL 299.

2.1.2 Material

Provide enameled steel extinguisher shell.

2.1.3 Size

5 pounds extinguishers.

2.1.4 Accessories

Forged brass valve

Pressure gage

2.2 EQUIPMENT

2.2.1 Cabinets

2.2.1.1 Material

Provide enameled steel cabinets.

2.2.1.2 Type

Provide semi-recessed cabinet for wall studs.

2.2.1.3 Size

Dimension cabinets to accommodate the specified fire extinguishers.

2.2.2 Wall Brackets

Provide spring-clip fire extinguisher wall brackets.

Provide wall bracket and accessories as approved.

2.2.2.1 Identification

Provide lettering complying with authorities having jurisdiction for letter style, size, spacing, and location. Locate as indicated by the drawings.

Identify bracket-mounted fire extinguishers with the words "FIRE EXTINGUISHER" in red letter decals applied to mounting surface.

Orientation: Vertical.

PART 3 EXECUTION

3.1 INSTALLATION

Install Fire Extinguishers where indicated on the drawings. Verify exact locations prior to installation.

Provide extinguishers which are fully charged and ready for operation upon installation. Provide extinguishers complete with Manufacturer's Warranty with Inspection Tag attached.

Install fire extinguishers in locations indicated and in compliance with requirements of authorities having jurisdiction.

Comply with the manufacturer's recommendations for all installations.

3.2 PROTECTION

3.2.1 Repairing

Remove and replace damaged and unacceptable portions of completed work with new work at no additional cost to the Government.

Submit replacement parts list indicating specified items replacement part, replacement cost, and name, address and contact for replacement parts distributor.

3.2.2 Cleaning

Clean all surfaces of the work, and adjacent surfaces which are soiled as a result of the work. Remove from the site all construction equipment, tools, surplus materials and rubbish resulting from the work.

-- End of Section --